# ARCH 331 ARCHITECTURAL STRUCTURES

# LECTURE NOTE SET Fall 2013



by

## Anne Nichols

Associate Professor of Practice Department of Architecture A413 Langford Texas A&M University College Station, TX 77843-3137 (979) 845-6540 fax: (979) 862-1571 http://faculty.arch.tamu.edu/anichols <u>anichols@tamu.edu</u>

# TABLE OF CONTENTS

Syllabus
Student Understandings
List of Symbol Definitions
Structural Glossary
Note Set 2.1 Structural Systems
Note Set 2.2 Structural Planning
Note Set 2.3 Math for Structures
Note Set 2.4 Numerical Computations
Note Set 2.5 Problem Solving, Units and Numerical Accuracy
Note Set 3.1 Forces and Vectors
Note Set 3.2 Moments
Note Set 4.1 Point Equilibrium and Truss Analysis
Note Set 4.2 Truss Analysis Using Multiframe
Note Set 5.1 Equilibrium of Rigid Bodies
Note Set 5.2 Method of Sections for Truss Structures
Note Set 6.1 Mechanics of Materials
Note Set 6.2 Stress and Strain - Elasticity
Note Set 6.3 Thermal Effects and Indeterminacy
Note Set 6.4Sustainability Considerations of Materials
Note Set 7Beam Structures and Internal Forces
Note Set 8.1 Beam Analysis Using Multiframe
Note Set 8.2 Beam Diagrams and Formulas
Note Set 9.1 Centers of Gravity - Centroids
Note Set 9.2 Moments of Inertia
Note Set 10.1 Beam Bending Stresses and Shear Stress
Note Set 10.2 Introduction to Beam Stress Analysis and Preliminary Design
Note Set 11 Pinned Frames and Arches
Note Set 12.1 Rigid and Braced Frames
Note Set 12.2 Columns and Stability
Note Set 12.3 Frame Analysis Using Multiframe
Note Set 13.1 Common Design Loads in Building Codes

- Note Set 13.2 ..... Structural Load Requirements
- Note Set 13.3 ...... Design Wind Pressures Envelope Procedure
- Note Set 13.4 ...... Earthquake Ground Motion
- Note Set 13.5 ...... Building Code Requirements by Construction
- Note Set 13.6 ...... SEI/ASCE 7-10: Minimum Design Loads for Buildings

#### and Other Structures

- Note Set 14 ...... System Assemblies & Loads Tracing
- Note Set 15.1 ...... Wood Design
- Note Set 15.2 ...... Beam Design and Deflections
- Note Set 18 ..... Steel Design
- Note Set 22.1 ...... Reinforced Concrete Design
- Note Set 22.2 ...... Steel Reinforcement Charts (Appendix E)
- Note Set 24 ..... Torsion
- Note Set 25.1 ..... One-Way Frame Analysis
- Note Set 25.2 ...... Thickness and Cover Requirements for Fire Protection
- Note Set 25.3 ...... Openings in Concrete Slab Systems
- Note Set 27.1 ...... Foundation Design
- Note Set 27.2 ...... Design of Isolated Square and Rectangular Footings
- Note Set 28.1 ...... Masonry Design
- Note Set 28.2 ...... BIA Technical Notes: Reinforced Brick Masonry Beams
- Note Set 28.3 ...... NCMA Tek Notes: Concrete Masonry



TEXAS A&M

DEPARTMENT OF ARCHITECTURE SYLLABUS

Course title and numberARCH 331 – Architectural Structures (section 500)Term (e.g., Fall 200X)Fall 2013Meeting times and locationLecture: 2:20-3:35 pm T,R; Lab: 3:35-4:50 pm in 111 Langford C (1:40 total)

#### **Course Description and Prerequisites**

Architectural Structures. (2-2). Credit 3. Physical principles that govern statics and strength of materials through the design of architectural structures from a holistic view, in the context of architectural ideas and examples; introduction to construction, behavior of materials, and design considerations for simple and complex structural assemblies; computer applications. Prerequisites: Junior or senior classification in environmental design; MATH 142 or equivalent; PHYS 201.

#### Learning Outcomes or Course Objectives

- The student will be able to read a text or article about structural technology, identify the key concepts and related equations, and properly apply the concepts and equations to appropriate structural problems (**relevance**). The student will also be able to define the answers to key questions in the reading material. The student will be able to evaluate their own skills, or lack thereof, with respect to reading and comprehension of structural concepts, **clarity** of written communication, reasonable determination of **precision** in numerical data, and **accuracy** of computations.
- The student will be able to read a problem statement, interpret the structural wording in order to identify the concepts and select equations necessary to solve the problem presented (**significance**). The student will be able to identify common steps in solving structural problems regardless of the differences in the structural configuration and loads, and apply these steps in a clear and structured fashion (**logic**). The student will draw upon existing mathematical and geometrical knowledge to gather information, typically related to locations and dimensions, provided by representational drawings or models of structural configurations, and to present information, typically in the form of plots that graph variable values. The student will be able to draw representational structural models and diagrams, and express information provided by the figures in equation form. The student will compare the computational results in a design problem to the requirements and properly decide if the requirements have been met. The student will take the corrective action to meet the requirements.
- The student will create a structural model with a computer application based on the concepts of the behavior and loading of the structural member or assemblage. The student will be able to interpret the modeling results and relate the results to the solution obtained by manual calculations.
- The student will be able to articulate the physical phenomena, behavior and design criteria which influence structural space and form. (**depth**) The student will be able to identify the structural purpose, label, behavior, advantages and disadvantages, and interaction of various types of structural members and assemblies. (**breadth**) The student will create a physical structure or structures using non-traditional building materials, considering material and structural behavior, in order to demonstrate the behavior and limitations of a variety of structural arrangements. The student will produce proper documentation and drawings of the size, spacing, location and connection of parts for the construction of the structure.
- The student will interact and participate in group settings to facilitate peer-learning and teaching. In addition, the student will be able to evaluate the comprehension of concepts, clarity of communication of these concepts or calculations, and the precision and accuracy of the data used in the computations in the work of their peers.

#### Instructor Information

Dr, Anne Nichols, Associate Professor of the Practice
(979) 845-6540
anichols@tamu.edu
1-2:30 pm MW, 11am-12 pm TR (and by appointment)
A413 Langford

#### **Textbook and/or Resource Material**

Required Text:

• <u>Statics and Strength of Materials – Foundations for Structural Design</u>, Onouye, (2005) Pearson - Prentice Hall, ISBN 0-13-111837-4

**Recommended Texts:** 

- A Structures Primer, Kaufman, (2010) Prentice Hall, ISBN 978-0-13-230256-3
- Understanding Structures, Moore, (1999) McGraw-Hill, ISBN 9780070432536

References:

- ACI 318-11 Code and Commentary
- AISC 14<sup>th</sup> ed. Steel Construction Manual
- Masonry Joint Structural Code
- National Design Specifications for Wood

#### **Grading Policies**

Students should refer to the Academic section in Student Rules and Regulations <u>http://student-rules.tamu.edu</u>.

Assignments:

- Due as stated on the assignment statements.
- Only <u>one</u> assignment without University excuse may be turned in for credit no later than one week after the due date **and** before final exams begin. All other assignments will receive <u>no credit</u> if late without a recognized excuse or after final exams have begun.
- Assignments with incorrect formatting will be penalized.

Quizzes:

- Quizzes will be given at any time during the class period. Make-up quizzes without an excuse will not be given.
- Practice quizzes will be posted electronically.
- No quiz scores will be "dropped".
- Use of cell phones with a calculator application during quizzes and exams is prohibited.

Final Exam:

• The final exam will be comprehensive and is officially scheduled for 1-3 PM Wednesday, December 11.

#### Teaching Assistant:

• Victoria Garcia (m2310 3@neo.tamu.edu)

Structures Help Desk:

- Miray Oktem (<u>mrycan@neo.tamu.edu</u>)
- ARCA129 845-6580 Posted Hours (link)

Other Resources:

 The Student Learning Center provides tutoring in math and physics. (<u>http://slc.tamu.edu/tutoring.shtml</u>) Other tutoring services are listed at <u>http://scs.tamu.edu/sites/default/files/tutoring.pdf</u> The Academic Success Center offers workshops at <u>http://us.tamu.edu/Undergraduate-Studies/Academic-Success-Center</u>

Grievances:

• For grievances other than those listed in Part III in <u>Texas A&M University Student Rules</u>: <u>http://student-rules.tamu.edu/</u> the *instructor* must be the first point of contact.

Format:

Date Name Course Given: Find: Solution: :

#### **Other Pertinent Grading Information (Rubric Included)**

The levels listed for graded work (projects, quizzes, exams) and pass-fail work (assignments) *must both be met* to earn the course letter grade:

Letter Grade	Graded work	Pass-Fail work
А	A average (90-100%)	Pass for 90 to 100% of assignments
В	B average (80-89%)	Pass for 83 to 100% of assignments
С	C average (70-79%)	Pass for 75 to 100% of assignments
D	D average (60-69%)	Pass for 65 to 100% of assignments
F	F average (<59%)	Pass for 0% to 100% of assignments

*Graded work:* This typically constitutes 6 quizzes, a learning portfolio (worth 1.5 quizzes) and a final exam (worth 3 quizzes). This equates to proportions of approximately 57% to quizzes, 14% to the learning portfolio, and 29% to the final exam.

*Pass/fail work:* This constitutes all practice assignments and projects, each with a value of 1 unit. Criteria for passing is *at least* 75% completeness and correctness along with every problem attempted. Percent effort expected for a problem in a practice assignment is provided on the assignment statement. This is considered a lab course and the assignments **are required work** with credit given for competency. The work is necessary to apply the material and prepare for the quizzes and exam. It is expected that this work will be completed with assistance or group participation, but all *graded* work is only by the individual.

#### **Attendance Policies**

The University views class attendance as the responsibility of an individual student. Attendance is essential to complete the course successfully. University rules related to excused and unexcused absences are located online at <a href="http://student-rules.tamu.edu/rule07">http://student-rules.tamu.edu/rule07</a>

Project due dates will be provided in the project statements. Students should contact the instructor if work is turned in late due to an absence that is excused under the University's attendance policy. In such cases the instructor will either provide the student an opportunity to make up any quiz, exam or other graded activities or provide a satisfactory alternative to be completed within 30 calendar days from the last day of the absence. There will be no opportunity for students to make up work missed because of an unexcused absence.

#### **Other Pertinent Attendance Information**

Absences related to illness or injury must be documented according to <u>http://shs.tamu.edu/attendance.htm</u> *including* the Explanatory Statement for Absence from class for 3 days or less. Doctor visits not related to immediate illness or injury are not excused absences.

Lecture, Lab, and Textbook:

- The lecture slides should be viewed prior to class. Class will be reserved for review of the lectures. Lab will consist of problem solving requiring the textbook. The lecture slide handouts are available on the class web page and eCampus.
- Attendance is required for both lecture and lab.
- Use of electronic devices during lecture and lab is prohibited.

Notes:

• The notes and related handouts are available on the class web page at <a href="http://faculty.arch.tamu.edu/anichols/331frame.html">http://faculty.arch.tamu.edu/anichols/331frame.html</a>, or on eCampus. A bound set can be purchased from the Notes-n-Quotes at 701 W. University, directly across from the Mitchell Physics Building in the Northgate Neighborhood.

eCampus:

eCampus is the on-line course system useful for downloading files, uploading assignments, reading
messages and replying, as well as posting scores; and is accessed with your neo account. This will be
used to post class materials, questions and responses by class members and the instructor, and
scores. It can be accessed at <a href="http://ecampus.tamu.edu/">http://ecampus.tamu.edu/</a>

#### Course Topics, Calendar of Activities, Major Assignment Dates

**Tentative Schedule** (subject to change at any time throughout the semester) Note: Materials in the Class Note Set not specifically mentioned above are provided as references or aids.

Week	То	pic	Required Reading/Problems
1		Design Loads and Structural	Read*: Ch. 1, § 5.1
		Performance Requirements	Solve: Assignment 1 (start)
	2.	Structural Systems, Planning and	Read: Appendix B; note sets 2.1, 2.2, 2.3 & 2.4
		Design	Reference: note set 2.5
2	3.	Forces and Moments	Read: Ch. 2; note sets 3.1 & 3.2
			Due: Assignment 1
	4.	Equilibrium of a Point & Analysis of	Read: § 3.1, pg. 89-95; note set 4.1
		Planar Trusses	Reference: note set 4.2
3	5.		Read: § 3.2, 3.3, pg. 98-110; note sets 5.1 & 5.2
		Planar Trusses	Due: Project
	6.	Mechanics of Materials	Read: Ch. 6; note sets 6.1, 6.2 & 6.3
			Reference: note set 6.4
			Due: Assignment 2
4	7.	Beam Shear and Bending	Read: § 8.1-8.2, note set 7
			Quiz 1
	8.	Semi-graphical Method: Shear and	<b>Read:</b> § 8.3-8.4; (note set 7)
		Bending Moment Diagrams	Reference: note sets 8.1 & 8.2
F	0	Boom Section Droportion	Due: Assignment 3 Read: § 7.1-7.4; note sets 9.1 & 9.2
5	9.	Beam Section Properties	<b>Redu.</b> 97.1-7.4, Hole Sets 9.1 & 9.2
	10.	. Beam Stresses	Read: § 9.1-9.4; note set 10.1
			<b>Reference:</b> note set 10.2
			Due: Assignment 4
6	11.	. Other Beams and Pinned Frames	Read: § 4.2, pg. 73; note set 11
			Quiz 2
	12.	. Rigid Frames - Compression &	Read: § 10.1,10.2 & 10.5; note sets 12.1 & 12.2
		Buckling	Reference: note set 12.3
			Due: Assignment 5
7	13.	. Design Loads, Codes and	Read: § 5.1; note set 13.1
		Methodology	Reference: note sets 13.2, 13.3, 13.4, 13.5
	14.	. System Assemblies and Load Tracing	<b>Read:</b> § 5.2, 5.3, 4.4; note set 14
			Due: Assignment 6
8	15.	Wood Construction	<b>Read:</b> § 9.5-9.6; note sets 15.1 & 15.2
	40	Materials & Beam Design	Quiz 3
	16.	. Column Design	Read: Column Design
0	17	Joints and Connection Stresses	Due: Assignment 7
9	17.	Joints and Connection Stresses	Read: note set 15.1
	18	Steel Construction	Read: note set 18
		Materials & Beam Design	Due: Assignment 8
10	19.		Read: pg. 98-110; note set 18
			Reference: note set 5.2
			Quiz 4
	20.	. Column Design &	Read: § 10.3; note set 18
		Tension Members	Due: Assignment 9
11	21.	Bolted Connections & Welds	Read: note set 18
	22.	Concrete Construction	Read: note set 22.1
		Materials & Beam Design	Reference: note set 22.2
10	- 00	Theome & Cloba	Due: Assignment 10
12	23.	T-beams & Slabs	Read: note set 22.1
	24	Shoor Torsion Deinforcement 9	Quiz 5 Read: note sets 22.1 & 24
	24.	. Shear, Torsion, Reinforcement & Deflection	Due: Assignment 11
13	25.		Read: note sets 22.1 & 25.1
15	20.	Beams	<b>Reference:</b> note sets 25.2 & 25.3
		Dourio	

Week	Торіс		Required Reading/Problems
(13)	26.	Columns & Frames	Read: note set 22.1
			Due: Assignment 12
14	27.	Foundation Design & Footings	Read: note sets 27.1 & 27.2
			Quiz 6
	28. N	lasonry Construction	Read: note set 28.1
		Beams & Columns	Reference: note sets 28.2 & 28.3
			Due: Assignment 13 & Learning Portfolio
	28. N		Read: note set 28.1 Reference: note sets 28.2 & 28.3

FINAL: 1-3 PM Wednesday, December 11

#### Americans with Disabilities Act (ADA)

The Americans with Disabilities Act (ADA) is a federal anti-discrimination statute that provides comprehensive civil rights protection for persons with disabilities. Among other things, this legislation requires that all students with disabilities be guaranteed a learning environment that provides for reasonable accommodation of their disabilities. If you believe you have a disability requiring an accommodation, please contact Disability Services, in Cain Hall, Room B118, or call 845-1637. For additional information visit http://disability.tamu.edu

#### **Academic Integrity**

"An Aggie does not lie, cheat, or steal, or tolerate those who do."

Upon accepting admission to Texas A&M University, a student immediately assumes a commitment to uphold the Honor Code, to accept responsibility for learning, and to follow the philosophy and rules of the Honor System. Students will be required to state their commitment on examinations, research papers, and other academic work. Ignorance of the rules does not exclude any member of the TAMU community from the requirements or the processes of the Honor System. *For additional information please visit:* <u>http://aggiehonor.tamu.edu</u>

#### Care of Facilities

The use of spray paint or other surface-altering materials is not permitted in the Langford Complex, except in designated zones. Students who violate this rule will be liable for the expenses associated with repairing damaged building finishes and surfaces. At the end of the semester, your area must be clean of all trash.

#### Studio Policy (required of all studios)

All students, faculty, administration and staff of the Department of Architecture at Texas A&M University are dedicated to the principle that the Design Studio is the central component of an effective education in architecture. They are equally dedicated to the belief that students and faculty must lead balanced lives and use time wisely, including time outside the design studio, to gain from all aspects of a university education and world experiences. They also believe that design is the integration of many parts, that process is as important as product, and that the act of design and of professional practice is inherently interdisciplinary, requiring active and respectful collaboration with others.

Students and faculty in every design studio will embody the fundamental values of optimism, respect, sharing, engagement, and innovation. Every design studio will therefore encourage the rigorous exploration of ideas, diverse viewpoints, and the integration of all aspects of architecture (practical, theoretical, scientific, spiritual, and artistic), by providing a safe and supportive environment for thoughtful innovation. Every design studio will increase skills in professional communication, through drawing, modeling, writing and speaking.

Every design studio will, as part of the syllabus introduced at the start of each class, include a clear statement on time management, and recognition of the critical importance of academic and personal growth, inside and outside the studio environment. As such it will be expected that faculty members and students devote quality time to studio activities, while respecting the need to attend to the broad spectrum of the academic life. Every design studio will establish opportunities for timely and effective review of both process and products. Studio reviews will include student and faculty peer review. Where external reviewers are introduced, the design studio instructor will ensure that the visitors are aware of the Studio Culture Statement and recognize that the design critique is an integral part of the learning experience. The design studio will be recognized as place for open communication and movement, while respecting the needs of others, and of the facilities.

#### **Important Links Below**

Department of Architecture Website Department Financial Assistance Academic Calendar Final Exam Schedule Online On-Line Catalog Student Rules Aggie Honor System Office American Institute of Architecture website http://dept.arch.tamu.edu/ http://dept.arch.tamu.edu/financial-assistance/ http://admissions.tamu.edu/registrar/general/calendar.aspx http://admissions.tamu.edu/registrar/general/finalschedule.aspx http://catalog.tamu.edu http://student-rules.tamu.edu/ http://aggiehonor.tamu.edu/ http://www.aia.org/index.htm

	Sun	T OF ARCHITECTUI	Tue	ARCH 331 Wed	Thu	FAL Fri	Sat
		19				23	
AUGUST	18	19	20	21	22	23 last day to register	24
	25 freshma convoc		27 Lect 1	28	29 Lect 2	30 last day to add academic convocation	31
	1	2	3 Lect 3 #1 due	4	5 Lect 4	6	7
R	8	9	10 Lect 5 project due	11	12 Lect 6 #2 due	13	14
SEPTEMBER	15	16	17 <b>Lect 7</b> Quiz 1	18	19 Lect 8 #3 due	20	21
SEI	22	23	24 Lect 9	25	<sup>26</sup> Lect 10 #4 due	27	28
	29	30	1 Lect 11 Quiz 2	2	3 Lect 12 #5 due	4	5
	6	7	8 Lect 13	9	10 Lect 14 #6 due	11	12
BER	13	14 (mid-term grades due)	15 Lect 15 Quiz 3	16	17 Lect 16 #7 due	18	19
OCTOBER	20	<sup>21</sup> college classes canceled for Symposium	22 Lect 17	23	24 Lect 18 #8 due	25	26
	27	28	29 Lect 19 Quiz 4	30	<sup>31</sup> Lect 20 #9 due	1	2
	3	4	5 Lect 21	6	7 Lect 22 #10 due	8	9
IBER	10	11	12 Lect 23 Quiz 5	13	14 Lect 24 #11 due	15 last day to Q-drop	16
NOVEMBER	17 Bonfir Remer	18 e nbrance day	19 Lect 25	20	21 Lect 26 #12 due	22	23
	24	25	26 Lect 27 Quiz 6	27	28 Thanksgivin	29 g Holiday	30
	1	2 (dead day) Friday classes	3 Lect 28 #13 & portfolio de (dead day) Thursday class		5 Days	6 Final exams	7
DECEMBER	8	9	10	11 I-3pm <b>331 FINAL</b>	12	13 Commencement (and Saturday)	14
DECE	15	16 Grades due	17	18	19	20	21
	22	23	24	25 Winter Holiday	26	27	28

### **ARCH 331. Student Understandings**

- 1) I understand that there are intellectual standards in this course and that I am responsible for monitoring my own learning.
- 2) I understand that the class will focus on practice, not on lecture.
- 3) I understand that I am responsible for preparing for lecture with the assigned reading and lecture show by internalizing key concepts, recognizing key questions, and evaluating what makes sense and what doesn't make sense to me.
- 4) I understand that I will be held regularly responsible for assessing my own work using criteria and standards discussed in class.\_\_\_\_\_
- 5) I understand that if at any time in the semester I feel unsure about my "grade", I may request an assessment from the instructor.\_\_\_\_\_
- 6) I understand that there are <u>13 practice assignments</u>, one due every week during the bulk of the semester.
- 7) I understand that I will occasionally be required to assess the work of my classmates in an objective manor using the same criteria and standards used to assess my own work.\_\_\_\_\_
- 8) I understand that there are <u>6 graded quizzes</u>, one given every other week during the bulk of the semester.
- 9) I understand that there is a final exam in the course.
- **10**) I understand that I must do a Learning Portfolio, which is a self-evaluation that makes my "case" for receiving a particular grade using criteria provided in class and citing evidence from my work across the semester.
- 11) I understand that the work of the course requires <u>Consistent classroom attendance</u> and active participation.\_\_\_\_\_
- 12) I understand that I will regularly be required to demonstrate that I have prepared for lecture.
- **13**) I understand that the class will not be graded on a curve. I understand that it is theoretically possible for the whole class to get an A or an F.\_\_\_\_\_
- 14) I understand the basis of the final grade as outlined in the syllabus.
- 15) I understand that since the final grade is based on percentages from graded work and competency on assignments as outlined in the syllabus, that the minimum level of both must be satisfied to obtain the letter grade. The criteria for assignments that are considered "passing" is outlined in the syllabus section on Learning Objectives.

NAME

signature

DATE\_\_\_\_\_

printed name

# List of Symbol Definitions

а	long dimension for a section subjected to torsion (in, mm); acceleration (ft/sec <sup>2</sup> , m/sec <sup>2</sup> ); width of the base of a retaining wall for pressure calculation (ft, m); equivalent square column size in spread footing design (in, ft, mm, m); distance used in beam formulas (ft, m); depth of the effective compression block in a concrete beam (in, mm)
a	
a	area bounded by the centerline of a thin walled section subjected to torsion (in <sup>2</sup> , mm <sup>2</sup> )
A	area, often cross-sectional (in <sup>2</sup> , ft <sup>2</sup> , mm <sup>2</sup> , m <sup>2</sup> )
$A_b$	area of a bolt (in <sup>2</sup> , mm <sup>2</sup> )
$A_e$	<u>effective</u> net area found from the product of the net area $A_n$ by the shear lag factor $U$ (in <sup>2</sup> , ft <sup>2</sup> , mm <sup>2</sup> , m <sup>2</sup> )
$A_g$	gross area, equal to the total area ignoring any holes or reinforcement (in <sup>2</sup> , ft <sup>2</sup> , mm <sup>2</sup> , m <sup>2</sup> )
$A_{gv}$	gross area subjected to shear for block shear rupture (in <sup>2</sup> , ft <sup>2</sup> , mm <sup>2</sup> , m <sup>2</sup> )
$A_n$	net area, equal to the gross area subtracting any holes (in <sup>2</sup> , ft <sup>2</sup> , mm <sup>2</sup> , m <sup>2</sup> ) (see $A_e$ )
$A_{net}$	net area, equal to the gross area subtracting any reinforcement (in <sup>2</sup> , ft <sup>2</sup> , mm <sup>2</sup> , m <sup>2</sup> )
$A_{nt}$	net area subjected to tension for block shear rupture (in <sup>2</sup> , ft <sup>2</sup> , mm <sup>2</sup> , m <sup>2</sup> )
$A_{nv}$	net area subjected to shear for block shear rupture (in <sup>2</sup> , ft <sup>2</sup> , mm <sup>2</sup> , m <sup>2</sup> )
$A_p$	bearing area (in <sup>2</sup> , ft <sup>2</sup> , mm <sup>2</sup> , m <sup>2</sup> )
A <sub>req</sub> 'a	area required to satisfy allowable stress (in <sup>2</sup> , $ft^2$ , $mm^2$ , $m^2$ )
$A_s$	area of steel reinforcement in concrete beam and masonry design (in <sup>2</sup> , ft <sup>2</sup> , mm <sup>2</sup> , m <sup>2</sup> )
$A'_s$	area of steel compression reinforcement in concrete beam design (in <sup>2</sup> , ft <sup>2</sup> , mm <sup>2</sup> , m <sup>2</sup> )
$A_{st}$	area of steel reinforcement in concrete and masonry column design (in <sup>2</sup> , ft <sup>2</sup> , mm <sup>2</sup> , m <sup>2</sup> )
$A_{throat}$	t area across the throat of a weld (in <sup>2</sup> , ft <sup>2</sup> , mm <sup>2</sup> , m <sup>2</sup> )
$A_{v}$	area of concrete shear stirrup reinforcement (in <sup>2</sup> , ft <sup>2</sup> , mm <sup>2</sup> , m <sup>2</sup> )
$A_{web}$	web area in a steel beam equal to the depth x web thickness $(in^2, ft^2, mm^2, m^2)$
$A_{I}$	area of column in spread footing design (in <sup>2</sup> , ft <sup>2</sup> , mm <sup>2</sup> , m <sup>2</sup> )
$A_2$	projected bearing area of column load in spread footing design (in <sup>2</sup> , ft <sup>2</sup> , mm <sup>2</sup> , m <sup>2</sup> )
ASD	Allowable Stress Design
b	width, often cross-sectional (in, ft, mm, m); narrow dimension for a section subjected to torsion (in, mm); number of truss members; rectangular column dimension in concrete footing design (in, mm, m); distance used in beam formulas (ft, m)
$b_E$	effective width of the flange of a concrete T beam cross section (in, mm)
$b_{f}$	width of the flange of a steel or concrete T beam cross section (in, mm)
$b_o$	perimeter length for two-way shear in concrete footing design (in, ft, mm, m)
$b_w$	width of the stem (web) of a concrete T beam cross section (in, mm)

- *B* spread footing or retaining wall base dimension in concrete design (ft, m); dimension of a steel base plate for concrete footing design (in, mm, m)
- $B_s$  width within the longer dimension of a rectangular spread footing that reinforcement must be concentrated within for concrete design (ft, m)
- $B_1$  factor for determining  $M_u$  for combined bending and compression
- distance from the neutral axis to the top or bottom edge of a beam (in, mm, m);
   distance from the center of a circular shape to the surface under torsional shear strain (in, mm, m);

rectangular column dimension in concrete footing design (in, mm, m); the distance from the top of a masonry beam to the neutral axis

- $c_i$  distance from the center of a circular shape to the inner surface under torsional shear strain (in, mm, m)
- $c_o$  distance from the center of a circular shape to the outer surface under torsional shear strain (in, mm, m)
- $c_1$  coefficient for shear stress for a rectangular bar in torsion
- $c_2$  coefficient for shear twist for a rectangular bar in torsion
- *CL*, ℓ center line
- C compression label; compression force (lb, kips, N, kN): dimension of a steel base plate for concrete footing design (in, mm, m)
- $C_b$  modification factor for moment in ASD & LRFD steel beam design,  $C_b = 1$  for simply supported beams (0 moments at the ends)
- $C_c$  column slenderness classification constant for steel column design; compressive force in the concrete of a doubly reinforced concrete beam (lb, k, N, kN)
- $C_C$  curvature factor for laminated arch design
- $C_D$  load duration factor for wood design
- $C_f$  form factor for circular sections or or square sections loaded in plane of diagonal for wood design
- $C_{fu}$  flat use factor for other than decks in wood design
- $C_F$  size factor for wood design
- $C_H$  shear stress factor for wood design
- $C_i$  incising factor for wood design
- $C_L$  beam stability factor for wood design
- $C_m$  modification factor for combined stress in steel design; compression force in the masonry for masonry design (lb, k, N, kN)
- $C_M$  wet service factor for wood design
- $C_p$  column stability factor for wood design
- $C_r$  repetitive member factor for wood design
- $C_{v}$  web shear coefficient for steel design
- $C_V$  volume factor for glue laminated timber design

- $C_s$  compressive force in the compression steel of a doubly reinforced concrete beam (lb, k, N, KN)
- $C_t$  temperature factor for wood design
- $\begin{array}{ll} d & \mbox{depth, often cross-sectional (in, mm, m);} \\ & \mbox{diameter (in, mm, m);} \\ & \mbox{perpendicular distance from a force to a point in a moment calculation (in, ft, mm, m);} \\ & \mbox{effective depth from the top of a reinforced concrete or masonry beam to the centroid of the tensile steel (in, ft, mm, m):} \\ & \mbox{critical cross section dimension of a rectangular timber column cross section related to the profile (axis) for buckling (in, mm, m);} \\ & \mbox{symbol in calculus to represent a very small change (like the greek letters for d, see $\delta \& $\Delta$ ) } \end{array}$
- *d* ´ effective depth from the top of a reinforced concrete beam to the centroid of the compression steel (in, ft, mm, m)
- $d_b$  bar diameter of a reinforcing bar (in, mm) nominal bolt diameter (in, mm)
- $d_f$  depth of a steel column flange (wide flange section) (in, mm)
- $d_x$  difference in the x direction between an area centroid ( $\overline{x}$ ) and the centroid of the composite shape ( $\hat{x}$ ) (in, mm)
- $d_y$  difference in the y direction between an area centroid ( $\overline{y}$ ) and the centroid of the composite shape ( $\hat{y}$ ) (in, mm)
- *D* diameter of a circle (in, mm, m); dead load for LRFD design
- DL dead load
- *e* eccentric distance of application of a force (P) from the centroid of a cross section (in, mm)
- *E* modulus of elasticity (psi; ksi, kPa, MPa, GPa); earthquake load for LRFD design
- $E_c$  modulus of elasticity of concrete (psi; ksi, kPa, MPa, GPa)
- $E_s$  modulus of elasticity of steel (psi; ksi, kPa, MPa, GPa)
- f symbol for stress (psi, ksi, kPa, MPa)
- $f_a$  calculated axial stress (psi, ksi, kPa, MPa)
- $f_b$  calculated bending stress (psi, ksi, kPa, MPa)
- $f_c$  calculated compressive stress (psi, ksi, kPa, MPa)
- $f'_c$  concrete design compressive stress (psi, ksi, kPa, MPa)
- $f_{cr}$  calculated column stress based on the critical column load  $P_{cr}$  (psi, ksi, kPa, MPa)
- $f_m$  calculated compressive stress in masonry (psi, ksi, kPa, MPa)
- $f'_m$  masonry design compressive stress (psi, ksi, kPa, MPa)
- $f_p$  calculated bearing stress (psi, ksi, kPa, MPa)
- $f_s$  stress in the steel reinforcement for concrete or masonry design (psi, ksi, kPa, MPa)

- $f'_s$  compressive stress in the compression reinforcement for concrete beam design (psi, ksi, kPa, MPa)
- $f_t$  calculated tensile stress (psi, ksi, kPa, MPa)
- $f_v$  calculated shearing stress (psi, ksi, kPa, MPa)
- $f_x$  combined stress in the direction of the major axis of a column (psi, ksi, kPa, MPa)
- $f_v$  yield stress (psi, ksi, kPa, MPa)
- *F* force (lb, kip, N, kN);
   capacity of a nail in shear (lb, kip, N, kN);
   symbol for allowable stress in design codes (psi, ksi, kPa, MPa);
   fluid load for LRFD design
- $F_a$  allowable axial stress (psi, ksi, kPa, MPa)
- $F_b$  allowable bending stress (psi, ksi, kPa, MPa)
- $F'_{b}$  allowable bending stress for combined stress for wood design (psi, ksi, kPa, MPa)
- $F_c$  allowable compressive stress (psi, ksi, kPa, MPa)
- $F_{c\perp}$  allowable compressive stress perpendicular to the wood grain (psi, ksi, kPa, MPa)

*F<sub>connector</sub>* resistance capacity of a connector (lb, kips, N, kN)

- $F_{cE}$  intermediate compressive stress for ASD wood column design dependant on material (psi, ksi, kPa, MPa)
- $F_{cr}$  flexural buckling (column) stress in ASD and LRFD (psi, ksi, kPa, MPa)
- $F'_{c}$  allowable compressive stress for ASD wood column design (psi, ksi, kPa, MPa)
- $F_c^*$  intermediate compressive stress for ASD wood column design dependant on load duration (psi, ksi, kPa, MPa)
- $F_e$  elastic critical buckling stress is steel design

 $F_{EXX}$  yield strength of weld material (psi, ksi, kPa, MPa)

Fhorizontal-resist resultant frictional force resisting sliding in a footing or retaining wall (lb, kip, N, kN)

- $F_n$  nominal strength in LRFD steel design (psi, ksi, kPa, MPa) nominal tension or shear strength of a bolt (psi, ksi, kPa, MPa)
- $F_p$  allowable bearing stress parallel to the wood grain (psi, ksi, kPa, MPa)
- $F_s$  allowable tensile stress in reinforcement for masonry design (psi, ksi, kPa, MPa)
- $F_{sliding}$  resultant force causing sliding in a footing or retaining wall (lb, kip, N, kN)
- $F_t$  allowable tensile stress (psi, ksi, kPa, MPa)
- $F_{\nu}$  allowable shear stress (psi, ksi, kPa, MPa); allowable shear stress in a welded connection
- $F_x$  force component in the x coordinate direction (lb, kip, N, kN)
- $F_y$  force component in the y coordinate direction (lb, kip, N, kN); yield stress (psi, ksi, kPa, MPa)
- $F_{yw}$  yield stress in the web of a steel wide flange section (psi, ksi, kPa, MPa)

- $F_u$ ultimate stress a material can sustain prior to failure (psi, ksi, kPa, MPa)F.S.factor of safetygacceleration due to gravity, 32.17 ft/sec<sup>2</sup>, 9.807 m/sec<sup>2</sup>;
- *g* acceleration due to gravity, 32.17 ft/sec<sup>2</sup>, 9.807 m/sec<sup>2</sup>; gage spacing of staggered bolt holes (in, mm)
- *G* shear modulus (psi; ksi, kPa, MPa, GPa); gigaPascals (10<sup>9</sup> Pa or 1 kN/mm<sup>2</sup>); relative stiffness of columns to beams in a rigid connection (*see*  $\Psi$ ); specific gravity (ie. factor multiplied by density of water to get density)
- $\begin{array}{ll} h & \text{depth, often cross-sectional (in, ft, mm, m);} \\ & \text{height (in, ft, mm, m);} \\ & \text{sag of a cable structure (ft, m);} \\ & \text{effective height of a wall or column (see <math>\ell_e$ )} \end{array}
- $h_c$  height of the web of a wide flange steel section (in, ft, mm, m)
- $h_f$  depth of a flange in a T section (in, ft, mm, m); height of a concrete spread footing (in, ft, mm, m)
- *H* hydraulic soil load for LRFD design; height of retaining wall (ft, m)
- $H_A$  horizontal force due to active soil pressure (lb, k, N, kN)
- *I* moment of inertia  $(in^4, mm^4, m^4)$
- $\bar{I}$  moment of inertia about the centroid (in<sup>4</sup>, mm<sup>4</sup>, m<sup>4</sup>)
- $I_c$  moment of inertia about the centroid (in<sup>4</sup>, mm<sup>4</sup>, m<sup>4</sup>)
- $I_{min}$  minimum moment of inertia of I<sub>x</sub> and I<sub>y</sub> (in<sup>4</sup>, mm<sup>4</sup>, m<sup>4</sup>)
- $I_{transformed}$  moment of inertia of a multi-material section transformed to one material (in<sup>4</sup>, mm<sup>4</sup>, m<sup>4</sup>)
- $I_x$  moment of inertia with respect to an x-axis (in<sup>4</sup>, mm<sup>4</sup>, m<sup>4</sup>)
- $I_y$  moment of inertia with respect to a y-axis (in<sup>4</sup>, mm<sup>4</sup>, m<sup>4</sup>)
- *j* multiplier by effective depth of masonry section for moment arm, jd (*see d*)
- $J, J_o$  polar moment of inertia (in<sup>4</sup>, mm<sup>4</sup>, m<sup>4</sup>)
- k kips (1000 lb);
   shape factor for plastic design of steel beams, M<sub>p</sub>/M<sub>y</sub>;
   effective length factor for columns (*also K*);
   distance from outer face of W flange to the web toe of fillet (in, mm);
   multiplier by effective depth of masonry section for neutral axis, kd
- kg kilograms
- kN kiloNewtons (10<sup>3</sup> N)
- kPa kiloPascals (10<sup>3</sup> Pa)
- K effective length factor with respect to column end conditions (also k); masonry mortar strength designation
- $K_{cE}$  material factor for wood column design

$\ell$	length (in, ft, mm, m);
	cable span (ft, m)

- $l_d$  development length for reinforcing steel (in, ft, mm, m) (also  $L_d$ )
- $l_{dc}$  development length for column dowels (in, ft, mm, m)
- $l_{dh}$  development length for hooks (in, ft, mm, m)
- $\ell_e$  effective length that can buckle for wood column design (in, ft, mm, m) (also  $L_e$ )
- $l_n$  clear span from face of support to face of support in concrete design (in, ft, mm, m)
- $l_s$  lap splice length in concrete design (in, ft, mm, m)
- *lb* pound force
- L length (in, ft, mm, m); live load for LRFD design; spread footing dimension in concrete design (ft, m)
- $L_b$  unbraced length of a steel beam in LRFD design (in, ft, mm, m)
- $L_c$  clear distance between the edge of a hole and edge of next hole or edge of the connected steel plate in the direction of the load (in, ft, mm, m)
- $L_d$  development length of reinforcement in concrete (ft, m) (also  $l_d$ )
- $L_e$  effective length that can buckle for column design (in, ft, mm, m) (also  $\ell_e$ )
- $L_m$  projected length for bending in concrete footing design (ft, m)
- $L_p$  maximum unbraced length of a steel beam in LRFD design for full plastic flexural strength (in, ft, mm, m)
- *L<sub>r</sub>* roof live load in LRFD design;
   maximum unbraced length of a steel beam in LRFD design for inelastic lateral-torsional buckling (in, ft, mm, m)
- *L'* length of an angle in a connector with staggered holes (in, mm); length of the one-way shear area in concrete footing design (ft, m)
- *LL* live load
- *LRFD* Load and Resistance Factor Design
- *m* mass (lb-mass, g, kg); meters
- mm millimeters
- *M* moment of a force or couple (lb-ft, kip-ft, N-m, kN-m); bending moment (lb-ft, kip-ft, N-m, kN-m); masonry mortar strength designation
- *M<sub>a</sub>* required bending moment in steel ASD beam design (unified) (lb-ft, kip-ft, N-m, kN-m)
- $M_A$  moment value at quarter point of unbraced beam length for LRFD beam design (lb-ft, kip-ft, N-m, kN-m)
- $M_B$  moment value at half point of unbraced beam length for LRFD beam design (lb-ft, kip-ft, N-m, kN-m)

- $M_C$  moment value at three quarter point of unbraced beam length for LRFD beam design (lb-ft, kip-ft, N-m, kN-m)
- *M<sub>m</sub>* moment capacity of a reinforced masonry beam (lb-ft, kip-ft, N-m, kN-m)
- $M_n$  nominal flexure strength with the full section at the yield stress for LRFD steel beam design (lb-ft, kip-ft, N-m, kN-m); nominal flexure strength with the steel reinforcement at the yield stress and compressive stress at the concrete design strength for reinforced beam design (lb-ft, kip-ft, N-m, kN-m)

*M*<sub>overturning</sub> resulting moment from all forces on a footing or retaining wall causing overturning (lb-ft, kip-ft, N-m, kN-m)

- $M_p$  (also M<sub>ult</sub>) internal bending moment when all fibers in a cross section reach the yield stress (lbft, kip-ft, N-m, kN-m)
- $M_{resist}$  resulting moment from all forces on a footing or retaining wall resisting overturning (lb-ft, kip-ft, N-m, kN-m)
- $M_u$  maximum moment from factored loads for LRFD beam design (lb-ft, kip-ft, N-m, kN-m)
- $M_{ult}$  (also M<sub>p</sub>) internal bending moment when all fibers in a cross section reach the yield stress (lbft, kip-ft, N-m, kN-m)
- $M_y$  internal bending moment when the extreme fibers in a cross section reach the yield stress (lb-ft, kip-ft, N-m, kN-m)
- $M_1$  smaller end moment used to calculate  $C_m$  for combined stresses in a beam-column (lb-ft, kip-ft, N-m, kN-m)
- $M_2$  larger end moment used to calculate C<sub>m</sub> for combined stresses in a beam-column (lb-ft, kip-ft, N-m, kN-m)
- *MPa* megaPascals ( $10^6$  Pa or 1 N/mm<sup>2</sup>)
- *n* number of truss joints, nails or bolts;modulus of elasticity transformation coefficient for steel to concrete or masonry
- *n.a.* neutral axis (axis connecting beam cross-section centroids)
- N Newtons (kg-m/sec<sup>2</sup>);
   bearing-type connection with bolt threads included in shear plane; normal load (lb, kip, N, kN); masonry mortar strength designation; bearing length on a wide flange steel section (in, mm); number of stories
- *o* point of overturning of a retaining wall, commonly at the "toe"

o.c. on-center

- *O* point of origin; masonry mortar strength designation
- *p* pitch of nail or bolt spacing (in, ft, mm, m); pressure (lb/ft<sup>2</sup>, kips/ft<sup>2</sup>, N/m<sup>2</sup>, Pa, MPa)
- $p_A$  active soil pressure (lb/ft<sup>2</sup>, kips/ft<sup>2</sup>, N/m<sup>2</sup>, Pa, MPa)
- *P* force, concentrated (point) load (lb, kip, N, kN);axial load in a column or beam-column (lb, kip, N, kN)

- $P_a$  allowable axial load (lb, kip, N, kN);
  - required axial force in ASD steel design (unified) (lb, kip, N, kN)

 $P_{allowable}$  allowable axial load (lb, kip, N, kN)

- $P_c$  available axial strength for steel unified design (lb, kip, N, kN)
- $P_{cr}$  critical (failure) load in column calculations (lb, kip, N, kN)
- $P_{dowels}$  nominal capacity of dowels from concrete column to footing in concrete design ((lb, kip, N, kN))
- $P_{el}$  Euler buckling strength in steel unified design (lb, kip, N, kN)
- $P_n$  nominal column or bearing load capacity in LRFD steel and concrete design (lb, kip, N, kN); nominal axial load for a tensile member or connection in LRFD steel (lb, kip, N, kN)
- $P_o$  maximum axial force with no concurrent bending moment in a reinforced concrete column (lb, kip, N, kN)
- $P_r$  required axial force in steel unified design (lb, kip, N, kN)
- $P_u$  factored column load calculated from load factors in LRFD steel and concrete design (lb, kip, N, kN);

factored axial load for a tensile member or connection in LRFD steel (lb, kip, N, kN)

- *Pa* Pascals  $(N/m^2)$
- *q* shear flow (lb/in, kips/ft, N/m, kN/m); soil bearing pressure (lb/ft<sup>2</sup>, kips/ft<sup>2</sup>, N/m<sup>2</sup>, Pa, MPa)

 $q_{allowed}$  allowable soil bearing pressure (lb/ft<sup>2</sup>, kips/ft<sup>2</sup>, N/m<sup>2</sup>, Pa, MPa)

- $q_g$  gross allowed soil pressure (lb/ft<sup>2</sup>, kips/ft<sup>2</sup>, N/m<sup>2</sup>, Pa, MPa)
- $q_{net}$  net allowed soil bearing pressure (lb/ft<sup>2</sup>, kips/ft<sup>2</sup>, N/m<sup>2</sup>, Pa, MPa)
- $q_u$  ultimate soil bearing strength in allowable stress design (lb/ft<sup>2</sup>, kips/ft<sup>2</sup>, N/m, Pa, MPa); factored soil bearing pressure in concrete design from load factors (lb/ft<sup>2</sup>, kips/ft<sup>2</sup>, N/m, Pa, MPa) MPa)
- *Q* first moment area used in shearing stress calculations (in<sup>3</sup>, mm<sup>3</sup>, m<sup>3</sup>): generic axial load quantity for LRFD design (*also see R*)

 $Q_{connected}$  first moment area used in shearing stress calculations for built-up beams (in<sup>3</sup>, mm<sup>3</sup>, m<sup>3</sup>)

- $Q_x$  first moment area about an x axis (using y distances) (in<sup>3</sup>, mm<sup>3</sup>, m<sup>3</sup>)
- $Q_y$  first moment area about an y axis (using x distances) (in<sup>3</sup>, mm<sup>3</sup>, m<sup>3</sup>)
- *r* radius of a circle or arc (in, mm, m); radius of gyration (in, mm, m)
- $r_o$  polar radius of gyration (in, mm, m)
- $r_x$  radius of gyration with respect to an x-axis (in, mm, m)
- $r_y$  radius of gyration with respect to a y-axis(in, mm, m)
- *R* force, reaction or resultant (lb, kip, N, kN);
   radius of curvature of a beam (ft, m);
   rainwater or ice load for LRFD design;
   generic load quantity (force, shear, moment, etc.) for LRFD design (*also see Q*);
   radius of curvature of a laminated arch (ft, m)

- $R_a$  required strength (ASD-unified) (also see  $V_a$ ,  $M_a$ )
- $R_n$  concrete beam design ratio =  $M_u/bd^2$  (lb/in<sup>2</sup>, MPa) nominal value for LRFD design to be multiplied by  $\phi$  (also see  $P_n$ ,  $M_n$ ) nominal value for ASD design to be divided by the safety factor  $\Omega$
- $R_u$  design value for LRFD design based on load factors (also see  $P_u$ ,  $M_u$ )
- $R_x$  reaction or resultant component in the x coordinate direction (lb, kip, N, kN)
- $R_y$  reaction or resultant component in the y coordinate direction (lb, kip, N, kN)
- *s* length of a segment of a thin walled section (in, mm);
   spacing of stirrups in reinforced concrete beams (in, mm);
   longitudinal center-to-center spacing of any two consecutive holes (in, mm)
- s.w. self-weight
- section modulus (in<sup>3</sup>, mm<sup>3</sup>, m<sup>3</sup>);
   snow load for LRFD design;
   allowable strength per length of a weld for a given size (lb/in, kips/in, N/mm, kN/m);
   masonry mortar strength designation

 $S_{required}$  section modulus required to not exceed allowable bending stress (in<sup>3</sup>, mm<sup>3</sup>, m<sup>3</sup>)

- $S_x$  section modulus with respect to the x-centroidal axis (in<sup>3</sup>, mm<sup>3</sup>, m<sup>3</sup>)
- $S_y$  section modulus with respect to the y-centroidal axis (in<sup>3</sup>, mm<sup>3</sup>, m<sup>3</sup>)
- *SC* slip critical bolted connection
- S4S surface-four-sided
- t thickness (in, mm, m)
- $t_f$  thickness of the flange of a steel beam cross section (in, mm, m)
- $t_w$  thickness of the web of a steel beam cross section (in, mm, m)
- *T* tension label;

tensile force (lb, kip, N, kN); torque (lb-ft, k-ft, N-m, kN-m); throat size of a weld (in, mm); effect of thermal load for LRFD design; period of vibration (sec)

- $T_s$  tension force in the steel reinforcement for masonry design (lb, kip, N, kN)
- U shear lag factor for steel tension member design (see  $A_e$  and  $A_{net}$ )
- $U_{bs}$  reduction coefficient for block shear rupture
- *v* shear force per unit length (lb/ft, k/ft, N/m, kN/m) (see q)
- V volume (in<sup>3</sup>, ft<sup>3</sup>, mm<sup>3</sup>, m<sup>3</sup>); shear force (lb, k, N, kN); wind speed (mi/hr, m/hr)
- $V_a$  required shear in steel ASD design (unified) (lb, kip, N, kN)
- $V_c$  shear force capacity in concrete (lb, kip, N, kN)
- $V_n$  nominal shear strength capacity for LRFD beam design (lb, kip, N, kN)
- $V_s$  shear force capacity in steel shear stirrups(lb, kip, N, kN)

- $V_u$  maximum shear from factored loads for LRFD design (lb, kip, N, kN); shear at a distance *d* away from the face of support for reinforced concrete beam design (lb, kip, N, kN)
- $V_{u1}$  maximum one-way shear from factored loads for LRFD beam design (lb, kip, N, kN)
- $V_{u2}$  maximum two-way shear from factored loads for LRFD beam design (lb, kip, N, kN)
- *w* load per unit length on a beam (lb/ft, k/ft, N/m, kN/m) (*also*  $\omega$ ); load per unit area (lb/ft<sup>2</sup>, kips/ft<sup>2</sup>, N/m<sup>2</sup>, Pa, MPa); width dimension (in, ft, mm, m)

wadjusted distributed load for equivalent live load deflection limit (lb/ft, kip/ft, N/m, kN/m)

- $w_c$  weight of reinforced concrete per unit volume (lb/ft<sup>3</sup>, N/m<sup>3</sup>)
- $w_{equivalent}$  the equivalent distributed load derived from the maximum bending moment (lb/ft, kip/ft, N/m, kN/m)
- $w_u$  factored load per unit length on a beam from load factors (lb/ft, kip/ft, N/m, kN/m); factored load per unit area on a surface from load factors (lb/ft<sup>2</sup>, kip/ft<sup>2</sup>, N/m<sup>2</sup>, kN/m<sup>2</sup>)
- W weight (lb, kip, N, kN);
  total load from a uniform distribution (lb, kip, N, kN);
  wind load for LRFD design;
  wide flange shape designation (i.e. W 21 x 68)
- *x* a distance in the x direction (in, ft, mm, m); the distance from the top of a concrete beam to the neutral axis
- $\overline{x}$  the distance in the x direction from a reference axis to the centroid of a shape (in, mm)
- $\hat{x}$  the distance in the x direction from a reference axis to the centroid of a composite shape (in, mm)
- *X* bearing-type connection with bolt threads excluded from shear plane
- y a distance in the y direction (in, ft, mm, m); distance from the neutral axis to the y-level of a beam cross section (in, mm)
- $\overline{y}$  the distance in the y direction from a reference axis to the centroid of a shape (in, mm)
- $\hat{y}$  the distance in the y direction from a reference axis to the centroid of a composite shape (in, mm)
- *Z* plastic section modulus of a steel beam (in<sup>3</sup>, mm<sup>3</sup>);
   lateral design value for a single fastener in a timber connection (lb/nail, k/bolt)
- $Z_x$  plastic section modulus of a steel beam with respect to the x axis (in<sup>3</sup>, mm<sup>3</sup>)
- ' symbol for feet
- " symbol for inches
- # symbol for pounds
- = symbol for equal to
- $\approx$  symbol for approximately equal to
- $\propto$  symbol for proportional to
- $\leq$  symbol for less than or equal to
- symbol for integration

- $\alpha$  coefficient of thermal expansion (/°C, /°F); angle, in a math equation (degrees, radians)
- $\beta$  angle, in a math equation (degrees, radians)
- $\beta_c$  ratio of long side to short side of the column in concrete footing design
- $\beta_1$  coefficient for determining stress block height, *a*, based on concrete strength,  $f'_c$ ; coefficient for determining stress block height, *c*, in masonry LRFD design
- $\delta$  elongation (in, mm)
- $\delta_P$  elongation due to axial load (in, mm)
- $\delta_{s}$  shear deformation (in, mm)
- $\delta_{\tau}$  elongation due to change in temperature (in, mm)
- $\Delta$  beam deflection (in, mm); an increment
- $\Delta_{LL}$  beam deflection due to live load (in, mm)
- $\Delta_{max}$  maximum calculated beam deflection (in, mm)
- $\Delta_{TL}$  beam deflection due to total load (in, mm)
- $\Delta_x$  beam deflection in beam diagrams and formulas (in, mm)
- $\Delta T$  change in temperature (°C, °F)
- $\varepsilon$  strain (no units)
- $\varepsilon_t$  thermal strain (no units)
- $\varepsilon_{v}$  yield strain (no units)
- φ diameter symbol;
   angle of twist (degrees, radians);
   resistance factor in LRFD steel design and reinforced concrete design
- $\phi_b$  resistance factor for flexure in LRFD design
- $\phi_c$  resistance factor for compression in LRFD design
- $\phi_t$  resistance factor for tension in LRFD design
- $\phi_v$  resistance factor for shear in LRFD design
- $\mu$  Poisson's ratio;
  - coefficient of static friction
- γ specific gravity of a material (lb/in<sup>3</sup>, lb/ft<sup>3</sup>, N/m<sup>3</sup>,kN/m<sup>3</sup>);
   angle, in a math equation (degrees, radians);
   shearing strain;
   load factor in LRFD design
- $\gamma_D$  dead load factor in LRFD design
- $\gamma_L$  live load factor in LRFD design

 $\theta \qquad \text{angle, in a trig equation, ex. sin} \theta \text{ (degrees, radians);} \\ \text{slope of the deflection of a beam at a point (degrees, radians)}$ 

 $\pi$  pi (180°)

- ho radial distance (in, mm); radius of curvature in beam deflection relationships (ft, m); reinforcement ratio in concrete beam design = A<sub>s</sub>/bd
- $\rho_b$  balanced reinforcement ratio in masonry design

 $\rho_{balanced}$  balanced reinforcement ratio in concrete beam design

- $\rho_g$  reinforcement ratio in concrete column design =  $A_{st}/A_g$
- $\rho_{max}$  maximum reinforcement ratio allowed in concrete beam design for ductile behavior
- $\sigma$  engineering symbol for normal stress (axial or bending)
- au engineering symbol for shearing stress
- $v_c$  shear strength in concrete design
- ω load per unit length on a beam (lb/ft, kip/ft, N/m, kN/m) (*see w*); load per unit area (lb/ft<sup>2</sup>, kips/ft<sup>2</sup>, N/m<sup>2</sup>, Pa, MPa)
- $\omega'$  load per unit volume (lb/ft, kip/ft, N/m, kN/m) (see  $\gamma$ )
- $\Sigma$  summation symbol
- $\Omega$  safety factor for ASD of steel (unified)
- $\Psi$  relative stiffness of columns to beams in a rigid connection (see G)

#### **Structural Glossary**

Allowable strength: Nominal strength divided by the safety factor.

- Allowable stress: Allowable strength divided by the appropriate section property, such as section modulus or cross section area.
- Applicable building code: Building code und which the structure is designed.
- ASD (Allowable Strength Design): Method of proportioning structural components such that the allowable strength equals or exceeds the required strength of the component under the action of the ASD load combinations.
- ASD load combination: Load combination in the applicable building code intended for allowable strength design (allowable stress design).
- *ASTM standards:* The American Society of Testing and Materials specifies standards for performance and testing of construction materials.

Axial force: A force that is acting along the longitudinal axis of a structural member.

Base shear: A lateral (wind or seismic) force acting at the base of a structure.

Beam: Structural member that has the primary function of resisting bending moments.

Beam-column: Structural member that resists both axial force and bending moment.

- *Bearing (local compressive yielding): Limit state* of *local* compressive *yielding* due to the action of a member bearing against another member or surface.
- Bending moment: A force rotating about a point; causes bending in beams, etc.
- *Block shear rupture:* In a connection, *limit state* of tension fracture along one path and shear yielding or shear fracture along another path.
- *Bracing:* Diagonal members that are used to stiffen a structure, by utilizing the inherent in-plane stiffness of a triangular framework.
- *Braced frame:* An essentially vertical truss system that provides resistance to lateral forces and provides stability for the *structural system*.
- *Buckling: Limit state* of sudden change in the geometry of a structure or any of its elements under a critical loading condition.
- Buckling strength: Nominal strength for buckling or instability limit states.
- *Built-up member, cross-section, section, shape:* Member, cross-section, section or shape fabricated from elements that are nailed, welded, glued or bolted together.
- *Camber:* Curvature fabricated into a beam or truss so as to compensate for deflection induced by loads.
- *Cantilevers:* Structural elements or systems that are supported only at one end.
- *Cement:* The generic name for cementitious (binder) materials used in concrete, which is a commonly used building material.
- Center of gravity: The location of resultant gravity forces on an object or objects.

*Centroid:* The center of mass of a shape or object.

*Chord member:* Primary member that extends, usually horizontally, through a truss *connection*.

- *Cold-rolled steel structural member:* Shape manufactured by roll forming cold-or hot- rolled coils or sheets without manifest addition of heat such as would be required for hot forming.
- Collector: An element that transfers load from a diaphragm to a resisting element.
- Column: Structural member that has the primary function of resisting axial force.
- Component (of vector): One of several vectors combined to a resultant vector.
- *Composite:* Condition in which steel and concrete elements and members work as a unit in the distribution of internal forces.
- *Composite materials:* Those consisting of a combination of two of more distinct materials, together yielding superior characteristics to those of the individual constituents.
- Compression: A force that tends to shorten or crush a member or material.
- Concentrated force: A force acting on a single point.
- Concentrated load: An external concentrated force (also known as a point load).
- Concrete: Material composed mainly of cement, crushed rock or gravel, sand and water.
- *Concrete crushing: Limit state* of compressive failure in concrete having reached the ultimate strain.
- Connection: A connection joins members to transfer forces or moments from one to the other.
- *Cope:* Cutout made in a structural member to remove a flange and conform to the shape of an intersecting member.
- *Couple:* A couple is a system of two equal forces of opposite direction offset by a distance. A couple causes a moment whose magnitude equals the magnitude of the force times the offset distance.
- *Cover plate:* Plate welded or bolted to the flange of a member to increase cross-sectional area, section modulus or moment of inertia.
- Creep: Plastic deformation that proceeds with time.
- Damping: Reduces vibration amplitude, like amplitude seismic vibration.
- Dead load: The weight of a structure or anything permanently attached to it.
- *Deflection:* Deflection is the vertical moment under gravity load of beams for example, while lateral movement under wind of seismic load is called drift.
- Deformation: A change of the shape of an object or material.
- *Design load:* Applied *load* determined in accordance with either *LRFD load combinations* or *ASD load combinations*, whichever is applicable.
- *Design strength: Resistance factor* multiplied by the *nominal strength*, ØR*n*.
- *Design stress range:* Magnitude of change in stress due to the repeated application and removal of service live *loads*. For locations subject to stress reversal it is the algebraic difference of the peak stresses.
- *Design stress: Design strength* divided by the appropriate section property, such as section modulus or cross section area.

- *Determinate structure:* A structure with the number of reactions equal to the number of static equations (3).
- Diagonal Bracing: Inclined structural member carrying primarily axial force in a braced fame.
- *Diaphragm plate:* Plate possessing in-plane shear stiffness and strength, used to transfer forces to the supporting elements.
- *Diaphragm:* Roof, floor or other membrane or bracing system that transfers in-plane forces to the lateral force resisting system.
- Displacement: May be a translation, a rotation, or a combination of both.
- Distributed load: An external force which acts over a length or an area.
- Double curvature: Deformed shape of a beam with one or more inflection points within the span.
- *Double-concentrated forces:* Two equal and opposite forces that form a couple on the same side of the loaded member.
- Drift: Lateral deflection of structure due to lateral wind or seismic load.
- *Ductibility:* The capacity of a material to deform without breaking; it is measured as the ratio of total strain at failure, divided by the strain at the elastic limit.
- *Durability:* Ability of a material, element or structure to perform its intended function for its required life without the need for replacement or significant repair, but subject to normal maintenance.
- Dynamic equilibrium: Equilibrium of a moving object without change of motion.
- Dynamic load: Cyclic load, such as gusty wind or seismic loads.
- *Effective length factor, K:* Ratio between the *effective length* and the unbraced length of the member.
- *Effective length:* Length of an otherwise identical *column* with the same strength when analyzed with pinned end conditions.
- Effective net area: Net area modified to account for the effect of shear lag.
- *Effective section modulus:* Section modulus reduced to account for buckling of slender compression elements.
- *Effective width:* Reduced width of a plate or slab with an assumed uniform stress distribution which produces the same effect on the behavior of a structural member as the actual plate or slab with its nonuniform stress distribution.
- Elastic: A material or structure is elastic if it returns to its original geometry upon unloading.
- *Elastic/plastic:* Materials that have both an elastic zone and a plastic zone (i.e. steel).
- *Elastic limit:* The point of a stress/strain graph beyond which deformation of a material is plastic, i.e. remains permanently deformed.
- Elastic modulus: The linear slope value relating material stress to strain.
- End-bearing pile: A pile supported on firm soil or rock.
- *Energy:* The work to move a body a distance; energy is the product of forces times distance.
- Epicenter: The point on the Earth's surface above the hypocenter where an earthquake originates.

- *Equilibrium:* An object is in equilibrium if the resultant of all forces acting on it has zero magnitude.
- External force: A force acting on an object; external forces are also called applied forces.
- Factored load: Product of a load factor and the nominal load.
- *Fatigue: Limit state* of crack initiation and growth resulting from repeated application of live *loads*, usually by reversing the loading direction.
- *Fillet weld:* Weld of generally triangular cross section made between intersecting surfaces of elements.
- *Fitted bearing stiffener: Stiffener* used at a support or concentrated *load* that fits tightly against one or both flanges of a *beam* so as to transmit load through bearing.

Fixed connection: A connection that resists axial and shear forces and bending moments.

- Flexure: Bending deformation (of increasing curvature).
- *Flexural buckling:* Buckling mode in which a compression member deflects laterally without twist or change in cross-sectional shape.
- *Flexural-torsional buckling:* Buckling mode in which a compression member bends and twists simultaneously without change in cross-sectional shape.
- *Force:* Resultant of distribution of stress over a prescribed area, or an action that tends to change the shape of an object, move an object, or change the motion of an object.
- *Foundations:* There are two basic types: 'shallow,' which includes pad footing, strip footings and rafts and 'deep' i.e. piles. The choice is a function of the strength and stiffness of the underlying strata and the load to be carried, the aim being to limit differential settlement on the structure and more importantly the finishes.
- *Fully restrained moment connection:* Connection capable of transferring moment with negligible rotation between connected members.
- *Funicular:* The shape of a chain or string suspended form two points under any load.
- *Gravity:* An attractive force between objects; each object accelerates at the attractive force divided by its mass.
- Groove weld: Weld in a groove between connection elements.
- Gusset plate: Plate element connecting truss members of a strut or brace to a beam or column.
- Hertz: Cycles per second.
- Horizontal diaphragm: A floor or roof deck to resist lateral load.
- Horizontal shear: Force at the interface between steel and concrete surfaces in a composite beam.

Indeterminate structure: A structure with more unknown reactions than static equations (3).

- Inelastic: Inelastic (plastic) strain implies permanent deformation.
- Inertia: Tendency of objects at rest to remain at rest and objects in motion to remain in motion.
- *In-plane instability: Limit state* of a *beam-column* bent about its major axis while *lateral buckling* or *lateral-torsional buckling* is prevented by *lateral bracing*.

- *Instability: Limit state* reached in the loading of a structural component, frame or structure in which a slight disturbance in the *loads* or geometry produces large displacements.
- Internal force: The force within an object that resists external forces, also called resisting force.
- *Joint:* Area where two or more ends, surfaces, or edges are attached. Categorized by type of *fastener* or weld used and method of force transfer.

Joist: A repetitive light beam.

- *K-connection:* Connection in which forces in *branch members* or connecting elements transverse to the *main member* are primarily equilibrated by forces in other branch members or connecting elements on the same side of the main member.
- *Kern:* The core of a post or other compression member which limits eccentric stresses being tensile.
- *Lacing:* Plate, angle or other steel shape, in a lattice configuration, that connects two steel shapes together.
- Lap joint: Joint between two overlapping connection elements in parallel planes.
- *Lateral bracing: Diagonal bracing, shear walls* or equivalent means for providing in-plane lateral stability.
- *Lateral load resisting system:* Structural system designed to resist lateral loads and provide stability for the structure as a whole.
- *Lateral load: Load*, such as that produced by wind or earthquake effects, acting in a lateral direction.
- *Lateral-torsional buckling:* Buckling mode of a flexural member involving deflection normal to the plane of bending occurring simultaneously with twist about the shear center of the cross-section.
- *Length effects:* Consideration of the reduction in strength of a member based on its *unbraced length*.
- *Limit state:* Condition in which a structure or component becomes unfit for service and is judged either to be no longer useful for its intended function (*serviceability limit state*) or to have reached its ultimate load-carrying capacity (*strength limit state*).
- *Linear:* A structural or material behavior is linear if its deformation is directly proportional to the loading.
- *Line of action:* The line of action defines the location and incline of a vector.
- *Linear elastic:* A force-displacement relationship which is both linear and elastic.
- Live load: Any load not permanently attached to the structure.
- *Load:* Force or other action that results from the weight of building materials, occupants and their possessions, environmental effects, differential movement, or restrained dimensional changes.
- *Load effect:* Forces, stresses and deformations produced in a *structural component* by the applied *loads*.

- *Load factor:* Factor that accounts for deviations of the *nominal load* from the actual *load*, for uncertainties in the analysis that transforms the load into a *load effect* and for the probability that more than one extreme load will occur simultaneously.
- Local bending: Limit state of large deformation of a flange under a concentrated tensile force.
- Local buckling: Limit state of buckling of a compression element within a cross section.
- *Local crippling: Limit state* of local failure of web plate in the immediate vicinity of a concentrated *load* or reaction.
- Local yielding: Yielding that occurs in a local area of an element.
- *LRFD (Load and Resistance Factor Design):* Method of proportioning *structural components* such that the *design strength* equals or exceeds the *required strength* of the component under the action of the *LRFD load combinations*.
- *LRFD load combination:* Load combination in the *applicable building code* intended for strength design (*load and resistance factor design*).
- *Main member: Chord member* or column to which *branch members* or other connecting elements are attached.
- Mass: Mass is the property of an object to resist acceleration.
- Magnitude: a scalar value of physical units, such as force or displacement.
- *Modulus of elasticity:* The proportional constant relating stress/strain of material in the linear elastic range: calculated as stress divided by strain. The modulus of elasticity is the slope of the stress-strain graph, usually denoted as E, also as Young's Modulus Y, or E-Modulus.
- Moment: A force causing rotation without translation; defined as force times lever arm.
- *Moment of inertia:* Moment of inertia is the capacity of an object to resist bending or buckling, defined as the sum of all parts of the object times the square of their distance from the centroid.
- Moment connection: Connection that transmits bending moment between connected members.
- *Moment frame:* Framing system that provides resistance to lateral loads and provides stability to the *structural system*, primarily by shear and flexure of the framing members and their connections.
- Net area: Gross area reduced to account for removed material.
- Nominal dimension: Designated or theoretical dimension, as in the tables of section properties.
- Nominal load: Magnitude of the load specified by the applicable building code.
- *Nominal strength:* Strength of a structure or component (without the *resistance factor* or *safety factor* applied) to resist *load effects*, as determined in accordance with this *Specification*.
- *Normal stress:* Stress acting parallel to the axis of an object in compression and tension; normal stress is usually simply called stress.
- *Out-of-plane buckling: Limit state* of a beam-column bent about its major axis while lateral buckling or *lateral-torsional buckling* is not prevented by lateral bracing.
- Overlap connection: Connection in which intersecting branch members overlap.
- Overturn: Topping, or tipping over under lateral load.

- *Permanent load: Load* in which variations over time are rare or of small magnitude. All other *loads* are *variable loads*.
- Pin connection: A pin connection transfers axial and shear forces but no bending moment.
- Pin support: A pin support resists axial and shear forces but no bending moment.
- *Pitch:* Longitudinal center-to-center spacing of fasteners. Center-to-center spacing bolt threads along axis of bolt.
- *Plastic:* Material may be elastic or plastic. Plastic deformation of a structure or material under load remains after the load is removed.
- *Plastic analysis: Structural analysis* based on the assumption of rigid-plastic behavior, in other words, that equilibrium is satisfied throughout the structure and the stress is at or below the yield stress.
- *Plastic hinge:* Yielded zone that forms in a structural member when the *plastic moment* is attained. The member is assumed to rotate further as if hinged, except that such rotation is restrained by the *plastic moment*.
- Plastic moment: Theoretical resisting moment developed within a fully yielded cross section.
- *Plastic stress distribution method:* Method for determining the stresses in a composite member assuming that the steel section and the concrete in the cross section are fully plastic.
- Plate girder: Built-up beam.
- *Plug weld:* Weld made in a circular hole in one element of a joint fusing that element to another element.
- *Post-buckling strength: Load* or force that can be carried by an element, member, or frame after initial buckling has occurred.
- *Pressure:* Similar to stress, the force intensity at a point, except that pressure is acting on the surface of an object rather than within the object.
- *Prying action:* Amplification of the tension force in a bolt caused by leverage between the point of applied load, the bolt and the reaction of the connected elements.
- Punching load: Component of branch member force perpendicular to a chord.
- *P-* $\delta$  *effect:* Effect of *loads* acting on the deflected shape of a member between joints or nodes.
- $P-\Delta$  effect: Effect of loads acting on the displaced location of joints or nodes in a structure. In tiered building structures, this is the effect of loads acting on the laterally displaced location of floors and roofs.
- *Radius of gyration:* A mathematical property, determining the stability of a cross section, defined as:  $r = \sqrt{I/A}$ , where I = moment of inertia and A = cross section area.
- *Reaction:* The response of a structure to resist applied load.
- *Required strength:* Forces, stresses and deformations acting on the *structural component*, determined by either *structural analysis*, for the *LRFD* or *ASD load combinations*, as appropriate, or as specified by the *Specification* or Standard.
- *Resilience:* The property of structures to absorb energy without permanent deformation of fracture.

- *Resistance factor \phi:* Factor that accounts for unavoidable deviations of the *nominal strength* from the actual strength and for the manner and consequences of failure.
- *Resultant:* The resultant of a system of forces is a single force or moment whose magnitude, direction, and location make it statically equivalent to the system of forces.
- Retaining wall: Wall used to hold back soil or other materials.
- Roller support: In two dimensions, a roller support restrains one translation degree of freedom.
- Rupture strength: In a connection, strength limited by tension or shear rupture.
- *Safety factor:* Factor that accounts for deviations of the actual strength from the nominal strength, deviations of the actual *load* from the *nominal load*, uncertainties in the analysis that transforms the load into a *load effect*, and for the manner and consequence of failure.
- Scalar: A mathematical entity with a numeric value but no direction (in contrast to a vector).
- Section modulus: The property of a cross section defined by its shape and orientation; section modulus is denoted S, and S = I/c, where I = moment of inertia about the centroid and c is the distance from the centroid to the edge of the section,
- *Service load combination:* Load combination under which serviceability limit states are evaluated.
- Service load: Load under which serviceability limit states are evaluated.
- *Serviceability limit state:* Limiting condition affecting the ability of a structure to preserve its appearance, maintainability, durability or the comfort of its occupants or function of machinery, under normal usage.
- Shear: A sliding force, pushing and pulling in opposite directions.
- *Shear buckling: Buckling* mode in which a plate element, such as the web of a beam, deforms under pure shear applied in the plane of the plate.
- *Shear connector:* Headed stud, cannel, plate or other shape welded to a steel member and embedded in concrete of a *composite member* to transmit shear forces at the interface between the two materials.
- *Shear connector strength: Limit state* of reaching the strength of a *shear connector*, as governed by the connector bearing against the concrete in the slab or by the *tensile strength* of the connector.
- Shear modulus: The ratio of shear stress divided by the shear strain in a linear elastic material.
- Shear rupture: Limit state of rupture (fracture) due to shear.
- *Shear strain:* Strain measuring the intensity of racking in a material. Shear strain is measured as the change in angle of a small square part of a material.
- Shear stress: Stress acting parallel to an imaginary plane cut through an object.
- *Shear wall:* Wall that provides resistance to lateral loads in the plane of the wall and provides stability for the structural system.
- Shear yielding: Yielding that occurs due to shear.
- *Shear yielding (punching):* In a connection, *limit state* based on out-of-plane shear strength of the *chord* wall to which *branch members* are attached.

- *Slip:* In a bolted connection, *limit state* of relative motion of connected parts prior to the attainment of the *available strength* of the connection.
- *Slip-critical connection:* Bolted *connection* designed to resist movement by friction on the faying surface of the connection under the clamping forces of the bolts.
- Slot weld: Weld made in an elongated hole fusing an element to another element.
- Splice: Connection between two structural elements joined at their ends to forma single, longer element.
- *Stability:* Condition reached in the loading of a structural component, frame or structure in which a slight disturbance in the *loads* or geometry does not produce large displacements.
- Static equilibrium: Equilibrium of an object at rest.
- Stiffness: The capacity of a material to resist deformation.
- *Stiffened element:* Flat compression element with adjoining out-of-plane elements along both edges parallel to the direction of loading.
- *Stiffener:* Structural element, usually an angle or plate, attached to a *member* to distribute *load*, transfer shear or prevent buckling.
- *Stiffness:* Resistance to deformation of a member or structure, measured by the ratio of the applied force (or moment) to the corresponding displacement (or rotation).
- *Strain:* Change of length along an axis, calculated as  $\varepsilon = \Delta L/L$ , where L is the original length and  $\Delta L$  is the change of length.
- *Strength:* The capacity of a material to resist breaking.
- *Strength design:* A design method based on factored load and ultimate strength for concrete design.
- *Strength limit state:* Limiting condition affecting the safety of the structure, in which the ultimate load-carrying capacity is reached.
- Stress: Force per unit area caused by axial force, moment, shear or torsion.
- *Stress concentration:* Localized stress considerably higher than average (even in uniformly loaded cross sections of uniform thickness) due to abrupt changes in geometry or localized loading.
- *Stress resultant:* A system of forces which is statically equivalent to a stress distribution over an area.
- Stress: The internal reaction to an applied force, measured in force per unit area.
- Structure: Composition of elements that define form and resist applied loads.
- *Structural Aluminum:* Elements manufactured of aluminum for structural purposes, generally 50% larger than comparable steel elements due to the lower *modulus of elasticity*.
- *Structural Steel:* Elements manufactured of steel with properties designated by *ASTM standards*, including A36, A992 & A572.
- Strong axis: Major principal centroidal axis of a cross section.
- *Structural analysis:* Determination of *load effects* on members and *connections* based on principles of structural mechanics.

Structural component: Member, connector, connecting element or assemblage.

- *Structural system:* An assemblage of load-carrying components that are joined together to provide interaction or interdependence.
- *T-connection: Connection* in which the *branch member* or connecting element is perpendicular to the *main member* and in which forces transverse to the main member are primarily equilibrated by shear in the main member.
- Tensile rupture: Limit state of rupture (fracture) due to tension.
- *Tensile strength (of material):* Maximum tensile stress that a material is capable of sustaining as defined by ASTM.
- Tensile strength (of member): Maximum tension force that a member is capable of sustaining.
- Tensile yielding: Yielding that occurs due to tension.
- Tension: A force that tends to elongate or enlarge an object.
- *Tension and shear rupture:* In a bolt, *limit state* of rupture (fracture) due to simultaneous tension and shear *force*.
- *Tie plate:* Plate element used to join parallel components of a *built-up column*, girder or strut rigidly connected to the parallel components and designed to transmit shear between them.
- Torsion: A twisting moment.
- Torsional bracing: Bracing resisting twist of a beam or column.
- *Torsional buckling: Buckling* mode in which a compression member twists about its shear center axis.
- Torsional yielding: Yielding that occurs due to torsion.
- Translation: Motion of an object along a straight line path without rotation.
- *Transverse reinforcement:* Steel reinforcement in the form of closed ties or welded wire fabric providing confinement for the concrete surrounding the steel shape core in an *encased concrete composite column*.
- Transverse stiffener: Web stiffener oriented perpendicular to the flanges, attached to the web.
- Truss: A linear support system consisting of triangular panels usually with pin joints.
- Ultimate strength: The utmost strength reached by a material before breaking.
- *Unbraced length:* Distance between braced points of a member, measured between the centers of gravity of the bracing members.
- *Uneven load distribution:* In a *connection*, condition in which the load is not distributed through the cross section of connected elements in a manner that can be readily determined.
- *Unframed end:* The end of a member not restrained against rotation by stiffeners of connection elements.
- *Unstiffened elements:* Flat compression element with an adjoining out-of-plane element along one edge parallel to the direction of loading.
- Uplift: Upward force, usually wind uplift.
- Variable load: Load not classified as permanent load.

Vector: A mathematical entity having a magnitude, line of action, and a direction in space.

- *Vertical bracing system:* System of *shear walls, braced frames* or both, extending through one or more floors of a building.
- Vertical diaphragm: A wall to resist lateral load.
- Vibration: The cyclic motion of an object.
- Wall: A vertical element to resist load and define space; shear walls also resist lateral loads.
- Weak axis: Minor principal centroidal axis of a cross section.
- Web buckling: Limit state of lateral instability of a web.
- *Web compression buckling: Limit state* of out-of-plane compression buckling of the web due to a concentrated compression force.
- *Web sideway buckling: Limit state* of lateral buckling of the tension flange opposite the location of a concentrated compression force.
- *Weld metal:* Portion of a fusion weld that has been completely melted during welding. Weld metal has elements of filler metal and base metal melted in the weld thermal cycle.
- Working stress: The same as allowable stress.
- *Yield moment:* In a member subjected to bending, the moment at which the extreme outer fiber first attains the *yield stress*.
- *Yield point:* First stress in a material at which an increase in strain occurs without an increase in stress as defined by ASTM.
- *Yield strength: Stress* at which a material exhibits a specified limiting deviation from the proportionality of stress to strain as defined by ASTM.
- Yield strain: The strain of a material which occurs at the level of yield stress.
- *Yield stress:* Generic term to denote either *yield point* or *yield strength*, as appropriate for the material.
- Yielding: Limit state of inelastic deformation that occurs after the yield stress is reached.
- *Yielding (plastic moment): Yielding* throughout the cross section of a member as the bending moment reaches the *plastic moment*.
- *Yielding (yield moment): Yielding* at the extreme fiber on the cross section of a member when the bending moment reached the *yield moment*.

References:

AISC, Specifications for Structural Steel Buildings, 13<sup>th</sup> ed. (2005) Jacqueline Glass, Encyclopaedia of Architectural Technology, Wiley, Cornwall (2002)

# **Structural Systems**

from <u>Architectural Structures</u>, Wayne Place, Wiley, 2007:

STRUCTURAL DESIGN PROCESS

#### **1.1 Nature of the Process**

Architects have a huge array of issues to address in architectural practice. Among these are the following: keeping rain out of a building, getting water off a site, thermal comfort, visual comfort, space planning, fire egress, fire resistance, corrosion and rot resistance, vermin resistance, marketing, client relations, the law, contracts, construction administration, the functional purposes of architecture, the role of the building in the larger cultural context, security, economy, resource management, codes and standards, and how to make a building withstand all the forces to which it will likely be subjected during its lifetime. This last subject area is referred to as *architectural structures*.

Because of the extraordinary range of demands on an architect's time and skills and the extraordinary number of subjects that architecture students must master, architectural structures are typically addressed in only two or three lecture courses in an accredited architectural curriculum in the United States. These two or three lecture courses must be contrasted with the ten or twelve courses that will normally be taken by a graduate of an accredited structural engineering curriculum. This contrast in level of focus makes it clear why a good structural engineering consultant is a very valuable asset to an architect. However, having a good structural consultant does not relieve the architect of serious responsibility in the structural domain. All architects must be well versed in matters related to structures. The architect has the primary responsibility for establishing the structural concept for a building, as part of the overall design concept, and must be able to speak the language of the structural consultant with sufficient skill and understanding to take full advantage of the consultant's capabilities.

### 1.2 General Comments Regarding Architectural Education


Structural design is one of the more rigorous aspects of architectural design. Much knowledge has been generated and codified over the centuries that human beings have been practicing in and developing this field. This book gives primary attention to those things that are known, quantified, and codified.

However, very few things in the realm of architecture yield a single solution. To any given design problem, there are many possible solutions, and picking the best solution is often the subject of intense debate. Therefore, no one should come to this subject matter assuming that this text, or any text, is going to serve up a single, optimized solution to any design problem, unless that design problem has been so narrowly defined as to be artificial.

In design, there is always a great deal of latitude for personal expression. Design is purposeful action. The designer must have an attitude to act. Architecture students develop an attitude through a chaotic learning process involving a lot of trial and error. In going through this process, an architecture student must remain aware of a fundamental premise: the process is more important than the product; that is, the student's learning and development are more important than the output. The student has a license to make mistakes. It is actually more efficient to plow forward and make mistakes than to spend too much time trying to figure out how to do it perfectly the first time. To paraphrase the immortal words of Thomas Edison: To have good ideas, you should have many ideas and then throw out the bad ones. Of course, throwing out the bad ones reguires a lot of rigorous and critical thinking. No one should ever fall in love with any idea that has not been subjected to intense and prolonged critical evaluation and withstood the test with flying colors. Furthermore, important ideas should be subjected to periodic reevaluation. Times and conditions change. Ideas that once seemed unassailable may outlive their usefulness or, at the very least, need updating in the light of new knowledge and insights.

In pursuing this subject matter, it is valuable to have a frame of reference regarding the roles of the architect, as the leader of the design team, and the structural engineer, as a crucial contributor of expertise and hard work needed to execute the project safely and effectively. The diagram in Figure 1.1 will help provide that frame of reference.

In contemplating the diagram in Figure 1.1, keep in mind that design and analysis are two sides of the same coin and that the skills and points of view of architects and engineers, although distinctive, also overlap and sometimes blur together. The most effective design teams consist of individuals with strong foci who can play their respective roles while having enough overlap in understanding and purpose that they can see each other's point of view and cooperate in working toward mutually understood and shared goals. The most harmful poison to a design team is to have such a separation in points of view and understanding that a rift develops between the members of the team. Cooperation is the watchword in this process, as in all other team efforts.

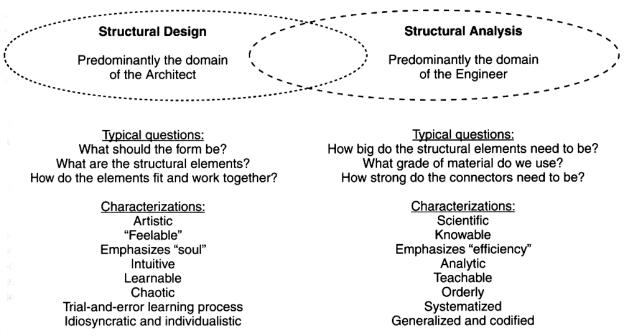

**Figure 1.1** Nature of the design process and roles of the design participants.

# Design Criteria for the Behavior of the Overall System

Components of a system consist of vertical and horizontal elements. Connections of the vertical to horizontal elements are also necessary. For the structural elements to behave and respond as designed, the system must have the following qualities:

- the components stay together
- the system resists overturning, sliding, twisting and excessive distortion
- the system has internal stability
- the system has overall strength and stiffness



### "Order" of Design

There is no set order to design of a structural system. But there are certain stages that can be recognized. These may be referred to as *preliminary, revised* and *final,* or more formally as:

<u>First order</u>: which can include determining structural type and organization, design intent, and contextual or programmatic emphasis. Preliminary member size charts are useful at this stage.

<u>Second order:</u> which can include evaluating structural strategies, choice of construction materials, and structural system options with those materials. System selection design aids are useful at this stage.

<u>Third order</u>: which, after the design has been narrowed down, is where analysis and design (shape and size) of individual structural elements (beams, columns, connections, etc.) is performed. The outcome here may direct further first order or second order investigations!!!

Precast concrete: double tee RATIONALE	Inherently fire-resistive construction	Simple, site-fabricated systems	Systems without beams in roof or floors	Precast-concrete systems without ribs	Short-span, one-way, easily modified	Quickly erected; avoid site-cast concrete	Easily formed or built on site	Highly prefabricated; modular components	Lightweight, easily formed or prefabricated	Precast, site-cast concrete; steel frames	Strong; prefabricated; lightweight	Capable of forming rigid joints	Lightweight, short-span systems	Systems without rigid joints	Multipurpose components	Systems that inherently provide voids	Two-way, long-span systems	Long-span systems
Precast concrete: single tee										80								
Precast concrete: hollow-core slab				R		the second				11								
Precast concrete: solid slab																		
Site-cast concrete: wattle slab		_	alla.		13300	_	381	_	_	199				_	_	_	_	_
Site-cast concrete: two-way slab Site-cast concrete: one-way joists		1844 N	613 M	_		_	231	_	_		_				_			_
Site-cast concrete: two-way plate			1000	110			1111	_	-		-		_	_	-		_	_
Site-cast concrete: one-way slab		aca Pici	ALC: NO		11.95						-			-	-		-	-
Steel decking	COLUMN T	10.615		9355														
Steel space frame																	22	
Steel open-web joists																		
Steel frame (rigid connections)					10,00													
Steel frame (hinge connections)	10.00	5855								193								_
Heavy-frame timber Masonry bearing wall		118	-		1611	0.053	1993	1990	1963	-	_		12122	0.000		_	_	_
Light-frame timber	0110	HAR	-	-		111	-	3113		_	_	-		199	1183	13.223	_	_
Jodmit omost tdoi l		19.534	-		1993	10.010	12533		2555	-	-	-	1111	100	8209	10750	_	-
DESIGN CRITERIA	Exposed, fire-resiant construction	Irregular building form	Irregular column placement	Minimize floor thickness	Allow for future renovations	Permit construction in poor weather	Minimize off-site fabrication time	Minimize on-site erection time	Minimize low-rise construction time	Minimize medium-rise construction time	Minimize high-rise construction time	Minimize shear walls or diagonal bracing	Minimize dead load on foundations	Minimize damage due to foundation settlement	Minimize the number of separate trades on job	Provide concealed space for mech. services	Minimize the number of supports	Long spans

3

from Understanding Structures, Fuller Moore, McGraw-Hill, 199	9:

DESIGN CRITERIA: SUMMARY CHART


		WOOD AND MASONRY	AND			STEEL				-	ITIS	CAST (	SITECAST CONCRETE	ETE				PREC	PRECAST CONCRETE	ONCRE	H
	29–65 Pages	едея вадея	71–85 Pages	Pages 71–85	Pages 19–88	Бадеs 102–103 Радеs	Pages 87–105	Pages 87-105	Pages 114–115	۲۱۱–۱۱۲ Pages Pages ۲۱–۱۱۲	Pages	118–119 Pages	118–119 Pages	120–121 Pages	120–121 Pages	122–123 Pages	122–123 Pages	132–133 Pages	132–133 Pages	134–135 Pages	134–132 <b>Bag</b> es
GIVE SPECIAL CONSIDERATION TO THE SYSTEMS INDICATED IF YOU WISH TO:	Platform Frame	əmsr1 rədmiT	Ordinary Construction	Mill Constroction	Light Gauge Steel Framing Single-Story Rigid	Steel Frame Steel Frame	Hinged Connections Steel Frame—	Rigid Connections One-Way	del2 bilo2 Postfensionated	dal2 bilo2 yeW-9nO fsio[ yeW-9nO	Postfensioned Paroisnetten Paroisnetten	Two-Way Flat Plate	Posttensioned Two-Way Flat Plate	dsl2 fsl3 vsW-owT	Posttensioned Two-Way Flat Slab	dal2 əffisW	Posttensioned Waffle Slab	dsIS bilo2	Hollow Core Slab	Double Tee	əəT əlpni2
Create a highly irregular building form	•		•		•			•	•			•	•	•	•						
Expose the structure while retaining a high fire-resistance rating		•		•				•	•	•	•	•	•	•	•	•	•	•	•	•	•
Allow column placements that deviate from a regular grid												•	•	•	•						
Minimize floor thickness									•			•	•	•	•			•	•		
Minimize the area occupied by columns or bearing walls						•		•								•	•			•	•
Allow for changes in the building over time	•	•	•	•	•	•	•	•		•								•	•		
Permit construction under adverse weather conditions	•	•			•	•												•	•	•	•
Minimize off-site fabrication time	•		•	•	•			•	٠	•	•	•	•	•	•	•	•				
Minimize on-site erection time		•				•		-										•	•	•	•
Minimize construction time for a one- or two-story building	•	•			•	•		•													
Minimize construction time for a 4- to 20-story building								•	•	•	•	•	•	•	•	•	•	•	•	•	•
Minimize construction time for a building 30 stories or more in height		×				•	•														
Avoid the need for diagonal bracing or shear walls						•	•	•	•	•	•	٠	•	٠	•	•	•				
Minimize the dead load on a foundation	•	•			•	•		-													
Minimize structural distress due to unstable foundation conditions	•	•				-	•											•	•	•	•
Minimize the number of separate trades needed to complete a building			•	•																	
Provide concealed spaces for ducts, pipes, etc.	•		•																		

from The Architect's Studio (	Companion, 3 <sup>rd</sup> ed.,	Allen & Iano,	Wiley, 2002


# System Types by Material

from <u>Structures</u>, Schodek & Bechthold, 6<sup>th</sup> ed.. Pearson, 2008:


Timber Systems

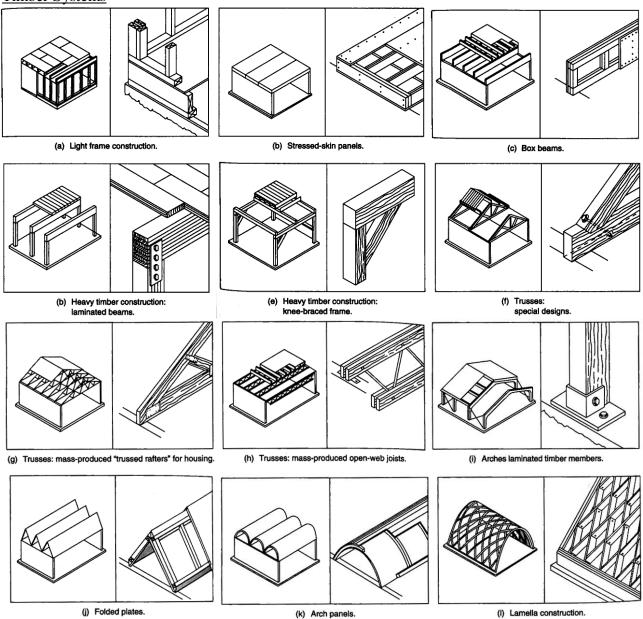



# Reinforced Concrete Systems



(a) One-way flat plate (poured in place).









(c) One-way pan joist system (poured in place).


# Reinforced Concrete Systems (continued)




(d) Two-way flat plate (poured in place).




(g) Two-way waffle slab (poured in place).




(j) Prestressed single tees (precast).




(e) Two-way flat slab (poured in place).




(h) Prestressed long-span planks (precast).




(k) Beam-and-column system (precast).



(f) Two-way beam-and-slab system (poured in place).




(i) Prestressed channels (precast).




(I) Housing system (precast walls and planks post-tensioned together).


Steel Systems




(a) Steel deck and beam floor system.




(d) Plate girders.




(b) Steel deck and open-web bar joist system.






(c) Composite steel and concrete floor system.



(f) Welded trusses: tube members.

# Steel Systems(continued)

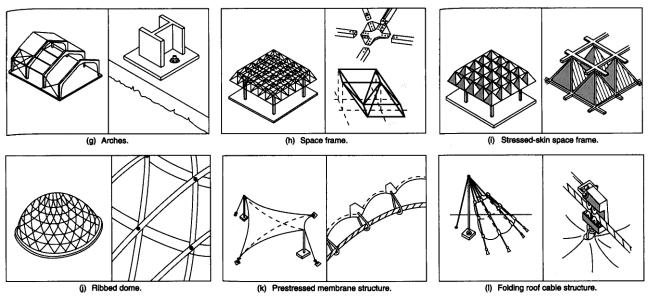


# **Structural Planning**

#### **Design Issues**


(Reference: The Architect's Studio Companion, 3rd ed., Allen & Iano, Wiley, 2002)

Lateral Stability: Wind forces and inertial forces due to ground acceleration are two types of lateral loads buildings must be designed to resist. Without resisting elements or systems, the buildings will move a little, a lot, or suddenly. Stability is the ability to flex and not suddenly "snap" or in other words, the ability to remain in the configuration intended to transfer load.


• Resisting systems include *shear walls, braced frames* and *rigid frames*:

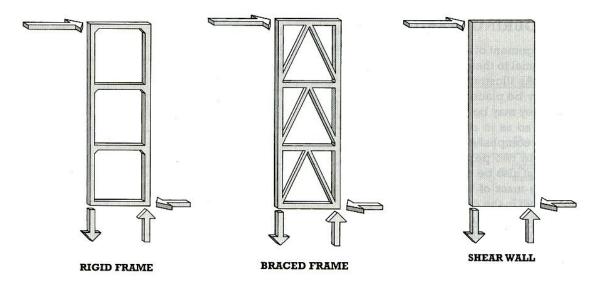


Configurations are important for the systems to be effective. Symmetrical or balanced arrangements are the most effective for resisting the lateral forces from all directions.




Stabilizing elements may be placed within the interior or at the perimeter of a building.



Stabilizing elements should be arranged in a balanced fashion.




Rigid frame structures require no additional bracing or shear walls, as shown in this elevation and plan.




The locations of braced frames or shear walls must be considered in relation to the elevation and plan of the building.

<u>Vertical Load Resistance</u>: Load bearing walls, columns and frames are examples of vertical load resisting elements. They can support a variety of horizontal spanning elements, such as beams and slabs. The order, or modular placement, becomes important, and uniform arrangements are economical. Load bearing walls can also function as shear walls to resist lateral loads. They are commonly constructed of reinforced concrete or masonry.

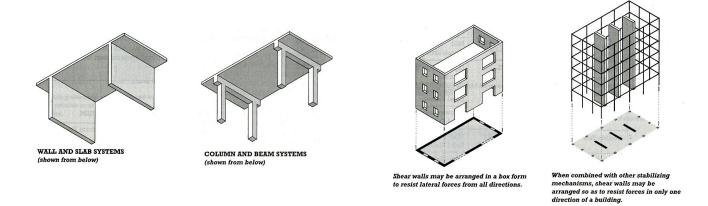

<u>Horizontal Load Resistance:</u> The combination of vertical and horizontal load resistance is dependant upon construction materials and size or utility of spaces. Slabs can act as diaphragms to transmit loads to the columns, shear wall or frames. They are commonly constructed of reinforced concrete. Rigid frames are commonly steel or monolithically cast reinforced concrete.

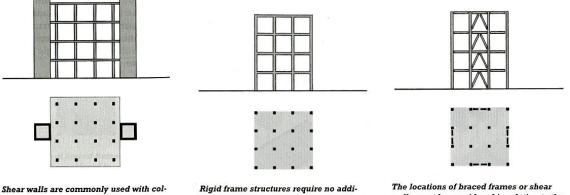


Shear walls are commonly used with column and slab systems. In this elevation and plan, the shear walls are shown incorporated into a pair of vertical cores.

Rigid frame structures require no additional bracing or shear walls, as shown in this elevation and plan.


The locations of braced frames or shear walls must be considered in relation to the elevation and plan of the building.

<u>Multistory Design Issues</u>: As a building gets taller, it is exposed to more wind load that it must resist laterally. It also increases in mass at each story, which makes the inertial forces from ground acceleration very complex. The behavior of a structure under these types of loads is dependent upon the arrangement of the masses and the stiffness and placement of the horizontal and vertical load resisting elements.

Cores are quite common to increase stiffness vertically. Unfortunately, they can't provide effective horizontal load transfer, and should not be relied on as the sole lateral resistant mechanism! Exterior bracing or tube formations, such as the Sears Tower in Chicago, are other multistory configurations to resist lateral loads.

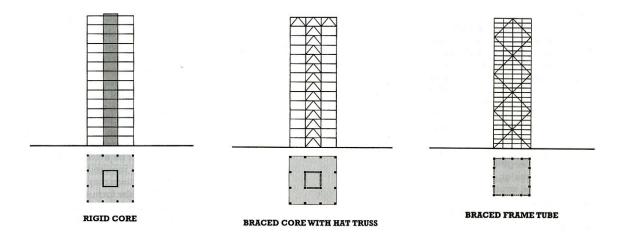

Vertical and horizontal "discontinuities" contribute to irregular or poor lateral response. Vertical discontinuities include "cut-outs" in stories, or changes in plan vertically, while horizontal continuities include problems such as "soft stories" which have different stiffness from the rest of the structure, and unbalanced placement of shear walls.



Transfer beams or trusses may be used to interrupt vertical loadbearing elements where necessary.



UNBALANCED PLAN




UNBALANCED SECTION




BALANCED

PLAN

BALANCED SECTION



Discrete building masses should be structurally independent. Inherently unstable building masses should be avoided.



Discontinuities in the stiffness of structures at different levels should be avoided, or additional stabilizing elements may be required.

# **Structural Plans and Grids**

(Reference: <u>Construction Graphics</u>, 1<sup>st</sup> ed., Bisharat, Wiley, 2004)



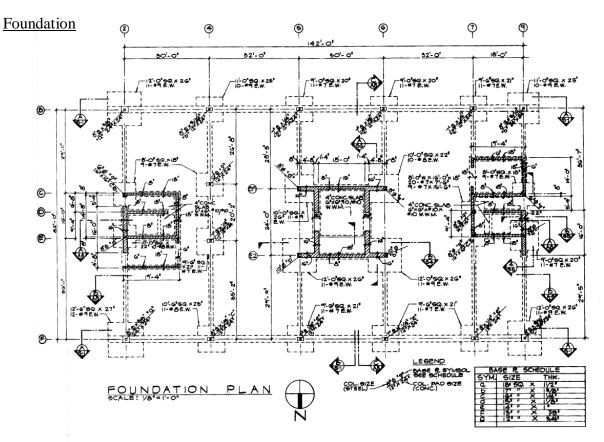


Figure 7.4 This foundation plan uses a grid referencing system, though not the one promoted by the National CAD Standard. Note the idiosyncrasies in this drawing: north is normally the top of the page. (From *The Professional Practice of Architectural Working Drawings*, 2nd edition, by Osamu Wakita and Linde, Richard, John Wiley & Sons, Inc., 1995. Used with permission of John Wiley & Sons, Inc.)

### Footing Detail

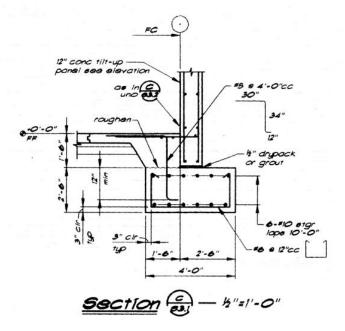

**Figure 8.5b** Footings are often depicted in wall sections on subsequent sheets, but in this instance the engineer is showing just a footing section, denoted C S3.1 on the plan in 8.5a.

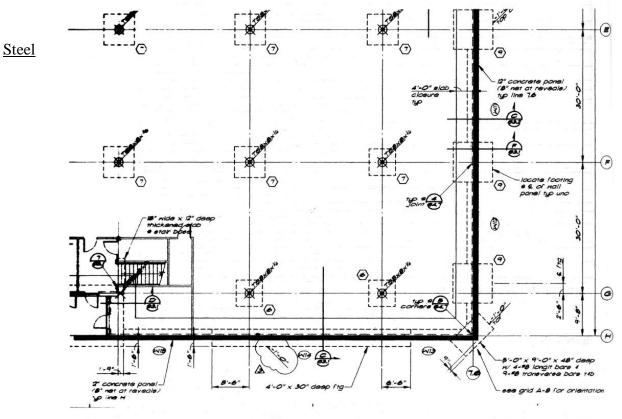

**Figure 8.5a** Drawings of structural steel framing systems begin with the foundation plan, which is where the columns

and footings that carry the frame are described. (Drawing courtesy of Buehler and Buehler Structural Engineers.)



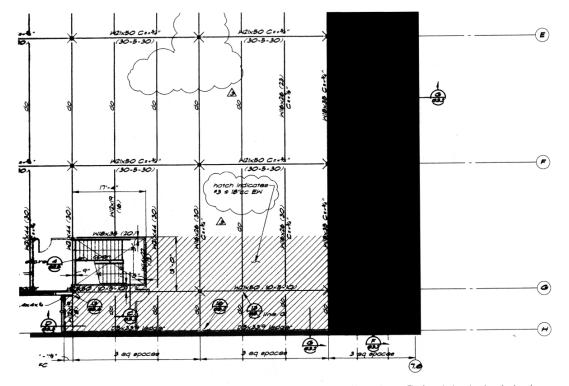


Figure 8.5c The first floor framing plan commonly shows column locations and lists girders and beams by size. The floor deck is also described on the plan. The girder designation W21  $\times$  50 C = +  $\frac{3}{4}$ " (above gridline F) and 30-5-30 (below gridline F) is, respectively, the girder size and camber and number of headed stud anchors required in each third of the beam (left, center, right). The beam designation is slightly different (see lines perpendicular to girder lines): Above the beam line following the beam size is the number of headed stud anchors to be uniformly distributed between columns on the top of the beam, with the camber listed below the beam line. (Drawing courtesy of Buehler and Buehler Structural Engineers.)

#### Reinforced Masonry

Figure 8.6a In this partial floor plan for a reinforced masonry structure, the wall descriptions are very simple. Note the conservative use of the masonry symbol and the consequent uncluttered appearance of the drawing. The split-bubble referencing system used throughout these drawings directs the reader's attention to several details, depicted on other pages as well as the page on which they originate. Details 1 A-4/A-6 and 3 A-4/A-6 are building sections; details A and B A-4/A-4 are details of the connection to existing concrete columns; and detail E A-4/A-11 is a roof connection detail. In the upper right part of the drawing is the reference to an exterior elevation (A A-4/A-5).

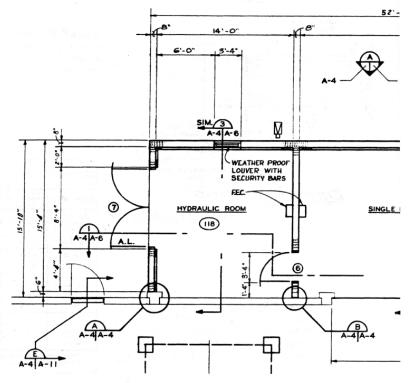

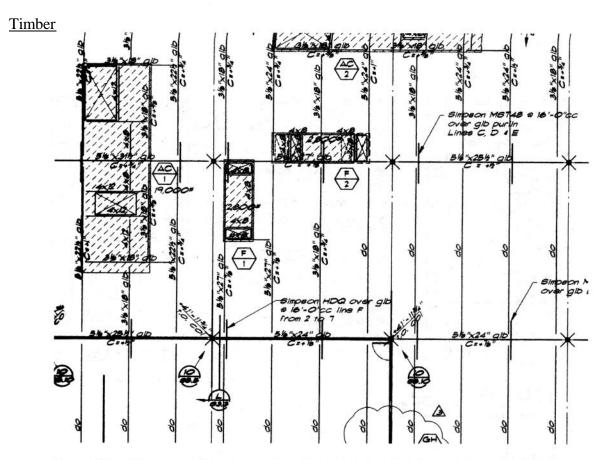


**Figure 8.7a** This partial roof framing plan shows the glued-laminated girder and beam system. Note the weight of AC unit 1 and how the structural engineer has addressed the additional loading where mechanical equipment is supported by the roof. (Drawing courtesy of Buehler and Buehler Structural Engineers.)

**Common Span Lengths and Depths:** from <u>Structures</u>, 6<sup>th</sup> ed., Schodek & Bechthold, Pearson/Prentice Hall, 2007

# Span Range by System

									100	Fee				
				(	20	40	60	80	100	140	180	220	260	3
			Planks	-		+		-		+				-
		Timber	Joists	I	Store Store	Current of	Colonia Colonia	10	_					-
3			Laminated beams						-				-	-
			Box beams	0.	and a second		No.							
	SL		Slabs											
			Beams	T	100									
	Beams	Reinforced	Pan-joist	had	1000									
	ш	concrete	Precast planks		CY I				,					
			Precast channels	T			in the second							
			Precast tees	T		1								
Sme			Decking	m				Τ						
syste		Steel	Wide-flanges	I		MU PAG		1						1
One-way systems			Plate girders	T	T				1					$\top$
-e	ed	Timber	Plywood	$\overline{\mathcal{N}}$										+
	Folded plates	Concrete	Poured-in-place	Л					A State	of and		1		$\vdash$
	Trusses		Trussed rafters											+
		Timber	Open-web	ww				Sal						+
			Special design	<u>7777</u>										+
			Open-web	ww										+
		Steel	Special shapes		Ste									-
ł		Timber	Laminated	$\overline{\Omega}$		-						1000		
	Arches	Steel	Built-up							All and a second	-	Contraction of the second		Constant of
	Arc	Concrete	Formed concrete	$\overline{\mathbf{a}}$		-	1							
	Cables	Steel	Cable			+	T						1.1.1.1	SHORE S
+	Cables	Steel										ng miles		T
			Flat plate Two-way	<del>₽</del> ₽	_	200		+	-					-
	Flat plates	Concrete	beam-and-slab	<b>1</b>			10.000	Cille I						-
y sy	- 4		Waffle slab	╋┉╋					00000000000					-
I WU-WAY SYSIE		Steel	Space frame	TT										
-	Shells	Concrete	Dome	$\square$										
	S	Steel	Ribbed dome					and the second	in the second					$\rightarrow$
				C	)		20	)		40	e	60	80	

FIGURE 13.12 Approximate span ranges of different systems. (See also more detailed charts in Chapter 15.)

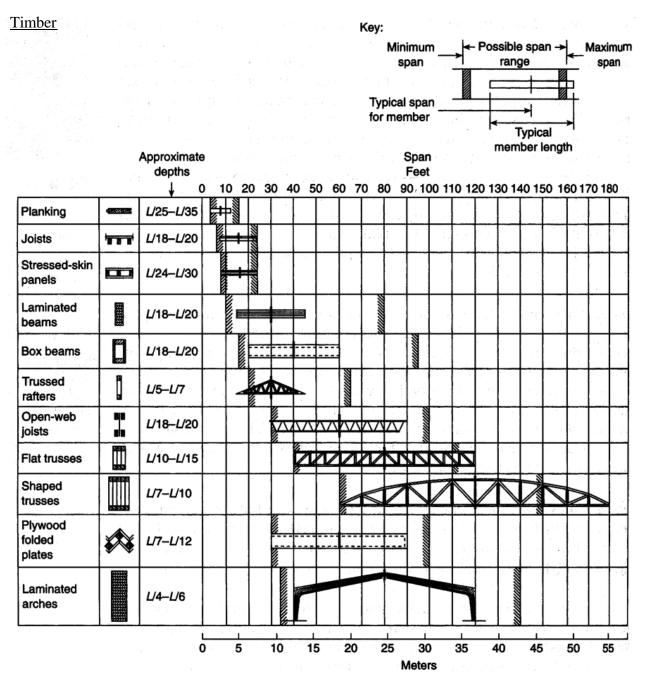

**FIGURE 15.4** Approximate span ranges for timber systems. So that typical sizes of different timber members can be compared, the diagrams of the members are scaled to represent typical span lengths for each of the respective elements. The span lengths that are actually possible for each element are noted by the maximum and minimum span marks.

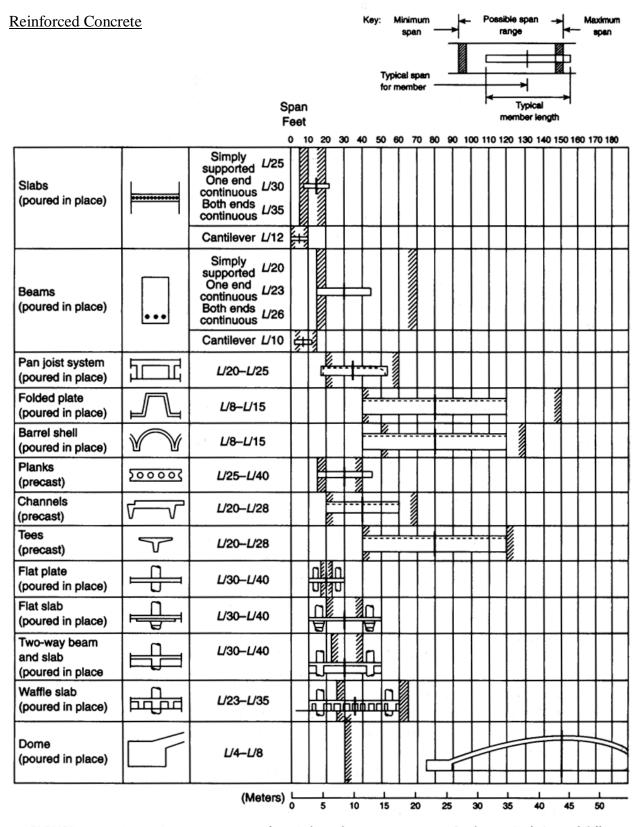


FIGURE 15.6 Approximate span ranges for reinforced-concrete systems. So that typical sizes of different members can be compared, the diagrams of the members are scaled to represent typical span lengths for each of the respective elements. The span lengths that are actually possible for each element are noted by the maximum and minimum span marks.


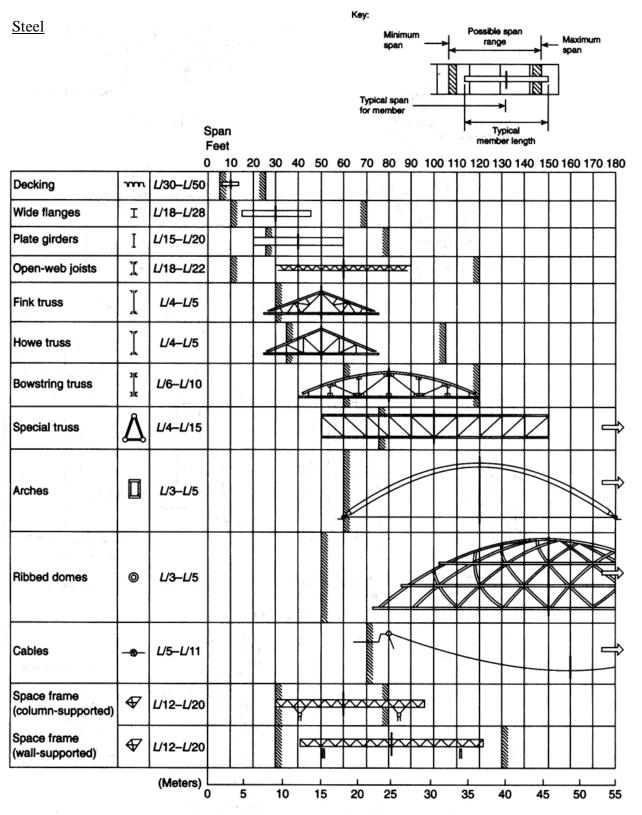


FIGURE 15.9 Approximate span ranges for steel systems. So that typical sizes of different members can be compared, the diagrams of the members are scaled to represent typical span lengths for each of the respective elements. The span lengths that are actually possible for each element are noted by the maximum and minimum span marks.


#### F2010abn

# Math for Structures I


- 1. Parallel lines never intersect.
- 2. Two lines are *perpendicular* (or *normal*) when they intersect at a right angle =  $90^{\circ}$ .
- 3. *Intersecting* (or *concurrent*) lines cross or meet at a point.
- 4. If two lines cross, the opposite angles are identical:



5. If a line crosses two parallel lines, the intersection angles with the same orientation are identical:



6. If the sides of two angles are parallel and intersect in the same fashion, the angles are identical.



7. If the sides of two angles are parallel, but intersect in the opposite fashion, the angles are *supplementary*:  $\alpha + \beta = 180^{\circ}$ .



8. If the sides of two angles are perpendicular and intersect in the same fashion, the angles are identical.



F2010abn

β

α

В

| 90° A


9. If the sides of two angles are perpendicular, but intersect in the opposite fashion, the angles are *supplementary*:  $\alpha + \beta = 180^{\circ}$ .

- 10. If the side of two angles bisects a right angle, the angles are *complimentary*:  $\alpha + \gamma = 90^{\circ}$ .
- 11. If a right angle bisects a straight line, the remaining angles are *complimentary*:  $\alpha + \gamma = 90^{\circ}$ .
- 12. The sum of the interior angles of a triangle =  $180^{\circ}$ .
- 13. For a right triangle, that has one angle of  $90^{\circ}$ , the sum of the other angles =  $90^{\circ}$ .
- 14. For a right triangle, the sum of the squares of the sides equals the square of the hypotenuse:


$$AB^2 + AC^2 = CB^2$$

15. Similar triangles have identical angles in the same orientation. Their sides are related by:



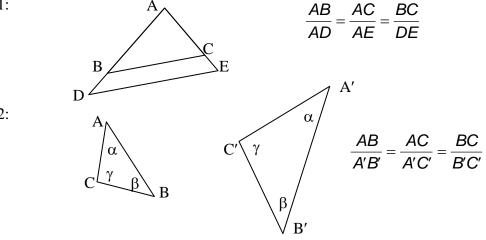

Case 2:



16. For right triangles:

$$sin = \frac{oppositeside}{hypotenuse} = sin\alpha = \frac{AB}{CB}$$

$$cos = \frac{adjacentside}{hypotenuse} = cos\alpha = \frac{AC}{CB}$$

$$tan = \frac{oppositeside}{adjacentside} = tan\alpha = \frac{AB}{AC}$$

#### (SOHCAHTOA)


- 17. If an angle is greater than 180° and less than 360°, sin will be less than 0. If an angle is greater than 90° and less than 270°, cos will be less than 0. If an angle is greater than 90° and less than 180°, *tan* will be less than 0. If an angle is greater than 270° and less than 360°, *tan* will be less than 0.
- 18. LAW of SINES (any triangle)

$$\frac{\sin\alpha}{A} = \frac{\sin\beta}{B} = \frac{\sin\gamma}{C}$$

$$B$$

$$C$$

$$\beta$$




19. LAW of COSINES (any triangle)

$$A^2 = B^2 + C^2 - 2BC\cos\alpha$$

- 20. Surfaces or areas have dimensions of width and length and units of length squared (ex. in<sup>2</sup> or inches x inches).
- 21. Solids or volumes have dimension of width, length and height or thickness and units of length *cubed* (ex.  $m^3$  or m x m x m)
- 22. Force is defined as mass times acceleration. So a weight due to a mass is accelerated upon by gravity:  $F = m \cdot g$   $g = 9.81 \frac{m}{sec^2} = 32.17 \frac{ft}{sec^2}$
- 23. Weight can be determined by volume if the unit weight or *density* is known:  $W = V \cdot \gamma$ where  $\cdot V$  is in units of length<sup>3</sup> and  $\gamma$  is in units of force/unit volume
- 24. Algebra: If  $a \cdot b = c \cdot d$ then it can be rewritten:  $a \cdot b + k = c \cdot d + k$ add a constant  $c \cdot d = a \cdot b$ switch sides divide both sides by b  $a = \frac{c \cdot d}{b}$ divide both sides by  $b \cdot c$  $\frac{a}{c} = \frac{d}{b}$

25. Cartesian Coordinate System



- 26. Solving equations with one unknown:
  - 1<sup>st</sup> order polynomial:  $2x-1=0\cdots$   $2x=1\cdots$   $x=\frac{1}{2}$  $ax+b=0\cdots$   $x=\frac{-b}{a}$

2<sup>nd</sup> order polynomial

$ax^2 + bx + c = 0 \cdots$	$x = \frac{-b \pm \sqrt{b^2 - 4ac}}{2a}$	two answers (radical <i>cannot</i> be negative)
$x^2 - 1 = 0 \cdots$ (a = 1, b = 0, c = -1)	$x=\frac{-0\pm\sqrt{0^2-4(-1)}}{2\cdot 1}\cdots$	$x = \pm 1$

### 27. Solving 2 linear equations simultaneously:

One equation consisting only of variables can be rearranged and then substituted into the second equation:

ex:	5x - 3y = 0	add 3y to both sides to rearrange	5x = 3y
	4x - y = 2	divide both sides by 5	$X = \frac{3}{5} Y$
		substitute x into the other equation	$4(\frac{3}{5}y) - y = 2$
		add like terms	$\frac{7}{5}y = 2$
		simplify	$y = \frac{10}{7} = 1.43$

Equations can be added and factored to eliminate one variable:

ex: 2x+3y=8 4x-y=2 multiply both sides by 3 and add simplify put x=1 in an equation for y simplify 2x+3y=8 12x-3y=6 14x+0=14 x=1  $2\cdot 1+3y=8$  3y=6y=2

- 28. Derivatives of polynomials y = constant  $\frac{dy}{dx} = 0$  y = x  $\frac{dy}{dx} = 1$  y = ax  $\frac{dy}{dx} = a$   $y = x^2$   $\frac{dy}{dx} = 2x$   $y = x^3$   $\frac{dy}{dx} = 3x^2$
- 29. The minimum and maximum of a function can be found by setting the derivative = 0 and solving for the unknown variable.
- 30. Calculators (and software) process equations by an "order of operations", which typically means they process functions like exponentials and square roots before simpler functions such as + or -. BE SURE to specify with parenthesis what order you want, or you'll get the wrong answers. It is also important to have degrees set in your calculator for trig functions.

For instance, Excel uses – for sign (like -1) first, then will process exponents and square roots, times and divide, followed by plus and minus. If you type  $4x10^2$  and really mean  $(4x10)^2$  you will get an answer of 400 instead of 1600.

#### Numerical Computations

from Statics and Strength of Materials, 5th ed. Morrow & Kokernak, Prentice Hall, 2004

#### Accuracy

The accuracy of a numerical value is often expressed in terms of the number of *significant digits* that the value contains. What are significant digits? Any nonzero digit is considered significant; zeroes that appear to the left or right of a digit sequence are used to locate the decimal point and are not considered significant. Thus the numbers 0.00345, 3.45, 3450, and 3,450,000 all contain three significant digits represented by the sequence 3-4-5. Zeroes bounded on both sides by nonzero digits are also significant; 0.0005067, 5.067, 50.67, and 506,700 each contain four significant digits, as represented by the numerical sequence 5-0-6-7.

The accuracy of a solution can be no greater than the accuracy of the data on which the solution is based. For example, the length of one side of a right triangle may be given as 20 ft. Without knowing the possible error in the length measurement, it is impossible to determine the error in the answer obtained from it. We will usually assume that the data are known with an accuracy of 0.2 percent. The possible error in the 20-ft length would therefore be 0.04 ft.

To maintain an accuracy of approximately 0.2 percent in our calculations, we will use the following practical rule: use four digits to record numbers beginning with 1 and three digits to record numbers beginning with 2 through 9. Thus a length of 19 ft becomes 19.00 ft, a length of 20 ft becomes 20.0 ft, and a length of 43 ft becomes 43.0 ft.

You will notice one exception to this rule throughout the text: values of the trigonometric functions are traditionally written to four decimal places, and that practice will be followed here, not for increased accuracy, but to clarify the computations used in worked examples.

#### **Rounding Off Numbers\***

If the data are given with greater accuracy than we wish to maintain (see Fig. 1.1), the following rules may be used to round off their values:

- 1. When the digit dropped is greater than 5, increase the digit to the left by 1. *Example*: 23.56 ft becomes 23.6 ft.
- 2. When the digit dropped is less than 5, drop it without changing the digit to the left. *Example:* 23.34 ft becomes 23.3 ft.
- 3. When the digit dropped is 5 followed only by zeros, increase the digit to the left by 1 only if it becomes even. If the digit to the left becomes odd, drop the 5 without changing the digit to the left. *Example:* 23.5500 ft rounded to three numbers becomes 23.6 ft, and 23.4500 ft becomes 23.4 ft. (This practice is often referred to as the *round-even rule.*)

<sup>\*</sup>American Society of Mechanical Engineers (ASME) Orientation and Guide for Use of SI (Metric) Units, 9th edition, 1982, p 11. By increasing the digit to the left for a final 5 followed by zeros only if the digit becomes even, we are dividing the rounding process evenly between increasing the digit to the left and leaving the digit to the left unchanged.

## Calculators

Electronic calculators and computers are widely available for use in engineering. Their speed and accuracy make it possible to do difficult numerical computations in a routine manner. However, because of the large number of digits appearing in solutions, their accuracy is often misleading. As pointed out previously, the accuracy of the solution can be no greater than the accuracy of the data on which the solution is based. Care should be taken to retain sufficient digits in the intermediate steps of the calculations to ensure the required accuracy of the final answer. Answers with more significant digits than are reasonable should not be recorded as the final answer. An accuracy greater than 0.2 percent is rarely justified.

# **Problem Solving, Units and Numerical Accuracy**

# Problem Solution Method:

1.	Inputs Outputs "Critical Path" $ \begin{array}{c} \hline \\ \hline \\$						
2.	Draw simple diagram of body/bodies & forces acting on it/them.						
3.	Choose a reference system for the forces.						
4.	Identify key geometry and constraints.						
5.	Write the basic equations for force components.						
6.	5. Count the equations & unknowns.						
7.	SOLVE						
8.	"Feel" the validity of the answer. (Use common sense. Check units)						
Ex	ample: Two forces, A & B, act on a particle. What is the resultant? 1. <u>GIVEN:</u> Two forces on a particle and a diagram with size and orientation <u>FIND:</u> The "resultant" of the two forces						

# SOLUTION:

- 2. Draw what you know (the diagram, any other numbers in the problem statement that could be put on the drawing....)
- 3. Choose a reference system. What would be the easiest? Cartesian, radian?
- 4. Key geometry: the location of the particle as the origin of all the forces Key constraints: the particle is "free" in space
- 5. Write equations:  $size of A^2 + size of B^2 = size of resultant$  $sin \alpha = \frac{size of B}{size of A + B}$
- 6. Count: Unknowns: 2, magnitude and direction  $\leq$  Equations: 2  $\therefore$  can solve
- 7. Solve: graphically or with equations
- 8. "Feel": Is the result bigger than A and bigger than B? Is it in the right direction? (like A & B)

Units

Units	Mass	Length	Time	Force
SI	kg	m	S	$N = \frac{kg \cdot m}{s^2}$
Absolute English	lb	ft	S	Poundal = $\frac{lb \cdot ft}{s^2}$
Technical English	$slug = \frac{lb_{f} \cdot s^{2}}{ft}$	ft	S	Ib <sub>force</sub>
Engineering English	lb	ft	S	Ib <sub>force</sub>
	$lb_{force} = lb_{(mass)} \times 32$	2.17 $\frac{ft}{s^2}$		
gravitational constant	$g_c = 32.17 \frac{ft}{s^2}$	(English)		
	$g_{c} = 9.81 \frac{m}{s^{2}}$	(SI)		
conversions (pg. vii)	1 in = 25.4 mm 1 lb = 4.448 N			

Numerical Accuracy

Depends on 1) accuracy of data you are given

2) accuracy of the calculations performed

*The solution CANNOT be more accurate than the less accurate of #1 and #2 above!* 

<b>DEFINITIONS:</b>	precision	the number of significant digits
	accuracy	the possible error

*Relative error* measures the degree of accuracy:

 $\frac{relative error}{measurement} \times 100 = degree of accuracy(\%)$ 

For engineering problems, accuracy *rarely* is less than 0.2%.

# **Forces and Vectors**

Nota	tion:		
F	= name for force vectors, as is <i>A</i> , <i>B</i> , <i>C</i> , <i>T</i> and <i>P</i>	tail	= start of a vector (without arrowhead)
$F_x$	= force component in the x direction	tip	= direction end of a vector (with
$F_y$	= force component in the y direction		arrowhead)
R	= name for resultant vectors	x	= x axis direction
$R_x$	= resultant component in the x	У	= y axis direction
	direction	$\theta$	= angle, in a trig equation, ex. $\sin\theta$ ,
$R_y$	= resultant component in the y		that is measured between the x axis
	direction		and <i>tail</i> of a vector

# Characteristics

• Forces have *a point of application* – tail of vector

size – units of lb, K, N, kN

direction - to a reference system, sense indicated by an arrow

- Classifications include: *Static & Dynamic*
- Structural types separated primarily into *Dead Load* and *Live Load* with further identification as wind, earthquake (seismic), impact, etc.


# **Rigid Body**

- *Ideal* material that doesn't deform
- Forces on rigid bodies can be *internal* within or at connections

or external - applied


• Rigid bodies can *translate* (move in a straight line)

or *rotate* (change angle)




- Weight of truck is external (gravity)
- Push by driver is external
- Reaction of the ground on wheels is external

If the truck moves forward: *it translates* If the truck gets put up on a jack: *it rotates*  • *Transmissibility:* We can replace a force at a point on a body by that force on another point on the body <u>along the line of action of the force.</u>

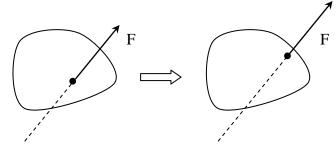

External conditions haven't changed


For the truck:



- The same external forces will result in the same conditions for motion
- Transmissibility applies to EXTERNAL forces. INTERNAL forces respond differently when an external force is moved.
- DEFINITION: 2D Structure A structure that is flat and may contain a plane of symmetry. All forces on this structure are in the same plane as the structure.

# **Internal and External**

- Internal forces occur within a member or between bodies within a system
- *External forces* represent the action of other bodies or gravity on the rigid body




# Force System Types

- *Collinear* all forces along the same **line**
- *Coplanar* all forces in the same **plane**
- *Space* out there

Further classification as

- *Concurrent* all forces go through the same **point**
- *Parallel* all forces are **parallel**


# **Graphical Addition**

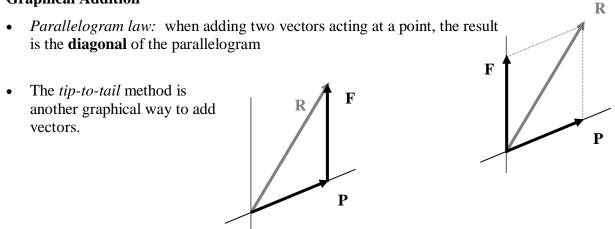


• With **3** (three) or more vectors, successive application of the parallelogram law will find the resultant *OR* drawing all the vectors **tip-to-tail** in any order will find the resultant.

# **Rectangular Force Components and Addition**

- It is convenient to resolve forces into perpendicular components (at 90°).
- Parallelogram law results in a rectangle.
- Triangle rule results in a right triangle.





3

$$\theta \text{ is:} \qquad between \ x \ \& F$$

$$F_{x} = F \cdot \cos \theta$$

$$F_{y} = F \cdot \sin \theta$$

$$F = \sqrt{F_{x}^{2} + F_{y}^{2}}$$

$$\tan \theta = \frac{F_{y}}{F_{x}}$$

$$(F_{x} \otimes F_{y})$$

$$F = \sqrt{F_{x}^{2} + F_{y}^{2}}$$

$$(F_{x} \otimes F_{y})$$


$$F = \sqrt{F_{x}^{2} + F_{y}^{2}}$$

When  $90^{\circ} < \theta < 270^{\circ}$ ,  $F_x$  is *negative* When  $180^{\circ} < \theta < 360^{\circ}$ ,  $F_y$  is *negative* When  $0^{\circ} < \theta < 90^{\circ}$  and  $180^{\circ} < \theta < 270^{\circ}$ ,  $\tan\theta$  is *positive* When  $90^{\circ} < \theta < 180^{\circ}$  and  $270^{\circ} < \theta < 360^{\circ}$ ,  $\tan\theta$  is *negative* 

• Addition (analytically) can be done by adding all the *x* components for a **resultant** *x* component and adding all the **y** components for a resultant *y* component.

$$R_x = \sum F_x$$
,  $R_y = \sum F_y$  and  $R = \sqrt{R_x^2 + R_y^2}$   $\tan \theta = \frac{R_y}{R_x}$ 

**<u>CAUTION</u>**: An interior angle,  $\phi$ , between a vector and *either* coordinate axis can be used in the trig functions. BUT <u>No sign</u> will be provided by the trig function, which means **you** must give a sign and determine if the component is in the x or y direction. For example,  $F \sin \phi = opposite \ side$ , which whould be negative in x!



# Example 1 (page 9)


### Example Problem 2.2

A utility pole supports two tension forces *A* and *B* with the directions shown. Using the parallelogram law and the tip-to-tail methods, determine the resultant force for *A* and *B* (magnitude and direction).

Scale: 1" = 200 lb.

### Steps:


- 1. <u>GIVEN</u>: Write down what's given (drawing and numbers).
- 2. <u>FIND</u>: Write down what you need to find. (resultant graphically)
- 3. SOLUTION:
- 4. Draw the 400 lb and 600 lb forces to scale with tails at 0. (If the scale isn't given, you must choose one that fits on your paper, ie. 1 inch = 200 lb.)
- 5. Draw parallel reference lines at the ends of the vectors.
- 6. Draw a line from O to the intersection of the reference lines
- 7. Measure the length of the line
- 8. Convert the line length by the scale into pounds (by multiplying by the force measure and dividing by the scale value, ie X inches \* 200 lb / 1 inch).




## Alternate solution:

- 4. Draw one vector
- 5. Draw the other vector at the TIP of the first one (away from the tip).
- 6. Draw a line from 0 to the tip of the final vector and continue at step 7

### Example 2 (pg 12)

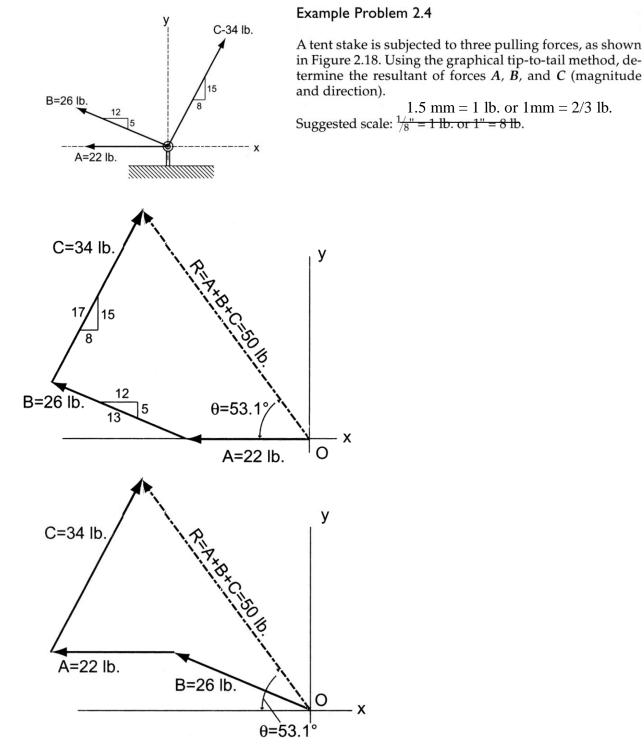

# Example 3 (pg 16)



# Example Problem 2.7


A large eyebolt (Figure 2.24) is used in supporting a canopy over the entry to an office building. The tension developed in the support rod is equal to 2600 newtons. Determine the rectangular components of the force if the rod is at a 5 in 12 slope.

Also determine the embedment length, L, if the anchor can resist 500 N for ever cm of embedment.

Example 4 (pg 19) Determine the resultant vector analytically with the component method.

Example Problem 2.9 (Figure 2.29)

This is the same problem as Example Problem 2.2, which was solved earlier using the graphical methods.




# Moments


Not	ation:		
d	= perpendicular distance to a force from a point	$M \ W$	<ul><li>moment due to a force</li><li>name for force due to weight</li></ul>
F	<ul> <li>name for force vectors or magnitude of a force, as is P, Q, R</li> </ul>	$x \\ \theta$	= horizontal distance = angle, in a trig equation, ex. $\sin\theta$ ,
$F_x \\ F_y$	<ul><li>= force component in the x direction</li><li>= force component in the y direction</li></ul>		that is measured between the x axis and <i>tail</i> of a vector

# Moment of a Force About an Axis

- Two forces of the same size and direction acting at different points *are not equivalent*. They may cause the same **translation**, but they cause different **rotation**.
- DEFINITION: *Moment* A moment is the tendency of a force to make a body rotate about an axis. It is measured by F×d, where d is the distance **perpendicular** to the line of action of the force and through the axis of rotation.

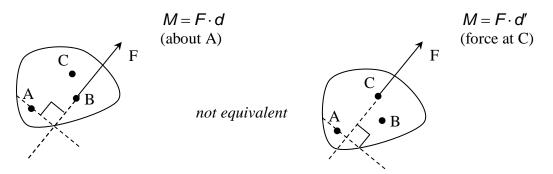


• For the same force, the bigger the **lever arm** (or moment arm), the bigger the moment *magnitude*, i.e.  $M_A = F \cdot d_1 < M_A = F \cdot d_2$ 

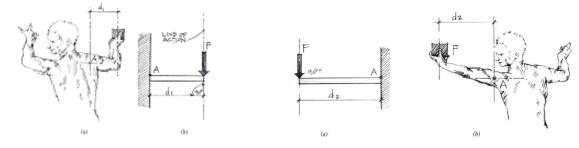


- Units: SI: N·m, KN·m Engr. English: lb-ft, kip-ft
- Sign conventions: Moments have magnitude *and* rotational direction: positive - negative - CCW + CCW -




• Moments can be <u>added as scalar quantities</u> when there is a sign convention.

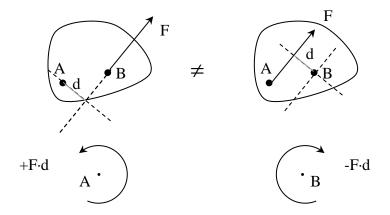


• Repositioning a force along its line of action results in the same moment about any axis.

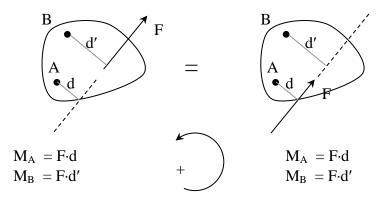


- A force is completely defined (except for its exact position on the line of action) by  $F_x$ ,  $F_y$ , and  $M_A$  about A (size and direction).
- The *sign* of the moment is determined by which side of the axis the force is on.

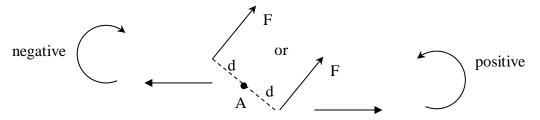


• *Varignon's Theorem:* The moment of a force about any axis is equal to the sum of moments of the components about that axis.

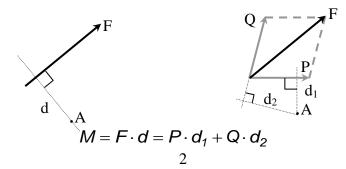

• <u>Proof 1:</u> Resolve F into components along line BA and perpendicular to it  $(90^\circ)$ .

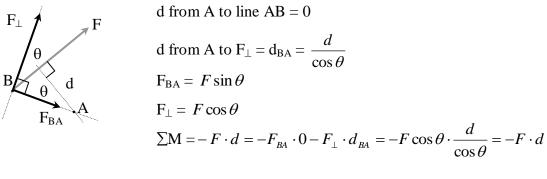


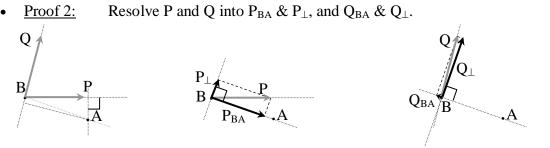


d from A to line AB = 0  $M_{A \text{ by } P} = -P_{\perp} \cdot d_{BA}$   $M_{A \text{ by } Q} = -Q_{\perp} \cdot d_{BA}$  $\sum M = -P_{\perp} \cdot d_{BA} + (-Q_{\perp} \cdot d_{BA})$ 

and we know  $d_{BA}$  from Proof 1, and by definition:  $P_{\perp} + Q_{\perp} = F_{\perp}$ . We know  $d_{BA}$  and  $F_{\perp}$  from above, so again  $M = -F_{\perp} \cdot d_{BA} = -F \cdot d$ 

• By choosing component directions such that d = 0 to one of the components, we can simplify many problems.






#### Example Problem 2.13 (Figure 2.35)

A 1-foot-wide slice of a 4-foot-thick concrete gravity dam weighs 10,000 pounds and the equivalent force due to water pressure behind the dam is equal to 1200 pounds. The stability of the dam against overturning is evaluated about the "toe" at A.

Determine the resultant moment at *A* due to the two forces shown. Is the dam stable?




Example Problem 2.15 (Figure 2.38)


The same problem from Example Problem 2.14 will be solved using the principle of moments. (Figure 2.36) (Moment at A)

# Moment Couples

• *Moment Couple:* Two forces with equal magnitude, parallel lines of action and opposite sense tend to make our body rotate even though the sum of forces is 0. The sum of the moment of the forces about any axis *is not* zero.

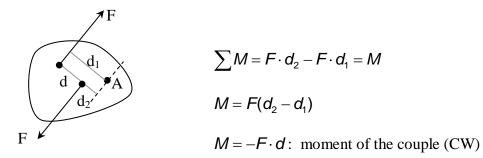

- M does *not depend on where A is.* M depends on the perpendicular distance between the line of action of the parallel forces.
- M for a couple (defined by F and d) is a <u>constant.</u> And the sense (+/-) is obtained by observation.
- Just as there are equivalent moments (other values of F and d that result in M) there are equivalent couples. The magnitude is the same for different values of F and resulting d or different values of d and resulting F.

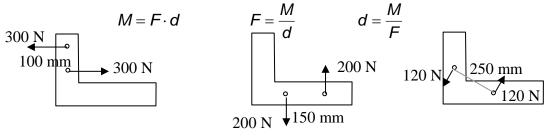

# **Equivalent Force Systems**

- Two systems of forces are equivalent if we can transform one of them into the other with:
  - 1.) replacing *two forces on a point* by their **resultant**
  - 2.) resolving a *force* into two components
  - 3.) canceling two equal and opposite forces on a point
  - 4.) attaching two equal and opposite forces to a point
  - 5.) moving a force along its line of action'
  - 6.) replacing a force and moment on a point with a force on another (specific) point
  - 7.) replacing a force on point with a force and moment on another (specific) point
     \* based on the parallelogram rule and the principle of transmissibility
- The <u>size and direction</u> are important for a moment. The location on a body doesn't matter because couples with the same moment will have the <u>same effect on the rigid body</u>.


# **Addition of Couples**

- Couples can be added as *scalars*.
- Two couples can be *replaced* by a single couple with the magnitude of the algebraic sum of the two couples.

# Resolution of a Force into a Force and a Couple


• The equivalent action of a force on a body can be reproduced by that force and a force couple:

If we'd rather have F acting at A' which isn't in the line of action, we can instead add F and -F at A' with no change of action by F. Now it becomes a couple of F separated by d and the force F moved to A'. The size is  $F \cdot d=M$ 

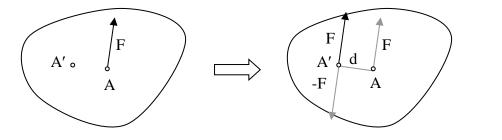


The couple can be represented by a moment symbol:

• Any force can be replaced by itself at another point and the moment equal to the force multiplied by the distance between original line of action and *new* line of action.



### Resolution of a Force into a Force and a Moment


• *Principle:* Any force **F** acting on a rigid body (say the one at A) may be moved to any given point A', provided that a couple **M** is added: <u>the moment **M** of the couple must equal the moment of **F** (in its original position at A) about A'.</u>

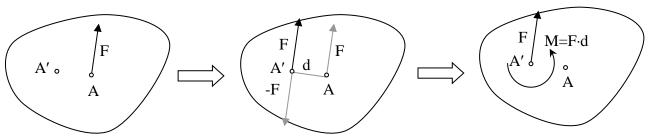


• IN REVERSE: A force **F** acting at A' and a couple **M** may be combined into a single resultant force **F** acting at A (a distance *d* away) where the moment of **F** about A' is equal to **M**.

## **Resultant of Two Parallel Forces**

• Gravity loads act in one direction, so we may have parallel forces on our structural elements. We know how to find the resultant **force**, but the *location* of the resultant must provide the equivalent total moment from each individual force.

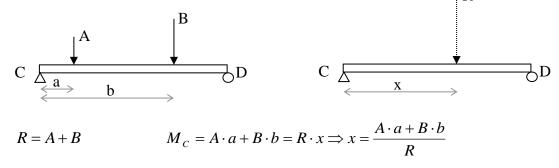


Example 3 (pg 19)



## Example Problem 2.19

The cantilevered beam shown in Figure 2.43 is subjected to two equal and opposite forces as shown. Determine the resultant moment  $M_A$  at the beam support and the moment  $M_B$  at the free end.


#### Example 4 (pg 34)

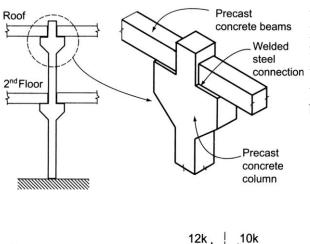



## Example Problem 2.22 (Figures 2.49 and 2.50)

A major, precast-concrete column supports beam loads from the roof and second floor as shown. Beams are supported by seats projecting from the columns. Loads from the beams are assumed to be applied one foot from the colconnection umn axis.


> Determine the equivalent column load condition when all beam loads are shown acting through the column axis.








Roof level (c)










# **Equilibrium of a Particle & Truss Analysis**

#### Notation:

b (C)	<ul><li>number of members in a truss</li><li>shorthand for <i>compression</i></li></ul>	$R_x$	= resultant component in the x direction
F	= name for force vectors, as is <i>X</i> , and <i>P</i>	$R_y$	= resultant component in the y direction
$F_{AB}$	= name of a truss force between joints	Т	= name for a tension force
	named A and B, ex.	(T)	= shorthand for <i>tension</i>
FBD	= free body diagram	х	= x axis direction, or horizontal
$F_x$	= force component in the x direction,		dimension
	as is $T_x$	у	= y axis direction, or vertical
$F_y$	= force component in the y direction,		dimension
	as is $T_y$	W	= name for force due to weight
h	= cable sag height	μ	= coefficient of static friction
L	= span length	$\theta$	= angle, in a trig equation, ex. $\sin\theta$ ,
п	= number of joints in a truss	Ū	that is measured between the x axis
Ν	= normal force (perpendicular to		and <i>tail</i> of a vector
	something)	Σ	= summation symbol
R	= name for resultant vectors	—	

• EQUILIBRIUM is the state where the resultant of the forces on a particle or a rigid body is *zero*. There will be no rotation or translation. The forces are referred to as <u>balanced</u>.

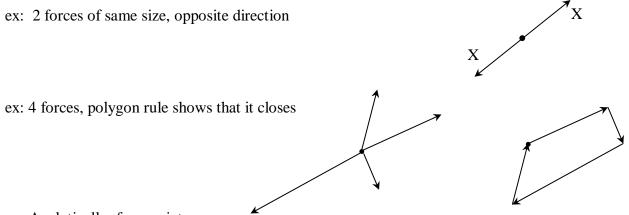

• Analytically, for a point:

 $R_x = \sum F_x = 0$   $R_y = \sum F_y = 0$  (scalar addition)

• NEWTON'S FIRST LAW: If the resultant force acting on a particle is zero, the particle will remain at rest (if originally at rest) or will move with constant speed in a straight line (if originally in motion).

### Collinear Force System

- All forces act along the same line. Only one equilibrium equation is needed:  $\sum F_{(in-line)} = 0$
- Equivalently:  $R_x = \sum F_x = \mathbf{0}$  and  $R_y = \sum F_y = \mathbf{0}$

## Concurrent Force System


- All forces act through the same point. Only two equilibrium equations are needed:  $R_x = \sum F_x = \mathbf{0}$  and  $R_y = \sum F_y = \mathbf{0}$
- It is ABSOLUTELY NECESSARY to consider all the forces acting on a body (applied directly and indirectly) using a FREE BODY DIAGRAM. Omission of a force would ruin the conditions for equilibrium.
- FREE BODY DIAGRAM (aka FBD): Sketch of a significant isolated particle of a body or structure showing all the forces acting on it. Forces can be from
  - externally applied forces
  - weight of the rigid body
  - reaction forces or constraints
  - forces developed within a section member
- How to solve when there are more than three forces on a free body:
  - 1. Resolve all forces into x and y components using known and unknown forces and angles. (Tables are helpful.)
  - 2. Determine if any unknown forces are related to other forces and write an equation.
  - *3.* Write the two equilibrium equations (in x and y).
  - 4. Solve the equations simultaneously when there are the same number of equations as unknown quantities. (see math handout)
- Common problems have unknowns of: 1) magnitude of force

# 2) direction of force

# FREE BODY DIAGRAM STEPS FOR A POINT;

- 1. Determine the point of interest. (What point is in equilibrium?)
- 2. Detach the point from and all other bodies ("free" it).

- 3. Indicate all external forces which include:
  - action on the point by the supports & connections
  - action on the point by other bodies
  - the weigh effect (=force) of any body attached to the point (force due to gravity)
- 4. All forces should be clearly marked with magnitudes and direction. The sense of forces should be those acting on the point not from the point.
- 5. Dimensions/angles should be included for force component computations.
- 6. Indicate the unknown forces, such as those reactions or constraining forces where the body is supported or connected.
- *Force Reactions* can be categorized by the type of connections or supports. A force reaction is a force with known line of action, or a force of unknown direction. The line of action of the force is directly related to the motion that is prevented.



up and down

The line of action should be indicated on the FBD. The sense of direction is determined by the type of support. (Cables are in tension, etc...) If the sense isn't obvious, assume a sense. When the reaction value comes out positive, the assumption was correct. When the reaction value comes out negative, the assumption was opposite the actual sense. DON'T CHANGE THE ARROWS ON YOUR FBD OR SIGNS IN YOUR EQUATIONS.

With the 2 equations of equilibrium for a point, there can be no more than 2 unknowns. •

## Friction


There will be a force of resistance to movement developed at the contact face between objects when one is made to slide against the other. This is known as *static friction* and is determined from the reactive force, N, which is normal to the surface, and a coefficient of friction,  $\mu$ , which is based on the materials in contact.

 $F = \mu N$ 

S2012abn

- If the static friction force is exceeded by the pushing force, there will still be friction, but it is called *kinetic friction*, and it is smaller than static friction, so it is moving.
- The friction resistance is independent of the amount of contact area.

Materials	$\mu$ range
Metal on ice	0.03-0.05
Metal on metal	0.15-0.60
Metal on wood	0.20-0.60
Metal on stone	0.30-0.70
Wood on wood	0.30-0.70
Steel on steel	0.75
Stone on stone	0.40-0.70
Rubber on concrete	0.60-0.90
Aluminum on aluminum	1.10-1.70

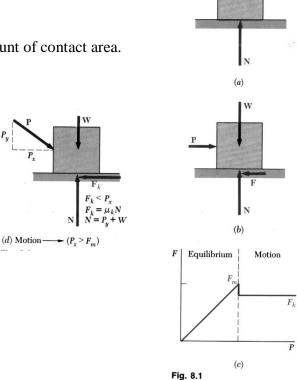

• CABLE STRUCTURES:


Cables have the same tension all along the length if they are not cut. The force *magnitude* is the same everywhere in the cable even if it changes angles. Cables CANNOT be in compression. (They flex instead.)

*High-strength steel* is the most common material used for cable structures because it has a high strength to weight ratio.

Cables must be supported by vertical supports or towers and must be anchored at the ends. Flexing or unwanted movement should be resisted. (Remember the Tacoma Narrows Bridge?)

Cables with a single load have a **concurrent** force system. It will only be in equilibrium if the cable is **symmetric**.

The forces anywhere in a *straight segment* can be resolved into x and y components of  $T_x = T \cos \theta$  and  $T_y = T \sin \theta$ .



The shape of a cable having a *uniform distributed load* is almost parabolic, which means the geometry and cable length can be found with:

$$y = 4h(Lx - x^2) / L^2$$

where y is the vertical distance from the straight line from cable start to end

h is the vertical sag (maximum y)

x is the distance from one end to the location of y

L is the horizontal span.


 $L_{total} = L(1 + \frac{8}{3}h^2/L^2 - \frac{32}{5}h^4/L^4)$ 


where  $L_{total}$  is the total length of parabolic cable

h and L are defined above.

# **Cables with Several Concentrated Loads or Fixed Geometry**


- In order to completely constrain cables, the number of unknown support reactions *will be more* than the available number of equilibrium equations. We can solve because we have additional equations from geometry due to the **slope** of the cable.
- The tension in the cable IS NOT the same everywhere, but the horizontal component in a cable segment WILL BE.

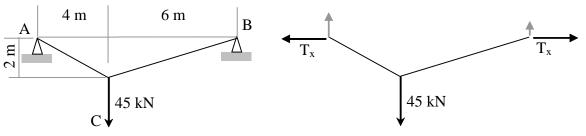



### **Truss Structures**

- A truss is made up of straight two-force members connected at its ends. The triangular arrangement produces stable geometry. Loads on a truss are applied at the joints only.
- Joints are pin-type connections (resist translation, not rotation).
- Forces of action and reaction on a joint must be equal and opposite.
- Members in TENSION are being pulled.
- Members in COMPRESSION are being squeezed.




- External forces act on the joints.
- <u>Truss configuration</u>:

Three members form a <u>rigid assembly</u> with **3** (three) connections.

To add members and still have a rigid assembly, **2** (two) more must be added with one connection between.

For rigidity: b = 2n - 3, where b is number of members and n is number of joints




## Method of Joints

- The method takes advantage of the conditions of equilibrium at each joint.
- 1. Determine support reaction forces.
- 2. Draw a FBD of each member AND each joint
- 3. Identify geometry of angled members
- 4. Identify zero force members and other special (easy to solve) cases
- 5. Each pin is in equilibrium ( $\sum F_x = 0$  and  $\sum F_y = 0$  for a concurrent force system)
- 6. Total equations = 2n = b+3 (one force per member + 3 support reactions)

Advantages: Can find every member force Disadvantages: Lots of equations, easy to lose track of forces found.


Tools available:

Tip-to-tail method for 3 joint forces must close Analytically, there will be at most 2 unknowns with 2 equilibrium equations.

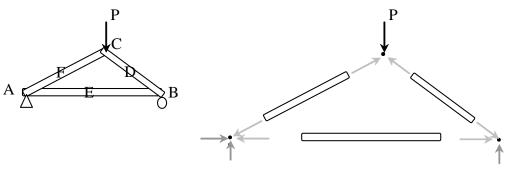


<u>Joint Configurations</u> (special cases to recognize for faster solutions)

Case 1) Two Bodies Connected

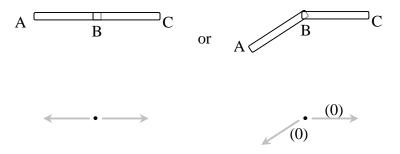

 $F_{AB}$  has to be **equal** (=) to  $F_{BC}$ 


Case 2) Three Bodies Connected with Two Bodies in Line

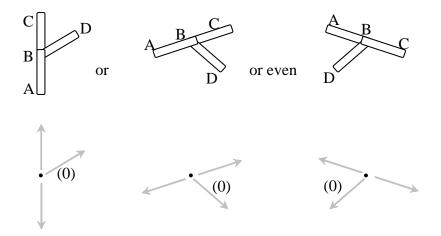

 $F_{AB}$  and  $F_{BC}$  have to be equal, and  $F_{BD}$  has to be **0** (zero).

Case 3) Three Bodies Connected and a Force – 2 Bodies aligned & 1 Body and a Force are Aligned

Four Bodies Connected - 2 Bodies Aligned and the Other 2 Bodies Aligned

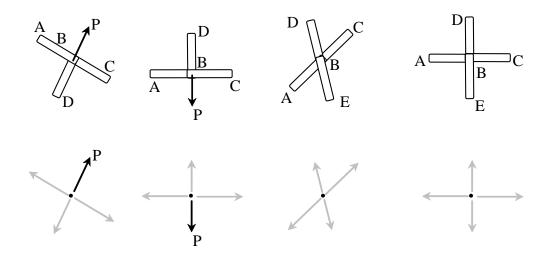

 $F_{AB}$  has to equal  $F_{BC}$ , and  $[F_{BD}$  has to equal P] or  $[F_{BD}$  has to equal  $F_{BE}]$ 

#### Graphical Analysis


The method utilizes what we know about force triangles and plotting force magnitudes to scale.

- 1. Draw an accurate form diagram of the truss at a convenient scale with the loads and support reaction forces.
- 2. Determine the support reaction forces.
- 3. Working clockwise and from left to right, apply interval notation to the diagram, assigning capital letters to the spaces between external forces and numbers to internal spaces.
- 4. Construct a load line to a convenient scale of length to force by using the interval notation and working clockwise around the truss from the upper left plotting the lengths of the vertical and horizontal loads.
- 5. Starting at a left joint where we know there are fewer than three forces, we draw reference lines in the direction of the unknown members so that they intersect. Label the intersection with the number of the internal space.
- 6. Go to the next joint (clockwise and left to right) with two unknown forces and repeat for all joints. The diagram should close.
- 7. Measure the line segments and apply interval notation to determine their sense: Proceeding clockwise around the joint, follow the notation. The direction toward the joint is compressive. The direction away from the joint is tensile.

# Example 1 (pg 49)

#### Example Problem 3.1: Equilibrium of a Particle


Two cables, shown in Figure 3.8, are used to support a weight W = 800 lb., suspended at concurrent point *C*. Determine the tension developed in cables *CA* and *CB* for the system to be in equilibrium. Solve this problem analytically and check the answer graphically.



# Example 2 (pg 56)


### Example Problem 3.5


A compound cable system supports a weight W = 800 lb. at point B, as shown in Figure 3.18. Cable BA is attached to a wall support at A and concurrent point C is supported by a compression strut DC. Determine all of the cable forces and the compression in strut DC.



# Example 3 (pg 90) Example Problem 4.1 (Method of Joints)

An asymmetrical roof truss, shown in Figure 4.4, supports two vertical roof loads. Determine the support reactions at each end, then, Using the method of joints, solve for all member forces. Summarize the results of all member forces on a FBD (this diagram is referred to as a *force summation diagram*).



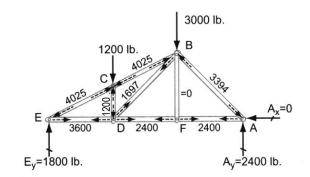

#### Example 4

Using the method of joint, determine all member forces.

#### SOLUTION:

Find the joints with 2 (or less unknowns) for FBD's : A and H. while looking for any special cases like E, which has "crossed" members and forces.  $F_{DE} = F_{EF}$  and  $F_{EC} = 500$  lb (tension). (Check off members found: AB, BD, AD, BC, DC, DE, EG, EF, CG, CF, FG, GH, FH)

Let's use A first (but H is just as acceptable). Draw the point, adding the known force, and draw the unknown member forces away from the point, assuming tension (shown as dashed). Find the geometry of member AB from the rise of 10 ft and the run of 15 ft. The hypotenuse will be  $\sqrt{10^2 + 15^2} = 18.03$ :

$$\Sigma F_x = F_{AD} + F_{AB} \frac{15}{18.03} = 0$$
  

$$\Sigma F_y = 412.5^{lb} + F_{AB} \frac{10}{18.03} = 0$$
  

$$F_{AB} = (-412.5)^* 18.03/10 = -743.7 \text{ lb (C)}$$

and substituting the (negative) value of F<sub>AB</sub> into the  $\Sigma F_{\nu}$ , F<sub>AD</sub> = 618.75 lb (T) (Check off members found: AB, BD, AD, BC, DC, DE, EC, EF, CG, CF, FG, GH, FH)

Review which joints have 2 (or less) unknowns: B and H.

Let's use B. Because we know FAB is in compression we draw the force into the point. We need the geometry of member BC with a rise of 5 (15-10) and a run of 15 with a hypotenuse of  $\sqrt{5^2 + 15^2}$  = 15.81:

$$\Sigma F_x = 743.7^{lb} \frac{15}{18.03} + F_{BC} \frac{15}{15.81} = 0 \qquad F_{BC} = -652.1 \text{ lb (C)}$$
  

$$\Sigma F_y = 743.7^{lb} \frac{10}{18.03} + F_{BC} \frac{5}{15.81} - F_{BD} = 0 \qquad \text{(substituting the negative value of F_{BC})}$$

 $F_{BD} = 206.2 \text{ lb} (T)$ (Check off members found: AB, BD, AD, BC, DC, DE, EC, EF, CG, CF, EF, FG, GH, FH)

Review which joints have 2 (or less) unknowns: D and H. Let's use D. Both FAD and FBD are tensile, so we can draw them away. The geometry of DE is familiar with the rise the same as the run for an angle of 45°:

 $\Sigma F_{x} = -618.75^{lb} + F_{DC} \cos 45^{\circ} + F_{DE} = 0$ 

$$\Sigma F_v = -150^{lb} + 206.2^{lb} + F_{DC} \sin 45^\circ = 0$$
 FDC = -79.5 lb (C)

and substituting the (negative) value of  $F_{DC}$  into the  $\Sigma F_{y}$ ,  $F_{DE}$  = 675.0 lb (T) =  $F_{EF}$  (! from above) (Check off members found: AB, BD, AD, BC, DC, DE, EC, EF, CG, CF, FG, GH, FH)

Review which joints have 2 (or less) unknowns: C and H. Let's use C. Draw F<sub>DC</sub> and F<sub>BC</sub> as compressive forces. And the geometry has been found due to symmetry, with the angle of  $F_{CF}$  a negative 45°:


$$F_x = 652.1^{lb} \frac{15}{15.81} + 79.5^{lb} \cos 45^\circ + F_{CF} \cos(-45^\circ) + F_{CG} \frac{15}{15.81} = 0$$
  
$$\Sigma F_y = 652.1^{lb} \frac{5}{15.81} + 79.5^{lb} \sin 45^\circ - 500^{lb} + F_{CF} \sin(-45^\circ) - F_{CG} \frac{5}{15.81} = 0$$

Solve simultaneously because there isn't an easy way to find one unknown equal to a value multiplied by the other unknown:


$$\Sigma F_x = 674.9^{lb} + 0.707 F_{CF} + 0.949 F_{CG} = 0$$


$$\Sigma F_y = -237.6^{lb} - 0.707 F_{CF} - 0.316 F_{CG} = 0$$


 $\frac{237.6^{tb} - 0.707F_{CF} - 0.316F_{CG} = 0}{437.5^{tb} + 0F_{CF} + 0.633F_{CG} = 0}$ Fcg = -690.8 lb (C) and substituting, FcF = -27.6 lb (C) add: (Check off members found: AB, BD, AD, BC, DC, DE, EC, EF, CG, CF, FG, GH, FH)

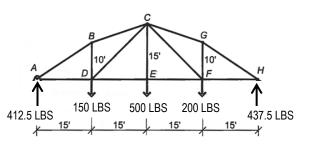












#### Example 4 (continued)

Review which joints have 2 (or less) unknowns: *G*, *F* and *H*. Let's use *F* (because H really looks like *A* mirrored). Draw  $F_{CF}$  as compressive and  $F_{EF}$  in tension. The angle from for  $F_{CF}$  is negative 45°:

$$\Sigma F_x = -675.0^{lb} + 27.6^{lb} \cos(-45^\circ) + F_{FH} = 0 \quad \text{Fr} = 055.5 \text{ ID (1)}$$
  
$$\Sigma F_y = 27.6^{lb} \sin(-45^\circ) - 200^{lb} + F_{FG} = 0 \quad \text{Fr} = 219.5 \text{ Ib (T)}$$

(Check off members found:

AB, BD, AD, BC, DC, DE, EC, EF, CG, CF, FG, GH, FH)

Review which joints have 2 (or less) unknowns; which are *G* and *H*. Let's use *G* and pretend that we have only found  $F_{GF}$  (and not  $F_{CG}$ ) in order to show a set of equations that use substitution with the algebra. The geometry has been found due to symmetry:


$$\Sigma F_x = -F_{CG} \frac{15}{15.81} + F_{GH} \frac{15}{18.03} = 0 \quad \text{rearranging:} \quad F_{CG} = F_{GH} \frac{15}{18.03} \cdot \frac{15.81}{15} = F_{GH} \frac{15.81}{18.03}$$
$$\Sigma F_y = F_{CG} \frac{5}{15.81} - F_{GH} \frac{10}{18.03} - 219.5^{lb} = 0$$


Substituting:


$$\Sigma F_y = (F_{GH} \frac{15.81}{18.03}) \frac{5}{15.81} - F_{GH} \frac{10}{18.03} - 219.5^{lb} = 0$$
  
lifying  $-0.277 F_{cm} = 219.5^{lb}$  F<sub>GH</sub> = -791.6 lb (C)

Simplifying  $-0.277 F_{GH} = 219.5^{lb}$  F<sub>GH</sub> = -791.6 lb (C) and F<sub>CG</sub> = -694.1 lb (C) (which validates the earlier answer found of 690.8 lb (C) with respect to rounding errors in all fractions and trig functions) (Check off members found: AB, BD, AD, BC, DC, DE, EC, EF, CG, CF, FG, GH, FH)

(Typically, the last joint left will verify that the joint is in equilibrium with values found, but in this exercise the last joint was used to show the algebraic method of substitution.)

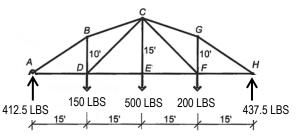






## **Truss Analysis using Multiframe**

- 1. The software is on the computers in the College of Architecture in Programs under the Windows Start menu (see <u>https://wikis.arch.tamu.edu/display/HELPDESK/Computer+Accounts</u> for lab locations). Multiframe is under the Bentley Engineering menu.
- 2. There are tutorials available on line at <u>http://www.formsys.com/mflearning</u> that list the tasks and order in greater detail. The first task is to define the unit system:
  - Choose Units... from the View menu. Unit sets are available, but specific units can also be selected by double clicking on a unit or format and making a selection from the menu.

Units					×
Unit Set:	Configuration:				
American	Unit Type	Unit	Decimal Places	Format	~
Australian	1 Length	ft	<b>▼</b> 3	Fixed Decimal	
British Canadian	2 Angle	deg	3	Fixed Decimal	
European	3 Deflection	in	3	Fixed Decimal	
Japanese	4 Rotation	deg	3	Fixed Decimal	
	5 Force	kip	3	Fixed Decimal	
	6 Moment	lbf-ft	3	Fixed Decimal	
	7 Dist. Force	lbf/ft	3	Fixed Decimal	
	8 Stress	ksi	3	Fixed Decimal	
	9 Mass	dl	3	Fixed Decimal	
	10 Mass/Length	lb/ft	3	Fixed Decimal	
	11 Area	in²	3	Fixed Decimal	
	12 Mmt of Inertia	in^4	3	Fixed Decimal	
	13 Density	lb/ft³	3	Fixed Decimal	
	14 Section Modulus	s in <sup>s</sup>	3	Fixed Decimal	~
	<	: <u></u>			>
				OK Ca	ncel

3. To see the scale of the geometry, a grid option is available:

• Choose Grid... from the View menu



4. To create the geometry, you must be in the Frame window (default). The symbol is the frame in the window toolbar:

The Member toolbar shows ways to create members:




The Generate toolbar has convenient tools to create typical structural shapes.

• To create a truss, use the add connected members button:



- Select a starting point and ending point with the cursor. The location of the cursor and the segment length is displayed at the bottom of the geometry window. The ESC button will end the segmented drawing. Continue to use the add connected members button. Any time the cursor is over an existing joint, the joint will be highlighted by a red circle.
- The geometry can be set precisely by selecting the joint (drag), and bringing up the joint properties menu (right click) to set the coordinates.

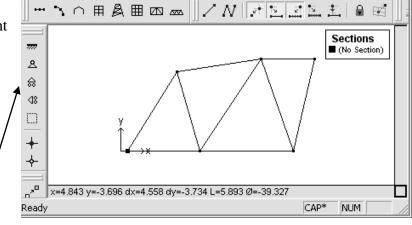

- The support types can be set by selecting the joint (drag) and using the Joint Toolbar (pin shown), or the Frame / Joint Restraint ... menu (right click).
- NOTE: If the support appears at both ends of the member, you had the member selected rather than the joint. Select the joint to change support for and right click to select the joint restraints menu or select the correct support on the joint toolbar.

Re	straints				×
[	- Restrain	ts			
	D	8	<del>7777</del>	$\widehat{\hat}$	
	⊲8	盎	<b>≓</b> 8	#	
	Restrain		acemen	ts:	OK
	x' y'	Øz'			Cancel

The support forces will be determined in the analysis.

- 5. All members must have sections assigned (see section 6.) in order to calculate reactions and deflections. To use a standard steel section **proceed to step 6.** For custom sections, the section information must be entered. To define a section:
  - Choose Edit Sections / Add Section... from the Edit menu
  - Type a name for your new section
  - Choose group <u>Frame</u> from the group names provided so that the section will remain with the file data
  - Choose a shape. The Flat Bar shape is a rectangular section.
  - Enter the cross section data.

<u>N</u> ame:	New Section		Prop	erties:			
<u>G</u> roup:	Custom1	•		Property	Value	Units	
	Custom1		1 1	Weight	0.000	lb/ft	1 6
	Custom2		2	A	0.000	in^2	
	Custom3		3	١x	0.000	in^4	
	Frame		4	ly	0.000	in^4	
			5	J	0.000	in^4	
		D	6	E	0.000	ksi	1 L
			7	G	0.000	ksi	
			8	D	0.000	in	
	В	<u> </u>	9	В	0.000	in	
	K D		10	tf	0.000	in	
			. 11	tw	0.000	in	
Shape:	Flat Bar	-	12	fy	0.000	ksi	

7777

8

⇔ ⊲°

Table values 1-9 must have values for a Flat Bar, but not all are used for every analysis. A recommendation is to put the value of 1 for those properties you don't know or care about. Properties like  $t_f$ ,  $t_w$ , etc. refer to wide flange sections.

- Answer any query. If the message says there is an error, the section will not be created until the error is corrected.
- 6. The standard sections library loaded is for the United States. If another section library is needed, use the Open Sections Library... command under the file menu, choose the library folder, and select the SectionsLibrary.slb file.

Select the members (drag to make bold) and assign sections with the Section button on the Member toolbar:



• Choose the group name and section name: (STANDARD SHAPES)

(CUSTOM)

Laroup: Section:		Section:
M         ₩44x290           S         ₩44x285           WT         ₩44x262           MT         ₩44x262           MT         ₩44x280           C         ₩44x280           MC         ₩44x198           HP         ₩40x655           Angle         ₩40x533           Double Angle         ₩40x533           Diable Angle         ₩40x533	HP Angle Double Angle Pipe Sq. Tube Rect Tube HSS Round HSS Square HSS Rectangular Custom1 Custom2 Custom3 Frame	generic1

- 7. In order for Multiframe to recognize that the truss members are two-force bodies, all joints must be highlighted and assigned as pins with the Pinned Joints button on the Joint toolbar:
- 8. The truss geometry is complete, and in order to define the load conditions you must be in the Load window represented by the green arrow:
- 9. The Load toolbar allows a joint to be loaded with a force or a moment in global coordinates, shown by the first two buttons after the display numbers button. It allows a member to be loaded with a distributed load, concentrated load or moment (next three buttons) in global coordinates, as well as loading with distributed or single force or moment in the local coordinate system (next three buttons). It allows a load panel to be loaded with a distributed load in global or local coordinates (last two buttons).
  - Choose the joint to be loaded (drag) and select the load type (here shown for point loading):.



 $\cap$ 


Σ Ξ

- Choose the direction by the arrow shown. There is no need to put in negative values for downward loading.
- Enter the values of the load

Global Joint Load	X
Magnitude 1.000 lbf	OK
	Cancel

*NOTE: <u>Do not</u> put support reactions as applied loads. The analysis will determine the reaction values* 

Multiframe will automatically generate a grouping called a Load Case named Load Case 1 when a load is created. All additional loads will be added to this load case unless a new load case is defined (Add case under the Case menu).

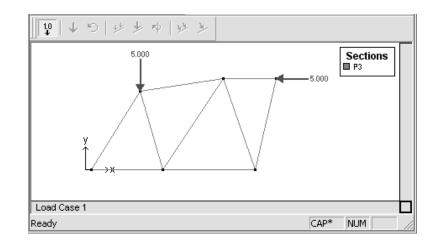


- 10. In order to run the analysis after the geometry, member properties and loading has been defined:
  - Choose Analyze Linear from the Case menu
- 11. If the analysis is successful, you can view the results in the Plot window represented by the red moment diagram:
- 12. The Plot toolbar allows the numerical values to be shown (1.0 button), the reaction arrows to be shown (brown up arrow) and reaction moments to be shown (brown curved arrow):
  - To show the axial force diagram, Choose the purple Axial Force button. Tensile members will have "T" by the value (if turned on), while compression members will have "C" by the value
  - To show the deflection diagram, Choose the blue Deflection button
  - To animate the deflection diagram, Choose Animate... from the Display menu. You can also save the animation to a .avi file by checking the box.










• To see exact values of axial load and deflection, double click on the member and move the vertical cross hair with the mouse. The ESC key will return you to the window.

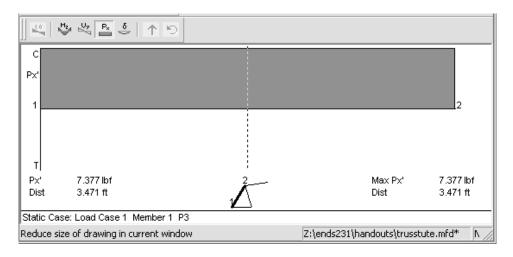

13. The Data window (D) allows you to view all data "entered" for the geometry, sections and loading. These values can be edited.



14. The Results window (R) allows you to view all results of the analysis including displacements, reactions, member forces (actions) and stresses. These values can be cut and pasted into other Windows programs such as Word or Excel.

	Joint	Label	Rx' Ibf	Ry' Ibf	Mz' Ibf-ft
1	1		5.000	6.246	0.000
2	2		0.000	-0.000	0.000
3	3		-0.000	-0.000	0.000
4	4		0.000	0.000	0.000
5	5		0.000	-1.246	0.000
6	6		0.000	-0.000	0.000
7	Total	(Global)	Rx=5.000	Rv=5.000	

	Memb	Label	Joint	Px' Ibf	Vy' Ibf	Mz' Ibf-ft	
1	1		1	7.377	0.000	0.000	
2	1		2	-7.377	0.000	0.000	
3	2		2	-0.681	0.000	0.000	
4	2		3	0.681	0.000	0.000	
5	3		1	1.075	0.000	0.000	
6	3		3	-1.075	0.000	0.000	
7	4		2	4.157	0.000	0.000	
8	4		4	-4.157	0.000	0.000	
✓ ► A Member Actions							

NOTE: Px' refers to the axial load (P) in the local axis x direction (x').

- 15. To save the file Choose Save from the File menu.
- 16. To load an existing file Choose Open... from the File menu.
- 17. To print a plot Choose Print Window... from the File menu. As an alternative, you may copy the plot (Ctrl+c) and paste it in a word processing document (Ctrl+v).

# **Equilibrium of Rigid Bodies**

Nota	tion:		
k F F <sub>x</sub> Fy FBD L M	<ul> <li>spring constant</li> <li>name for force vectors, as is P</li> <li>force component in the x direction</li> <li>force component in the y direction</li> <li>free body diagram</li> <li>beam span length</li> <li>moment due to a force</li> </ul>	$W \\ W \\ lpha \\  heta \\  het$	<ul> <li>name for distributed load</li> <li>name for total force due to distributed load</li> <li>angle, in a math equation</li> <li>angle, in a trig equation, ex. sinθ, that is measured between the x axis and <i>tail</i> of a vector</li> </ul>
x	= horizontal distance	${\Sigma}$	= summation symbol

• *Definition:* Equilibrium is the state when all the external forces acting on a rigid body form a system of forces equivalent to zero. There will be no rotation or translation. The forces are referred to as <u>balanced</u>.

$$R_x = \sum F_x = 0$$
  $R_y = \sum F_y = 0$  AND  $\sum M = 0$ 

• It is ABSOLUTELY NECESSARY to consider all the forces acting on a body (applied directly and indirectly) using a FREE BODY DIAGRAM. Omission of a force would ruin the conditions for equilibrium.

## FREE BODY DIAGRAM STEPS;

- 1. Determine the free body of interest. (What body is in equilibrium?)
- 2. Detach the body from the ground and all other bodies ("free" it).
- 3. Indicate all external forces which include:
  - action on the free body by the supports & connections
  - action on the free body by other bodies
  - the weigh effect (=force) of the free body itself (force due to gravity)
- 4. All forces should be clearly marked with magnitudes and direction. The sense of forces should be those acting *on the body* not by the body.
- 5. Dimensions/angles should be included for moment computations and force computations.
- 6. Indicate the <u>unknown</u> angles, distances, forces or moments, such as those reactions or constraining forces where the body is supported or connected. (*Text uses hashes on the unknown forces to distinguish them.*)


F2011abn

• *Reactions* can be categorized by the type of connections or supports. A reaction is a force with known line of action, or a force of unknown direction, or a moment. The line of action of the force or direction of the moment is directly related to the motion that is prevented.

	prevents motion: up and down	prevents vertical	motion: & horizontal	prevents: rotation & translation
	Support Connection orts for Coplanar Structure		Structural An	alysis, 4 <sup>th</sup> ed., R.C. Hibbele
Type of Connection	Idealized n Symbol	Reaction	Numbe	r of Unknowns
(1)	ht cable	F	force	known. The reaction is a that acts in the direction e cable or link.
(2) TOILETS		F	force	known. The reaction is a that acts perpendicular to urface at the point of contact.
rocker (3) smooth contacting sur	rface	1 F	force	known. The reaction is a that acts perpendicular to urface at the point of contact.
(4) smooth pin-connected	l collar	F	force	known. The reaction is a that acts perpendicular to urface at the point of contact.
(5) smooth pin or hinge	θ	$F_y$ $F_x$		knowns. The reactions are force components.
slider fixed-connected collar	j − F	м (		knowns. The reactions force and a moment.
(7) fixed support	F <sub>x</sub>	M Fy	the m	nknowns. The reactions are noment and the two force ponents.

The line of action should be indicated on the FBD. The sense of direction is determined by the type of support. (Cables are in tension, etc...) *If the sense isn't obvious, assume a sense*. When the reaction value comes out positive, the assumption was correct. When the reaction value comes out negative, the assumption was *opposite* the actual sense. *DON'T CHANGE THE ARROWS ON YOUR FBD OR SIGNS IN YOUR EQUATIONS*.

• With the 3 equations of equilibrium, there can be no more than 3 unknowns. COUNT THE NUMBER OF UNKNOWN REACTIONS.

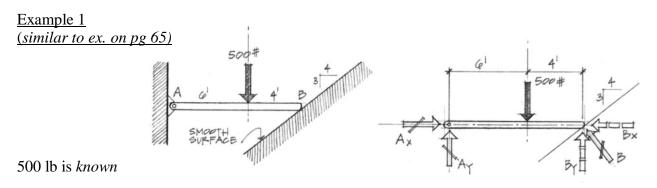

check:

reactions for the pin-type support at  $A = A_x \& A_y$ 

reactions and components for the smooth surface at B = B (perpendicular to ground only)

# equations = **3** 

## procedure:


Write summation of forces in x and y and set = 0.

Choose a place to take a moment. Summing moments at A means that  $A_x$ ,  $A_y$  and  $B_x$  have moment arms of *zero*.

- The general rule is to sum at point where there are the <u>most</u> unknown reactions which usually results in one unknown left in the equation. This "point" could also be where two lines of action intersect.
- More than one moment equation can be used, but it will not be unique. Only 3 equations are unique. Variations:

$$\sum F_x = 0 \qquad \sum F_y = 0 \qquad \sum M_1 = 0 \quad \text{or}$$
$$\sum F_x = 0 \qquad \sum M_1 = 0 \qquad \sum M_2 = 0 \quad \text{or}$$
$$\sum M_1 = 0 \qquad \sum M_2 = 0 \qquad \sum M_3 = 0$$

Recognizing support unknowns in FBD's

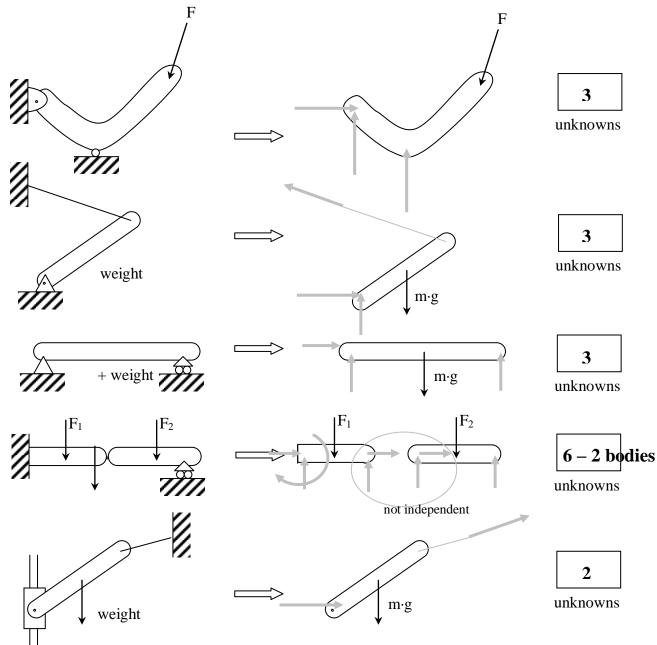



# **Statical Indeterminancy and Improper Constraints**

- Definition: A completely constrained rigid body has the same number of unknown reactions as number of equilibrium equations and cannot move under the loading conditions. The reactions are <u>statically determinate.</u>
- *Definition:* Statically indeterminate reactions appear on a rigid body when there are more unknown reactions than the number of equilibrium equations. The reactions that cannot be solved for are <u>statically indeterminate</u>. The <u>degree of indeterminacy</u> is the number of additional equations that would be needed to solve, i.e. one more = 1<sup>st</sup> degree, 2 more = 2<sup>nd</sup> degree...

## Example of Static Indeterminancy:

Find the reactions on the cantilever when a pin is added at C







With 5 unknowns, two won't be solvable. (statically indeterminate to the  $2^{nd}$  degree)

Definition: When the support conditions provide the same or less unknown reactions as the equations of equilibrium but allow the structure to move (not equilibrium), the structure is considered <u>partially constrained</u>. This occurs when the reactions must be either concurrent or parallel.

# Example of Partial Constraints:

Find the reactions when the pin support at A changes to a roller





If  $\Sigma F$  has to equal 0, the x component must be 0, meaning B = 0.


A would have to equal 100 N, but then  $\Sigma$ M wouldn't be 0.

- The condition of at most as many unknown reactions as equilibrium equations is <u>necessary</u> for static determinacy, but isn't <u>sufficient</u>. *The supports must completely constrain the structure*.
- We'd like to avoid partial or improper constraint in the design of our structures. However, some structures with these types of constraints may not collapse. They may move. Or they may require advanced analysis to find reaction forces.

Example of Partial Constraints and Static Indeterminacy:

Find the weight and reactions when the sleeve track is horizontal


k = 5 N/mm $k(\Delta l) = F$  by spring length of <u>unstretched</u> spring = 450 mm




For  $\Sigma$ F to equal 0, the spring force must be 0 (x component = 0) meaning it *can't* be stretched if there is no movement

# **Rigid Body Cases:**

1. Two-force body: Equilibrium of a body subjected to two forces on two points <u>requires</u> that those forces be **equal** and **opposite** and act in the <u>same line of action</u>.

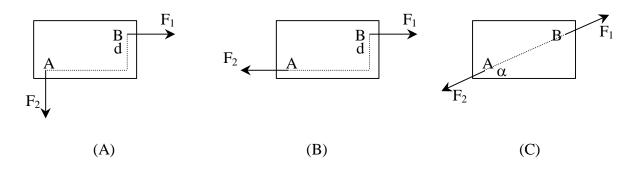



2. Three-force body: Equilibrium of a body subjected to three forces on three points <u>requires</u> that the line of action of the forces be <u>concurrent (intersect)</u> or <u>parallel</u> AND that the resultant equal zero.

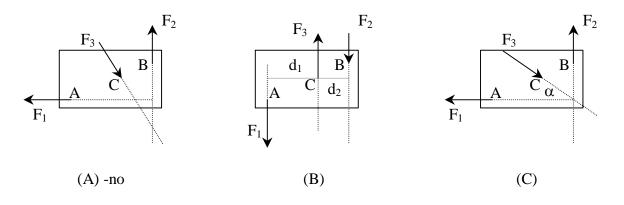



### Loads, Support Conditions & Reactions for Beams

#### Types of Forces












Types of supports:

- Statically determinate (number of unknowns ≤ number of equilibrium equations)








cantilever


simply supported (most common)

overhang

- Statically indeterminate: (need more equations from somewhere




restrained, ex.



# Distributed Loads


Distributed loads may be replaced by concentrated loads acting through the balance/center of the distribution or *load area*: THIS IS AN **EQUIVALENT** FORCE SYSTEM.

- *w* is the symbol used to describe the *load* per unit **length**.
- W is the symbol used to describe the *total load*.

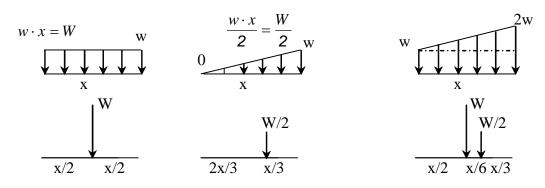

#### Example 2 (*changed* from pg 72) Example Problem 3.14—Cantilever (Figure 3.42)

Determine the support reactions developed at *A* for a cantilever beam supporting a trapezoidal load and a point load (horizontal) on the bar at the free end.




# Method of Sections for Truss Analysis

#### Notation:

```
 \begin{array}{ll} (C) &= \text{ shorthand for compression} \\ P &= \text{ name for load or axial force vector} \end{array} \end{array} (T) &= \text{ shorthand for tension} \\ \end{array}
```


<u>Joint Configurations</u> (special cases to recognize for faster solutions)

Case 1) Two Bodies Connected




 $F_{AB}$  has to be equal and opposite to  $F_{BC}$ 

Case 2) Three Bodies Connected with Two Bodies in Line



 $F_{AB}$  and  $F_{BC}$  have to be equal, and  $F_{BD}$  has to have zero force.

Case 3) Three Bodies Connected and a Force – 2 Bodies aligned & 1 Body and a Force are Aligned Four Bodies Connected - 2 Bodies Aligned and the Other 2 Bodies Aligned

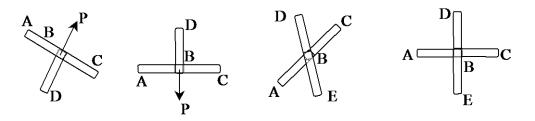


 $F_{AB}$  has to equal  $F_{BC}$ , and  $[F_{BD}$  has to equal P] or  $[F_{BD}$  has to equal  $F_{BE}]$ 

Method of Sections (relies on internal forces being in equilibrium with external forces on a section)

- 1. Determine support reaction forces.
- 2. Cut a section in such a way that force action lines intersect.
- 3. Solve for equilibrium. Sum moments about an intersection of force lines of action

Advantages: Quick when you only need one or two forces (only 3 equations needed) Disadvantages: Not always easy to find a place to cut a section or see where force lines intersect

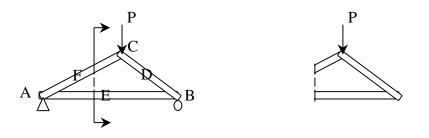

- <u>Compound Truss</u>: A truss assembled of simple trusses and additional links. It has b=2n-3, is statically determinate, rigid and completely constrained with a pin and roller. It can be identified by triangles with pins in the middle of some sides.
- <u>Statically Indeterminate Trusses:</u>


Occur if there are more members than equations for all the joints

OR if there are more reaction supports unknowns than 3

• <u>Diagonal Tension Counters</u>: Crossed bracing of cables or slender members is commonly used in bridge trusses, buildings and towers. These trusses look indeterminate, but can be solved statically because the bracing cannot hold a compressive force. The members are excluded in the analysis.

#### Method:


- 1. Determine support reaction forces.
- 2. Cut a section in such a way that the tension counters are exposed.
- 3. Solve for force equilibrium in *y* with one counter. If the value is positive (in tension), this is the solution.
- 4. Solve for force equilibrium in *y* with the other counter.



# Example 1 (pg 99)

A 64-foot parallel chord truss (Figure 4.30) supports horizontal and vertical loads as shown. Using the method of sections, determine the member forces *BC*, *HG*, and *GD*.

(Support forces must be found as well).

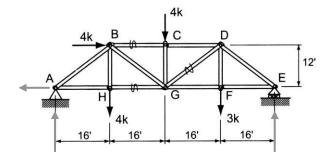

#### Example 2

Using the method of sections, determine member forces in FE, EB, BC, AB and FB.

#### SOLUTION:

A section can't pass through 5 members, so there will have to be two sections. The first passes through FE, EB and BC.

FE is shown assumed to be in compression, while the other forces are drawn assumed to be in tension.

There can be only two intersections when two of the three forces are parallel - at E and B:

$$\begin{split} \Sigma M_E = & 100^{lb}(\,6ft\,) - BC(\,8ft\,) = 0 \\ \text{BC} = & 75^{\text{lb}} \ \text{(T)} \end{split}$$

 $\Sigma M_B = 100^{lb} (12 ft) - FE(8 ft) = 0$  FE = 150<sup>lb</sup> (C)

Because EB is the only unknown force with a y component, it is useful to sum forces in the y direction (although it also has the only remaining unknown x component):

$$\begin{split} \Sigma F_y &= 100^{lb} - EB(\frac{8\,ft}{\sqrt{100}\,ft}) = 0\\ (\text{or } \Sigma F_x &= 150^{lb} - 75^{lb} - EB(\frac{6\,ft}{\sqrt{100}\,ft}) = 0)\\ \text{EB} &= 125^{lb} \ \text{(T)} \end{split}$$


A second section can be drawn through AB, FB and FE.


There are three points of intersection of the unknown forces - at A, F and B. B is not on the section, but we know where it is.


$$\Sigma M_A = -300^{lb}$$
(6*ft*) + *FB*(6*ft*) = 0 FB = 300<sup>lb</sup> (C)


$$\Sigma M_F = -200^{lb}(6ft) + AB_y(6ft) = 0 \text{ (sliding AB components to A)}$$
  
AB = AB<sub>y</sub>( $\sqrt{100}/8$ ) = 250<sup>lb</sup> (T)  
or  $\Sigma M_F = -200^{lb}(6ft) + AB_x(8ft) = 0 \text{ (sliding AB components to B)}$   
AB = AB<sub>x</sub>( $\sqrt{100}/6$ ) = 250<sup>lb</sup> (T)

 $\Sigma M_B = -200^{lb} (6ft) + FE(8ft) = 0$ FE = 150<sup>lb</sup> (C)

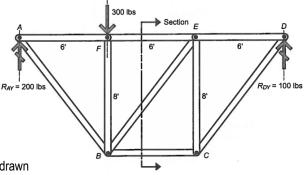




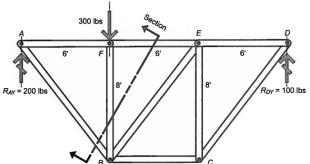




# Example 3 (pg 90) Example Problem 4.1 (Method of Joints)

An asymmetrical roof truss, shown in Figure 4.4, supports two vertical roof loads. Determine the support reactions at each end, then, using the method of joints, solve for all member forces. Summarize the results of all member forces on a FBD (this diagram is referred to as a *force summation diagram*). Determine the member forces *CB*, *DB* and *DF*.



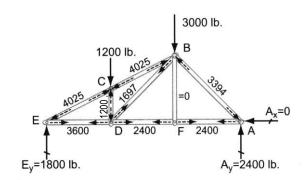

#### Example 4

Using the method of sections, determine member forces in BC, CD and BD.

#### SOLUTION:

Find the support reactions from rigid body equilibrium, or in this case, from load tracing with symmetrical loads.

Draw a section line through the members of interest, cutting through no more than 3 members to separate the truss into two pieces. In this case, BC and CD can be cut through, while BD will need another section.

Draw one of the sections, exposing the member forces. Drawing them "out" or "away" from the cut assumes tension. BC is drawn in compression. So is DC, but because it has a 45 degree angle, the components will have the same magnitude.

Find a point to sum moments where two unknown forces intersect. This may be on a point of the section or off the section. X is such a location where the line of action of BC intersects that of DE. For every 15 ft to the left, the line slopes down 5 ft, so X is located (10 ft/ 5 ft)15 ft = 30 ft to the left of B.

$$\Sigma M_X = 450^{lb}(15ft) - 300^{lb}(30ft) - DC_y(30ft) = 0$$
  
DCy = -75 lb, so DC = DC<sub>y</sub>/sin45 = 106 <sup>lb</sup> tension

(compression was assumed, but the answer was negative indicating our assumption wasn't verified).

(Notice that  $DC_x$  and  $DC_y$  "slid" down to D and then the lever arm for  $DC_x$  was 0. The components can also slide to the other end point of the member to locate the lever arms)

Summing at D where DC and DE intersect means there will be no lever arms. Sliding the components of BC to B means there will be no lever arm for BC<sub>y</sub>:


$$\Sigma M_D = -450^{lb}(15ft) + BC_x(10ft) = 0$$
 BC<sub>x</sub> = 675<sup>lb</sup>, so BC = BC<sub>x</sub> $\sqrt{10}/3$  = 711.5<sup>lb</sup> compression


Draw a section line that passes through BD and cuts through no more than three members.


If we hadn't already found BC, we could sum moments at point X again to eliminate BC and AD from our equation, leaving BD.

But it is obvious that we have only one unknown y force, which is BD:

$$\Sigma F_y = 450^{lb} - BD - 711.5^{lb} \left( \frac{1}{\sqrt{10}} \right) = 0$$
 BD = 225<sup>lb</sup> tension

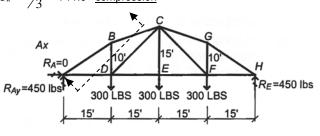



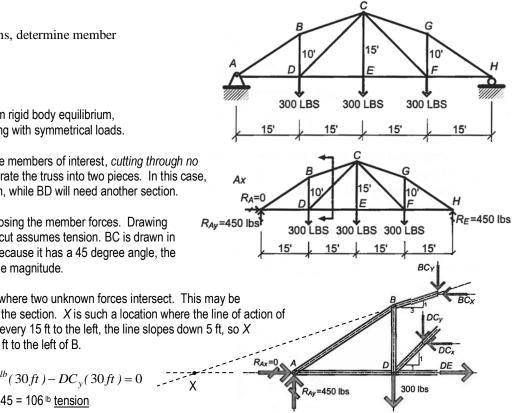

# **Mechanics of Materials**

Notation:		
A = area (net = with holes, bearing = in	Р	= name for axial force vector
contact, etc)	P'	= name for internal axial force vector
d = diameter of a hole	R	= name for reaction force vector
f = symbol for stress	t	= thickness of a hole or member
$f_{allowable}$ = allowable stress	x	= horizontal dimension
$f_v$ = shear stress	У	= vertical dimension
$f_p$ = bearing stress (see P)	γ	= density of a material (unit weight)
$F_{allowed}$ = allowable stress (used by codes)	$\sigma$	= engineering symbol for normal
$F_{v}$ = allowable shear stress	U	stress
$kPa = kilopascals or 1 kN/m^2$	τ	= engineering symbol for shearing
q = allowable soil bearing pressure	U	stress
<i>psi</i> = pounds per square inch		54055


*Mechanics of Materials* is a basic engineering science that deals with the relation between externally applied load and its effect on deformable bodies. The main purpose of Mechanics of Materials is to answer the question of which requirements have to be met to assure STRENGTH, RIGIDITY, AND STABILITY of engineering structures.

To solve a problem in Mechanics of Materials, one has to consider THREE ASPECTS OF THE PROBLEM:

- 1. **STATICS**: equilibrium of external forces, internal forces, stresses
- 2. GEOMETRY: deformations and conditions of geometric fit, strains
- 3. **MATERIAL PROPERTIES**: stress-strain relationship for each material, obtained from material testing.
- STRESS The intensity of a force acting over an **area**.

## Normal Stress

Stress that acts along an *axis* of a member; can be internal or external; can be compressive or tensile.



$$f = \sigma = \frac{P}{A_{net}}$$
 Strength condition:  $f = \frac{P}{A_{net}} < f_{allowable} \text{ or } F_{allowed}$ 

## Shear Stress

Stress that acts perpendicular to an *axis or length* of a member, or **parallel** to the cross section is called shear stress.

Shear stress cannot be assumed to be uniform, so we refer to *average shearing stress*.

 $f_v = \tau = \frac{P}{A_{net}}$  Strength condition:  $f_v = \frac{P}{A_{net}} < \tau_{allowable} \text{ or } F_{allowed}$ 

#### **Bearing Stress**

A compressive normal stress acting between two bodies.


$$f_p = \frac{P}{A_{bearing}}$$

#### **Bending Stress**

A normal stress caused by bending; can be compressive or tensile. (Discussed in Note Set on Beam Bending.)

## **Torsional Stress**


A shear stress caused by torsion (moment around the axis). (Discussed in Note Set on Torsion.)

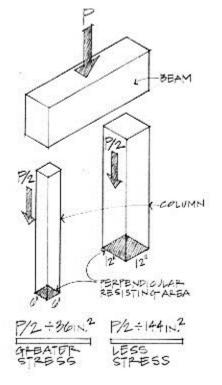


Р

## **Bolts in Shear and Bearing**

Single shear - forces cause only one shear "drop" across the bolt.



(a) Two steel plates bolted using one bolt.



(b) Elevation showing the bolt in shear.

section

A


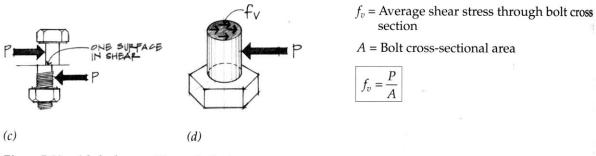


Figure 5.11 A bolted connection—single shear.

Double shear - forces cause two shear changes across the bolt.




(two shear planes)

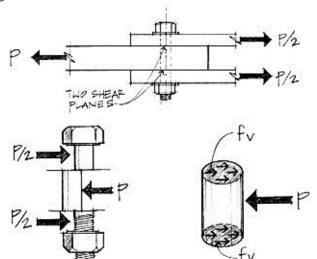

Free-body diagram of middle section of the bolt in shear. Figure 5.12 A bolted connection in double shear.

<u>Bearing of a bolt on a bolt hole</u> – The bearing surface can be represented by *projecting* the cross section of the bolt hole on a plane (into a rectangle).

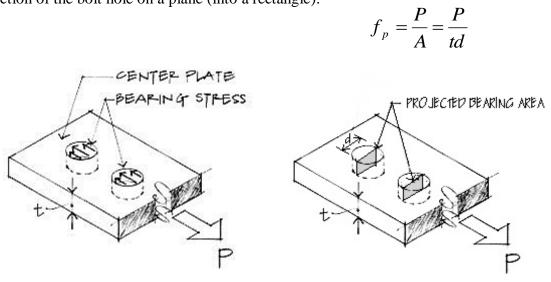



Bearing stress on plate.

#### Example 1 (pg 201)\*

#### Example Problem 6.8 (Figures 6.18 to 6.20)

Apipe storage rack is used for storing pipe in a shop. The support rack beam is fastened to the main floor beam using steel straps  $\frac{1}{2}$ " × 2" in dimension. Round bolts are used to fasten the strap to the floor beam in single shear. (a) If the weight of the pipes impose a maximum tension load of 10,000 pounds in each strap, determine the tension stress developed in the steel strap. (b) Also, what diameter bolt is necessary to fasten the strap to the floor beam if the allowable shear stress for the bolts equals  $F_v = 15,000 \text{ lb}/\text{in}.^2$ ? Determine the bearing stress in the strap from the bolt diameter chosen. If the straps are 10 ft. in length, how much elongation would occur? What is the ultimate load capacity in each strap? Assume A36 steel:  $F_u = 58 \text{ ksi}, E = 29 \times 10^3 \text{ ksi}.$ 

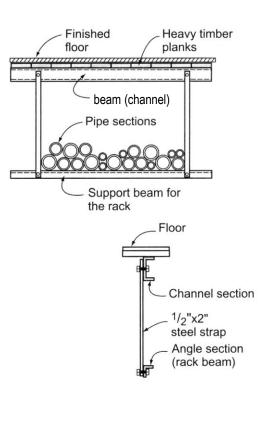




#### Example 2 (pg 202) Example Problem 6.9 (Figures 6.21 to 6.26)

A 75 mm  $\times$  200 mm "rough cut" beam is supported by columns at both ends. Column *AB* supports the beam in bearing while column *CD* utilizes a shear block at *C*. Both columns bear on concrete footings on the ground.

- a. What is the compressive stress developed in column *AB*?  $R_A = 24$  kN
- b. What is the bearing stress that develops at C between the beam and shear block made from a 100 mm  $\times$  100 mm block cut from a post?
- c. What is the required depth *y* necessary to resist the shear force developed at the glued joint between the shear block and post? Assume that the glue is capable of safely resisting 500 kPa (72.5 psi) in shear.
- d. Determine the size of square footing required to take the maximum column load if the allowable soil pressure  $q = 73 \text{ kN}/\text{m}^2 = 73 \text{ kPa}$  (1525 psf).

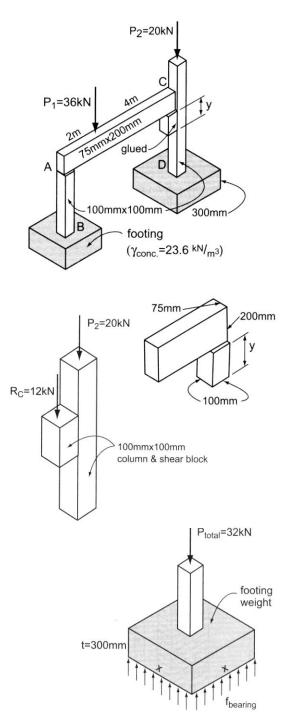

B

1

δ

C

p

# **Stress and Strain – Elasticity**

#### Notation:


Α	= area	t	= thickness
D	= diameter dimension	$\delta$	= elongation or length change
E	= modulus of elasticity or Young's	ε	= strain
	modulus	$\phi$	= angle of twist
f	= stress	,	= resistance factor for LRFD
$F_{allow}$	$x_{x}$ = allowable stress		= diameter symbol
$F_t$	= allowable tensile stress		= lateral strain ratio or Poisson's ratio
<i>F.S.</i>	= factor of safety	μ	
h	= height	γ	= shear strain
kPa	= kilopascals or $1 \text{ kN/m}^2$		= density or unit weight
	= kips per square inch	γ <sub>D</sub>	= dead load factor for LRFD
L	= length	γı	= live load factor for LRFD
LRF	D = load and resistance factor design	$\theta$	= angle of principle stress
MPa	= megapascals or $10^6 \text{ N/m}^2$ or	ρ	= radial distance
	$1 \text{ N/mm}^2$		
q	= allowable soil bearing pressure	$\sigma$	= engineering symbol for normal
psf	= pounds per square foot	_	stress
P	= name for axial force vector	τ	= engineering symbol for shearing
R	= name for design quantity (force or		stress
	moment) for LRFD, ex. $R_L$ , $R_D$ , or		
	$R_n$		

## Normal Strain

In an axially loaded member, normal strain,  $\varepsilon$  is the change in the length,  $\delta$  with respect to the original length, L.

$$\varepsilon = \frac{\delta}{L}$$

It is UNITLESS, but may be called strain or microstrain  $(\mu)$ .

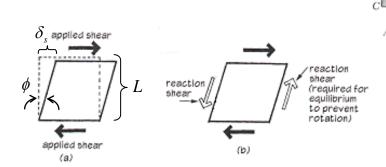


## Shearing Strain

In a member loaded with shear forces, shear strain,  $\gamma$  is the change in the sheared side,  $\delta_s$  with respect to the original height, L. For small angles:  $\tan \phi \cong \phi$ .

$$\gamma = \frac{\delta_s}{L} = \tan \phi \cong \phi$$

In a member subjected to twisting, the shearing strain is a measure of the angle of twist with respect to the length and distance from the center,  $\rho$ :

$$v = \frac{\rho q}{L}$$




## Testing of Load vs. Strain

Behavior of materials can be measured by recording deformation with respect to the size of the load. For members with constant cross section area, we can plot stress vs. strain.

<u>BRITTLE MATERIALS</u> - ceramics, glass, stone, cast iron; show abrupt fracture at small strains.

<u>DUCTILE MATERIALS</u> – plastics, steel; show a yield point and large strains (considered *plastic*) and "necking" (give warning of failure)

<u>SEMI-BRITTLE MATERIALS</u> – concrete; show no real yield point, small strains, but have some "strain-hardening".

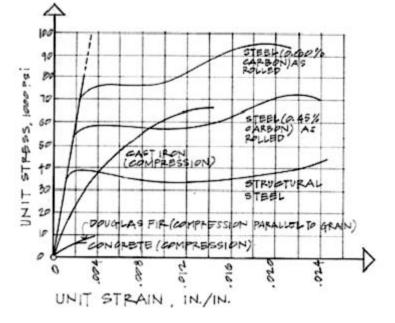


## Linear-Elastic Behavior

In the straight portion of the stress-strain diagram, the materials are *elastic*, which means if they are loaded and unloaded no permanent **deformation** occurs.

## **True Stress & Engineering Stress**

True stress takes into account that the area of the cross section changes with loading.

Engineering stress uses the original area of the cross section.



3

## Hooke's Law – Modulus of Elasticity

In the linear-elastic range, the slope of the stress-strain diagram is *constant*, and has a value of E, called Modulus of Elasticity or Young's Modulus.

 $f = E \cdot \varepsilon$ 

<u>Isotropic Materials</u> – have the **same** E with any direction of loading.

<u>Anisotropic Materials</u> – have **different** E's with the direction of loading.

Orthotropic Materials - have directionally based E's

Table D-1 Elastic moduli of select	ted materials
------------------------------------	---------------

	Modulus of elasticity E		Shear me	Shear modulus G		
Material	10 <sup>6</sup> psi	GPa	10 <sup>6</sup> psi	GPa	ratio <i>v</i>	
Aluminum	10	70	3.8	26	0.33	
Aluminum alloys	10-12	70-80	3.8-4.4	26-30	0.33	
2014-T6	10.6	73	4	28	0.33	
6061-T6	10	70	3.8	26	0.33	
7075-T6	10.4	72	3.9	27	0.33	
Brick (compression)	1.5-3.5	1024				
Cast iron	12-25	80-170	4.5-10	31–69	0.2-0.3	
Gray cast iron	14	97	5.6	39	0.25	
Concrete (compression)	2.6-4.4	18-30			0.1-0.2	
Copper	17	115	6.2	43	0.35	
Copper alloys	14-18	96-120	5.2-6.8	36-47	0.33-0.35	
Brass	14-16	96-110	5.2–6	36-41	0.34	
80% Cu, 20% Zn	15	100	5.5	38	0.33	
Naval brass	15	100	5.5	38	0.33	
Bronze	14-17	96-120	5.2-6.3	36-44	0.34	
Manganese bronze	15	100	5.6	39	0.35	
Glass	7-12	50-80	2.9–5	20-33	0.20-0.27	
Magnesium	5.8	40	2.2	15	0.34	
Nickel	30	210	11.4	80	0.31	
Nylon	0.3-0.4	2-3			0.4	
Rubber	0.0001-0.0006	0.001-0.004	0.00004-0.0002	0.0003-0.0014	0.44-0.50	
Steel	28-32	190-220	10.8-12.3	75–85	0.28-0.30	
Stone (compression)						
Granite	6–10	40–70			0.2-0.3	
Marble	7–14	50-100			0.2-0.3	
Titanium	16	110	5.8	40	0.33	
Titanium alloys	15-18	100-124	5.6-6.8	39–47	0.33	
Tungsten	52	360	22	150	0.2	
Wood (bending)						
Ash	1.5-1.6	10-11				
Oak	1.6-1.8	11-12				
Southern pine	1.6–2	11-14				
Wrought iron	28	190	10.9	75	0.3	

#### **Plastic Behavior & Fatigue**

Permanent deformations happen outside the linear-elastic range and are called *plastic* deformations. Fatigue is damage caused by reversal of loading.

- The <u>proportional limit</u> (at the end of the **elastic** range) is the greatest stress valid using Hooke's law.
- The <u>elastic limit</u> is the maximum stress that can be applied before permanent deformation would appear upon unloading.
- The <u>yield point (at the *yield stress*) is where a ductile material continues to elongate without an increase of load. (May not be well defined on the stress-strain plot.)</u>
- The <u>ultimate strength</u> is the largest stress a material will see before rupturing, also called the *tensile strength*.
- The <u>rupture strength</u> is the stress at the point of rupture or failure. It may not coincide with the ultimate strength in ductile materials. In brittle materials, it will be the same as the ultimate strength.
- The <u>fatigue strength</u> is the stress at failure when a member is subjected to reverse cycles of stress (up & down or compression & tension). This can happen at much lower values than the ultimate strength of a material.
- <u>Toughness</u> of a material is how much work (a combination of stress and strain) us used for fracture. It is the area under the stress-strain curve.

Concrete does not respond well to tension and is tested in compression. The strength at crushing is called the *compression strength*.

Materials that have time dependent elongations when loaded are said to have *creep*. Concrete and wood creep. Concrete also has the property of shrinking over time.

#### **Poisson's Ratio**

For an isometric material that is homogeneous, the properties are the same for the cross section:  $C_{1} = C_{2}$ 

$$\varepsilon_y = \varepsilon_z$$

There exists a linear relationship while in the linear-elastic range of the material between *longitudinal strain* and *lateral strain*:

$$\mu = -\frac{\text{lateral strain}}{\text{axial strain}} = -\frac{\varepsilon_y}{\varepsilon_x} = -\frac{\varepsilon_z}{\varepsilon_x} \qquad \qquad \varepsilon_y = \varepsilon_z = -\frac{\mu f_x}{E}$$

<u>Positive strain</u> results from an increase in length with respect to overall length. <u>Negative strain</u> results from a decrease in length with respect to overall length.

 $\mu$  is the <u>Poisson's ratio</u> and has a value between 0 and  $\frac{1}{2}$ , depending on the material


#### **Relation of Stress to Strain**

$$f = \frac{P}{A}$$
;  $\varepsilon = \frac{\delta}{L}$  and  $E = \frac{f}{\varepsilon}$  so  $E = \frac{P/A}{\delta/L}$  which rearranges to:  $\delta = \frac{PL}{AE}$ 

## **Orthotropic Materials**


One class of non-isotropic materials is *orthotropic materials* that have directionally based values of modulus of elasticity and Poisson's ratio (E,  $\mu$ ).


Ex: plywood, laminates, fiber reinforced polymers with direction fibers




In some sudden changes of cross section, the stress concentration changes (and is why we used *average* normal stress). Examples are sharp notches, or holes or corners.

(Think about airplane window shapes...)








#### **Maximum Stress**

When both normal stress and shear stress occur in a structural member, the maximum stresses can occur at some other planes (angle of  $\theta$ ).

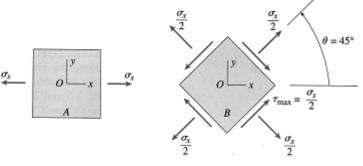

Maximum Normal Stress happens at  $\theta = 0^{\circ}$  AND

Maximum Shearing Stress happens at  $\theta = 45^{\circ}$  with only normal stress in the *x* direction.

## Allowable Stress Design (ASD) and Factor of Safety (F.S.)

There are uncertainties in material strengths:  $F.S = \frac{ultimate\ load}{allowable\ load} = \frac{ultimate\ stress}{allowable\ stress}$ 

Allowable stress design determines the allowable stress by: *allowable stress* =  $\frac{ultimate stress}{F.S}$ 

## Load and Resistance Factor Design – LRFD

There are uncertainties in material strengths and in structural loadings.

 $\gamma_D R_D + \gamma_L R_L \le \phi R_n$ 

where	$\gamma = $ load factor for Dead and Live load R = load (dead or live)	
	$\phi$ = resistance factor R <sub>n</sub> = nominal load (capacity)	

Nota	tion:	
A E	<ul> <li>area</li> <li>modulus of elasticity or Young's modulus</li> </ul>	$\varepsilon_t$ = thermal strain (no units) $\delta$ = elongation or length change
f L P P' α	<ul> <li>stress</li> <li>length</li> <li>name for axial force vector</li> <li>name of reaction force</li> <li>coefficient of thermal expansion for</li> </ul>	$\delta_P$ = elongation due to axial load $\delta_{restr}$ = restrained length change $\delta_T$ = elongation due or length change due to temperature $\Delta T$ = change in temperature
	a material	

# **Thermal Effects and Indeterminacy**

# **Thermal Strains**

Physical restraints limit deformations to be the same, or sum to **zero**, or be proportional with respect to the rotation of a rigid body.

We know axial stress relates to axial strain:


$$\delta = \frac{PL}{AE}$$
 which relates  $\delta$  to P

Deformations can be caused by the *material* reacting to a change in energy with temperature. In general (there are some exceptions):

- Solid materials can **contract** with a decrease in temperature.
- Solid materials can **expand** with an increase in temperature.

The change in length per unit temperature change is the *coefficient of thermal expansion*,  $\alpha$ .


It has units of  $\circ_F$  or  $\circ_C$  and the deformation is related by:  $\delta_{\tau} = \alpha(\Delta T)L$ 

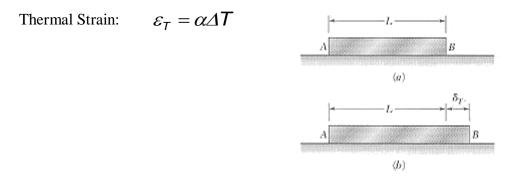

There is **no stress** associated with the length change with free movement, BUT if there are restraints, thermal deformations or strains *can cause internal forces and stresses*.

#### How A Restrained Bar Feels with Thermal Strain

- 1. Bar pushes on supports because the material needs to expand with an increase in temperature.
- 2. Supports push *back*.
- 3. Bar is restrained, can't move and the reaction causes internal *stress*.



# **Superposition Method**


If we want to solve a statically indeterminate problem that has extra support forces:

- We can remove a support or supports that *makes the problem look statically determinate*
- Replace it with a reaction and treat it like it is an applied force
- Impose geometry restrictions that the support imposes

For <u>Example</u>:

$$\delta_T = \alpha (\Delta T)L \qquad \qquad \delta_p = -\frac{PL}{AE}$$
$$\delta_P + \delta_T = 0 \qquad \qquad -\frac{PL}{AE} + \alpha (\Delta T)L = 0$$

$$P = \alpha(\Delta T)L\frac{AE}{L} = \alpha(\Delta T)AE$$
  $f = -\frac{P}{A} = -\alpha(\Delta T)E$ 

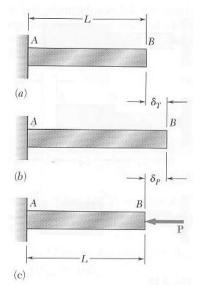


#### Example 1 (pg 228)


# Example Problem 6.24 (Figures 6.58 and 6.59)

A W8×67 steel beam, 20 ft. in length, is rigidly attached at one end of a concrete wall. If a gap of 0.010 in. exists at the opposite end when the temperature is  $45^{\circ}$ F, what results when the temperature rises to  $95^{\circ}$ F?

ALSO: If the beam is anchored to a concrete slab, and the steel sees a temperature change of  $50^{\circ}$  F while the concrete only sees a change of  $30^{\circ}$  F, determine the compressive stress in the beam.

$\alpha_c = 5.5 \text{ x } 10^{\text{-6}} \text{ /}^{\circ} \text{ F}$	$E_{c} = 3 \times 10^{6} \text{ psi}$
$\alpha_{\rm s} = 6.5 \text{ x } 10^{-6} \text{ /}^{\circ} \text{ F}$	$E_{s} = 29 \times 10^{6} \text{ psi}$





#### Example 2

**5.21** A short concrete column measuring 12 in. square is reinforced with four #8 bars ( $A_s = 4 \times 0.79$  in.<sup>2</sup> = 3.14 in.<sup>3</sup>) and supports an axial load of 250k. Steel bearing plates are used top and bottom to ensure equal deformations of steel and concrete. Calculate the stress developed in each material if:

 $E_c = 3 \times 10^6$  psi and  $E_s = 29 \times 10^6$  psi

Solution:

From equilibrium:

$$[\Sigma F_y = 0] - 250 \text{ k} + f_s A_s + f_c A_c = 0$$
  

$$A_s = 3.14 \text{ in.}^2$$
  

$$A_c = (12'' \times 12'') - 3.14 \text{ in.}^2 \cong 141 \text{ in.}^2$$
  

$$3.14 f_s + 141 f_c = 250 \text{ k}$$

From the deformation relationship:

$$\delta_s = \delta_c; \ L_s = L_c$$
$$\therefore \frac{\delta_s}{L} = \frac{\delta_c}{L}$$

and

 $\varepsilon_s = \varepsilon_c$ Since

$$E = \frac{f}{\epsilon}$$


and


$$\frac{f_s}{E_s} = \frac{f_c}{E_c}$$

$$f_s = f_c \frac{E_s}{E_c} = \frac{29 \times 10^3 (f_c)}{3 \times 10^3} = 9.67 f_c$$

Substituting into the equilibrium equation:

3.14  $(9.76 f_c) + 141 f_c = 250$ 30.4  $f_c + 141 f_c = 250$ 171.4  $f_c = 250$   $f_c = 1.46$  ksi  $\therefore f_s = 9.67$  (1.46) ksi  $f_s = 14.1$  ksi







# Sustainability Considerations in Materials

from <u>Fundamentals of Building Construction Materials & Methods</u>, 5th ed., Allen and Iano (2008)

# **CONSIDERATIONS OF SUSTAINABILITY IN WOOD CONSTRUCTION**

#### Wood: A Renewable Resource

Wood is the only major structural material that is renewable.

• In the United States and Canada, tree growth each year greatly exceeds the volume of harvested trees, though many timberlands are not managed in a sustainable manner.

• On other continents, many countries long ago felled the last of their forests, and many forests in other countries are being depleted by poor management practices and slashand-burn agriculture. Particularly in the case of tropical hardwoods, it is wise to investigate sources and to ensure that the trees were grown in a sustainable manner.

• Some panel products can be manufactured from rapidly renewable vegetable fibers, recoverable and recycled wood fibers, or recycled cellulose fibers.

• Bamboo, a rapidly renewable grass, can replace wood in the manufacture of flooring, interior paneling, and other finish carpentry applications. In other parts of the world, bamboo is used for the construction of scaffolding, concrete formwork, and even as the source of fibrous material for structural panels analogous to wood-based oriented strand board (OSB), particleboard, and fiberboard.

#### **Forestry Practices**

• Two basic forms of forest management are practiced in North America: sustainable forestry, and clearcutting and replanting. The clearcutting forest manager attains sustainable production by cutting all the trees in an area, leaving the stumps, tops, and limbs to decay and become compost, setting out new trees, and tending them until they are ready for harvest. In sustainable forestry, trees are harvested more selectively from a forest in such a way as to minimize damage to the forest environment and maintain the biodiversity of its natural ecosystem.

• Environmental problems often associated with logging of forests include loss of wildlife habitat, soil erosion, pollution of waterways, and air pollution from machinery exhausts and burning of tree wastes. A recently clearcut forest is a shockingly ugly tangle of stumps, branches, tops, and substandard logs left to decay. It is crisscrossed by deeply rutted, muddy haul roads. Within a few years, decay of the waste wood and new tree growth largely heal the scars. Loss of forest area may raise levels of carbon dioxide, a greenhouse gas, in the atmosphere, because trees take up carbon dioxide from the air, utilize the carbon for growth, and give back pure oxygen to the atmosphere.

• The buyer of wood products can support sustainable forestry practices by specifying products certified as originating from sustainable forests, those that are managed in a socially responsible and environmentally sound manner. FSC-certified wood products, for example, satisfy the requirements of LEED and all other major green building assessment programs.

#### **Mill Practices**

• Skilled sawyers working with modern computerized systems can convert a high percentage of each log into marketable wood products. A measure of sawmill performance is the lumber recovery factor (LRF), which is the net volume of wood products produced from a cubic meter of log.

• Manufactured wood products such as oriented strand board, particleboard, I-joists, and laminated strand lumber efficiently utilize most of the wood fiber in a tree and can be produced from recycled or younger-growth, rapidly renewable materials; finger-jointed lumber is made by gluing end to end short pieces of lumber that might otherwise be treated as waste. The manufacturer of large, solid timbers generates more unused waste and yields fewer products from each log.

• Kiln drying uses large amounts of fuel but produces more stable, uniform lumber than air drying, which uses no fuel other than sunlight and wind.

• Mill wastes are voluminous: Bark may be shredded to sell as a landscape mulch, composted, burned, or buried in a landfill. Sawdust, chips, and wood scraps may be burned to generate steam to power the mill, used as livestock bedding, composted, burned, or buried in a landfill.

• Many wood products can be manufactured with significant percentages of recoverable or recycled wood, plant fiber, or paper materials.

#### Transportation

• Because the major commercial forests are located in concentrated regions of the United States and Canada, most lumber must be shipped considerable distances. Fuel consumption is minimized by planing and drying the

lumber before it is shipped, which reduces both weight and volume.

• Some wood products can be harvested or manufactured locally or regionally.

## **Energy Content**

• Solid lumber has an embodied energy of roughly 1000 to 3000 BTU per pound (2.3 to 7.0 MJ/kg). An average 8-footlong  $2 \times 4$  (2.4-m-long  $38 \times 89$  mm) has an embodied energy of about 17,000 BTU (40 MJ). This includes the energy expended to fell the tree, transport the log, saw and surface the lumber, dry it in a kiln, and transport it to a building site.

• Manufactured wood products have higher embodied energy content than solid lumber, due to the glue and resin ingredients and the added energy required in their manufacture. The embodied energy of such products ranges from about 3000 to 7500 BTU per pound (7.0 to 17 MJ/kg).

• Wood construction involves large numbers of steel fasteners of various kinds. Because steel is produced by relatively energy-intensive processes, fasteners add considerably to the total energy embodied in a wood frame building.

• Wood does not have the lowest embodied energy of the major structural materials when measured on a pound-forpound basis. However, when buildings of comparable size, but structured with either wood, light gauge steel studs, or concrete, are compared, most studies indicate that those of wood have the lowest total embodied energy of the three. This is due to wood's lighter weight (or, more precisely, its lesser density) in comparison to these other materials, as well as the relative efficiency of the wood light frame construction system.

#### **Construction Process**

• A significant fraction of the lumber delivered to a construction site is wasted: It is cut off when each piece is sawed to size and shape and ends up on the scrap heap, which is usually burned or taken to a landfill. On-site cutting of lumber also generates considerable quantities of sawdust. Construction site waste can be reduced by designing buildings that utilize full standard lengths of lumber and full sheets of wood panel materials.

• Wood construction lends itself to various types of prefabrication that can reduce waste and improve the efficiency of material usage in comparison to on-site building methods.

#### Indoor Air Quality (IAQ)

• Wood itself seldom causes IAQ problems. Very few people are sensitive to the odor of wood.

• Some of the adhesives and binders used in gluelaminated lumber, structural composite lumber, and wood panel products can cause serious IAQ problems by giving off volatile organic compounds such as formaldehyde. Alternative products with low-emitting binders and adhesives are also available.

• Some paints, varnishes, stains, and lacquers for wood also emit fumes that are unpleasant and/or unhealthful.

• In damp locations, molds and fungi may grow on wood members, creating unpleasant odors and releasing spores to which many people are allergic.

## **Building Life Cycle**

• If the wood frame of a building is kept dry and away from fire, it will last indefinitely. However, if the building is poorly maintained and wood elements are frequently wet, wood components may decay and require replacement.

• Wood is combustible and gives off toxic gases when it burns. It is important to keep sources of ignition away from wood and to provide smoke alarms and easy escape routes to assist building occupants in escaping from burning buildings. Where justified by building size or type of occupancy, building codes require sprinkler systems to protect against the rapid spread of fire.

• When a building is demolished, wood framing members can be recycled directly into the frame of another building, sawn into new boards or timbers, or shredded as raw material for oriented-strand materials. There is a growing industry whose business is purchasing and demolishing old barns, mills, and factories and selling their timbers as *reclaimed lumber*.

A study commissioned by the Canadian Wood Council compares the full life cycle of three similar office buildings, one each framed with wood, steel, or concrete and all three operated in a typical Canadian climate. In this study, total embodied energy for the wood building is about half of that for the steel building and two-thirds of that for the concrete building. The wood building also outperforms the others in measures of greenhouse gas emissions, air pollution, solid waste generation, and ecological impact.

#### Fire-Resistive Heavy Timber Construction / 141

# **CONSIDERATIONS OF SUSTAINABILITY IN HEAVY TIMBER CONSTRUCTION**

In addition to the issues of sustainability of wood production and use that were raised in the previous chapter, there are issues that pertain especially to heavy timber frame construction:

It is wasteful to saw large, solid timbers from logs: In most instances, only one or two timbers can be obtained from a log, and it is often difficult to saw smaller boards from the leftover slabs.

Glue-laminated timbers and composite timbers utilize wood fiber much more efficiently than solid timbers.

Recycled timbers from demolished mills, factories, and barns are often available. Most of these are from old-growth forests in which trees grew slowly, producing fine-grained, dense wood. As a result, many have structural properties that are superior to those of new-growth timbers. Recycled timbers may be used as is, resurfaced to give them a new appearance, or resawn into smaller members. However, they often contain old metal fasteners. Unless these are meticulously found and removed, they can damage saw blades and planer knives, causing expensive mill shutdowns while repairs are made. Continuous bending action of beams may be created by splicing beams at points of inflection rather than over supports, as shown in Figures 4.15, 4.20 and 4.21. This reduces maximum bending moments, allowing timber sizes to be reduced substantially.

Timbers do not lose strength with age, although they do sag progressively if they are overloaded. When a heavy timber building is demolished at some time in the future, its timbers can be recycled, even if they were obtained as recycled material for the building that is being demolished.

A heavy timber frame enclosed with foam core sandwich or stressed-skin panels is relatively airtight and well insulated, with few thermal bridges. Heating and cooling of the building will consume relatively little energy.

The glues and finish coatings used with glue-laminated timbers may give off gases such as formaldehyde that can cause indoor air quality (IAQ) problems. It is wise to determine in advance what glues and coatings are to be used, and to avoid ones that may cause IAQ problems.

166 / Chapter 5 • Wood Light Frame Construction

# **CONSIDERATIONS OF SUSTAINABILITY IN WOOD LIGHT FRAME CONSTRUCTION**

In addition to the issues of sustainability of wood production and use that were raised in Chapter 3, there are issues that pertain especially to wood light frame construction:

• A wood light frame building can be designed to minimize waste in several ways. It can be dimensioned to utilize full sheets and lengths of wood products. Most small buildings can be framed with studs 24 inches (610 mm) o.c. rather than 16 inches (406 mm). A stud can be eliminated at each corner by using small, inexpensive metal clips to support the interior wall finish materials. If joists and rafters are aligned directly over studs, the top plate can be a single member rather than a double one. Floor joists can be spliced at points of inflection rather than over girders; this reduces bending moments and allows use of smaller joists. Roof trusses often use less wood than conventional rafters and ceiling joists.

• Laminated strand lumber and rim joists, wood I-joists, laminated veneer lumber beams and headers, glue-laminated girders, parallel strand lumber girders, and OSB sheathing are all materials that utilize trees more efficiently than solid lumber. Finger-jointed studs made up of short lengths of scrap lumber glued together may replace solid full-length wood studs.

• Framing carpenters can waste less lumber by saving cutoffs and reusing them rather than throwing them automatically on the scrap heap. In some localities, scrap lumber can be recycled by shredding it for use in OSB production. The burning of construction scrap should be discouraged because of the air pollution it generates.

• Although the thermal efficiency of wood light frame construction is inherently high, it can be improved substantially by various means, as shown in Figures 7.17–7.21. Wood framing is much less conductive of heat than light-gauge steel framing. Steel framing of exterior walls is not a satisfactory substitute for wood framing unless the heat flow path through the steel framing members can be broken with a substantial thickness of insulating foam.

#### 304 / Chapter 8 • Brick Masonry

# **CONSIDERATIONS OF SUSTAINABILITY IN BRICK MASONRY**

#### **Brick Masonry Materials**

• Mortar is made of minerals that are generally abundant in the earth. Portland cement and lime are energy-intensive products. (For more information about the sustainability of cement production, see Chapter 13.)

• Clay and shale, the raw materials for bricks, are plentiful. They are usually obtained from open pits, with the attendant disruption of drainage, vegetation, and wildlife habitat.

• Clay brick can include recycled brick dust, postindustrial wastes such as fly ash, and a variety of other waste products in their manufacture.

#### **Brick Manufacturing**

• Brick manufacturing plants are usually located close to the sources of their raw materials.

• Brick manufacturing produces few waste materials. Unfired clay is easily recycled into the production process. Fired bricks that are unusable are ground up and recycled into the production process or used as landscaping material.

• Brick manufacturing requires relatively large amounts of water. Water that doesn't evaporate can be reused many times. Little if any water need be discharged as waste.

• Because of the energy used in its firing, brick is a relatively energy-intensive product. Its embodied energy may range from about 1000 to 4000 BTU per pound (2.3-9.3 MJ/kg).

• The most common energy source for brick kilns is natural gas, although oil and coal are also used. Firing of clay masonry produces fluorine and chlorine emissions. Other types of air pollution can result from improperly regulated kilns.

• Most bricks are sold for use in regional markets close to their point of manufacture. This reduces the energy

required for shipping and makes much brick eligible for credit as a regional material.

#### **Brick Masonry Construction**

• Relatively small amounts of waste are generated on a construction site during brick masonry work, including partial bricks, unsatisfactory bricks, and unused mortar. These wastes generally go into landfills or are buried on the site.

• Sealers applied to brick masonry to provide water repellency and protection from staining are potential sources of emissions. Solvent-based sealers generally have higher emissions than water-based products.

#### **Brick Masonry Buildings**

• Brick masonry is not normally associated with any indoor air quality problems, although in rare circumstances it can be a source of radon gas.

• The thermal mass effect of brick masonry can be a useful component of fuel-saving heating and cooling strategies such as solar heating and nighttime cooling.

• Brick masonry is a durable form of construction that requires relatively little maintenance and can last a very long time.

• Construction with brick masonry can reduce reliance on paint finishes, a source of volatile organic compounds.

• Brick masonry is resistant to moisture damage and mold growth.

• When a brick building is demolished, sound bricks may be cleaned of mortar and reused (once their physical properties have been verified as adequate for the new use). Brick waste can be crushed and used for landscaping. Brick and mortar waste can also be used as on-site fill. Much such waste, however, is disposed of off-site in landfills.

## **CONSIDERATIONS OF SUSTAINABILITY IN STONE AND CONCRETE MASONRY**

#### **Stone and Concrete Masonry Materials**

• Stone is a plentiful but finite resource. It is usually obtained from open pits, with the attendant disruption of drainage, vegetation, and wildlife habitat.

• The detrimental impacts of stone quarrying can long outlive the buildings for which the stone was extracted.

• Quarry reclamation practices, such as revegetation, land reshaping, and habitat restoration, can mitigate some of the adverse environmental impacts of stone quarrying and convert exhausted quarry sites to other beneficial uses.

• Concrete used in the manufacture of masonry units may include recycled materials such as fly ash, crushed glass, slag, and other postindustrial wastes. For more information regarding the sustainability of concrete, see Chapter 13.

• Mortar used for stone and concrete masonry is made from minerals that are generally abundant in the earth. However, portland cement and lime are energy-intensive products to manufacture. For more information about the sustainability of cement production, see Chapter 13.

# Stone and Concrete Masonry Processing and Manufacturing

• Stone is heavy. It is expensive and energy intensive to transport. Stone may originate from local quarries or from sources in many places around the world. Fabrication may take place close to the source of the stone, close to the building site, or in some other location remote from both the stone's source and destination. Where uniquely sourced stones are desired or where specialized fabrication processes or skills are required, shipping over long distances may be required.

• The cutting, shaping, and polishing operations that take place during stone fabrication use large quantities of water that becomes contaminated with stone residue, lubricant, and abrasives. Water filtration and recycling systems can prevent contaminants from entering the wastewater stream and minimize water consumption.

• As much as one-half of quarried stone may become waste during fabrication. Depending on the type of stone, waste may be crushed and used as fill material on construction sites or as aggregate in concrete or asphalt. Stone with a strong color or other unique appearance qualities may be processed into aggregate for use in the manufacture of terrazzo, architectural concrete masonry units, or syntheic stone products. Much stone waste, however, is disposed of as landfill.

• The embodied energy of building stone can vary significantly with the source of the stone, fabrication processes, and distances and methods of shipping. Stone that is easily quarried and fabricated, and that is used locally, may have an embodied energy of as little as 300 to 400 BTU per pound (0.7–0.9 MJ/kg). On the other hand, stone that requires more effort and energy to extract and fabricate, and that is transported over long distances before arriving at the building site, may have an embodied energy 10 or even 20 times greater.

• Most concrete masonry units are manufactured in regional plants relatively close to their final end-use destinations.

• The use of lightweight concrete masonry reduces transportation-related costs and energy consumption.

• The embodied energy of concrete masonry units is slightly higher than that of the concrete from which they are made, due to the additional energy consumed in the curing of the units. Ordinary concrete masonry units have an embodied energy of approximately 250 BTU per pound (0.6 MJ/kg).

# Stone and Concrete Masonry Construction

• Relatively small amounts of waste are generated on a construction site during stone and concrete masonry construction, including, for example, stone cutoffs, partial blocks, and unused mortar. These wastes generally go into tandfills or are buried on the site.

• Sealers applied to stone and concrete masonry to provide water repellency and protection from staining are potential sources of emissions. Solvent-based sealers generally emit more air pollutants than water-based products.

#### Stone and Concrete Masonry Buildings

• Stone and concrete masonry are not normally associated with indoor air quality problems. In rare instances, stone aggregate in concrete or stone used in stone masonry has been found to be a source of radon gas emissions.

• The thermal mass effect of stone and concrete masonry can be a useful component of fuel-saving heating and cooling strategies such as solar heating and nighttime cooling.

• Stone and concrete masonry are dense materials that can effectively reduce sound transmission between adjacent spaces. • Stone and concrete masonry construction are noncombustible. Lightweight concrete masonry units are especially effective for construction of fire resistance rated assemblies.

• Lightweight concrete masonry units have greater thermal resistance than more dense concrete units, stone, or brick.

• Construction with stone or concrete masonry can reduce reliance on paint finishes, a source of volatile organic compounds.

• Stone and concrete masonry are durable forms of construction that require relatively little maintenance and can last a very long time.

• Stone and concrete masonry are resistant to moisture damage and mold growth.

• When a building with stone or concrete masonry is demolished, the stone or masonry units can be crushed and recycled for use as on-site fill or as aggregate for paving. Some building stone can be salvaged for new construction.

## **Concrete Masonry Sitework**

• Concrete masonry permeable pavers can facilitate on-site capture of storm water.

• Light-colored concrete pavers can lessen urban heat island effects.

• Interlocking concrete masonry units used in earth retaining walls are easily disassembled and reused

# **CONSIDERATIONS OF SUSTAINABILITY IN STEEL FRAME CONSTRUCTION**

# Manufacture

• The raw materials for steel are iron ore, coal, limestone, air, and water. The ore, coal, and limestone are minerals hose mining and quarrying cause disruption of land and loss of wildlife habitat, often coupled with pollution of errams and rivers. Coal, limestone, and low-grade iron ore are plentiful, but high-grade iron ore has been depleted in many areas of the earth.

• The steel industry has worked hard to reduce pollution of air, water, and soil, but much work remains to be done.

• Supplies of some alloying metals, such as manganese, chromium, and nickel, are becoming depleted.

• The manufacture of a ton of steel from iron ore by the basic oxygen process consumes 3170 pounds (1440 kg) of ore, 300 pounds (140 kg) of limestone, 900 pounds (410 kg) of coke (made from coal), 80 pounds (36 kg) of oxygen, and 2575 pounds (1170 kg) of air. In the process, 4550 pounds (2070 kg) of gaseous emissions are given off, and 600 pounds (270 kg) of slag and 50 pounds (23) of dust are generated. Further emissions emanate from the process of converting coal to coke.

• The embodied energy of steel produced from ore by the basic oxygen process is about 14,000 BTU per pound (33 MJ/kg). In modern facilities, scrap steel is typically added as an ingredient during this process, resulting in recycled materials content of 25 to 35 percent.

• Today, most structural steel in North America is made from recycled scrap by the electric arc furnace process; its embodied energy is approximately 4000 BTU per pound (9.3 MJ/kg), less than one-third that of steel made from ore. The recycled materials content of steel made by this process is 90 percent or higher.

• In North America, virtually all hot-rolled structural steel shapes are manufactured by the electric arc furnace process. Steel plate and sheet, used in the manufacture, for example, of light gauge steel members, decking, and hollow structural sections, may be produced by either the electric arc furnace or basic oxygen processes.

• Ninety-five percent or more of all structural steel used in North American building construction is eventually reorcled or reused, which is a very high rate. In a recent onerear period, 480 million tons (430 million metric tons) of strap steel were consumed worldwide. • Scrap used in the production of structural steel in minimills usually comes from sources within approximately 300 miles (500 km) of the mill. When the steel produced in such mills is then used for the construction of buildings not too far from the mill, the steel is potentially eligible for credit as a regionally extracted, processed, and produced material. This is most likely for the most commonly used steel alloys that are produced in the greatest number of mills. However, some less commonly produced steel alloys are only available from a limited number of mills or, in some cases, are produced solely overseas, and are not eligible for such a credit except for projects located fortuitously close to the mills where these particular types of steel are produced.

#### Construction

• Steel fabrication and erection are relatively clean, efficient processes, although the paints and oils used on steel members can cause air pollution.

• Steel frames are lighter in weight than concrete frames that would do the same job. This means that a steel building generally has smaller foundations and requires less excavation work.

• Some spray-on fireproofing materials can pollute the air with stray fibers.

## In Service

• Steel framing, if protected from water and fire, will last for many generations with little or no maintenance.

• Steel exposed to weather needs to be repainted periodically unless it is galvanized, given a long-lasting polymer coating, or made of more expensive stainless steel.

• Steel framing members in building walls and roofs should be thermally broken or insulated in such a way that they do not conduct heat between indoors and outdoors.

• When a steel building frame is demolished, its material is almost always recycled.

• Steel seldom causes indoor air quality problems, although surface oils and protective coatings sometimes outgas and cause occupant discomfort.

The Concept of Light Gauge Steel Construction / 491

#### CONSIDERATIONS OF SUSTAINABILITY IN LIGHT GAUGE STEEL FRAMING

In addition to the sustainability issues raised in the previeus chapter, which also apply here, the largest issue conterning the sustainability of light gauge steel construction whe high thermal conductivity of the framing members. If a dwelling framed with light gauge steel members is framed, insulated, and finished as if it were framed with wood, it will lose heat in winter at about double the rate of the equivalent wood structure. To overcome this limitation, energy codes now require light gauge steel framed buildings constructed in cold regions, including most of the continental United States, to be sheathed with plastic fram insulation panels in order to eliminate the extensive thermal bridging that can otherwise occur through the steel framing members. Even with insulating sheathing, careful attention must be given to avoid undesired thermal bridges. For example, on a building with a sloped roof, a significant thermal bridge may remain through the ceiling joist-rafter connections, as seen in Figure 12.4*b*. Foam sheathing on the inside wall and ceiling surfaces is one possible way to avoid this condition, but adding insulation to the inside of the metal framing exposes the studs and stud cavities to greater temperature extremes and increases the risk of condensation. It also still allows thermal bridging through the screws used to fasten interior gypsum wallboard to the framing. Though small in area, these thermal bridges can readily conduct heat and result in spots of condensation on interior finish surfaces in very cold weather.

#### 520 / Chapter 13 • Concrete Construction

# **CONSIDERATIONS OF SUSTAINABILITY IN CONCRETE CONSTRUCTION**

• Worldwide each year, the making of concrete consumes 1.6 billion tons (1.5 billion metric tons) of portland cement, 10 billion tons (9 billion metric tons) of sand and rock, and 1 billion tons (0.9 billion metric tons) of water, making the concrete industry the largest user of natural resources in the world.

• The quarrying of the raw materials for concrete in open pits can result in soil erosion, pollutant runoff, habitat loss, and ugly scars on the landscape.

• Concrete construction also uses large quantities of other materials—wood, wood panel products, steel, aluminum, plastics—for formwork and reinforcing.

• The total energy embodied in a pound of concrete varies, especially with the design strength. This is because higher-strength concrete relies on a greater proportion of portland cement in its mix, and the energy required to produce portland cement is very high in comparison to concrete's other ingredients. For average-strength concrete, the embodied energy ranges from about 200 to 300 BTU per pound (0.5-0.7 MJ/kg).

• There are various useful approaches to increasing the sustainability of concrete construction:

• Use waste materials from other industries, such as fly ash from power plants, slag from iron furnaces, copper slag, foundry sand, mill scale, sandblasting grit, and others, as components of cement and concrete.

• Use concrete made from locally extracted materials and local processing plants to reduce the transportation of construction materials over long distances.

• Minimize the use of materials for formwork and reinforcing.

• Reduce energy consumption, waste, and pollutant emissions from every step of the process of concrete construction, from quarrying of raw materials through the eventual demolition of a concrete building.

• In regions where the quality of the construction materials is low, improve the quality of concrete so that concrete buildings will last longer, thus reducing the demand for concrete and the need to dispose of demolition waste.

#### **Portland Cement**

• The production of portland cement is by far the largest user of energy in the concrete construction process, accounting for about 85 percent of the total energy required. Portland cement production also accounts for roughly 5 percent of all carbon dioxide gas generated by human activities worldwide and about 1.5 percent of such emissions in North America.

• Since 1970, the North American cement industry has reduced the amount of energy expended in cement production by one-third, and the industry continues to work toward further reductions.

• The manufacture of cement produces large amounts of air pollutants and dust. For every ton of cement clinker produced, almost a ton of carbon dioxide, a greenhouse gas is released into the atmosphere. Cement production accounts for approximately 1.5 percent of carbon dioxide emissions in the United States and 5 percent of carbon dioxide emissions worldwide.

• In the past 35 years, the emission of particulates from cement production has been reduced by more than 90 percent.

• The cement industry is committed to reducing greenhouse gas emissions per ton of product by 10 percent from 1990 levels by the year 2020. According to the Portland Cement Association, over concrete's lifetime, it reabsorbs roughly half of the carbon dioxide released during the original cement manufacturing process.

• The amount of portland cement used as an ingredient in concrete, and as a consequence, the energy required to produce the concrete, can be substantially reduced by the addition of certain industrial waste materials with cementing properties to the concrete mix. Substituting such supplementary cementitious materials, including fly ash, silica fume, and blast furnace slag, for up to half the portland cement in the concrete, can result in reductions in embodied energy of as great as one-third.

• When added to concrete, fly ash is most commonly substituted for portland cement at rates of between 15 and 25 percent. Mixes with even higher replacement rates, called *high-volume-fly-ash (HVFA) concrete*, are also finding increased acceptance. Concrete mixed with fly ash as an ingredient gains other benefits as well: It needs less water than normal concrete, its heat of hydration is lower, and it shrinks less, all characteristics that lead to a denser, more durable product. Research is underway to develop concrete mixes in which fly ash completely replaces all portland cement.

• Waste materials from other industries can also be used as cementing agents—wood ash and rice-husk ash are two examples. Used motor oil and used rubber vehicle tires can be employed as fuel in cement kilns. And while consuming waste products from other industries, a cement manufacturing plant can, if efficiently operated, generate virtually no solid waste itself.

# Aggregates and Water

• Sund and crushed stone come from abundant sources a many parts of the world, but high-quality aggregates are becoming scarce in some countries.

• lu rare instances, aggregate in concrete has been found to be a source of radon gas. Concrete itself is not associated with indoor air quality problems.

• Waste materials such as crushed, recycled glass, used foundry sand, and crushed, recycled concrete can subsitute for a portion of the conventional aggregates in concrete.

• Water of a quality suitable for concrete is scarce in many developing countries. Concretes that use less water by using superplasticizers, air entrainment, and fly ash could be helpful.

#### Wastes

• Asignificant percentage of fresh concrete is not used because the truck that delivers it to the building site contains more than is needed for the job. This concrete is often dumped on the site, where it hardens and is later removed and taken to a landfill for disposal. An empty transit-mix truck must be washed out after transporting each batch, which produces a substantial whume of water that contains portland cement particles, admixtures, and aggregates. These wastes can be recovered and recycled as aggregates and mixing water, but more concrete suppliers need to implement schemes for doing this.

#### Formwork

• Formwork components that can be reused many times have a clear advantage over single-use forms, which represent a large waste of construction material.

• Form release compounds and curing compounds should be chosen for low volatile organic compound content and biologradability.

• Insulating concrete forms eliminate most temporary formwork and produce concrete walls with high thermal insulating values.

## Reinforcing

• In North America, reinforcing bars are made almost entirely from recycled steel scrap, primarily junked automobiles. This reduces resource depletion and energy consumption significantly.

## **Demolition and Recycling**

• When a concrete building is demolished, its reinforcing steel can be recycled.

• In many if not most cases, fragments of demolished concrete can be crushed, sorted, and used as aggregates for new concrete. At present, however, most demolished concrete is buried on the site, used to fill other sites, or dumped in a landfill.

#### **Green Uses of Concrete**

• Pervious concrete, made with coarse aggregate only, can be used to make porous pavings that allow stormwater to filter into the ground, helping to recharge aquifers and reduce stormwater runoff.

• Concrete is a durable material that can be used to construct buildings that are long-lasting and suitable for adaptation and reuse, thereby reducing the environmental impacts of building demolition and new construction.

• In brownfield development, concrete fill materials can be used to stabilize soils and reduce leachate concentrations.

• Where structured parking garages (often constructed of concrete) replace surface parking, open space is preserved.

• Concrete's thermal mass can be exploited to reduce building heating and cooling costs by storing excess heat during overheated periods of the day or week and releasing it back to the interior of the building during underheated periods.

• Lighter-colored concrete paving reflects more solar radiation than darker asphalt paving, leading to lower paving surface temperatures and reduced urban heat island effects.

• Interior concrete slabs made with white concrete can improve illumination, visibility, and worker safety within interior spaces without the expense or added energy consumption of extra light fixtures or increasing the light output from existing fixtures. White concrete is made with white cement and white aggregates.

• Photocatalytic agents can be added to concrete used in the construction of roads and buildings. In the presence of sunlight, the concrete chemically breaks down carbon monoxide, nitrogen oxide, benzene, and other air pollutants.

# CONSIDERATIONS OF SUSTAINABILITY IN PRECAST CONCRETE CONSTRUCTION

In addition to the issues of sustainability of concrete construction that were raised in Chapter 13, there are issues that pertain especially to precast concrete construction:

Because of the higher-strength concrete mixes typically and in the production of precast concrete, its embodied energy is higher on a pound-for-pound basis than that of conventional concrete, generally falling in the range of 500 to BTU per pound (1.1-1.4 MJ/kg).

• Precast concrete production encourages the reuse of formwork, reducing waste. Wood and fiberglass forms can be used up to 50 times without major maintenance. Concrete and steel forms can be reused hundreds or thousands of times.

• Because precast concrete is manufactured in a conrolled, factory-like setting, raw materials are used more efficiently and less waste is produced. Gray water used in urious production processes, sand used in finishing, and large aggregate used to create voids in hollow planks can all be readily reused.

• In many cases, the optimized design of precast concrete results in elements that use less material than comparable sitecast concrete systems.

• Precast concrete elements with high-quality architectural finishes reduce the need for volatile organic compound-emitting paints or other finish coatings. Concrete is not easily damaged by moisture and does not support the growth of mold.

 Precast concrete wall panels with properly sealed joints have low permeability to air leakage, reducing building heating and cooling costs and contributing to good indoor air quality.

• Precast concrete wall panels can be reused when buildings are altered.

712 / Chapter 17 • Glass and Glazing

# **CONSIDERATIONS OF SUSTAINABILITY RELATING TO GLASS**

## **Glass Production**

• The major raw materials for glass—sand, limestone, and sodium carbonate—are finite but abundant minerals.

• The high embodied energy of glass manufactured using traditional methods, roughly 7000 BTU per pound (16 MJ/kg), can be reduced by as much as 30 to 65 percent as new, more energy efficient manufacturing technologies are introduced.

• Some glass production involves the generation of potentially unhealthful or pollution-causing waste materials. Traditional mirror glass manufacturing, for example, generates an acidic waste effluent with high concentrations of copper or lead. However, recently, mirror glass manufactured with more environmentally friendly production techniques has become available.

• Although glass bottles and containers are recycled into new containers at a high rate, there is little recycling of flat glass at the present time. Most old glass goes to landfills.

• Efforts are underway to find new uses for waste glass. For example, vitrified glass aggregate (glass that has been melted and rapidly quenched to trap heavy metals and other contaminants) can be reused in asphalt, concrete, construction backfill, roofing shingles, and ceramic tiles.

## Uses of Glass

• If it is not broken by accident or improper installation, glass lasts for a very long time with little degradation of quality, often much longer than most other building components.

• Glass is inert and does not affect indoor air quality. It is easily kept clean and free of molds and bacteria.

• The impact of glass on energy consumption can be very detrimental, very beneficial, or anything in between, depending on how intelligently it is used.

• If badly used, glass can contribute to summertime overheating from unwanted solar gain, excessive wintertime heat losses due to inherently low R-values, visual glare, wintertime discomfort caused by radiant heat loss from the body to cold glass surfaces, and condensation of moisture that can damage other building components.

• Well used, glass can bring solar heat into a building in winter and exclude it in summer, with attendant savings in heating and cooling energy. It can bring daylight into a building without glare, reducing both the use of electricity for lighting and the cooling load produced by that lighting.

• These benefits accrue over the entire life of the building, and the payoffs can be huge. Thus, glass is a key component of every energy-efficient building and a chief accomplice of the ill-informed designer in most energy-wasting buildings.

# **CONSIDERATIONS OF SUSTAINABILITY IN ALUMINUM CLADDING**

#### Manufacture

• The ore from which aluminum is refined, bauxite, is finite but relatively plentiful. The richest deposits are generally found in tropical areas, often where rain forests must be clearcut to facilitate mining operations.

• Aluminum is refined from bauxite by an electrolytic process that uses huge quantities of electricity. Aluminum smelters are often located near plentiful supplies of inexpensive hydroelectric power for this reason.

• The embodied energy in aluminum is roughly 100,000 BTU per pound (230 MJ/kg), seven times that of steel, making it one of the most energy-intensive materials used in construction.

• Large volumes of water are required for smelting. Wastewater from aluminum manufacture contains cyanide, antimony, nickel, fluorides, and other pollutants.

• Aluminum is recycled at a very high rate, due largely to industry efforts. Recycled aluminum is produced using only a fraction of the energy, approximately 5000 BTU per pound (12 MJ/kg), required to convert ore to aluminum.

• Aluminum extrusions are easy to produce and to form into cladding components. Their light weight saves transportation energy.

• Powder coatings for aluminum, which release no solvents into the atmosphere, are preferable environmentally to solvent-based coatings.

#### Construction

• Aluminum cladding is easy to erect because of its light weight and simple connections. Little waste or pollution is associated with the process. Scrap is readily recycled.

#### In Service

• Aluminum cladding seldom needs maintenance, lasts for a very long time, and can be recycled when a building is demolished.

• Because aluminum is highly conductive of heat, cladding components must be thermally broken.

• Aluminum foils used as vapor retarders, components of insulation systems, and radiant heat barriers save large amounts of heating and cooling energy. They are so thin that they consume little metal relative to the energy they can save over the lifetime of the building.

#### 890 / Chapter 23 • Interior Walls and Partitions

## **CONSIDERATIONS OF SUSTAINABILITY IN GYPSUM PRODUCTS**

#### Sources of Gypsum

• Naturally occurring gypsum is not renewable, but it is plentiful and widely distributed geographically.

• The majority of newly extracted gypsum is quarried in surface mines, with attendant risks of loss of wildlife habitat, surface erosion, and water pollution, as well as the problem of disposing of overburden and mine tailings.

• There is increasing use of *synthetic gypsum*, material recovered from power plant flue gases that would otherwise be sent to landfills, in the manufacture of gypsum construction materials. According to the Gypsum Association, approximately 1.5 million tons (1.4 million metric tons) of synthetic gypsum is used annually to produce about 7 percent of the U.S. construction industry's calcined gypsum. Some synthetic gypsums, however, contain toxic byproducts from the manufacturing processes in which they are produced and cannot be safely recycled into new construction materials.

#### **Gypsum Products Manufacturing**

• The calcining of gypsum involves temperatures that are not much higher than the boiling point of water, which means that the embodied energy of gypsum is relatively low, about 1200 BTU per pound (2.8 MJ/kg) for plaster and 2600 BTU per pound (6.0 MJ/kg) for gypsum board.

• The calcining process emits particulates of calcium sulfate, an inert, benign chemical, as dust.

• The paper faces of gypsum board are composed primarily of recycled newspapers.

• Some manufacturers produce gypsum board products made with as much as 95 percent recycled materials, including synthetic gypsum and recycled postconsumer waste paper.

#### **Gypsum Products on the Building Site**

• Approximately 15 million tons (14 million metric tons) of gypsum board are manufactured annually in the United States. On a typical construction site, about 10 to 12 percent of this material becomes waste.

• Gypsum board waste generated during construction can be minimized by sizing walls and ceilings to make efficient use of whole boards or by ordering custom-sized boards for nonstandard-size surfaces. • Gypsum board scrap can be permanently stored in the hollow cavities of finished walls, eliminating disposal and transportation costs and reducing the amount of material destined for landfills (though care must be taken not to create interference with the pulling of electrical wires at a later date).

• Some dust is generated by the cutting and sanding of gypsum board and plaster. This dust has not been tied to any specific illnesses, but it is a nuisance and a source of discomfort until the work is done and all the dust has been swept up and removed from the building. Remodeling and demolition also create large quantities of gypsum dust.

• Most installed gypsum products have extremely low emissions. Some joint compounds, however, may also be sources of emissions.

• Additives used in the manufacture of moisture-resistant and fire-resistant gypsum board are potential sources of volatile organic compound (VOC) emissions.

• Paints, wallcovering adhesives, and other products used to finish gypsum surfaces can be significant emitters of VOCs, and thus require care in selection and specification.

#### **Gypsum Disposal and Recycling**

• Gypsum board waste can be recycled back into the manufacture of new gypsum board products. Current efforts limit recycled content to no more than 15 or 20 percent, due to the amount of paper waste that can be safely introduced into the new gypsum without impairing its fire resistance.

• Gypsum board waste from the demolition of older buildings may be contaminated with nails, drywall tape, joint compound, and paint. Gypsum board demolished from buildings constructed prior to 1978 may be coated with lead-based paint. These foreign materials must be removed from the waste; their presence may limit the material's recycling potential.

• Gypsum board waste can be used as a soil amendment and plant nutrient. With the recent advent of mobile grinders, construction site recycling of gypsum board waste for use as a soil amendment on the same building site is now feasible.

• Gypsum is an ingredient in many manufacturing and industrial processes. Studies and small-scale tests currently underway to identify potential uses of gypsum board waste in such processes are likely to lead to additional recycling opportunities in the future.

# **Beam Structures and Internal Forces**

# Notation:


а	= algebraic quantity, as is $b, c, d$	R	= name for reaction force vector
A	= name for area	(T)	= shorthand for <i>tension</i>
b	= intercept of a straight line	V	= internal shear force
d	= calculus symbol for differentiation	V(x)	= internal shear force as a function of
(C)	= shorthand for <i>compression</i>		distance <i>x</i>
F	= name for force vectors, as is $P, F', P'$	W	= name for distributed load
	= internal axial force	W	= name for total force due to distributed
$F_x$	= force component in the x direction		load
$F_{v}$	= force component in the y direction	х	= horizontal distance
2	= free body diagram	у	= vertical distance
L	= beam span length	0	= symbol for order of curve
m	= slope of a straight line	1	= symbol for integration
M	= internal bending moment	Ā	= calculus symbol for small quantity
M(x)	= internal bending moment as a	Σ	= summation symbol
	function of distance <i>x</i>	-	

# • BEAMS


- Important type of structural members (floors, bridges, roofs)
- Usually long, straight and rectangular
- Have loads that are usually perpendicular applied at points along the length


# Internal Forces 2

- Internal forces are those that hold the parts of the member together for equilibrium
  - Truss members:




- For any member:
  - F = internal *axial force* (perpendicular to cut across section)
  - V = internal *shear force* (parallel to cut across section)
  - M = internal *bending moment*






# Support Conditions & Loading

- Most often loads are perpendicular to the beam and cause <u>only</u> internal shear forces and bending moments
- Knowing the internal forces and moments is *necessary* when designing beam size & shape to resist those loads
- Types of loads
  - Concentrated single load, single moment
  - Distributed loading spread over a distance, uniform or **non-uniform**.
- Types of supports
  - *Statically determinate*: simply supported, cantilever, overhang (number of unknowns < number of equilibrium equations)
  - *Statically indeterminate*: continuous, fixed-roller, fixed-fixed (number of unknowns < number of equilibrium equations)








М


# **Sign Conventions for Internal Shear and Bending Moment** (<u>different</u> from statics and truss members!)

When  $\Sigma F_y$  \*\*excluding V\*\* on the left hand side (LHS) section is <u>positive</u>, V will direct <u>down</u> and is considered <u>POSITIVE</u>.

When  $\Sigma M$  \*\*excluding M\*\* about the cut on the left hand side (LHS) section causes a smile which could hold water (curl upward), M will be <u>counter clockwise</u> (+) and is considered <u>POSITIVE.</u>

On the deflected shape of a beam, the point where the shape changes from smile up to frown is called the *inflection point*. The bending moment value at this point is **zero**.





# **Shear And Bending Moment Diagrams**

The plot of shear and bending moment as they vary across a beam length are *extremely important design tools:* V(x) is plotted on the y axis of the shear diagram, M(x) is plotted on the y axis of the moment diagram.

The *load* diagram is essentially the free body diagram of the beam *with the actual loading (not the equivalent of distributed loads.)* 

Maximum Shear and Bending – The maximum value, regardless of sign, is important for design.

# Method 1: The Equilibrium Method

Isolate FDB sections at significant points along the beam and determine V and M at the cut section. The values for V and M can also be written in equation format as functions of the distance to the cut section.

Important Places for FBD cuts

- at supports
- at concentrated loads
- at start and end of distributed loads
- at concentrated moments

# Method 2: The Semigraphical Method

Relationships exist between the loading and shear diagrams, and between the shear and bending diagrams.

Knowing the *area* of the loading gives the *change in shear* (V).

Knowing the *area* of the shear gives the *change in bending moment* (*M*).

Concentrated loads and moments cause a vertical jump in the diagram.

 $\frac{\Delta V}{\Delta x} = \frac{dV}{dx} = -w \qquad \text{(the negative shows it is down because we give w a positive value)}$  $V_D - V_C = -\int_{x_C}^{x_D} w dx = \text{the area under the load curve between C & D}$  $* <u>These shear formulas are NOT VALID at discontinuities like concentrated loads}</u>$ 

$$\frac{\Delta M}{\frac{\Delta x}{\lim 0}} = \frac{dM}{dx} = V$$

$$M_D - M_C = \int_{x_C}^{x_D} V dx = \text{the area under the shear curve between C & D}$$
\* These moment formulas ARE VALID even with concentrated loads.

\*These moment formulas are NOT VALID at discontinuities like applied moments.

The MAXIMUM BENDING MOMENT from a curve that is <u>continuous</u> can be found when the slope is zero  $\left(\frac{dM}{dx} = 0\right)$ , which is when the value of the shear is 0.

#### Basic Curve Relationships (from calculus) for y(x)

<u>Horizontal Line</u>: y = b (*constant*) and the area (change in shear)  $= b \cdot x$ , resulting in a:

Sloped Line: y = mx + b and the area (change in shear)  $= \frac{\Delta y \cdot \Delta x}{2}$ , resulting in a:

<u>Parabolic Curve</u>:  $y = ax^2 + b$  and the area (change in shear)  $= \frac{\Delta y \cdot \Delta x}{3}$ , resulting in a:

<u>3<sup>rd</sup> Degree Curve</u>:  $y = ax^3 + bx^2 + cx + d$ 

Free Software Site: http://www.rekenwonder.com/atlas.htm










#### BASIC PROCEDURE:

1. Find all support forces.

# V diagram:

- 2. At free ends and at simply supported ends, the shear will have a zero value.
- 3. At the left support, the shear will equal the reaction force.




- 5. At the right support, the reaction is treated just like the loads of step 4.
- 6. At the free end, the shear should go to zero.

# M diagram:

- 7. At free ends and at simply supported ends, the moment will have a zero value.
- 8. At the left support, the moment will equal the reaction moment (if there is one).
- 9. The moment will not change in x until there is another load or applied moment, where the moment is reduced if the applied moment is negative. If there is a value for shear on the V diagram, the change in moment is the area under the shear diagram.

*For a triangle in the shear diagram, the width will equal the height*  $\div$  *w*!

- 10. At the right support, the moment reaction is treated just like the moments of step 9.
- 11. At the free end, the moment should go to zero.

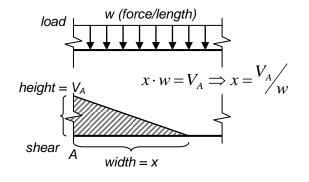


# Parabolic Curve Shapes Based on Triangle Orientation

In order to tell if a parabola curves "up" or "down" from a triangular area in the preceding diagram, the orientation of the triangle is used as a reference.


# Geometry of Right Triangles

Similar triangles show that four triangles, each with <sup>1</sup>/<sub>4</sub> the area of the large triangle, fit within the large triangle. This means that <sup>3</sup>/<sub>4</sub> of the area is on one side of the triangle, if a line is drawn though the middle of the base, and <sup>1</sup>/<sub>4</sub> of the area is on the other side.




By how a triangle is oriented, we can determine the curve shape in the next diagram.


<u>CASE 1</u>: *Positive* triangle with fat side to the *left*.




<u>CASE 2</u>: *Positive* triangle with fat side to the *right*.



CASE 3: Negative triangle with fat side to the *left*.




<u>CASE 4</u>: *Negative* triangle with fat side to the *right*.





# Example 1 (pg 273)


# Example Problem 8.1 (Equilibrium Method)


Draw the shear and moment diagram for a simply supported beam with a single concentrated load (Figure 8.8), using the equilibrium method. Verify the general equation from Beam Diagrams & Formulas.







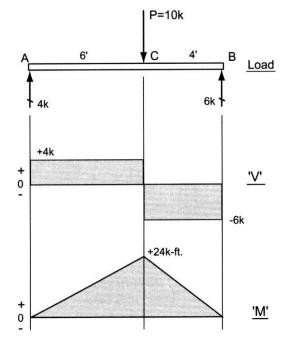





# Example 2 (pg 275)

# Example Problem 8.2(Equilibrium Method)

Draw V and M diagrams for an overhang beam (Figure 8.12) loaded as shown. Determine the critical  $V_{\rm max}$  and  $M_{\rm max}$  locations and magnitudes.


P=10k



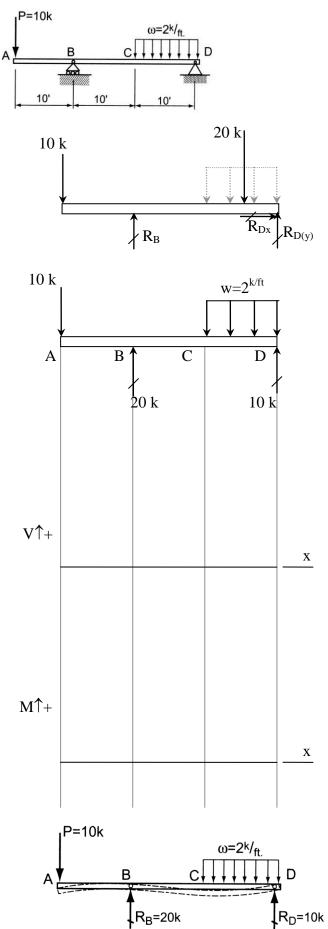

# Example 3 (pg 283) Example Problem 8.4


Construct the V and M diagrams for the girder that supports three concentrated loads as shown in Figure 8.28.

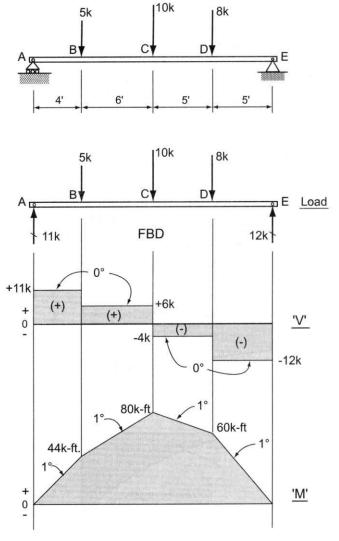

# Example 4 (pg 285)

# Example Problem 8.6 (Semi-Graphical Method)


Construct V and M diagrams for the simply supported beam *ABC*, which is subjected to a partial uniform load (Figure 8.30).

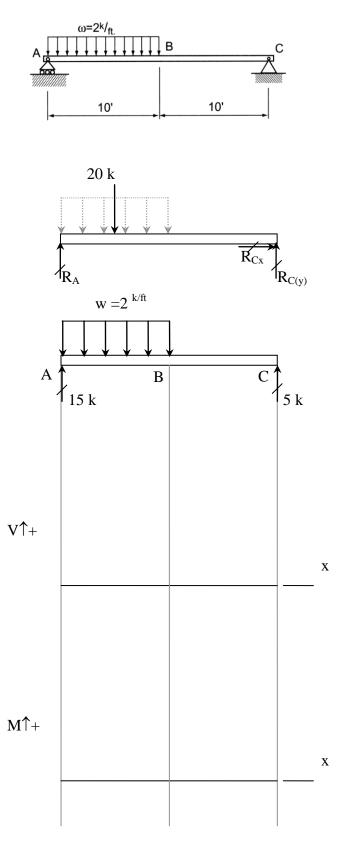


# Example 5 (pg 286)

# Example Problem 8.7 (Figure 8.31)

For a cantilever beam with an upturned end, draw the load, shear, and moment diagrams.

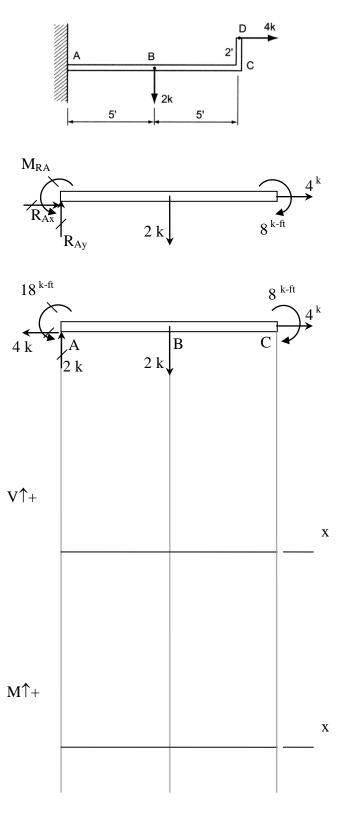

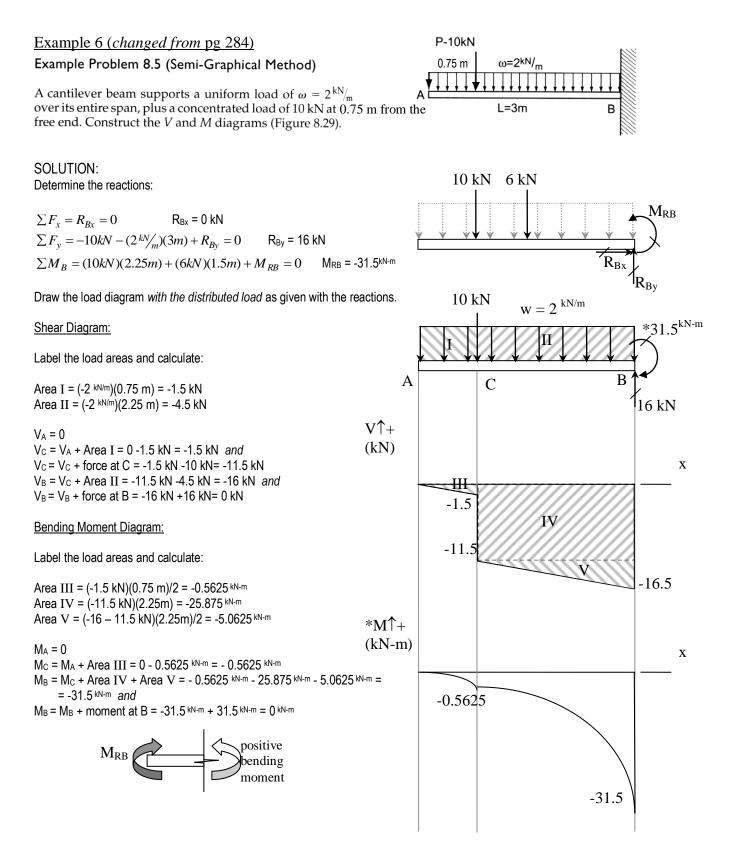

#### Example 7 (pg 287) Example Problem 8.9 (Figure 8.33)

A header beam spanning a large opening in an industrial building supports a triangular load as shown. Construct the V and M diagrams and label the peak values.

SOLUTION: Determine the reactions:

 $\Sigma F_x = R_{Bx} = 0 \qquad \text{R}_{\text{Bx}} = 0 \text{ kN}$  $\Sigma F_y = R_{Ay} - (300 \text{ N/m})(3m) \frac{1}{2} + -(300 \text{ N/m})(3m) \frac{1}{2} + R_{By} = 0$ 

or by load tracing  $R_{Ay} \& R_{By} = (wL/2)/2 = (300 \text{ N/m})(6 \text{ m})/4 = 450 \text{ N}$ 

 $\sum M_A = -(450N)(\frac{2}{3} \times 3m) - (450N)(3 + \frac{1}{3} \times 3m) + R_{By}(6m) = 0$ R<sub>By</sub> = 450 N

Draw the load diagram with the distributed load as given with the reactions.

#### Shear Diagram:

Label the load areas and calculate:

Area I = (-300 <sup>N/m</sup>)(3 m)/2 = -450 N Area II = -300 <sup>N/m</sup>)(3 m)/2 = -450 N

 $\begin{array}{l} V_A = 0 \; and \; V_A = V_A + \text{force at } A = 0 + 450 \; N = 450 \; N \\ V_C = V_A + \text{Area I} = 450 \; N \; -450 \; N = 0 \; N \\ V_B = V_C + \text{Area II} = 0 \; N - 450 \; N = -450 \; N \; and \\ V_B = V_B + \text{force at } B = -450 \; N + 450 \; N = 0 \; N \end{array}$ 

Bending Moment Diagram:


Label the load areas and calculate:

Areas III & IV happen to be parabolic segments with an area of 2bh/3: Area III = 2(3 m)(450 N)/3 = 900 N-mArea IV = -2(3 m)(450 N)/3 = -900 N-m

We can prove that the area is a parabolic segment by using the equilibrium method at C:

$$\sum M_{\text{sectioncut}} = M_C - (450N)(3m) + (450N)(\frac{1}{3} \times 3m) = 0$$
  
so M<sub>c</sub> = 900 <sup>N-m</sup>  
450 N

450 N

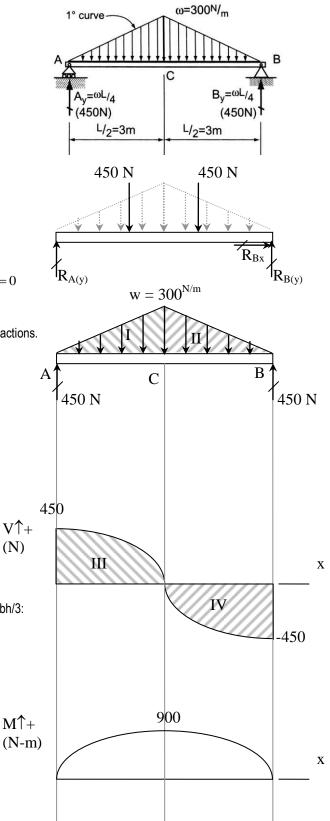


V

# **Beam Analysis Using Multiframe**

- 1. The software is on the computers in the College of Architecture in Programs under the Windows Start menu (see <u>https://wikis.arch.tamu.edu/display/HELPDESK/Computer+Accounts</u> for lab locations). Multiframe is under the Bentley Engineering menu.
- 2. There available on line at <u>http://www.formsys.com/mflearning</u> that list the tasks and order in greater detail. The first task is to define the unit system:
  - Choose Units... from the View menu. Unit sets are available, but specific units can also be selected by double clicking on a unit or format and making a selection from the menu.

nit Set:	Lor	ifiguration:				
American		Unit Type	Unit	Decimal Places	Format	~
Australian British Canadian European Japanese	1	Length	ft 💌	3	Fixed Decimal	
	2	Angle	deg	3	Fixed Decimal	
	3	Deflection	ection in		Fixed Decimal	
	4	Rotation	deg	3	Fixed Decimal	
	5	Force	kip	3	Fixed Decimal	=
	6	Moment	lbf-ft	3	Fixed Decimal	
	7	Dist. Force	lbf/ft	3	Fixed Decimal	
	8	Stress	ksi	3	Fixed Decimal	
	9	Mass	lb	3	Fixed Decimal	
	10	Mass/Length	lb/ft	3	Fixed Decimal	
	11	Area	in²	3	Fixed Decimal	
	12	Mmt of Inertia	in^4	3	Fixed Decimal	
	13	Density	lb/ft³	3	Fixed Decimal	
	14	Section Modulus	in³	3	Fixed Decimal	
	<			<u> </u>		2

- 3. To see the scale of the geometry, a grid option is available:
  - Choose Grid... from the View menu



4. To create the geometry, you must be in the Frame window (default). The symbol is the frame in the window toolbar:

The Member toolbar shows ways to create members:

The Generate toolbar has convenient tools to create typical structural shapes.

┉◝∩▤◬▦▨∞


• To create a beam with supports at one or both ends, use the add member button:



- Select a starting point and ending point with the cursor. The location of the cursor and the segment length is displayed at the bottom of the geometry window.
- To create a beam with supports NOT at the ends, use the add connected members button to create segments between supports and ends


 ' N *	

- Select a starting point and ending point with the cursor. The location of the cursor and the segment length is displayed at the bottom of the geometry window. The ESC button will end the segmented drawing.
- The geometry can be set precisely by selecting the beam member, bringing up the specific menu (right click), choosing Member Properties to set the length.

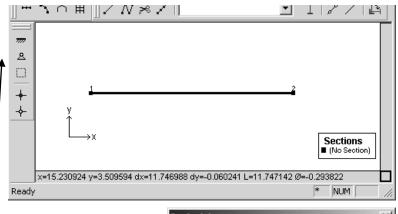

• The support types can be set by selecting the joint (drag) and using the Joint Toolbar (pin shown), or the Frame / Joint Restraint ... menu (right click).

NOTE: If the support appears at both ends of the beam, you had the beam selected rather than the joint. Select the joint to change the support for and right click to select the joint restraints menu or select the correct support on the joint toolbar.



The support forces will be determined in the analysis.

- 5. All members must have sections assigned (see section 6.) in order to calculate reactions and deflections. To use a standard steel section **proceed to step 6.** For custom sections, the section information must be entered. To define a section:
  - Choose Edit Sections / Add Section... from the Edit menu
  - Type a name for your new section
  - Choose group <u>Frame</u> from the group names provided so that the section will remain with the file data
  - Choose a shape. The Flat Bar shape is a rectangular section.
  - Enter the cross section data.

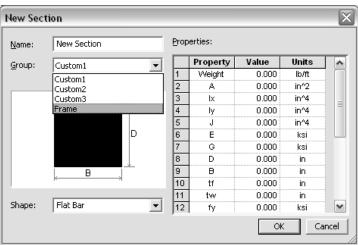


Table values 1-9 must have values for a Flat Bar, but not all are used for every analysis. A recommendation is to put the value of 1 for those properties you don't know or care about. Properties like t<sub>f</sub>, t<sub>w</sub>, etc. refer to wide flange sections.

- Answer any query. If the message says there is an error, the section will not be created until the error is corrected.
- 6. The standard sections library loaded is for the United States. If another section library is needed, use the Open Sections Library... command under the file menu, choose the library folder, and select the SectionsLibrary.slb file.

Select the members (drag to make bold) and assign sections with the Section button on the Member toolbar:



Choose the group name and section name:

(STA	ANDARD SHAPE	S)		(CUSTOM)	
Select Section		$\overline{\mathbf{X}}$	Select Section		×
Eroup: W M S WT MT ST C MC HP Angle Double Angle Pipe Sq. Tube Rect Tube	Section:           ₩44x335           ₩44x290           ₩44x285           ₩44x285           ₩44x285           ₩44x285           ₩44x248           ₩44x230           ₩44x230           ₩44x230           ₩40x855           ₩40x855           ₩40x855           ₩40x5531           ₩40x4303           ₩40x436		Group: HP Angle Double Angle Pipe Sq. Tube Rect Tube HSS Round HSS Square HSS Rectangular Custom1 Custom2 Custom3 Frame	Section:	OK Cancel

- 7. The beam geometry is complete, and in order to define the load conditions you must be in the Load window represented by the green arrow:

N

些 ₺

1.0

- 8. The Load toolbar allows a joint to be loaded with a force or a moment in global coordinates, shown by the first two buttons after the display numbers button. It allows a member to be loaded with a distributed load, concentrated load or moment (next three buttons) in global coordinates, as well as loading with distributed or single force or moment in the local coordinate system (next three buttons). It allows a load panel to be loaded with a distributed load in global or local coordinates (last two buttons).
  - Choose the member to be loaded (drag) and select the load type (here shown for global distributed loading):



\* \* \*


ሡ

- Choose the distribution type and direction. Note that the arrow shown is the direction of the loading. There is no need to put in negative values for downward loading.
- Enter the values of the load and distances (if any). Distances can be entered as a function of the length , i.e. L/2, L/4...


# *NOTE: <u>Do not</u> put support reactions as applied loads. The analysis will determine the reaction values.*

Multiframe will automatically generate a grouping called a Load Case named <u>Load</u> <u>Case 1</u> when a load is created. All additional loads will be added to this load case unless a new load case is defined (Add case under the Case menu).

- 9. In order to run the analysis after the geometry, member properties and loading has been defined:
  - Choose Linear from the Analyze menu
- 10. If the analysis is successful, you can view the results in the Plot window represented by the red moment diagram:




- To show the moment diagram, Choose the red Moment button
- To show the shear diagram, Choose the green Shear button
- To show the axial force diagram, Choose the purple Axial Force button
- To show the deflection diagram, Choose the blue Deflection button
- To animate the deflection diagram, Choose Animate... from the Display menu. You can also save the animation to a .avi file by checking the box.

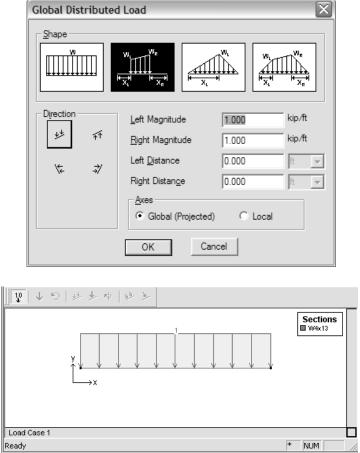













- To plot the bending moment on the "top" choose Preferences from the Edit menu and under the Presentation tab Draw moments on the compression face
- To see exact values of shear, moment and deflection, double click on the member and move the vertical cross hair with the mouse. The ESC key will return you to the window.

Mz'	2
vy	_2
dy'	
1	2
1	2
I : Mz' 31.376904 kip-ft Vy' 0.000000 kip dy' -561.925152 in 1	Max Mz' 31.376904 kip-ft Max Vy' 7.921777 kip Maax dy' 561.925152 in
vVy' -1.000000 kip/ft Dist 7.921687 ft	Max Wy' 1.000000 kip/ft Dist 7.921687 ft
static Case: Load Case 1 Member 1 P1 eady	* NUM

12. The Data window (D) allows you to view all data "entered" for the geometry, sections and loading. These values can be edited.



13. The Results window (R) allows you to view all results of the analysis including displacements, reactions, member forces (actions) and stresses. These values can be cut and pasted into other Windows programs such as Word or Excel.


Static Case: Load Case 1									
	Joint	Label	Rx' kip	Ry' kip	Mz' Ibf-ft				
1	1		0.000	7.922	0.000				
2	2		0.000	7.922	0.000				
3	Total	(Global)	Rx=0.000	Ry=15.844					
A Reactions & Member Actid									
Ready						*			

Memb	Label	Joint	Px' kip	Vy' kip	Mz' Ibf-ft
 1		1	0.000	7.922	0.000
1		2	0.000	7.922	0.000


NOTE: Px' refers to the axial load (P) in the local axis x direction (x'). Vy' refers to the shear perpendicular to the local x axis, and Mz' refers to the bending moment.

Ready


- 14. To save the file Choose Save from the File menu.
- 15. To load an existing file Choose Open... from the File menu.
- 16. To print a plot Choose Print Window... from the File menu. As an alternative, you may copy the plot (Ctrl+c) and paste it in a word processing document (Ctrl+v).

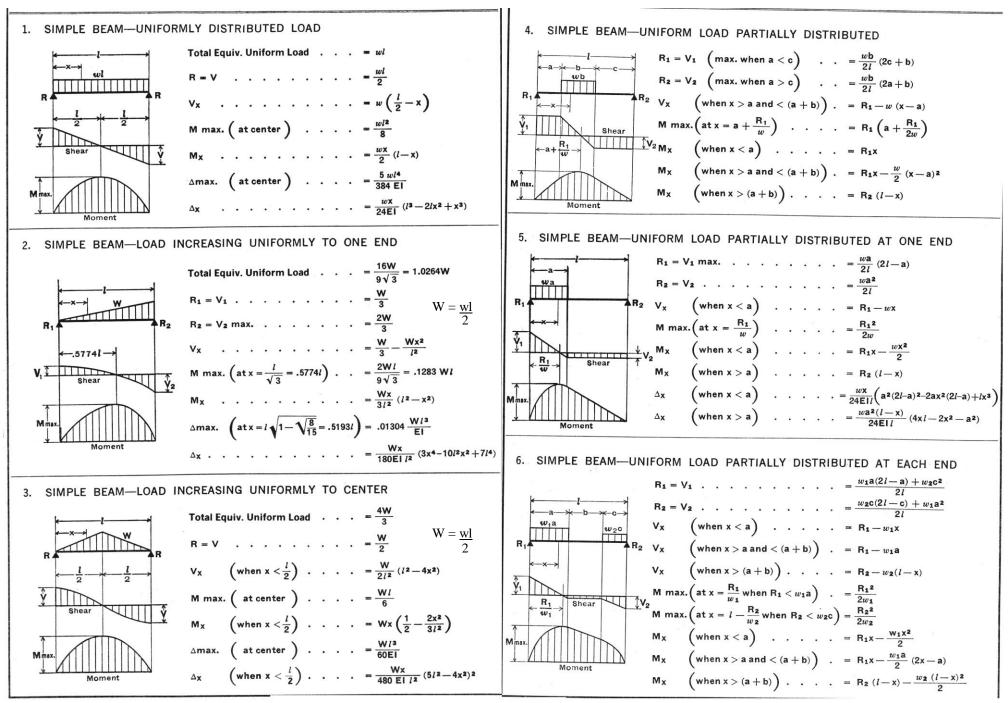


Note Set 8.2 (page 2)

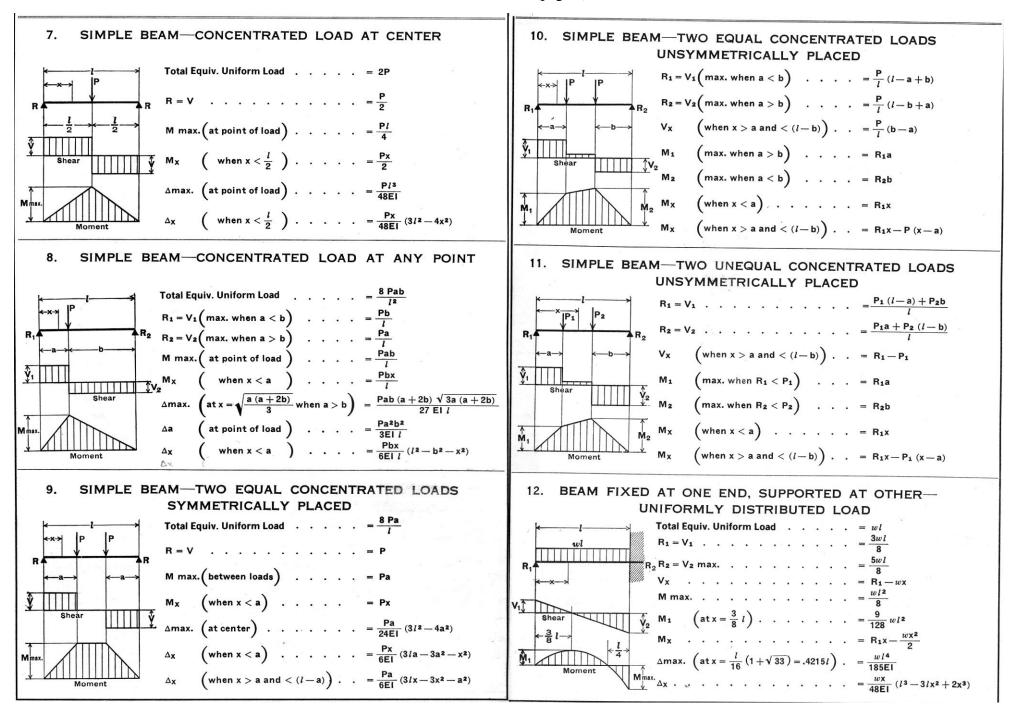


Note Set 8.2 (page 3)

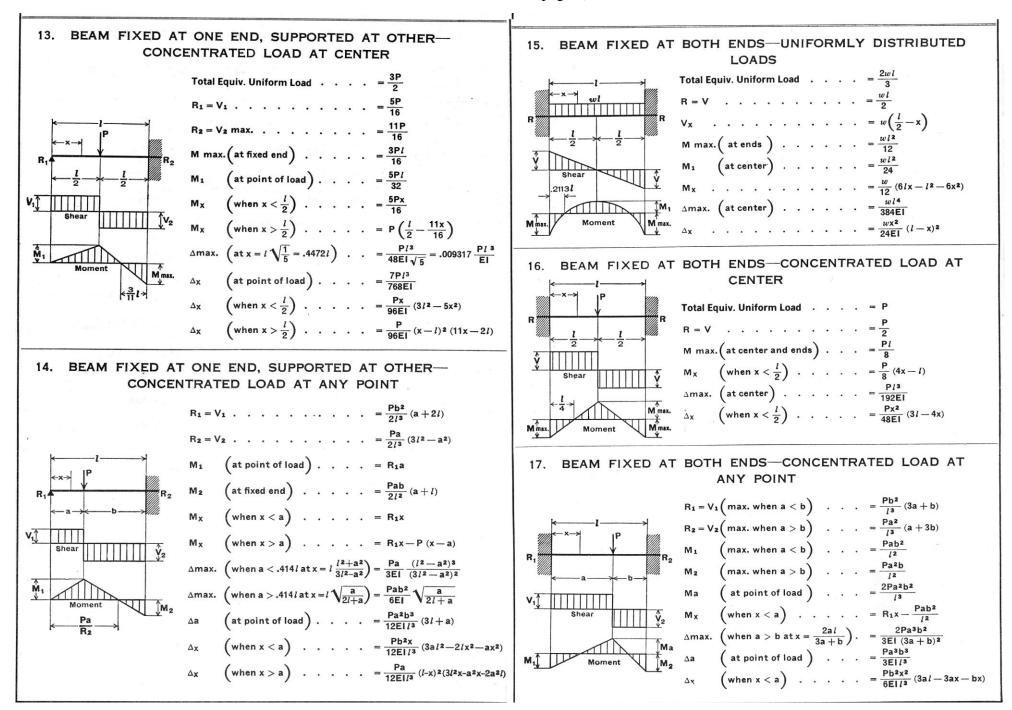


Note Set 8.2 (page 4)

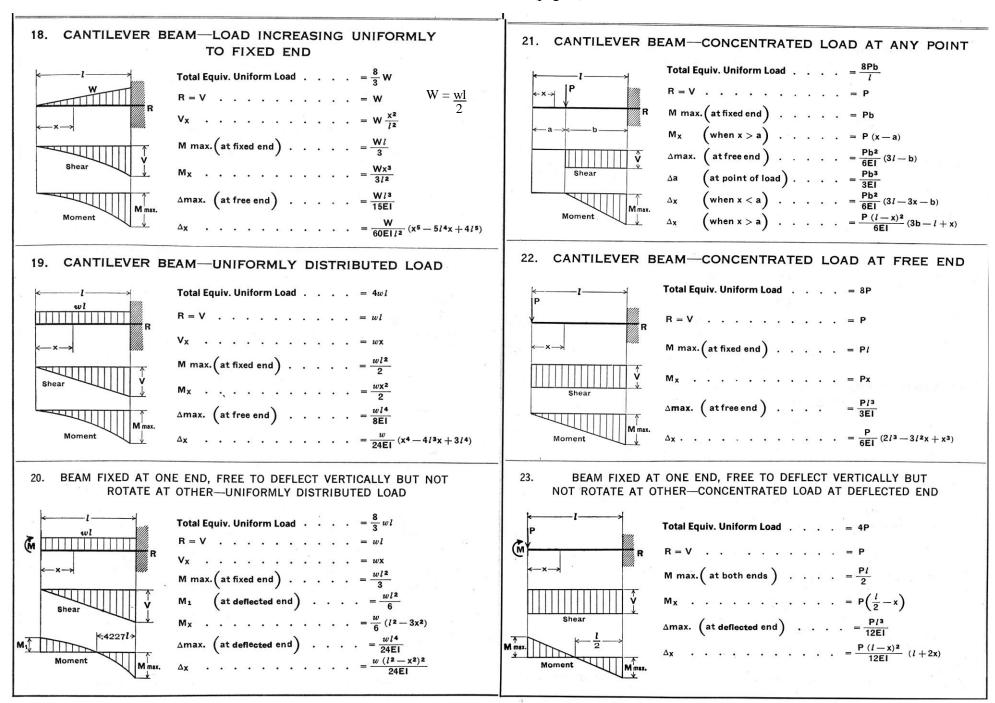


Note Set 8.2 (page 5)

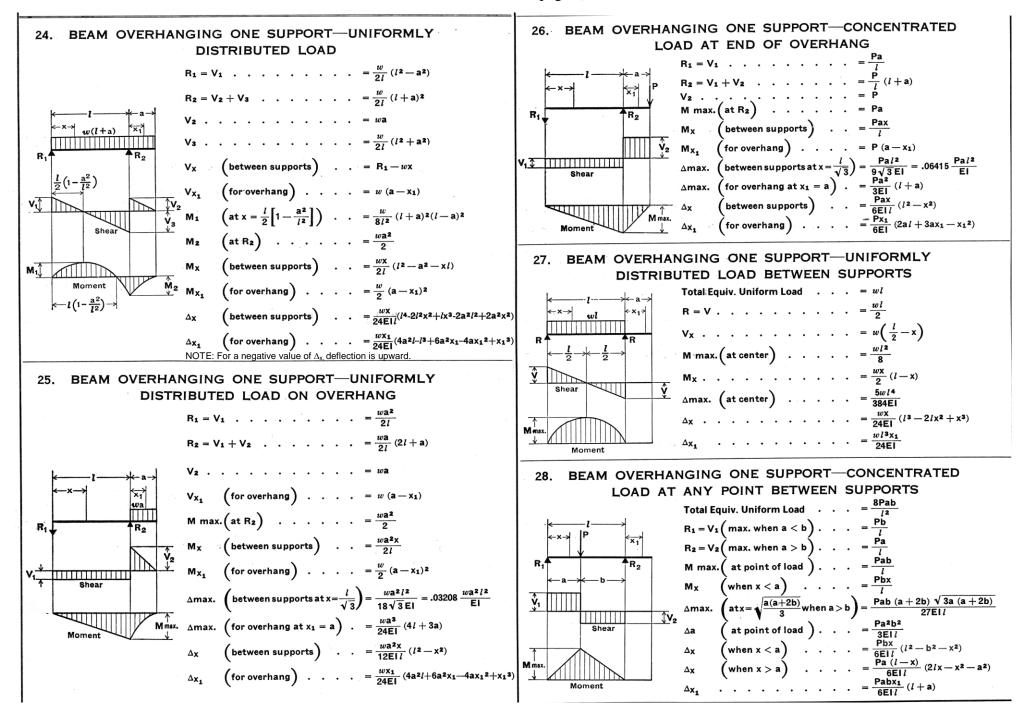

Note Set 8.2 (page 6)

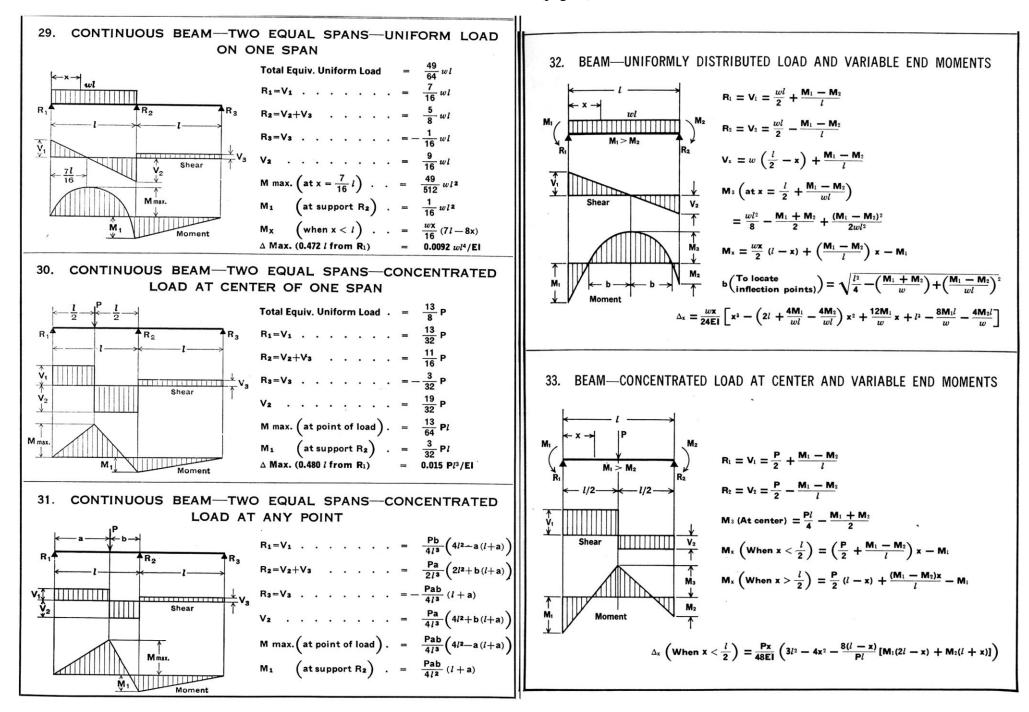


Note Set 8.2 (page 7)

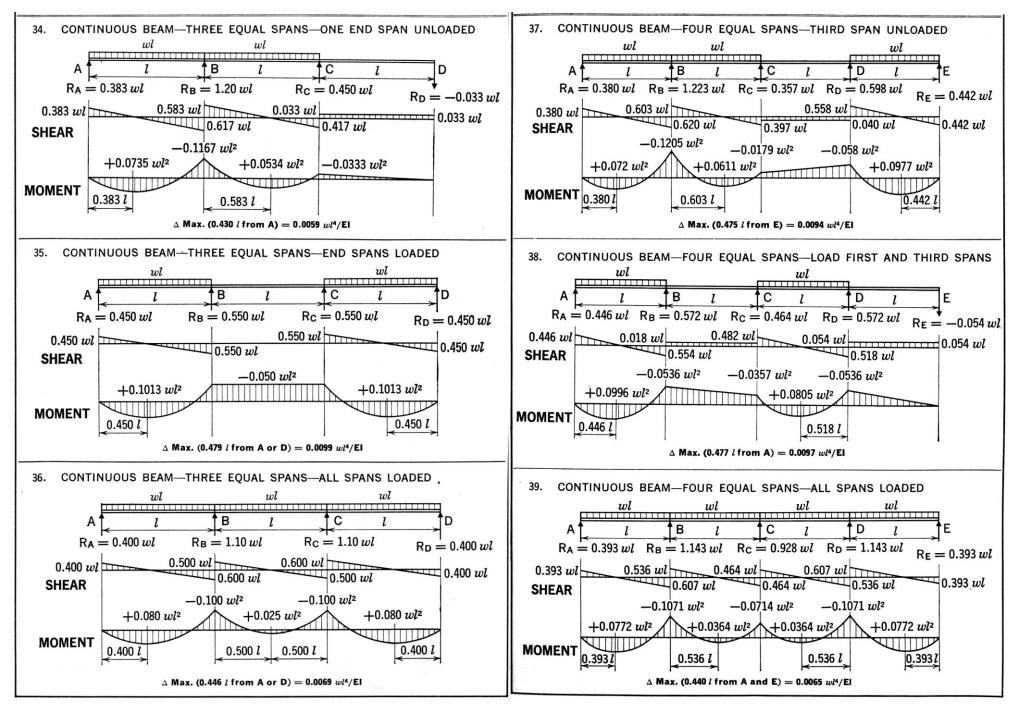

# **Centers of Gravity - Centroids**

	ſ	^	
A	= name for area	â	= the distance in the x direction from
C	= designation for channel section		a reference axis to the centroid of a
	= name for centroid		composite shape
$F_z$	= force component in the z direction	у	= vertical distance
Ĺ	= name for length	$\overline{\overline{v}}$	= the distance in the y direction from
0	= name for reference origin	2	a reference axis to the centroid of a
$Q_x$	= first moment area about an x axis		shape
	(using y distances)	ŷ	= the distance in the y direction from
$Q_y$	= first moment area about an y axis	<i>J</i>	a reference axis to the centroid of a
2	(using x distances)		composite shape
t	= name for thickness	_	1 1
tw	= thickness of web of wide flange	Z.	= distance perpendicular to <i>x</i> - <i>y</i> plane
W	0	J	= symbol for integration
VV	= name for force due to weight	Δ	= calculus symbol for small quantity
	= designation for wide flange section	_	
x	= horizontal distance	γ	= density of a material (unit weight)
$\overline{x}$	= the distance in the x direction from	Σ	= summation symbol
	a reference axis to the centroid of a		
	shape		

- The cross section shape and how it resists bending and twisting is important to understanding beam and column behavior.
- The *center of gravity* is the location of the equivalent force representing the total weight of a body comprised of particles that each have a mass gravity acts upon.



Resultant force: Over a body of constant thickness in x and y

$$\sum F_z = \sum_{i=1}^n \Delta W_i = \mathbf{W} \qquad \qquad \mathbf{W} = \mathbf{J} \, \mathbf{dW}$$

Location:  $\bar{x}$ ,  $\bar{y}$  is the equivalent location of the force W from all  $\Delta W_i$ 's over all x & y locations (with respect to the moment from each force) from:

$$\sum M_{y} = \sum_{i=1}^{n} x_{i} \Delta W_{i} = \bar{x} W \qquad \bar{x} W = \int x dW \Rightarrow \bar{x} = \frac{\int x dW}{W} \text{ OR } \qquad \boxed{\bar{x} = \frac{\sum (x \Delta W)}{W}}$$
$$\sum M_{x} = \sum_{i=1}^{n} y_{i} \Delta W_{i} = \bar{y} W \qquad \bar{y} W = \int y dW \Rightarrow \bar{y} = \frac{\int y dW}{W} \text{ OR } \qquad \boxed{\bar{y} = \frac{\sum (y \Delta W)}{W}}$$

• The *centroid of an area* is the average x and y locations of the area particles

For a discrete shape  $(\Delta A_i)$  of a uniform thickness and material, the weight can be defined as:

 $\begin{array}{ll} \Delta W_i = \gamma t \Delta A_i & \text{where:} \\ \gamma \text{ is weight per unit volume (= specific weight) with units of } \underline{N/m^3} \text{ or } \underline{lb/ft^3} \\ t \Delta A_i \text{ is the volume} \end{array}$ 

So if  $W = \gamma t A$ :

$$\overline{x} \gamma A = \int x \gamma dA \implies \overline{x}A = \int x dA \text{ OR } \qquad \overline{x} = \frac{\sum (x \Delta A)}{A} \text{ and similarly } \qquad \overline{y} = \frac{\sum (y \Delta A)}{A}$$

Similarly, for a line with constant cross section,  $a (\Delta W_i = \gamma a \Delta L_i)$ :

$$\overline{x}L = \int xdL \text{ OR } \qquad \overline{\overline{x}} = \frac{\Sigma(x\Delta L)}{L} \quad \text{and} \quad \overline{y}L = \int ydL \text{ OR } \qquad \overline{\overline{y}} = \frac{\Sigma(y\Delta L)}{L}$$

- $\bar{x}$ ,  $\bar{y}$  with respect to an x, y coordinate system is the centroid of an area AND the center of gravity for a body of uniform material and thickness.
- The *first moment of the area* is like a force moment: and is the **area** multiplied by the perpendicular distance to an axis.

# • <u>Centroids of Common Shapes</u>

Centroids of Common Shapes of Areas and Lines

Shape		x	$\overline{y}$	Area
Triangular area	$\frac{\overline{y}}{\overline{y}}$	$\frac{b}{3}$	$\frac{h}{3}$	$\frac{bh}{2}$
Quarter-circular area	C, C	$\frac{4r}{3\pi}$	$\frac{4r}{3\pi}$	$\frac{\pi r^2}{4}$
Semicircular area	o $\bar{x}$ $\bar{x}$ $\bar{x}$ $\bar{y}$ $o$	0	$\frac{4r}{3\pi}$	$\frac{\pi r^2}{2}$
Semiparabolic area		$\frac{3a}{8}$	$\frac{3h}{5}$	$\frac{2ah}{3}$
Parabolic area		0	$\frac{3h}{5}$	$\frac{4ah}{3}$
Parabolic span- drel	$y = kx^{2}$ $h$ $h$ $\overline{y}$	$\frac{3a}{4}$	$\frac{3h}{10}$	<u>ah</u> 3
Circular sector	$O$ $\overline{x}$ $x$	$\frac{2r\sin\alpha}{3\alpha}$	0	$lpha r^2$
Quarter-circular arc		$\frac{2r}{\pi}$	$\frac{2r}{\pi}$	$\frac{\pi r}{2}$
Semicircular arc		0	$\frac{2r}{\pi}$	πr
Arc of circle	$\alpha$ $C$ $\alpha$ $\overline{x}$ $\overline{x}$	<u>r sin α</u> α	0	2ar

- Symmetric Areas
  - An area is symmetric with respect to a line when every point on one side is mirrored on the other. The line divides the area into equal parts and the centroid will be on that axis.
  - An area can be symmetric to a *center point* when every (x,y) point is matched by a (-x,-y) point. It does not necessarily have an axis of symmetry. The center point is the *centroid*.
  - If the symmetry line is on an axis, the centroid location is on that axis (value of 0). With double symmetry, the centroid is at the intersection.
  - Symmetry can also be defined by areas that match across a line, but are 180° to each other.


#### **Basic Steps**

- 1. Draw a reference origin.
- 2. Divide the area into basic shapes
- 3. Label the basic shapes (components)
- 4. Draw a table with headers of *Component*, Area,  $\bar{x}$ ,  $\bar{x}A$ ,  $\bar{y}$ ,  $\bar{y}A$
- 5. Fill in the table value
- 6. Draw a summation line. Sum all the areas, all the  $\bar{x}A$  terms, and all the  $\bar{y}A$  terms
- 7. Calculate  $\hat{x}$  and  $\hat{y}$

#### • Composite Shapes

If we have a shape made up of basic shapes that we know centroid locations for, we can find an "average" centroid of the areas.

$$\hat{x}A = \hat{x}\sum_{i=1}^{n} A_{i} = \sum_{i=1}^{n} \overline{x}_{i}A_{i} \qquad \qquad \hat{y}A = \hat{y}\sum_{i=1}^{n} A_{i} = \sum_{i=1}^{n} \overline{y}_{i}A_{i}$$
OR
$$\hat{x} = \frac{\Sigma \overline{x}A}{A} \qquad \qquad \hat{y} = \frac{\Sigma \overline{y}A}{A}$$



<u>Centroid values can be negative.</u> <u>Area values can be negative (holes)</u>

3"

o

у

CG

х

у

x=5"

<u>y</u>=2.33"

0

3"

3"

Х

Π

9"

# Example 1 (pg 243)

#### Example Problem 7.1: Centroids (Figures 7.5 and 7.6)


Determine the centroidal x and y distances for the composite area shown. Use the lower left corner of the trapezoid as the reference origin.

					<u>۱</u>	<u>~</u>
Component	Area ( $\Delta A$ ) (in. <sup>2</sup> )	$\overline{x}(in.)$	$\overline{x}\Delta A(in.^3)$	$\overline{y}(in.)$	$\overline{y}\Delta A(in.^3)$	]
$ \begin{array}{c} y \\ g'' \\ g'' \\ x_1 \\ (a) \end{array} $	$\frac{9''(3'')}{2} = 13.5 \text{ in.}^2$	6"	81 in. <sup>3</sup>	4"	54 in. <sup>3</sup>	$\hat{x} = \frac{202.5in^3}{40.5in^2} = 5in$ $\hat{y} = \frac{94.5in^3}{40.5in^2}$
$ \begin{array}{c}                                     $	9" (3") = 27 in. <sup>2</sup>	4.5"	121.5 in. <sup>3</sup>	1.5"	40.5 in. <sup>3</sup>	40.5in <sup>2</sup> = 2.33in
	$A = \sum \Delta A = 40.5 \text{ in.}^2$		$\sum \overline{x} \underline{A} = 202.5 \text{ in.}^3$		$\sum \overline{y} \Delta A = 94.5 \text{ in.}^3$	

Example 2 (pg 245) Example Problem 7.3b (Figure 7.13)

An alternate method that can be employed in solving this problem is referred to as the *negative area method*.

A 6" thick concrete wall panel is precast to the dimensions as shown. Using the lower left corner as the reference origin, determine the center of gravity (centroid) of the panel.



# **Moments of Inertia**


Α	= name for area	$r_o$	= polar radius of gyration
b	= name for a (base) width	$r_x$	= radius of gyration with respect to an
d	= calculus symbol for differentiation		x-axis
	= name for a difference	$r_{v}$	= radius of gyration with respect to a
	= name for a depth	y	y-axis
$d_x$	= difference in the x direction	$t_f$	= thickness of a flange
$u_x$		5	0
	between an area centroid $(\bar{x})$ and	$t_w$	= thickness of web of wide flange
	the centroid of the composite shape	X	= horizontal distance
	$(\hat{\mathbf{x}})$	$\overline{x}$	= the distance in the x direction from
$d_{y}$	= difference in the y direction		a reference axis to the centroid of a
	between an area centroid ( $\overline{y}$ ) and		shape
	the centroid of the composite shape	â	= the distance in the x direction from
			a reference axis to the centroid of a
	(ŷ)		
h	= name for a height		composite shape
Ī	= moment of inertia about the	У	= vertical distance
•	centroid	$\overline{y}$	= the distance in the y direction from
Ţ			a reference axis to the centroid of a
$I_c$	= moment of inertia about the		shape
	centroid	ŷ	±
$I_x$	= moment of inertia with respect to an	У	= the distance in the y direction from
	x-axis		a reference axis to the centroid of a
$I_{y}$	= moment of inertia with respect to a		composite shape
9	y-axis	Ľ	= plate symbol
$J_o$	= polar moment of inertia, as is $J$		= symbol for integration
	1	J	
0	= name for reference origin	Σ	= summation symbol

- The cross section shape and how it resists bending and twisting is important to understanding beam and column behavior.
- Definition: Moment of Inertia; the second area moment

$$I_{y} = \int x^{2} dA \qquad \qquad I_{x} = \int y^{2} dA$$


We can define a single integral using a narrow strip:


for  $I_{x,}$ , strip is parallel to x for  $I_y$ , strip is parallel to y



\*I can be negative if the area is negative (a hole or subtraction).

A shape that has area at a greater distance away from an x axis *through its centroid* will have a **larger** value of I.





r

θ

0

pole

- Just like for center of gravity of an area, the moment of inertia can be determined with respect to *any* reference **axis**.
- Definition: Polar Moment of Inertia; the second area moment using polar coordinate axes

$$J_o = \int r^2 dA = \int x^2 dA + \int y^2 dA$$
$$J_o = I_x + I_y$$

• *Definition*: <u>Radius of Gyration</u>; the distance from the moment of inertia axis for an area at which the entire area could be considered as being concentrated at.


$$I_x = r_x^2 A \Longrightarrow r_x = \sqrt{\frac{I_x}{A}} \text{ radius of gyration in x}$$
  

$$r_y = \sqrt{\frac{I_y}{A}} \text{ radius of gyration in y}$$
  

$$r_o = \sqrt{\frac{J_o}{A}} \text{ polar radius of gyration, and } r_o^2 = r_x^2 + r_y^2$$

#### The Parallel-Axis Theorem

• The moment of inertia of an area with respect to any axis not through its centroid is equal to the moment of inertia of that area with respect to its own parallel centroidal axis plus the product of the area and the square of the distance between the two axes.

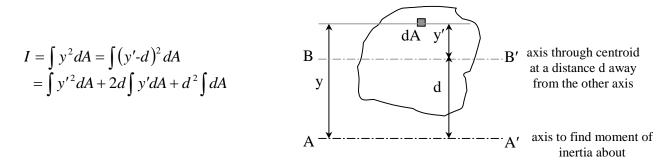

but  $\int y' dA = 0$ , because the centroid is on this axis, resulting in:

$$I_x = I_{cx} + Ad_y^2$$
 (text notation) or  $I_x = \bar{I}_x + Ad_y^2$   
where  $I_{cx}$  (or  $\bar{I}_x$ ) is the moment of inertia about the centroid of the area about an x axis and  $d_y$  is the y distance between the parallel axes

Similarly $I_y = \bar{I}_y + Ad_x^2$ Moment of inertia about a y axis $J_o = \bar{J}_c + Ad^2$ Polar moment of Inertia $r_o^2 = \bar{r}_c^2 + d^2$ Polar radius of gyration $r^2 = \bar{r}^2 + d^2$ Radius of gyration

\* I can be negative again if the area is negative (a hole or subtraction). \*\* If  $\overline{I}$  is not given in a chart, but  $\overline{x} \& \overline{y}$  are: YOU MUST CALCULATE  $\overline{I}$  WITH  $\overline{I} = I - Ad^2$ 

#### Composite Areas:

 $I = \sum \overline{I} + \sum Ad^2$  where  $\overline{I}$  is the moment of inertia about the centroid of the component area d is the distance from the centroid of the component area to the centroid of the composite area (ie.  $d_v = \hat{v} - \overline{v}$ )

#### **Basic Steps**

- 1. Draw a reference origin.
- 2. Divide the area into basic shapes
- 3. Label the basic shapes (components)
- 4. Draw a table with headers of

Component, Area,  $\bar{x}$ ,  $\bar{x}A$ ,  $\bar{y}$ ,  $\bar{y}A$ ,  $\bar{I}_x$ ,  $d_y$ ,  $Ad_y^2$ ,  $\bar{I}_y$ ,  $d_x$ ,  $Ad_x^2$ 

- 5. Fill in the table values needed to calculate  $\hat{x}$  and  $\hat{y}$  for the composite
- 6. Fill in the rest of the table values.
- 7. Sum the moment of inertia ( $\overline{I}$ 's) and  $Ad^2$  columns and add together.

\_


.

## Geometric Properties of Areas

	sperites of meas		
Rectangle	$\begin{array}{c c} y & y' \\ \hline \\ h \\ \hline \\ \hline$	$\bar{I}_{x'} = \frac{1}{12}bh^{3}$ $\bar{I}_{y'} = \frac{1}{12}b^{3}h$ $I_{x} = \frac{1}{3}bh^{3}$ $I_{y} = \frac{1}{3}b^{3}h$ $J_{C} = \frac{1}{12}bh(b^{2} + h^{2})$	Area = bh $\overline{x}$ = b/2 $\overline{y}$ = h/2
$\begin{array}{c c} \text{Triangle} \\ \hline \bullet \\ \hline \hline \hline \hline x \\ \hline b \end{array} \end{array}$	$ \begin{array}{c}             h \\             b \\           $	$\bar{I}_{x'} = \frac{1}{36}bh^3$ $I_x = \frac{1}{12}bh^3$ $\bar{I}_{y'} = \frac{1}{36}b^3h$	Area = $\frac{bh}{2}$ $\overline{x} = \frac{b}{3}$ $\overline{y} = \frac{h}{3}$
Circle		$\bar{I}_x = \bar{I}_y = \frac{1}{4}\pi r^4$ $J_O = \frac{1}{2}\pi r^4$	Area = $\pi r^2 = \pi d^2 / 4$ $\overline{x} = 0$ $\overline{y} = 0$
Semicircle	y c $r \rightarrow x$	$\bar{I}_x = 0.1098r^4$ $\bar{I}_y = \pi r^4 / 8$	Area = $\pi r^2 / 2 = \pi d^2 / 8$ $\overline{x} = 0$ $\overline{y} = 4r / 3\pi$
Quarter circle	$\begin{array}{c} y \\ \bullet C \\ \hline O \\ \hline \hline r \end{array} x$	$\bar{I}_x = 0.0549r^4$ $\bar{I}_y = 0.0549r^4$	Area = $\pi r^2 / 4 = \pi d^2 / 16$ $\overline{x} = \frac{4r}{3\pi}$ $\overline{y} = \frac{4r}{3\pi}$
Ellipse		$\bar{I}_x = \frac{1}{4}\pi ab^3$ $\bar{I}_y = \frac{1}{4}\pi a^3 b$ $J_O = \frac{1}{4}\pi ab(a^2 + b^2)$	Area = $\pi ab$ $\overline{x} = 0$ $\overline{y} = 0$
Semiparabolic area		$ar{I}_{x}$ = 16ah $^{3}/$ 175	Area = $\frac{4ah}{3}$
Parabolic area		$\bar{I}_{y}$ = 4a <sup>3</sup> h/15	$\overline{x} = 0$ $\overline{y} = \frac{3h}{5}$
Parabolic span- drel	$a = \frac{1}{1}$	$ar{I}_x$ = 37ah $^3/$ 2100 $ar{I}_y$ = a $^3$ h $/$ 80	Area = $\frac{ah}{3}$ $\overline{x} = \frac{3a}{4}$ $\overline{y} = \frac{3h}{10}$

## Example 1 (pg 257)


Find the moments of inertia ( $\hat{x} = 3.05$ ",  $\hat{y} = 1.05$ ").

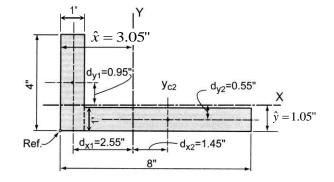


Component	I <sub>xc</sub> (in. <sup>4</sup> )	d <sub>y</sub> (in.)	$\frac{Ad_y^2}{(\text{in.}^4)}$	I <sub>yc</sub> (in. <sup>4</sup> )	<i>d<sub>x</sub></i> (in.)	$\frac{Ad_x^2}{(\text{in.}^4)}$
4" 4" 1" 4" 4" 4" 4" 4"	$\frac{(1)(4)^3}{12} = 5.33$	0.95	3.61	$\frac{(4)(1)^3}{12} = 0.33$	2.55	26.01
1"X_{C2}	$\frac{(7)(1)^3}{12} = 0.58$	0.55	2.12	$\frac{(1)(7)^3}{12} = 28.58$	1.45	14.72
	$\sum I_{xc} = 5.91$		$\sum A d_y^2 = 5.73$	$\sum I_{yc} = 28.91$		$\sum Ad_x = 40.73$

Example 2 (pg 253) Example Problem 7.6 (Figures 7.24 to 7.26)

Determine the *I* about the centroidal *x*-axis.





Determine the moments of inertia about the centroid of the shape.

Solution:

There is no reference origin suggested in figure (a), so the bottom left corner is good.


In figure (b) area A will be a complete rectangle, while areas C and A are "holes" with negative area and negative moment of inertias.

Area A = 200 mm x 100 mm = 20000 mm<sup>2</sup>

Area B =  $-\pi(30 \text{ mm})^2$  =  $-2827.4 \text{ mm}^2$ 

Area C =  $-1/2\pi(50 \text{ mm})^2$  = 3927.0 mm<sup>2</sup>

Area D = 100 mm x 200 mm x 1/2 = 10000 mm<sup>2</sup>

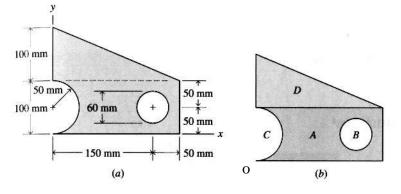

$I_x = (200 \text{ mm})(100 \text{ mm})^3/12 = 16.667 \text{ x} 10^6 \text{ mm}^4$ $I_y = (200 \text{ mm})^3(100 \text{ mm})/12 = 66.667 \text{ x} 10^6 \text{ mm}^4$
$I_x = I_y = -\pi (30 \text{ mm})^4/4 = -0.636 \text{ x} 10^6 \text{ mm}^4$
$I_x = -\pi (50 \text{ mm})^4/8 = -2.454 \text{ x} 10^6 \text{ mm}^4$ $I_y = -0.1098(50 \text{ mm})^4 = -0.686 \text{ x} 10^6 \text{ mm}^4$
I <sub>x</sub> = (200 mm)(100 mm) <sup>3</sup> /36 = 5.556 x 10 <sup>6</sup> mm <sup>4</sup>

 $I_y = (200 \text{ mm})^3 (100 \text{ mm})/36 = 22.222 \text{ x} 10^6 \text{ mm}^4$ 

shape	A (mm²)	x̄ (mm)	xĀ (mm³)	ȳ (mm)	ӯА (mm³)	$\hat{x} = \frac{2159218 \text{mm}^3}{23245.58 \text{mm}^2} = 92.9 \text{ mm}$
A	20000	100	2000000	50	1000000	23245.58mm <sup>2</sup>
В	-2827.43	150	-424115	50	-141372	1995612 mm <sup>3</sup>
С	-3926.99	21.22066	-83333.3	50	-196350	$\hat{y} = \frac{1995612 \text{ mm}^3}{23245.58 \text{ mm}^2} = 85.8 \text{ mm}$
D	10000	66.66667	666666.7	133.3333	1333333	23245.36 11111
	23245.58		2159218		1995612	


shape	l <sub>x</sub> (mm <sup>4</sup> )	d <sub>y</sub> (mm)	Ad <sub>y</sub> <sup>2</sup> (mm <sup>4</sup> )	l <sub>y</sub> (mm <sup>4</sup> )	d <sub>x</sub> (mm)	$\mathrm{Ad_x}^2$ (mm <sup>4</sup> )
А	16666667	35.8	25632800	66666667	-7.1	1008200
В	-636173	35.8	-3623751.73	-636173	-57.1	-9218592.093
С	-2454369	35.8	-5032988.51	-686250	71.67934	-20176595.22
D	5555556	-47.5333	22594177.8	22222222	26.23333	6881876.029
	19131680		39570237.5	87566466		-21505111.29

So, I<sub>x</sub> = 19131680 + 39570237.5 = 58701918 = 58.7 x 10<sup>6</sup> mm<sup>4</sup>

I<sub>x</sub> = 87566466 +-21505111.3 = 43572025 = 66.1 x 10<sup>6</sup> mm<sup>4</sup>

Example 4 (pg 258) Example Problem 7.10 (Figures 7.35 and 7.36)


Locate the centroidal x and y axes for the cross-section shown. Use the reference origin indicated and assume that the steel plate is centered over the flange of the wide-flange section. Compute the  $I_x$  and  $I_y$  about the major centroidal axes.



## Example 5 (pg 249)\*

Example Problem 7.5 (Figures 7.16 and 7.17)

A composite or built-up cross-section for a beam is fabricated using two  $\frac{1}{2}$ " × 10" vertical plates with a C12 × 20.7 channel section welded to the top and a W12 × 16 section welded to the bottom as shown. Determine the location of the major *x*-axis using the center of the W12 × 16's web as the reference origin. Also determine the moment of inertia about both major centroidal axes.



shape	A (in²)	⊼ (in)	⊼A (in³)	ӯ (in)	ӯА (in³)
channel	6.09	0	0.00	9.694	59.04
left plate	5	-3.25	-16.25	5.11	25.55
right plate	5	3.25	16.25	5.11	25.55
wide flange	4.71	0	0.00	0	0.00
	20.80		0.00		110.14

$$\hat{x} = \frac{0 \text{ i } n^3}{20.8 \text{ i } n^2} = 0 \text{ i } n$$
$$\hat{y} = \frac{110.14 \text{ i } n^3}{20.8 \text{ i } n^2} = 5.295 \text{ i } n$$

shape	I <sub>x</sub> (in <sup>4</sup> )	d <sub>y</sub> (in)	$\mathrm{Ad_y}^2$ (in <sup>4</sup> )	l <sub>y</sub> (in <sup>4</sup> )	d <sub>x</sub> (in)	$Ad_x^2$ (in <sup>4</sup> )
channel	3.880	-4.399	117.849	129.000	0.000	0.000
left plate	41.667	0.185	0.171	0.104	3.250	52.813
right plate	41.667	0.185	0.171	0.104	-3.250	52.813
wide flange	2.800	5.295	132.054	103.000	0.000	0.000
	90.013		250.245	232.208		105.625

I<sub>x</sub> = 90.013 + 250.245 = 340.259 = 340.3 in<sup>4</sup>

 $I_y = 232.208 + 105.625 = 337.833 = 337.8 \text{ in}^4$ 

# **Beam Bending Stresses and Shear Stress**

# Notation:

A	= name for area	п	= number of connectors across a joint
$A_{\rm web}$			= shorthand for neutral axis (N.A.)
Twee	section		= name for reference origin
b	= width of a rectangle		= pitch of connector spacing
υ	= total width of material at a		= name for a force vector
	horizontal section		= shear per length (shear flow)
с	= largest distance from the neutral	-	= first moment area about a neutral
ι	axis to the top or bottom edge of a	Q	axis
	beam	0	$c_{ted} = $ first moment area about a neutral
d	= calculus symbol for differentiation	Qconnee	axis for the connected part
a	= depth of a wide flange section	R	= radius of curvature of a deformed
d	= difference in the y direction	Λ	beam
$d_y$	-	S	= section modulus
	between an area centroid $(\overline{y})$ and		= section modulus required at
	the centroid of the composite shape	Sreq'd	allowable stress
	(ŷ)	+	= thickness of web of wide flange
DL	= shorthand for dead load		= internal shear force
Ε	= modulus of elasticity or Young's		= Internal shear force $_{dinal} =$ longitudinal shear force
	modulus		$a_{dinal}$ = longitudinal shear force
$f_b$	= bending stress	-	= name for distributed load
$f_c$	= compressive stress		= horizontal distance
$f_{max}$	= maximum stress		= vertical distance
$f_t$	= tensile stress	-	
$f_v$	= shear stress	$\overline{y}$	= the distance in the y direction from
$F_b$	= allowable bending stress		a reference axis $(n.a)$ to the centroid
$F_{conn}$	$_{ector}$ = shear force capacity per	^	of a shape
	connector	ŷ	= the distance in the y direction from
h	= height of a rectangle		a reference axis to the centroid of a
Ι	= moment of inertia with respect to		composite shape
	neutral axis bending	Δ	= calculus symbol for small quantity
$I_x$	= moment of inertia with respect to		= elongation or length change
	an x-axis	Е	= strain
L	= name for length	$\theta$	= arc angle
LL	= shorthand for live load	Σ	= summation symbol
М	= internal bending moment		
	= name for a moment vector		

#### **Pure Bending in Beams**

With bending moments along the axis of the member only, a beam is said to be in pure bending.

Normal stresses due to bending can be found for homogeneous materials having a plane of symmetry in the y axis that follow Hooke's law.

#### **Maximum Moment and Stress Distribution**

In a member of constant cross section, the maximum bending moment will govern the design of the section size when we know what kind of normal stress is caused by it.

For internal equilibrium to be maintained, the bending moment will be equal to the  $\Sigma M$  from the normal stresses × the areas × the moment arms. Geometric fit helps solve this statically indeterminate problem:

- 1. The normal planes remain normal for pure bending.
- 2. There is no net internal axial force.
- 3. Stress varies linearly over cross section.
- 4. Zero stress exists at the centroid and the line of centroids is the neutral axis (n. a)

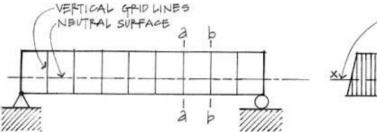


Figure 8.5(a) Beam elevation before loading.





Figure 8.5(b) Beam bending under load.







Figure 8.8 Bending stresses on section b-b.



CENTROIDAL AXIS

SP CALLED THE


1/2δ


1/2 δ


#### **Relations for Beam Geometry and Stress**

Pure bending results in a circular arc deflection. R is the distance to the center of the arc;  $\theta$  is the angle of the arc (radians); c is the distance from the n.a. to the *extreme fiber*;  $f_{max}$  is the maximum normal stress at the *extreme fiber*; y is a distance in y from the n.a.; M is the bending moment; I is the moment of inertia; S is the *section modulus*.

$$L = R\theta$$
  $\varepsilon = \frac{\delta}{L} = R$   $f = E\varepsilon = \frac{y}{c}f_{\text{max}}$ 





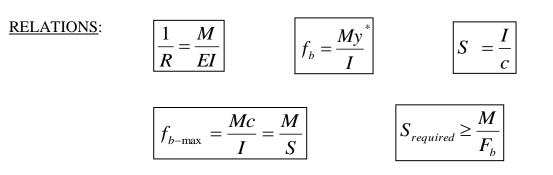

\*Note: y positive goes DOWN. With a positive M and y to the bottom fiber as positive, it results in a TENSION stress (we've called positive)

### **Transverse Loading in Beams**

We are aware that transverse beam loadings result in internal shear and bending moments.

We designed sections based on bending stresses, since this stress dominates beam behavior.

There can be shear stresses *horizontally* within a beam member. It can be shown that  $f_{horizontal} = f_{vertical}$ 








### **Equilibrium and Derivation**

In order for equilibrium for any element CDD'C', there needs to be a horizontal force  $\Delta H$ .



Q is a moment area with respect to the neutral axis of the area *above or below* the horizontal where the  $\Delta H$  occurs.

Q is a maximum when y = 0 (at the **neutral axis**).


q is a horizontal shear per unit length  $\rightarrow$  shear flow

$$V_{longitudinal} = \frac{V_T Q}{I} \Delta x$$

$$q = \frac{V_{longitudinal}}{\Delta x} = \frac{V_T Q}{I}$$

### **Shearing Stresses**

 $f_{v-ave} = 0$  on the beam's surface. Even if Q is a maximum at y = 0, we don't know that the thickness is a *minimum* there.

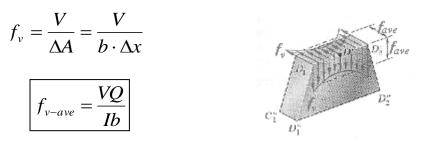

### **Rectangular Sections**

 $f_{v-\max}$  occurs at the neutral axis:

$$I = \frac{bh^{3}}{12} \qquad Q = A\bar{y} = b\frac{h}{2} \cdot \frac{1}{2}\frac{h}{2} = \frac{bh^{2}}{8}$$

then:

$$f_{v} = \frac{VQ}{Ib} = \frac{V\frac{1}{8}bh^{2}}{\frac{1}{12}bh^{3}b} = \frac{3V}{2bh}$$

$$f_{v} = \frac{3V}{2A}$$


đ


#### Webs of Beams

In steel W or S sections the thickness varies from the flange to the web.


We neglect the shear stress in the flanges and consider the shear stress in the web to be constant:


$$f_{v-\max} = \frac{3V}{2A} \approx \frac{V}{A_{web}}$$
  $f_v$ 



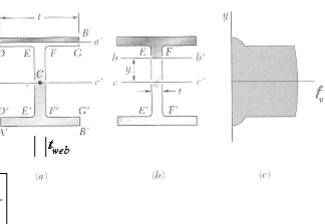


Webs of I beams can fail in tension shear across a panel with stiffeners or the web can buckle.

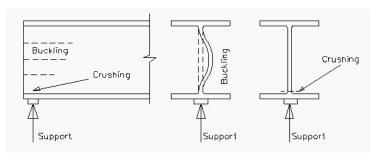









### **Shear Flow**


Even if the cut we make to find Q is not horizontal, but arbitrary, we can still find the shear flow, q, as long as the loads on thin-walled sections are applied in a plane of symmetry, and the cut is made *perpendicular* to the surface of the member.




 $q = \frac{VQ}{I}$ 

The shear flow magnitudes can be sketched by knowing Q.







## Connectors to Resist Horizontal Shear in Composite Members

Typical connections needing to resist shear are plates with nails or rivets or bolts in composite sections or splices.

The pitch (spacing) can be determined by the capacity in shear of the connector(s) to the shear flow over the spacing interval, p.

 $\frac{V_{longitudimal}}{p} = \frac{VQ}{I} \qquad \qquad V_{longitudimal} = \frac{VQ}{I} \cdot p$ 

where

p = pitch length  $nF_{connector} \ge \frac{VQ_{connected area}}{I} \cdot p$ 

n = number of connectors connecting the connected area to the rest of the cross section

F = force capacity in one connector

 $Q_{connected \; area} = A_{connected \; area} \times \, y_{connected \; area}$ 


 $y_{\text{connected area}} = \text{distance from the centroid of the connected area to the neutral axis}$ 

## **Connectors to Resist Horizontal Shear in Composite Members**

Even vertical connectors have shear flow across them.

The spacing can be determined by the capacity in shear of the connector(s) to the shear flow over the spacing interval, p.


$$p \leq \frac{nF_{connector}I}{VQ_{connected area}}$$




### **Unsymmetrical Sections or Shear**

If the section is <u>not</u> symmetric, or has a shear <u>not</u> in that plane, the member can bend and twist.


If the load is applied at the *shear center* there will not be twisting. This is the location where the moment caused by shear flow = the moment of the shear force about the shear center.

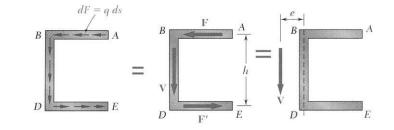


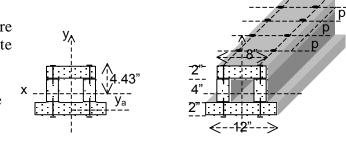

### Example 1 (pg 303) Example Problem 9.2 (Figures 9.15 to 9.18)

A beam must span a distance of 12' and carry a uniformly distributed load of 120 lb./ft. Determine which cross-section would be the least stressed: a, b, or c.

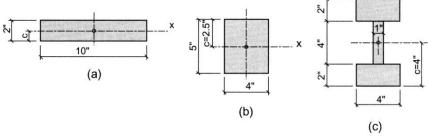

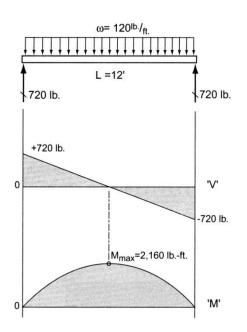



## Example 2 (pg 309) Example Problem 9.7 (Figures 9.31 to 9.33)


Design the roof and second-floor beams if  $F_b = 1550$  psi (Southern pine No. 1), and evaluate the shear stress.

Roof: Snow +DL = 200 lb/ft Walls: 400 lb on  $2^{nd}$  floor beams Railing: 100 lb on beam overhang Second Floor: DL + LL = 300 lb/ft (including overhang) \*Also select the most economical steel section for the second-floor when  $S_{req'd} \ge 165 \text{ in}^3$  and evaluate the shear stress when V = 60 k.

#### Roof:

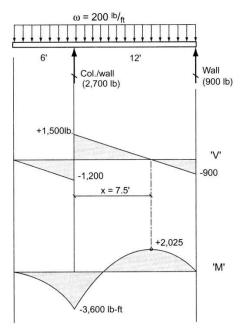



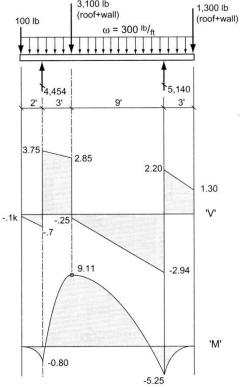

Component

---

-

## Example 3 (pg 313)

Example Problem 9.8: Shear Stress (Figures 9.43 to 9.47)

Calculate the maximum bending and shear stress for the beam shown.

ALSO: Determine the minimum nail spacing required (pitch) if the shear capacity of a nail (F<sub>connector</sub>) is 250 lb.

 $I_{xc}$  (in.<sup>4</sup>)

4

36

Component	A (in. <sup>2</sup> )	<u>y</u> (in.)	$\overline{y}\Delta A$ (in. <sup>3</sup> )
<u></u> .	12	7	84
	12	3	36

A (in.²)


12

12

*d<sub>y</sub>* (in.)

2

2





 $Ad_{y}^{2}$  (in.<sup>4</sup>)

48

48

– x









**8.11** A built-up plywood box beam with  $2 \times 4$  S4S top and bottom flanges is held together by nails. Determine the pitch (spacing) of the nails if the beam supports a uniform load of 200 #/ft. along the 26-foot span. Assume the nails have a shear capacity of 80# each.

#### Solution:

Construct the shear (V) diagram to obtain the critical shear condition and its location

Note that the condition of shear is critical at the supports, and the shear intensity decreases as you approach the center line of the beam. This would indicate that the nail spacing P varies from the support to midspan. Nails are closely spaced at the support, but increasing spacing occurs toward midspan, following the shear diagram.






$$f_{\nu-\text{max}} = \frac{(2,600\#)(83.3in.^3)}{(1,202.6in.^4)(\frac{1}{2}" + \frac{1}{2}")} = 180.2\,\text{psi}$$

SHEAR PLANES (A= 5,25 IN. 2)

#### Assume:

(n)F = Capacity of two nails (one each side) at the flange; representing two shear surfaces

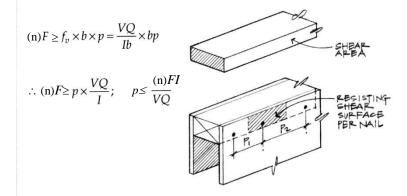

 $Q = A\overline{y} = (5.25 \text{ in.}^2)(8.25'') = 43.3 \text{ in.}^3$ 

à

Shear force =  $f_v \times A_v$ 


where:

N.A.


 $A_v =$  shear area

At the maximum shear location (support) where V = 2,600#

$$p = \frac{(2 \text{ nails} \times 80 \text{ \#/nail})(1,202.6 \text{ in.}^4)}{(2,600\text{\#})(43.3 \text{ in.}^3)} = 1.71''$$

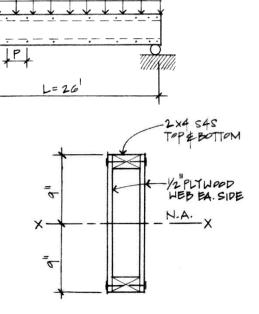

W= 200#/FT



## Introduction to Beam Stress Analysis and Preliminary Design

#### Beam Analysis

When the beam section is already known, beam analysis is used to calculate the maximum stresses. Beam design involves finding a trial section, recognizing that there is more load from the beam weight itself, performing analysis AND comparing stresses to some limits until the section satisfies all criteria.

#### Analysis Procedure

- 1. Solve for support forces and draw V & M diagrams to obtain  $V_{max}$  and  $M_{max}$  (maximum magnitudes)
- 2. Determine the critical section geometry properties:
  - centroid:  $\hat{y}$  (necessary to find the neutral axis,  $I_x$ , and to determine c the distance from the neutral axis to the "extreme" fiber of the cross section) (Note Set 9.1)
  - moment of inertia about axis of bending:  $I_x$  (Note Set 9.2)
  - section modulus  $S_x$  ( $S_x = I_x/c$ )

NOTE: if the section is a standard shape, the properties will be pre-determined and available in reference charts.

3. Calculate maximum bending stress using  $M_{max}$ :  $f_{b-max} = \frac{Mc}{I_x} = \frac{M}{S_x}$ 

4. Calculate maximum shear stress using  $V_{max}$ :

a. For a rectangular section ONLY: 
$$f_v = \frac{3V}{2A}$$

- A is the area (bh)

b. For a wide flange section ONLY: 
$$f_v = \frac{V}{A_{web}}$$

-  $A_{web}$  is the area determined from the thickness of the web and depth of the W ( $t_w d$ ). These values are available in reference charts.

c. OTHERWISE: 
$$f_{v-ave} = \frac{VQ}{I_x b}$$
 where:

- Q is the first moment area of a section "cut" at the neutral axis. It is the sum of all the basic areas of the section multiplied by **y distances from the neutral axis** for each to their centroids:  $Q = \sum A\overline{y}$ .  $\overline{y}$  is always measured from the neutral axis as the origin (y=0). (Note Set 10.1)
- *b* is the thickness of the section "cut" from the real material (voids aren't included).
- $I_x$  is the moment of inertia about the x axis (neutral axis)

5. If a section is built-up, and the shear force across an interface or the spacing for nails across that interface to resist the shear force is needed, then the form of the shear stress equation becomes: - - - -

$$nF_{connector} \ge \frac{VQ_{connected area}}{I_x} \cdot p$$

- *n* is the number of nails or bolts connecting the parts at the interface(s) of interest
- $F_{connector}$  is the shear force per nail or bolt that the connector can resists (capacity)
- $Q_{connected area}$  is the first moment of area a section "cut" at the interface(s) of interest to isolate the connected part. It is the sum of all the basic areas of the section multiplied by y distances from the neutral axis for each to their centroids:  $Q = \sum A \bar{y}$ .  $\bar{y}$  is always measured from the neutral axis as the origin (y=0). (Note Set 10.1)
- p is the "pitch" spacing between connectors along the axis of the beam
- $I_x$  is the moment of inertia about the x axis (neutral axis)

#### **Beam Design**

Design implies that the beam section has not yet been determined. Design involves choosing a trial section (preliminary design), then checking at every important computation of stress or deflection that the computed value does not exceed the acceptable limits. A finalized design means the section has been changed because of an unacceptable evaluation, but now meets all criteria.

#### Preliminary Design Procedure

The intent is to find the most light weight member satisfying the section modulus size.

**N** /

- 1. Know  $F_b$  (allowable stress) for the material or  $F_y$  &  $F_u$  for LRFD.
- 2. Draw V & M, finding M<sub>max</sub>.

3. Calculate 
$$S_{req'd}$$
 using  $M_{max}$ :  $S_{required} \ge \frac{M}{F_b}$ 

This step is equivalent to evaluating if  $f_b = \frac{M_{max}}{S_x} \le F_b$ rectangular beams  $S_x = \frac{bh^2}{6}$ 

4. For rectangular beams 
$$S_x =$$


- For steel or timber: use the section charts to find S that will work. And for steel, the design charts show the lightest section within a grouping of similar S's.
- For any thing else, try a nice value for b, and calculate h or the other way around.


## **Pinned Frames and Arches**

### Notation:


F	= name for force vectors	R	= name for reaction force vector
$F_x$	= force component in the x direction	W	= name for distributed load
$F_y$	= force component in the y direction	W	= name for total force due to
FBD	= free body diagram		distributed load
М	= name for reaction moment, as is $M_R$	Σ	= summation symbol


- A FRAME is made up of members where at least <u>one</u> member has more than 3 forces on it
  - Usually stationary and fully constrained
- A PINNED FRAME has member connected by pins
  - Considered *non-rigid* if it would collapse when the supports are removed
  - Considered *rigid* if it retains it's original shape when the supports are removed
- A RIGID FRAME is all one member with no internal pins
  - Typically statically indeterminate
  - **Portal** frames look like door frames
  - Gable frames have a peak.






- INTERNAL PIN CONNECTIONS:
  - Pin connection forces are **equal** and **opposite** between the bodies they connect.
  - There are 2 unknown forces at a pin, but if we know a body is a **two-force** body, the direction of the *resultant* force is known.

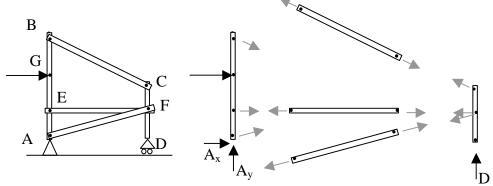




• AN ARCH is a structural shape that can span large distances and sees compression along its slope. It may have no hinges (or pins), two hinges at the supports, or two hinges at the supports with a hinge at the apex. The three-hinged arch types are statically determinate with 2 bodies and **6** unknown forces.

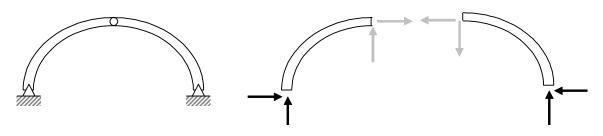

#### • CONTINUOUS BEAMS WITH PINS:

- If pins within the span of a beam over multiple supports result in static determinacy (the right number of unknowns for the number of equilibrium equations), the internal forces at the pins are applied as reactions to the adjacent span.




- The location of the internal pins can be chosen to increase or decrease the moments in order to make the section economical for both positive bending and negative bending (similar values for the moments).

#### Solution Procedure

- 1. Solve for the support forces on the entire frame (FBD) if possible.
- 2. Draw a FBD of each member:
  - Consider all two-force bodies first.
  - Pins are integral with members
  - Pins with applied forces should belong to members with greater than two forces [Same if pins connect 3 or more members]
  - Draw forces on either side of a pin <u>equal</u> and <u>opposite</u> with arbitrary direction chosen for the first side
  - Consider all multi-force bodies
  - Represent connection forces <u>not known</u> by x & y components
  - There are still three equilibrium equations available, but the moment equations may be more helpful when the number of unknowns is greater than two.


### Example 1 (pg 114) Example Problem 4.12

A pinned frame with a fixed base at A supports a load at the over hang equal to 500 pounds, as shown in Figure 4.68. Draw free body diagrams and solve for the support reactions and the pin reactions at B, C, and E.



### Example 2 (pg 115) Example 4.13 (Three-Hinged Arch)

An industrial building is framed using tapered steel sections (haunches) and connected with three hinges (Figure 4.70). Assuming that the loads shown are from gravity loads and wind, determine the support reactions at A and D and the pin reactions at B.

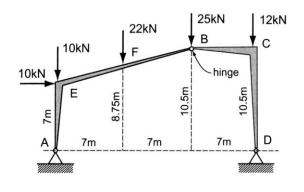


 $\omega_2 = 150$ lb./ft.


Example 3 (pg 73)

Example Problem 3.16 (Figures 3.44 and 3.45)


A compound beam has three supports at A, B and D and an internal hinge at C. Two uniformly distributed loads cover the entire length of the beams. Draw the appropriate FBDs and determine the reactions at the supports and the internal pin forces at C.

Also construct the shear and bending moment diagrams.




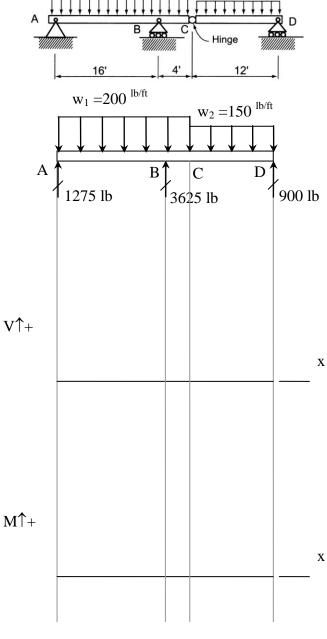

 $\omega_1 = 200 \text{lb./ft.}$ 







## **Rigid and Braced Frames**

#### Notation:

Ε	= modulus of elasticity or Young's modulus	$k_{\ell_{p}}$	= e = l
$F_x F_y$	<ul><li>= force component in the x direction</li><li>= force component in the y direction</li></ul>	$\ell_c$	= 1
5	<ul><li>= free body diagram</li><li>= relative stiffness of columns to</li></ul>	L M	= n = i
Ι	<ul> <li>beams in a rigid connection, as is Ψ</li> <li>moment of inertia with respect to neutral axis bending</li> </ul>	$V \ \Sigma$	= n = in = s

- effective length factor for columns
- length of beam in rigid joint
- length of column in rigid joint
- name for length
- internal bending moment
- name for a moment vector
- internal shear force
- summation symbol

## **Rigid Frames**

Rigid frames are identified by the lack of pinned joints within the frame. The joints are *rigid* and resist rotation. They may be supported by pins or fixed supports. They are typically statically indeterminate.

Frames are useful to resist **lateral** loads.

Frame members will see

- shear
- bending
- axial forces


and behave like beam-columns.


### Behavior


The relation between the joints has to be maintained, but the whole joint can rotate. The amount of rotation and distribution of moment depends on the stiffness (EI/L) of the members in the joint.


End restraints on columns reduce the effective length, allowing columns to be more slender. Because of the rigid joints, deflections and moments in beams are reduced as well.

Frames are sensitive to settlement because it induces strains and changes the stress distribution.









VVV

Staggered Truss

### Types

Gabled – has a peak

- *Portal* resembles a door. Multi-story, multiple bay portal frames are commonly used for commercial and industrial construction. The floor behavior is similar to that of continuous beams.
- *Staggered Truss* Full story trusses are staggered through the frame bays, allowing larger clear stories.

### Connections


- *Steel* Flanges of members are fully attached to the flanges of the other member. This can be done with welding, or bolted plates.
- *Reinforced Concrete* Joints are monolithic with continuous reinforcement for bending. Shear is resisted with stirrups and ties.


### **Braced Frames**


Braced frames have beams and columns that are "pin" connected with bracing to resist lateral loads.


### Types of Bracing


- knee-bracing
- diagonal (including eccentric)
- X
- K or chevron
- shear walls which resist lateral forces in the plane of the wall












Х


diagonal



## **Rigid Frame Analysis**

Structural analysis methods such as the *portal method* (approximate), the *method of virtual work*, *Castigliano's theorem*, the *force method*, the *slope-displacement method*, the *stiffness method*, and *matrix analysis*, can be used to solve for internal forces and moments and support reactions.

Shear and bending moment diagrams can be drawn for frame members by isolating the member from a joint and drawing a <u>free body diagram</u>. The internal forces at the end will be <u>equal and opposite</u>, just like for connections in *pinned frames*. Direction of the "beam-like" member is usually drawn by looking from the "inside" of the frame.

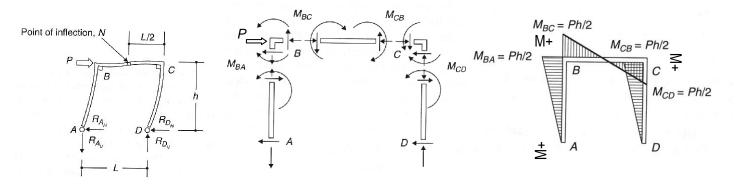

#### Frame Columns

Because joints can rotate in frames, the effective length of the column in a frame is harder to determine. The stiffness (EI/L) of each member in a joint determines how rigid or flexible it is. To find k, the relative stiffness, G or  $\Psi$ , must be found for both ends, plotted on the alignment charts, and connected by a line for braced and unbraced fames.

$$G = \Psi = \frac{\Sigma \frac{EI}{l_c}}{\Sigma \frac{EI}{l_b}}$$

where


E = modulus of elasticity for a member

I = moment of inertia of for a member

 $l_{\rm c}$  = length of the column from center to center


 $l_{\rm b}$  = length of the beam from center to center


- For pinned connections we typically use a value of 10 for  $\Psi$ .
- For fixed connections we typically use a value of 1 for  $\Psi$ .

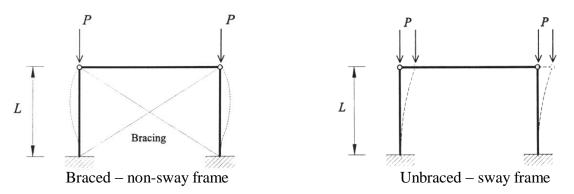

#### **Frame Design**

The possible load combinations for frames with dead load, live load, wind load, etc. is critical to the design. The maximum moments (positive and negative) may be found from different combinations and at different locations. Lateral wind loads can significantly affect the maximum moments.



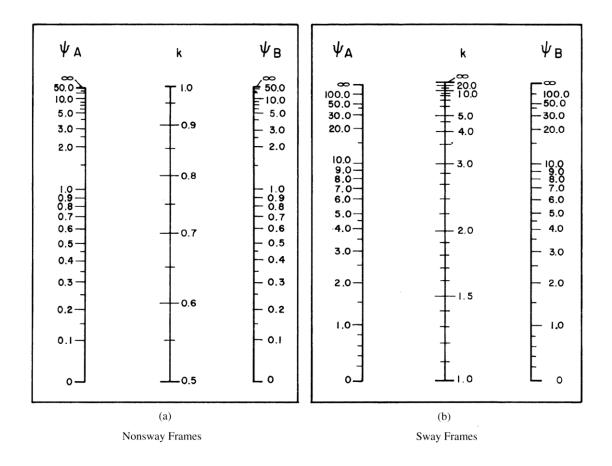


#### Plates and Slabs

If the frame is rigid or non-rigid, the floors can be a plate or slab (which has drop panels around columns). These elements behave differently depending on their supports and the ratio of the sides.

- one-way behavior: like a "wide" beam, when ratio of sides > 1.5
- two-way behavior: complex, non-determinate, look for handbook solutions

#### Floor Loading Patterns


With continuous beams or floors, the worst case loading typically occurs when alternate spans are loaded with live load (not every span). The maximum positive and negative moments may not be found for the same loading case! If you are designing with reinforced concrete, you must provide flexure reinforcement on the top and bottom and take into consideration that the maximum may move.





The rigid frame shown has been analyzed using an advanced structural analysis technique. The reactions at support A are:  $A_x = -28.6$  k,  $A_y = -15.3$  k,  $M_A = 208$  k-ft. The reactions at support D are:  $D_x = -11.4$  k,  $D_y = 15.3$  k,  $M_D = 110$  ft-k. Draw the shear and bending moment diagrams, and identify  $V_{max}$  &  $M_{max}$ .

Solution:


*NOTE:* The joints are not shown, and the load at joint *B* is put on <u>only</u> one body.

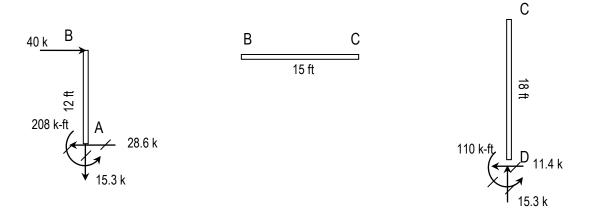


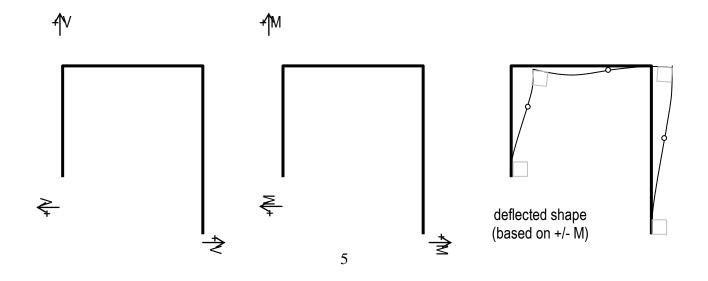



The rigid frame shown has been analyzed using an advanced structural analysis technique. The reactions at support A are:  $A_x = 2.37$  kN,  $A_y = 21.59$  kN,  $M_A = -4.74$  kN·m. The reactions at support C are:  $C_x = -2.37$  kN,  $C_y = 28.4$  kN,  $M_C = -26.52$  kN·m. Draw the shear and bending moment diagrams, and identify  $V_{max} \& M_{max}$ .

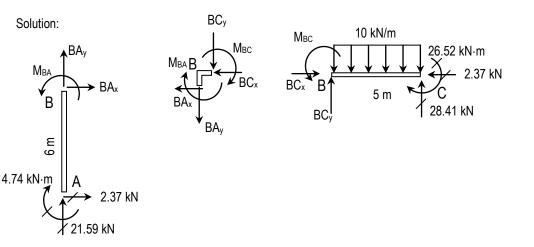



*Reactions* These values must be given or found from non-static analysis techniques. The values are given with respect to the global coordinate system we defined for positive and negative forces and moments for equilibrium.

*Member End Forces* The free-body diagrams of all the members and joints of the frame are shown above. The unknowns on the members are drawn positive, and the opposite directions are drawn on the joint. We can begin the computation of internal forces with either member AB or BC, both of which have only three unknowns.


*Member AB* With the magnitudes of reaction forces at A know, the unknowns are at end B of BA<sub>x</sub>, BA<sub>y</sub>, and M<sub>BA</sub>, which can get determined by applying  $\sum F_x = 0$ ,  $\sum F_y = 0$ , and  $\sum M_B = 0$ . Thus,

$$\sum F_x = 2.37kN + BA_x = 0 \quad BA_x = -2.37 \text{ kN}, \qquad \sum F_y = 21.59kN + BA_y = 0 \quad BA_y = -21.59 \text{ kN}$$
$$\sum M_B = 2.37kN(6m) - 4.74kN \cdot m + M_{BA} = 0 \quad M_{BA} = -9.48 \text{ kN} \cdot m$$


Joint B Because the forces and moments must be equal and opposite,  $BC_x = 2.37$  kN,  $BC_y = 21.59$  kN and  $M_{BC} = 9.48$  kN·m


*Member BC* All forces are known, so equilibrium can be checked:

$$\sum F_x = 2.37kN - 2.37kN = 0 \qquad \sum F_y = 21.59kN + 28.49kN - (10kN / m)5m = 0$$
  
$$\sum M_B = 28.41kN(5m) - 10kN / m(5m)(2.5m) - 26.52kN \cdot m + 9.48kN \cdot m = 0$$

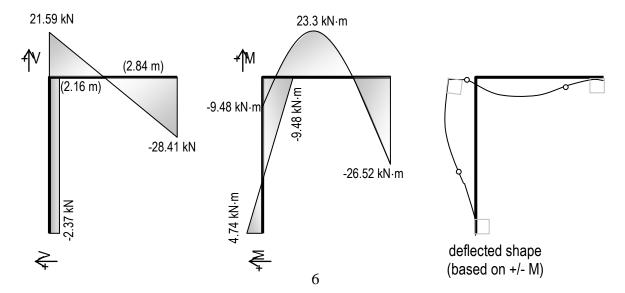

Find the column effective lengths for a steel frame with 12 ft columns, a 15 ft beam when the support connections are pins for a) when it is braced and b) when it is allowed to sway. The relative stiffness of the beam is twice that of the columns (2I).



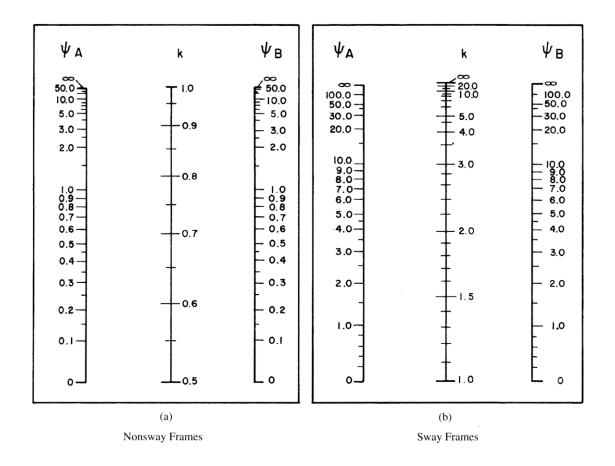

## **Columns and Stability**

### Notation:

$\begin{array}{llllllllllllllllllllllllllllllllllll$	$K = \text{effective length factor for columns}$ $L = \text{name for length}$ $L_e = \text{effective length that can buckle for column design, as is \ell_e, L_{effective} M = \text{internal bending moment, as is } M' N.A. = \text{shorthand for neutral axis} P = \text{name for axial force vector, as is } P' P_{crit} = \text{critical buckling load in column calculations, as is } P_{critical}, P_{cr} r = \text{radius of gyration} T = \text{symbol for compression} W = \text{designation for wide flange section} y = \text{vertical distance} z = \text{distance perpendicular to the } x-y plane \Delta = \text{calculus symbol for small quantity} = \text{displacement due to bending} \theta = \text{angle} \phi = \text{diameter symbol} \pi = \text{pi (3.1415 radians or 180^\circ)} \sigma = \text{engineering symbol for normal stress}$
--	--

## **Design Criteria**

Including strength (stresses) and servicability (including deflections), another requirement is that the structure or structural member be *stable*.


<u>Stability</u> is the ability of the structure to support a specified load without undergoing unacceptable (or sudden) deformations.

### **Physics**

Recall that things like to be or *prefer* to be in their lowest energy state (potential energy). Examples include water in a water tank. The energy it took to put the water up there is stored until it is released and can flow due to gravity.


### Stable Equilibrium

When energy is added to an object in the form of a push or disturbance, the object will return to it's original position. *Things don't change in the end.* 

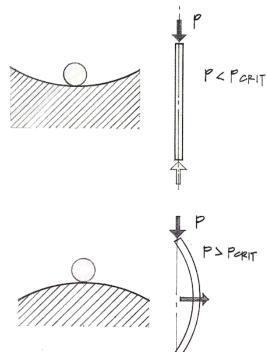


## Unstable Equilibrium

When energy is added to an object, the object will move and get more "disturbed". *Things change rapidly*.



When energy is added to an object, the object will move some then stop.. *Things change*.




2 AA

 $\Delta 6$ 

 $\Delta \theta$ 


### **Column with Axial Loading**

A column loaded centrically can experience unstable equilibrium, called *buckling*, because of how tall and slender they are. This instability is sudden and not good.



Buckling can occur in sheets (like my "memory metal" cookie sheet), pressure vessels or slender (narrow) beams not braced laterally.

Buckling can be thought of with the loads and motion of a column having a stiff spring at mid-height. There exists a load where the spring can't resist the moment in it any longer.




#### **Critical Buckling Load**

The critical axial load to cause buckling is related to the deflected shape we could get (or determine from bending moment of  $P \cdot \Delta$ ).

The buckled shape will be in the form of a *sine wave*.

#### **Euler Formula**

Swiss mathematician Euler determined the relationship between the critical buckling load, the material, section and <u>effective length</u> (as long as the material stays in the elastic range):



and the critical stress (if less than the normal stress) is:

$$f_{critical} = \frac{P_{critical}}{A} = \frac{\pi^2 E A r^2}{A (L_e)^2} = \frac{\pi^2 E}{\left(\frac{L_e}{r}\right)^2}$$

where I=Ar<sup>2</sup> and  $L_e/r$  is called the <u>slenderness ratio</u>. The smallest I of the section will govern.

### **Yield Stress and Buckling Stress**


The two design criteria for columns are that they do not buckle and the strength is not exceeded. Depending on slenderness, one will control over the other.


*But,* because in the real world, things are rarely perfect – and columns will not actually be loaded concentrically, but will see eccentricity – Euler's formula is used only if the critical stress is less than half of the yield point stress:


$$P_{critical} = \frac{\pi^2 E I_{\min}}{\left(L\right)^2}; \quad f_{critical} = \frac{P_{critical}}{A} < \frac{F_y}{2}$$

to be used for  $\frac{L_e}{r} > C_c = \sqrt{\frac{2\pi^2 E}{F_y}}$ 

where  $C_c$  is the column slenderness classification constant and is the slenderness ratio of a column for which the critical stress is equal to half the yield point stress.








### **Effective Length and Bracing**

Depending on the end support conditions for a column, the effective length can be found from the deflected shape (elastic equations). If a very long column is braced intermittently along its length, the column length that will buckle can be determined. The effective length can be found by multiplying the column length by an effective length factor, K.  $L_e = K \cdot L$ 

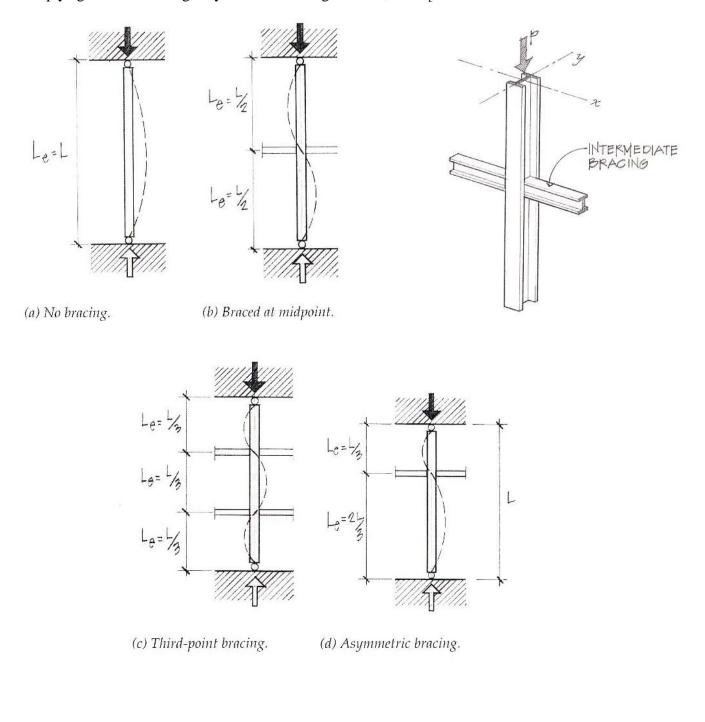

Buckled shape of column shown by dashed line				(d) (d) (1) (1) (1) (1) (1) (1) (1) (1	(e)		
Theoretical K value	0.5	0.7	1.0	1.0	2.0	2.0	
Recommended design values when ideal conditions are approximated	0.65	0.80	1.0	1.2	2.10	2.0	
End conditions code		Rotation free, Translation fixed Rotation fixed, Translation free					

### **Loading Location**


*Centric loading*: The load is applied at the centroid of the cross section. The limiting allowable stress is determined from strength (P/A) or buckling.

Eccentric loading:


The load is offset from the centroid of the cross section because of how the beam load comes into the column. This offset introduces bending along with axial stress. (This can also happen with continuous bea or wind loading.)



Wind Load Left Tension Left



Seismic Load Left Tension Left




Tension Left

C; T


### **Eccentric Loading**

With P, M<sub>1</sub>, and M<sub>2</sub>:


The eccentricity causes bending stresses by a moment of value  $P \times e$ . Within the elastic range (linear stresses) we can *superposition* or add up the normal and bending stresses:

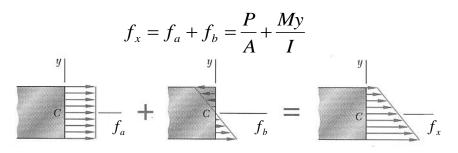

The resulting stress distribution is still *linear*. And the n.a. *moves* (if there is one).




The value of e (or location of P) that causes the stress at an edge to become zero is at the edge of the **kern**. As long as P stays within the kern, there will *not* be any tension stress.



If there is bending in two directions (**bi-axial** bending), there will be one more bending stress added to the total:

$$f_{x} = f_{a} + f_{bx} + f_{by} = \frac{P}{A} + \frac{M_{1}y}{I_{z}} + \frac{M_{2}z}{I_{y}}$$

Kern

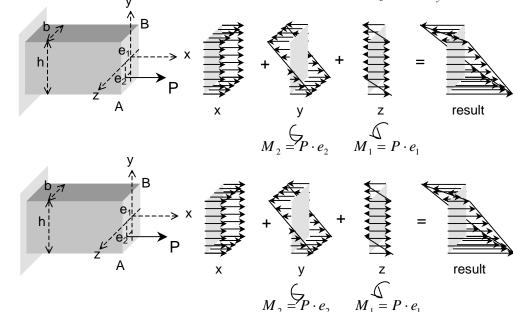


### **Eccentric Loading Design**

Because there are combined stresses, we can't just compare the axial stress to a limit axial stress or a bending stress to a limit bending stress. We use a limit called the **interaction** diagram. The diagram can be simplified as a straight line from the ratio of axial stress to allowable stress= 1 (no bending) to the ratio of bending

stress to allowable stress= 1 (no bending) to the ratio of bending stress to allowable stress = 1 (no axial load).

The interaction diagram can be more sophisticated (represented by a curve instead of a straight line). These type of diagrams take the effect of the bending moment increasing because the beam deflects. This is called the **P-\Delta** (**P-delta**) effect.



Limit Criteria Methods

1) 
$$\frac{f_a}{F_a} + \frac{f_b}{F_b} \le 1.0$$
 interaction formula (bending in one direction)


2) 
$$\frac{f_a}{F_a} + \frac{f_{bx}}{F_{bx}} + \frac{f_{by}}{F_{by}} \le 1.0$$
 interaction formula (biaxial bending)

3) 
$$\frac{f_a}{F_a} + \frac{f_b \times (Magnification \ factor)}{F_b} \le 1.0$$
 interaction formula (P- $\Delta$  effect)

### Example 1 (pg 346)

Example Problem 10.1: Short and Long Columns— Modes of Failure (Figures 10.11 and 10.12)

Determine the critical buckling load for a 3"  $\phi$  standard weight steel pipe column that is 16 ft. tall and pin connected. Assume that  $E = 29 \times 10^6$  psi




Example 2 (pg 346)

Example Problem 10.2 (Figure 10.13)

Determine the critical buckling stress for a 30-foot-long, W12×65 steel column. Assume simple pin connections at the top and bottom.

 $F_y = 36 \text{ ksi} (A36 \text{ steel}); \quad E = 29 \times 10^3 \text{ ksi}$ 



### Example 3 (pg357) Example Problem 10.8 (Figures 10.33 and 10.34a, b)

Determine the buckling load capacity of a 2×4 stud 12 feet high if blocking is provided at midheight. Assume  $E = 1.2 \times 10^6$  psi.

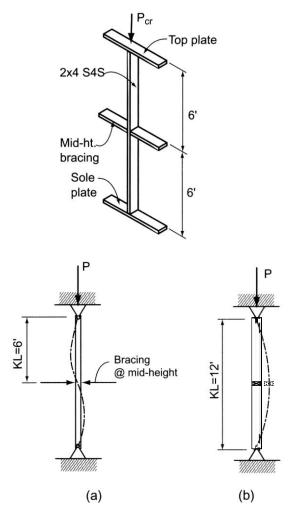



Figure 10.34 (a) Weak axis. (b) Strong axis.

### Frame Analysis Using Multiframe

- 1. The software is on the computers in the College of Architecture in Programs under the Windows Start menu (see https://wikis.arch.tamu.edu/display/HELPDESK/Computer+Accounts for lab locations). Multiframe is under the Bentley Engineering menu.
- 2. There are tutorials available on line at <u>http://www.formsys.com/mflearning</u> that list the tasks and order in greater detail. The first task is to define the unit system:
  - Choose Units... from the View menu. Unit sets are available, but specific units can also be selected by double clicking on a unit or format and making a selection from the menu. Pressure units are used for distributed area loads on load panels.

Jnit Set:	Cor	nfiguration:				
American		Unit Type	Unit	Decimal Places	Format	~
Australian	1	Length	ft	<b>▼</b> 3	Fixed Decimal	
British Canadian	2	Angle	deg	3	Fixed Decimal	
European	3	Deflection	in	3	Fixed Decimal	
Japanese	4	Rotation	deg	3	Fixed Decimal	
	5	Force	kip	3	Fixed Decimal	
	6	Moment	lbf-ft	3	Fixed Decimal	
	7	Dist. Force	lbf/ft	3	Fixed Decimal	
	8	Stress	ksi	3	Fixed Decimal	
	9	Mass	lb	3	Fixed Decimal	
	10	Mass/Length	lb/ft	3	Fixed Decimal	
	11	Area	in²	3	Fixed Decimal	
	12	Mmt of Inertia	in^4	3	Fixed Decimal	
	13	Density	lb/ft³	3	Fixed Decimal	
	14	Section Modulus	in³	3	Fixed Decimal	
		<b>1_</b> . <b>_</b> :				>

- 3. To see the scale of the geometry, a grid option is available:
  - Choose Grid... from the View menu



P

┉◝∩ฅዿ▦∞∞

4. To create the geometry, you must be in the Frame window (default). The symbol is the frame in the window toolbar: 

		33	
The Member toolbar shows	In		
ways to create members:	]] Z N % Z	<b>v</b>	II

The Generate toolbar has convenient tools to create typical structural shapes.

To create a frame, use the multi-bay frame button:



Enter the number of bays (horizontally), number of stories (vertically) and the corresponding spacings:

Generate Frame		X
Primary Structure		
Number of <u>b</u> ays	1	
Number of <u>s</u> tories	1	
Number of frames	1	
B <u>a</u> y spacing	20.000 ft	
Story <u>h</u> eight	5.000 ft	
Frame spacing	0.000 units	
- Secondary Structure		aha aha aha aha aha
Number of <u>S</u> econdary Bear	ms O	1
Number of <u>I</u> ertiary Beams	0	1
Secondary Beam Direction		
ОК	Cancel	

- If the frame does not have regular bays, use the add connected members button to create segments:
- <u>]</u> / N ≯ / |
- Select a starting point and ending point with the cursor. The location of the cursor and the segment length is displayed at the bottom of the geometry window. The ESC button will end the segmented drawing.
- The geometry can be set precisely by selecting the joint (drag), and bringing up the joint properties menu (right click) to set the coordinates.

7777

8

 $\square$ 

+

÷

• The support types can be set by selecting the joint (drag) and using the Joint Toolbar (fixed shown), or the Frame / Joint Restraint ... menu (right click).

NOTE: If the support appears at both ends of the member, you had the member selected rather than the joint. Select the

joint to change support for and right click to select the joint restraints menu or select the correct support on the joint toolbar.

 Restraints
 X

 Restraints
  $\bigcirc$ 
 $\bigcirc$   $\bigcirc$ 
 $\bigcirc$ </td

The support forces will be determined in the analysis.

- 5. All members must have sections assigned (see section 6.) in order to calculate reactions and deflections. To use a standard steel section **proceed to step 6.** For custom sections the section information must be entered. To define a section:
  - Choose Edit Sections / Add Section... from the Edit menu
  - Type a name for your new section
  - Choose group <u>Frame</u> from the group names provided so that the section will remain with the file data
  - Choose a shape. The Flat Bar shape is a rectangular section.
  - Enter the cross section data.

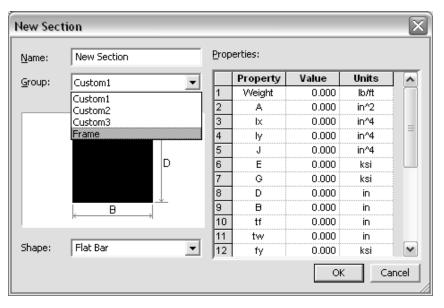



Table values 1-9 must have values for a Flat Bar, but not all are used for every analysis. A recommendation is to put the value of 1 for those properties you don't know or care about. Properties like  $t_f$ ,  $t_w$ , etc. refer to wide flange sections.

- Answer any query. If the message says there is an error, the section will not be created until the error is corrected.
- 6. The standard sections library loaded is for the United States. If another section library is needed, use the Open Sections Library... command under the file menu, choose the library folder, and select the SectionsLibrary.slb file.

Select the members (drag to make bold) and assign sections with the Section button on the Member toolbar:



• Choose the group name and section name:

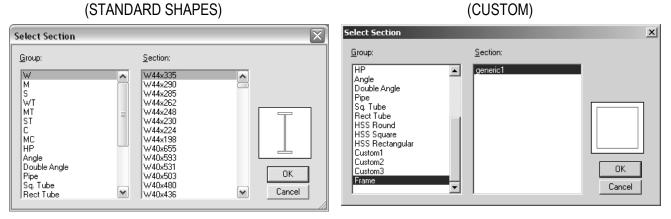

7. If there is an area that has a uniformly distributed load, load panels may be defined in the Frame window. Because the loaded area may not be visible in the current view, choose the View button at the lower left of the Frame window. The options for view are shown. (See 3D Frames, last page.)

Note Set 12.3

- Choose the panel type (rectangular, 4-node, or 3-node) from the menu and select the corners. If the area is rectangular, only the opposite corners need to be selected.
- Select the panel and from the pop-up menu, or the Frame menu, specify the load panel supports. The default supports are on all sides. If the panel is one way, chose the corresponding picture
- 8. The frame geometry is complete, and in order to define the load conditions you must be in the Load window represented by the green arrow:
- 9. The Load toolbar allows a joint to be loaded with a force or a moment in global coordinates, shown by the first two buttons after the display numbers button. It allows a member to be loaded with a distributed load, concentrated load or moment (next three buttons) in global coordinates, as well as loading with distributed or single force or moment in the local coordinate system (next three buttons). It allows a load panel to be loaded with a distributed load in global or local coordinates (last two buttons).


1.0

ъ

沙卡卡

- Choose the member to be loaded (drag) and select the load type (here shown for global distributed loading):
- Choose the distribution type and direction. Note that the arrow shown is the direction of the loading. There is no need to put in negative values for downward loading.
- Enter the values of the load and distances (if any). Distances can be entered as a function of the length , i.e. L/2, L/4...
- Area load units may have to be changed in the View Units dialogue.

*NOTE:* <u>Do not</u> put support reactions as applied loads. The analysis will determine the reaction values.

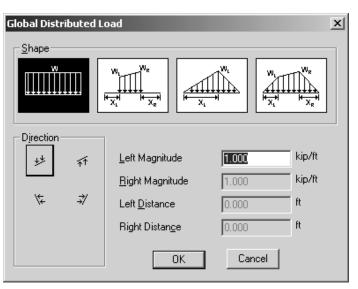

4-node Panel Support Types




\* \* \*



**ARCH 331** 

Multiframe will automatically generate a grouping called a Load Case named Load Case 1 when a load is created. All additional loads will be added to this load case unless a new load case is defined (Add case under the Case menu).


- 10. In order to run the analysis after the geometry, member properties and loading has been defined:
  - Choose Linear from the Analyze menu
- 11. If the analysis is successful, you can view the results in the Plot window represented by the red moment diagram:
- 12. The Plot toolbar allows the numerical values to be shown (1.0)button), the reaction arrows to be shown (brown up arrow) and reaction moments to be shown (brown curved arrow):
  - To show the moment diagram, Choose the red Moment button •
  - To show the shear diagram, Choose the green Shear button
  - To show the axial force diagram, Choose the purple Axial Force button
  - To show the deflection diagram, Choose the blue Deflection ٠ button

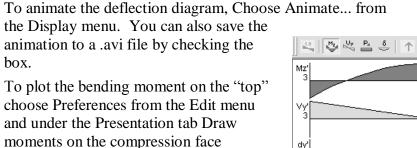


To see exact values of shear, moment and • deflection, double click on the member and move the vertical cross hair with the mouse. The ESC key will return you to the window.


box.

•








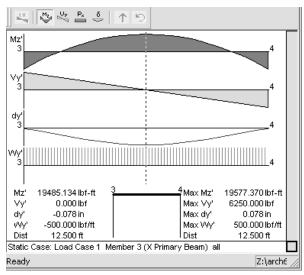

13. The Data window (D) allows you to view all data "entered" for the geometry, sections and loading. These values can be edited.



14. The Results window (R) allows you to view all results of the

analysis including displacements, reactions, member forces (actions) and stresses. These values can be cut and pasted into other Windows programs such as Word or Excel.

NOTE: Px' refers to the axial load (P) in the local axis x direction (x'). Vy' refers to the shear perpendicular to the local x axis, and Mz' refers to the bending moment.

	Memb	Label	Joint	Px' Ibf	Vy' Ibf	Mz' Ibf-ft
1	1	Column	1	6250.000	-1786.320	-9725.784
2	1	Column	3	-6250.000	1786.320	-19577.371
3	2	Column	2	6250.000	1786.320	9725.784
4	2	Column	4	-6250.000	-1786.320	19577.371
5	3	X Prima	3	1786.320	6250.000	19577.371
6	3	X Prima	4	-1786.320	6250.000	-19577.371

- 15. To save the file Choose Save from the File menu.
- 16. To load an existing file Choose Open... from the File menu.
- 17. To print a plot Choose Print Window... from the File menu. As an alternative, you may copy the plot (Ctrl+c) and paste it in a word processing document (Ctrl+v).

### Example of Combined Stresses:

for member 3: 
$$M_{max} = 19.6 \text{ k-ft}$$
,  $P = 1.76 \text{ k}$   
knowing  $A = 21.46 \text{ in}^2$ ,  $I = 796.0 \text{ in}^4$ ,  $c = 7.08 \text{ in}$   
 $f_{max} = \frac{1.76k}{21.46in^2} + \frac{19.6^{k-ft} \cdot 7.08in}{796in^4} \cdot \frac{12in}{ft} = 0.082ksi + 2.092ksi = 2.174ksi$ 

Results window:

	Memb	Label	Joint	Sbz'top ksi	Sbz' bot ksi	Sy' ksi	Sx' ksi	Sx'+Sbz' top ksi	Sx'+Sbz' bot ksi
1	1	Column	1	1.039	-1.039	-1152.461	0.286	1.325	-0.753
2	1	Column	3	-2.092	2.092	-1152.461	0.286	-1.806	2.378
3	2	Column	2	-1.039	1.039	1152.461	0.286	-0.753	1.325
4	2	Column	4	2.092	-2.092	1152.461	0.286	2.378	-1.806
5	3	X Prima	3	-2.092	2.092	4032.245	0.082	-2.011	2.174
6	3	X Prima	4	-2.092	2.092	-4032.245	0.082	-2.011	2.174


where Sx' refers to the axial stress, Sy' refers to the bending stress around the local vertical axis and Sz' refers to the bending stress around the local horizontal axis.

ീന


~ 、 ∩ 用 爲 ⊞ 四 ∞

### For 3D Frames:

- There are tutorials available on line at <u>http://www.formsys.com/mflearning</u> that list the tasks and order in greater detail. It expects that you have been through the 2D tutorial to build on the steps already mastered.
- There are standard 3D frame shapes on the frame toolbar.
- It is very useful to change the view to isometric with the View Button

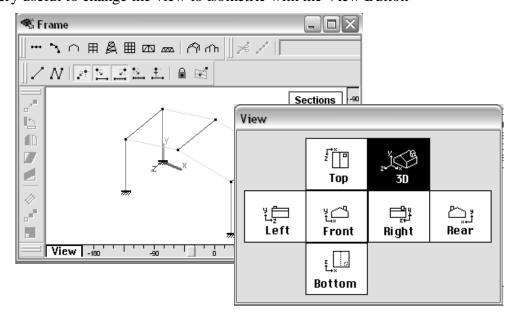


• If you wish to have additional beams supported by the beams of your frame, choose the beam and use the Subdivide Member menu under Geometry. This will make additional joints, but keep the segments together.

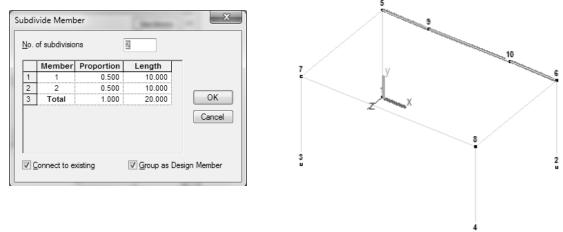

• In order to model a beam end as simply supported, you must release the restraint preventing rotation about the x-x axis of the beam. The pinned ends menu is useful for segments or subdivided members.



Or, by selecting a segment and right clicking for a menu, you can use Member Releases (also under the Frame menu) to release the Major Bending  $(M'_Z)$  for one end or both.



• It is necessary to understand the local member axes to assign the correct load direction. Choosing the *local* loading types will show the member orientation with respect to the load direction.

S Load	
10 4 5 4 4 4 4 5 5	
	Local Distributed Load 🛛 🔀
1000 1000 1000 1000 1000 1000 1000 1000 1000 1000	Shape $ \begin{array}{c}         \underbrace{ \begin{array}{c} \\ \\ \\ \\ \\ \\ \\ \\ \\ \\ \\ \\ \\ \\ \\ \\ \\ \\ \\$
Load Case 1	Image: Constraint of the second se

### **Common Design Loads in Building Codes**

A = name for area AASHTO = American Association of State	R	= rainwater load or ice water load symbol
Highway and Transportation	S	= snow load symbol
Officials	SEI	= Structural Engineering Institute
ASCE = American Society of Civil	t	= name for thickness
Engineers	Т	= effect of material & temperature
ASD = allowable stress design		symbol
D = dead load symbol	V	= name for volume
E = earthquake load symbol	W	= name for distributed load
F = hydraulic loads from fluids symbol	W	= wind load symbol
H = hydraulic loads from soil symbol		= force due to a weight
L = live load symbol		= name for total force due to
$L_r$ = live roof load symbol		distributed load
LRFD = load and resistance factor design	γ	= density or unit weight

### **Design Codes in General**

Design codes are issued by a professional organization interested in insuring safety and standards. They are legally backed by the engineering profession. Different design methods are used, but they typically defined the *load cases or combination*, stress or strength limits, and deflection limits.

### Load Types

Loads used in design load equations are given letters by *type*:

- D = dead load
- L = live load
- $L_r = live roof load$
- W = wind load
- S = snow load
- E = earthquake load
- R = rainwater load or ice water load
- T = effect of material & temperature
- H = hydraulic loads from soil
- F = hydraulic loads from fluids

### **Determining Dead Load from Material Weights**

Material density is a measure of how much mass in a unit volume causes a force due to gravity. The common symbol for density is  $\gamma$ . When volume, V, is multiplied by density, a force value results:

$$W = \gamma \cdot V$$

Materials "weight" can also be presented as a weight per unit area or length. This takes into account that the volume is a thickness times an area:  $V = t \cdot A$ ; so the calculation becomes:

 $W = (weight/unit area) \cdot A$ 

- $w = (weight/unit volume) \cdot t$  which is a weight per unit area
- $w = (weight/unit volume) \cdot A$  which is a weight per unit <u>length</u>

### **Minimum Concentrated Loads**

adapted from SEI/ASCE 7-10: Minimum Design Loads for Buildings and Other Structures

Location	Concentrated load lb (kN
Catwalks for maintenance access	300 (1.33)
Elevator machine room grating (on area of 2 in. by 2 in. (50 mm by 50 mm))	300 (1.33)
Finish light floor plate construction (on area of 1 in. by 1 in. (25 mm by25 mm))	200 (0.89)
Hospital floors	1,000 (4.45)
Library floors	1,000 (4.45)
Manufacturing	
Light	2,000 (8.90)
Heavy	3,000 (13.40)
Office floors	2,000 (8.90)
Awnings and canopies	
Skeleton structure with fabric	300 (1.33)
Support frame with screen enclosure	200 (0.89)
Roofs – primary members and subject to maintenance workers	300 (1.33)
School floors	1,000 (4.45)
Sidewalks, vehicular driveways, and yards subject to trucking (over	
wheel area of 4.5 in. by 4.5 in. (114 mm x 114 mm)	8,000 (35.60)
Stairs and exit ways on area of 2 in. by 2 in. (50 mm by 50 mm) non-	
concurrent with uniform load	300 (1.33)
Store floors	1,000 (4.45)

### Allowable Stress Design (ASD)

Combinations of service (also referred to as *working*) loads are evaluated for maximum stresses and compared to allowable stresses. When wind loads are involved, the allowable stresses are typically allowed to increase by 1/3. The allowed stresses are some fraction of limit stresses.

ASCE-7 (2010) combinations of loads:

1. <i>D</i>
2. $D + L$
3. $D + 0.75(L_r \text{ or } S \text{ or } R)$
4. $D + 0.75L + 0.75(L_r \text{ or } S \text{ or } R)$
5. $D + (0.6W  or  0.7E)$
6a. $D + 0.75L + 0.75(0.6W) + 0.75(L_r \text{ or } S \text{ or } R)$
6b. $D + 0.75L + 0.75(0.7E) + 0.75S$
7. $0.6D + 0.6W$
8. $0.6D + 0.7E$

When F loads are present, they shall be included with the same load factor as dead load D in 1 through 6 and 8.

When H loads are present, they shall have a load factor of 1.0 when adding to load

effect, or 0.6 when resisting the load when permanent.

### Load and Resistance Factor Design – LRFD

Combinations of loads that have been *factored* are evaluated for maximum loads, moments or stresses. These factors take into consideration how likely the load is to happen and how often. This "imaginary" worse case load, moment or stress is compared to a limit value that has been modified by a *resistance* factor. The resistance factor is a function of how "comfortable" the design community is with the type of limit, ie. yielding or rupture...

ASCE-7 (2010) combinations of factored nominal loads:

1. 1.4 <i>D</i>
2. $1.2D + 1.6L + 0.5(L_r \text{ or } S \text{ or } R)$
3. $1.2D + 1.6(L_r \text{ or } S \text{ or } R) + (L \text{ or } 0.5W)$
4. $1.2D + 1.0W + L + 0.5(L_r \text{ or } S \text{ or } R)$
5. $1.2D + 1.0E + L + 0.2S$
6. $0.9D + 1.0W$
7. $0.9D + 1.0E$

When F loads are present, they shall be included with the same load factor as dead load D in 1 through 5 and 7.

When *H* loads are present, they shall have a load factor of 1.6 when adding to load effect, or 0.9 when resisting the load when permanent.

### Minimum Uniformly Distributed Live Loads

Location	Uniform load psf $(kN/m^2)$
Apartments (see Residential)	
Access floor systems	
Office use	50 (2.4)
Computer use	100 (4.79)
Armories and drill rooms	150 (7.18)
Assembly areas and theaters	
Fixed seats (fastened to floor)	60 (2.87)
Lobbies	100 (4.79)
Movable seats	100 (4.79)
Platforms (assembly)	100 (4.79)
Stage floors	150 (7.18)

nted from SEI/ASCE 7-10: Minimum Design Loads for Buildings and Other Structures

	Uniform load $psf(kN/m^2)$
Balconies and decks	1.5 times the live load for th
	occupancy served. Not
	required to exceed 100 psf
	(4.79 kN/m2)
Catwalks for maintenance access	40 (1.92)
Corridors	+0 (1.92)
First floor	100 (4 70)
	100 (4.79)
Other floors, same as occupancy served except as indicated	100 (1.70)
Dining rooms and restaurants	100 (4.79)
Dwellings (see Residential)	
Elevator machine room grating (on area of 2 in. by 2 in.	300 (1.33)
(50 mm by 50 mm))	
Finish light floor plate construction (on area of 1 in. by 1 in.	200 (0.89)
(25 mm by 25 mm))	
Fire escapes	100 (4.79)
On single-family dwellings only	40 (1.92)
Garages	
Passenger vehicles only	40 (1.92)
	60 (2.87)
Helipads	00 (2.07)
Hospitals	(0, (2, 97))
Operating rooms, laboratories	60 (2.87)
Patient rooms	40 (1.92)
Corridors above first floor	80 (3.83)
Hotels (see Residential)	
Libraries	
Reading rooms	60 (2.87)
Stack rooms	150 (7.18)
Corridors above first floor	80 (3.83)
Manufacturing	
Light	125 (6.00)
Heavy	250 (11.97)
Office buildings	250 (11.57)
File and computer rooms shall be designed for heavier loads based	
on anticipated occupancy	100 (4 70)
Lobbies and first floor corridors	100 (4.79)
Offices	50 (2.40)
Corridors above first floor	80 (3.83)
Penal institutions	
Cell blocks	40 (1.92)
Corridors	100 (4.79)
Recreational uses	
Bowling alleys, poolrooms, and similar uses	75 (3.59)
Dance halls and ballrooms	100 (4.79)
Gymnasiums	100 (4.79)
Reviewing stands, grandstands, and bleachers	100 (4.79)
Stadiums and arenas with fixed seats (fastened to the floor)	60 (2.87)
Residential	00 (2.07)
One- and two-family dwellings	
Uninhabitable attics without storage	10 (0.48)
Uninhabitable attics with storage	20 (0.96)
Habitable attics and sleeping areas	30 (1.44)
All other areas except stairs	40 (1.92)
All other residential occupancies	
All other residential occupancies Private rooms and corridors serving them	40 (1.92)

Location	Uniform load $psf(kN/m^2)$
Roofs	
Ordinary flat, pitched, and curved roofs	20 (0.96n
Roofs used for roof gardens	100 (4.79)
Roofs used for assembly purposes	Same as occupancy served
Roofs used for other occupancies	As approved by authority
·	having jurisdiction
Awnings and canopies	
Fabric construction supported by a skeleton structure	5 (0.24) nonreducible
Screen enclosure support frame	5 (0.24) nonreducible
	and applied to the roof frame
	members only, not the screen
All other construction	20 (0.96)
Schools	
Classrooms	40 (1.92)
Corridors above first floor	80 (3.83)
First-floor corridors	100 (4.79)
Scuttles, skylight ribs, and accessible ceilings	200 (0.89)
Sidewalks, vehicular driveways, and yards subject to trucking	250 (11.97)
Stairs and exit ways	100 (4.79)
One- and two-family dwellings only	40 (1.92)
Storage areas above ceilings	20 (0.96)
Storage warehouses (shall be designed for heavier loads if required for	
anticipated storage)	
Light	125 (6.00)
Heavy	250 (11.97)
Stores	
Retail	
First floor	100 (4.79)
Upper floors	75 (3.59)
Wholesale, all floors	125 (6.00)
Walkways and elevated platforms (other than exit ways)	60 (2.87)
Yards and terraces, pedestrian	100 (4.79)

Live load reductions are not permitted for specific types (see code). Some occupancies must be designed for appropriate loads as approved by the authority having jurisdiction. Library stack room floors have specified limitations (see code) AASHTO lane loads should also be considered where appropriate.

Table 17-12 (cont.). Weights and Specific Gravities	Substance	TIMBER, U.S. SEASONED Moisture content by weight	Seasoned timber 15 to 20%	Green timber up to 50%	Cedar, white, red	Chestnut	Cypress	Fir, Douglas spruce	Fir, eastern	Hemlock	Hickory	Locust	Maple, hard	Maple, white	Oak, criestriut	Oak, red, black	Oak, white	Pine, Oregon	Pine, red	Pine, white	Pine, vellow, iong-teat	Poplar	Redwood, California	Spruce, white, black	Walnut, black				VARIOUS LIQUIDS	Alcohol, 100%	Acids, muriatic 40%	Acids, nitric 91%	Lve. soda 66%	Oils, vegetable	Oils, mineral, lubricants	Water, 4°C max. density	Water, 100-C	Water, snow, fresh fallen	Water, sea water				<b>GASE</b> C	Air. 0°C 760 mm	Ammonia	Carbon dioxide	Carbon monoxide	Gas, natural Gas, natural	Hvdrogen
Table 17-12 (cont.). hts and Specific Gra	Specific Gravity	0 66 0 76	8.4-8.7	7.4-8.9	0.6-8.8	4.1-4.3	19.25-19.3	7.2	7.6-7.9	6.7-7.3	5.2	I	1	3.6-4.0	25-30	11.37	7.3-7.6	1.74-1.83	7.2-8.0	3.7-4.6	8.8-9.0	8.9-9.2	21.1-21.5	10.4-10.6	2 7 - C 7	6.4-7.0	6.9-7.2	7.4-0.0					. 1	I	I	i I	1 47 4 60	0.90-0.97	0.40-0.50	0.70-0.80	2.40-2.60	2.45-2.72	2.90-3.00	0.70-1.15	1	0.92-0.96	1.0-2.0	1 1	1.53
Weig	Weight Ib per cu ft		534	509	481 556	262	1205	450	485	400	325	160-180	130-160	237	179	710	465	112	475	259	849 556	565	1330	656	459	418	440	267					32	39	48	8 8	02	28	28	47	156	161	184	28	42	59	94	48 67	96
	Substance	METALS, ALLOYS, ORES	Aluminum, cast, nammered Brass, cast, rolled	Bronze, 7.9 to 14% Sn	Bronze, aluminum Conner cast, rolled	Copper ore, pyrites	Gold, cast, hammered	Iron, cast, pig	Iron, wrought	Iron, speigel-elsen	Iron ore, hematite	Iron ore, hematite in bank	Iron ore, hematite loose	Iron ore, limonite	Iron ore, magnetite	Lead	ore, galena	Magnesium, alloys	Manganese	Manganese ore, pyrolusite	Monel Metal	Nickel	Platinum, cast, hammered .	Silver, cast, hammered	Tin cast hammered	Tin ore, cassiterite	Zinc, cast, rolled	Zinc ore, plende	de la	20	051		Cereals oats bulk	Cereals, barley		Cereals, wheat bulk	Como Flor Home	Cottori, riax, nerrip	Flour, loose	Flour, pressed	Glass, common	Glass, plate or crown	Glass, crystal	Paper	Potatoes, piled	Rubber, caoutchouc	Rubber goods	Saltheter	Starch
	Specific Gravity		4.50	2.7-3.2	2.55	1.8-2.6	1.8-2.6	2.9	2.5-2.6	25-2.7	2.8-3.2	2.3-2.8	3.0	2.5-2.8	0.0	2.6-2.9	0.37-0.90	2.5-2.8	2.2-2.5	6.2-1.2	0.7-0.7			I	I	I	1				1.1-1.5	1 2=1 5	1.1-1.4	0.65-0.85	0.28-0.44	1 0-1 4	10-03	0.87-0.91	0.87	0.79-0.82	c/.0-E/.0	0.000-0.00	1.20				1	1	1

### Building Material Weights-AISC Manual of Load and Resistance Factor Design, 3<sup>rd</sup> ed.

0.79 1.20 1.50 1.80 1.70 0.91-0.94 0.990-0.92 1.0 0.958 0.922 1.025 1.02-1.03

Note Set 13.1

Image: brance         Im		Weigh	Table Its and S	Table 17-12. Weights and Specific Gravities				Weig	Table 17- hts and Sp	Table 17-12 (cont.). Weights and Specific Gravities		
RFLAS. ALLONS OFES         United Res Not Section Control	Substance	Weight Ib per cu ft	Specific Gravity	Substance	Weight Ib per cu ft	Specific	Center	Weight Ib per	Specific	Cithetance	Weight Ib per	Specifi
2         Annumeric and humaning         2         2         3         0	ASHLAR, MASONRY Granite, svenite, gneiss	165	2.3-3.0	MINERALS Asbestos	153	Aliapin	METALS, ALLOYS, ORES	-	GIGVILY	TIMBER, U.S. SEASONED		
3         9         7.4.83         7.4.93         6         6           0.0         0.0.0.4 (35), 7.5.3         5.9.1 (35), 7.5.3         5.	Limestone, marble	160	2.3-2.8	Barytes	281	2.1-2.8 4.50	Aluminum, cast, hammere Brass, cast, rolled		2.55-2.75 8.4-8.7	Moisture content by weight: Seasoned timber 15 to 20%		
0         0		2	t. J	Bauxite	159	2.7-3.2	Bronze, 7.9 to 14% Sn	509 481	7.7	Green timber up to 50% Ash. white. red	40	0.62-0.6
Bit         Copper One pyrine         222         14.7         3         15.2         14.3         3         15.2         14.3         3         15.2         15.3         <	MORTAR RUBBLE MASONRY			Borax	109	1.7-1.8	Copper, cast, rolled	: :	8.8-9.0	Cedar, white, red	82	0.32-03
1         7	Granite, syenite, gneiss	155	2.2-2.8	Clay, marl.	137	1.8-2.6	Copper ore, pyrites	1205	4.1-4.3 19.25-19.3	Cypress	<del>1</del> 8	0.48
1         Conv. wrought         455         7.5-7.9         15         Fin. white         25           2         100. wrought         455         5.7.7.3         5.4.1.9         6.6.1.1.1.1.1.1.1.1.1.1.1.1.1.1.1.1.1.1	Candetone, marble	150	2.2-2.6	Dolomite	181	2.9	Iron, cast, pig	450	7.2	Fir, Douglas spruce	32	0.51
1         Constrained         Constraine <thconstrained< th=""> <thconstr< td=""><td></td><td>200</td><td>2:2_0:2</td><td>Greiss, serpentine</td><td>159</td><td>2.5-2.6</td><th>Iron, wrought</th><td>485</td><td>7.6-7.9</td><td>Fir, eastern</td><td>25</td><td>0.40</td></thconstr<></thconstrained<>		200	2:2_0:2	Greiss, serpentine	159	2.5-2.6	Iron, wrought	485	7.6-7.9	Fir, eastern	25	0.40
2         1         1000         1000         40           0<	DRY RUBBLE MASONRY			Granite, syenite	175	2.5-31	Iron ferro-silicon	437	6.7-7.3	Hemlock	29	0.42-0.5
Bit         Incorron the mentation in bank.         100-160         -         Lost one, permatritien in bank.         100-160         -         Lost one, permatritien in bank.         100-160         -         -         Lost one, meaning lost one, permatritien in bank.         100-160         -         -         Lost one, meaning lost one, permatritien in bank.         100-160         -         -         Lost one, permatritien in bank.         100-160         -         -         Lost one, meaning lost one, permatritien in bank.         100-160         -         -         Lost one, meaning lost one, permatritien in bank.         100-160         -         -         Lost one, meaning lost one, permatritien in bank.         100-160         -         -         Lost one, meaning lost one, permatritien bank.         100-160         -         -         Lost one, meaning lost one, permatritien bank.         100-160         -         100-160         -         20-160         -         100-160         -         20-160         -         20-160         -         20-160 <td>Granite, syenite, gneiss</td> <td>130</td> <td>1.9-2.3</td> <td>Greenstone, trap</td> <td>187</td> <td>2.8-3.2</td> <th>Iron ore, hematite</th> <td></td> <td>5.2</td> <td>Hickory</td> <td>49</td> <td>0.74-0.8</td>	Granite, syenite, gneiss	130	1.9-2.3	Greenstone, trap	187	2.8-3.2	Iron ore, hematite		5.2	Hickory	49	0.74-0.8
1         1         1         2         3         4	Sandstone, bluestone	110	1.8-1.9	Hornblende	187	2.3-2.8	Iron ore, hematite in bank		1 1	Manle hard	46	0.73
0         1         3         4 5-5.0         Ook (here that here the here that here the here that here tha				Limestone, marble	165	2.5-2.8	Iron ore, limonite		3.6-4.0	Maple, white	33 5	0.53
1         1         2	Pressed brick	140	5 2-2 3	Magnesite	187	3.0	Iron ore, magnetite		4.9-5.2	Oak, chestnut	54	0.86
Display         Constrained Maganese         463 (5)         7,2,7,6 (7,2,4)         Constraine (6)         463 (7,2,4)         7,2,7,6 (7,2,4)         Constraine (7,6)         463 (7,2,4)         7,2,7,6 (7,7,4)         Constraine (7,6)         463 (7,7,7)         7,2,7,6 (7,7,7)         Constraine (7,6)         463 (7,7,7)         7,2,7,6 (7,7,7)         Constraine (7,6)         463 (7,7,7)         473 (7,7,7)         473 (7,	Common brick	120	1.8-2.0	Porphyry	172	3.2	Iron slag		2.5-3.0	Oak, live	59	0.95
Bit         Magneties         112         1	Soft brick	100	1.5-1.7	Pumice, natural	40	0.37-0.90	Lead ore, galena		7.3-7.6	Oak, white	46	0.74
2.9         Marganese Marganese ore, pyridusie         475         7.2-6.0         Prine, while, black         2.0           2.9         Marganese ore, pyridusie         23         3.4.6         Prine, while, black         20           2.9         Marganese ore, pyridusie         23         3.4.6         Prine, while, black         20           2.0         Marganese ore, pyridusie         253         3.4.6         Prine, while, black         23           2.0         Street, cast, hammered         33         430         7.2.8         Walnut, while         26           2.0         Street, cast, hammered         533         214-10.6         Street, while, black         27           2.0         Street, cast, hammered         53         7.4.2         Walnut, while         27           2.1         The one, castellorid         430         7.2.5         Walnut, while         27           2.1         Zene one, blache         233         3-4.2         Markin, while         27           2.1         Cereals, keinter         21         21         21         21           2.1         Cereals, keinter         23         24.2         24         27           2.1         Cereals, keinter         24 <td< td=""><td>CONCRETE MASONRY</td><td></td><td></td><td>Quartz, flint Sandstone Muestone</td><td>165</td><td>2.5-2.8</td><th>Magnesium, alloys</th><td></td><td>1.74-1.83</td><td>Pine, Oregon</td><td>32</td><td>0.51</td></td<>	CONCRETE MASONRY			Quartz, flint Sandstone Muestone	165	2.5-2.8	Magnesium, alloys		1.74-1.83	Pine, Oregon	32	0.51
Bit         Memory	Cement, stone, sand	144	2.2-2.4	Shale, slate	175	2.7-2.5	Manganese ore overlisite		3.7-4.6	Pine, red	30	0.48
Norein Metal         556         88-90         Pms. yolow shortheit         38           11         Construction         556         88-90         Pms. yolow shortheit         38           12         Steler, cast, harmered         1330         211-215         Redword, California         28           Steler, cast, harmered         1330         211-215         Redword, California         28           Steler, cast, harmered         430         7.2.75         Wahut, black         28           Steler, cast, harmered         430         7.2.75         Wahut, black         28           Steler, cast, harmered         430         7.2.75         Wahut, black         28           The row, steller         430         7.2.75         Wahut, black         28           The row, steller         430         6.4.7.0         8         49         26           2015         Zine, cast, rest         440         6.4.7.0         75         49           2016         Steller         112         28         28         28         28           2017         Steller         28         28         28         28         28           2018         Steller         28         29         24 <td>Cement, slag, etc.</td> <td>130</td> <td>1.9-2.3</td> <td>Soapstone, talc</td> <td>169</td> <td>2.6-2.8</td> <th>Mercury</th> <td></td> <td>13.6</td> <td>Pine, yellow, long-leaf</td> <td>44</td> <td>0.70</td>	Cement, slag, etc.	130	1.9-2.3	Soapstone, talc	169	2.6-2.8	Mercury		13.6	Pine, yellow, long-leaf	44	0.70
Network         Sever         <	Cement, cinder, etc.	001	/.1-6.1				Monel Metal	556	8.8-9.0	Pine, yellow, short-leaf	88	0.61
New construction         555         104-10.6         Spruce while, black         27           Tro, cast, harmered         555         Tot, cast, harmered         555         Valut, while         26           Tro, cast, harmered         555         Tot, cast, harmered         555         Valut, black         26           Tro, cast, harmered         555         Walut, black         26         26         27           Znc, cast, lost, harmered         553         33-42         Xentu, black         26           Znc, cast, lost, harmered         555         Walut, black         26         26           Znc, cast, lost, harmered         555         Walut, black         26         27           Znc, cast, lost, harmered         555         Walut, cast, down, harmered         26           253         33-42         Xeds, mithic 47%         27           26         Cast, market 47%         24         24           265         Cast, market 47%         24         24           265         Cast, market 47%         27         24           266         Market, for mork 47%         27         24           267         Cast, market 47%         27         24           266         Cast, ma	VARIOUS BUILDING						Nickel		211-215	Poplar Redwood California	90	0.42
Steel rolled         490         7.85         Wahut, while         26           Tin cast, hammered         439         7.35         Wahut, while         26           Tin creat, stating         439         5.3-7.2         Xenol. 10%.         26           Zinc cast, rolled         233         3.3-4.2         Wahut, while         26           Zinc cast, rolled         233         3.3-4.2         Xenol. 10%.         26           Zinc cast, rolled         233         3.3-4.2         Xenol. 10%.         26           Zinc cast, rolled         233         3.3-4.2         Xenol. 10%.         27           Zinc cast, rolled         253         3.3-4.2         Xenol. 10%.         26           Zinc cast, rolled         233         3.3-4.2         Xenol. 10%.         27           Zinc cast, rolled         253         3.3-4.2         Xenol. 10%.         27           Zinc cast, rolled         25         Acids, mindred role.         26           Zinc cast, rolled         26         Cast mindred role.         25           Zinc cast, rolled         28         Cast mindred role.         26           Zinc cast, rolled         28         Cast mindred role.         26           Zinc cast, rollen	MATERIALS	11 01		STONE, QUARRIED, PILED	00		Silver, cast, hammered		10.4-10.6	Spruce, white, black	27	0.40-0.4
Tin creat, harmered         439         7.2-7.5         Wand, while         26           Tin creat, harmered         439         7.2-7.5         Wand, while         26           Tin creat, none         253         3.3-4.2         WARIOUS LIQUIDS         49           Tin creat, none         253         3.3-4.2         MARIOUS SOLIDS         44           Zinc cast, none         253         3.3-4.2         MARIOUS SOLIDS         44           VARIOUS SOLIDS         Zinc cast, none         438         6.4-7.0         75           Zinc cast, none         253         3.3-4.2         MARIOUS SOLIDS         75           Variation         253         3.3-4.2         25         75           Careals, contr, pressid         24         24         245         25           Dis, metral, ubricants         25         0.40-0.50         96         97           Dis, metral, ubricants         240-2.60         0.44         26         97           Dis, metral, ubricants         240-2.60         0.44         0.22-0.96         0.4760         076           Dis, metral, ubricants         240-2.60         0.44         0.22-0.96         0.4760         076           Dister, ice         26         <	Cement, portland, loose	67-04 06		Limestone, marble, quartz	95 95	1 1	Steel, rolled	490	7.85	Walnut, black	38	0.61
Time. cast. rolled         440         6.9-7.2         2         2         2         4         4         6         4         4         6         4         4         6         4         4         6         9         4         0 </td <td>Cement, portland, set</td> <td>183</td> <td>2.7-3.2</td> <td>Sandstone</td> <td>82</td> <td>I</td> <th>Tin, cast, hammered</th> <td></td> <td>6.4-7.0</td> <td>Walnut, white</td> <td>56</td> <td>0.41</td>	Cement, portland, set	183	2.7-3.2	Sandstone	82	I	Tin, cast, hammered		6.4-7.0	Walnut, white	56	0.41
Zinc ore, blende         253         3-4-2         Acond. 100%         49           1.5         VARIOUS LOUIDS         Acond. 100%         7         94           1.5         VARIOUS SOLIDS         Acond. 100%         7         94           0.44         Acond. 100%         7         94         7           0.45         Cereals, barley         bulk         39         -         94           0.45         Cereals, barley         bulk         39         -         94           0.46         Cereals, barley         bulk         39         -         94           0.47         Cereals, barley         bulk         39         -         -         94           0.41         Cereals, barley         bulk         39         -         -         94           0.41         Cereals, barley         bulk         39         -	Lime, gypsum, loose	53-64 103	1.4-1.9	Shale Greenstone, hornblende	92	1 1	Zinc, cast, rolled		6.9-7.2			
15       VARIOUS SOLIDS       Variable       49         17       Variable       Accids, mirrlo 91%       49         14       Cereals, barley       bulk       33       -       49         0.44       Cereals, barley       bulk       33       -       112       75         0.45       Cereals, barley       bulk       33       -       -       112       112         0.45       Cereals, barley       bulk       48       -       -       112       112         0.45       Cereals, barley       bulk       48       -       -       112       112         0.46       Cereals, barley       bulk       48       -       -       112       112         0.47       Cereals, barley       bulk       48       -       -       112       112         0.47       Cereals, barley       bulk       48       -       -       112       112         0.47       Cereals, barley       bulk       48       -       -       016       112       122         0.5       Mater, for max, deristy       East, attrater, and frant, and and frant, a	Slags, bank slag	67-72	1		2		Zinc ore, blende		3.9-4.2			
15         Annous sources         49           1.17         Annous sources         57           1.18         Cereals, barley         bulk           0.57         Annous sources         59           0.57         Hay and yer         51           0.57         Hay and         20           0.57         Hay and         23           0.57         Hay and         23           0.58         Cereals, barley         bulk           0.57         Hay and         23           0.58         Cereals, barley         bulk           0.57         Hay and         23           0.57         Hay and         23           0.58         Carsa         24           0.58         Mater, arow, ireart, low         26           0.58         Mater, arow, ireard, low         64           1.15         Carsa         0.5         24-2-2.0           1.15         Conelor         26         26-2-3.0 <td>Slags, bank screenings</td> <td>98-117</td> <td>1</td> <td></td> <td></td> <td></td> <th>d C</th> <td></td> <td></td> <td></td> <td></td> <td></td>	Slags, bank screenings	98-117	1				d C					
1.7       Acids, muriatic 40%       75         1.7       Arribus SOLIDS       Acids, muriatic 40%       75         1.4       Cereals, oats       bulk       32       -       94         0.85       Cereals, oats       bulk       32       -       106       112         0.85       Cereals, oats       bulk       33       -       018, mirratic 40%       75         0.85       Cereals, wheat       bulk       33       -       018, mirratic 40%       55         0.85       Cereals, wheat       bulk       48       -       147-1.50       Use, soda 65%       55         0.85       Cereals, wheat       bulk       48       -       018, mirratic 40%       57         0.85       Cereals, wheat       bulk       48       -       018, mirratic 40%       57         0.85       Cereals, wheat       bulk       48       -       018, mirratic 40%       57         0.85       Mater, for       Water, for       Water, for       56       44         0.85       Flau, 0*70-080       Mater, for       64       44         0.85       Flau, 0*70-080       070-0180       Mater, for       64         1.15	Slags, machine slag	90 49-55		BITUMINOUS SUBSTANCES			03			VARIOUS LIQUIDS Alcohol. 100%	49	0.79
1.7       Variables       22       -       Acids shrifts       94         0.86       Cereals, carls       bulk       32       -       124         0.86       Cereals, corn, yea       bulk       33       -       106       124         0.87       Cereals, corn, yea       bulk       33       -       0ils, weightab       106       57         0.87       Cereals, surfay       bulk       38       -       0ils, weightab       105       57         0.87       Cereals, wheat       bulk       48       -       Nater, 410       106       57         0.88       Cereals, wheat       bulk       48       -       Nater, 410       57       242         0.88       Conton, Flax, Henp       58       0.00-057       Water, snow, fresh failen       64         0.88       Flour, pressed       47       0.70-0.80       Water, snow, fresh failen       64         0.88       Flour, pressed       155       240-0.56       Water, snow, fresh failen       64         0.88       Flour, pressed       156       0.70-1.15       Art, 0°C 760 mm       0.41       0.47         1.15       2.46-2.72       Glass, sprandured, piled       2.45-2.72				Asphaltum	81	1.1-1.5	150			Acids, muriatic 40%	75	1.20
1.1         Cereals, only         32         -         Constraints         53           0.54         Cereals, onni yee         bulk         39         -         106         58           0.54         Cereals, onni yee         bulk         39         -         0018, weights, onti yee         55           0.57         Cereals, onni yee         bulk         39         -         018, minatil, lubricants         55           0.57         Cereals, onni yee         bulk         48         -         018, minatil, lubricants         55           0.57         Cereals, onni yee         03         147-150         Water, 100         56         53           0.57         Cereals, onnon         155         0.00-050         Water, 100         56         56           0.57         Cereals, common         156         2.40-2.60         Water, 100         56         56           0.58         Glass, common         156         2.40-2.60         Water, 100         50071         56           0.58         Glass, common         161         2.40-2.60         Water, 100         50         56           0.58         Glass, common         151         2.40-2.60         Water, 100         56	Clav drv	63		Coal, anthracite	97 84	1.4-1.7				Acids, nitric 91%	94	1.50
D55         Cereals, barley         Dulk         33         -         Oils, wegetable         58           1.4         Cereals, when         -         Nater, 47         -         0ils, wegetable         58           1.4         Cereals, when         -         Nater, 47         -         0ils, wegetable         58           1.4         Cereals, when         -         Nater, 47         -         0ils, wegetable         58           2.3         Cotton, Flax, Henp         58         0.90-0.97         Water, 100° C         58.33           2.7         Water, 100° C         -         Water, 100° C         58.33         56           2.3         Flour, pressed         147-150         Water, 100° C         59.33         56           2.47         2.470-550         Water, 100° C         59.36         56         56           2.47         2.470-560         Mater, 5ea water         56         56         56           2.48         0.66-102         0.66-102         0.645         56         56         56           2.48         0.66-102         0.645         242-260         0.645         56         56         56         56         56         56         56 <t< td=""><td>Clay, damp, plastic</td><td>11 8</td><td>1</td><td>Coal, lignite</td><td>78</td><td>1.1-1.4</td><th></th><td></td><td>I</td><td>Lve, soda 66%</td><td>106</td><td>1.70</td></t<>	Clay, damp, plastic	11 8	1	Coal, lignite	78	1.1-1.4			I	Lve, soda 66%	106	1.70
0.44         Cereals, word, yee, bulk         48         -         0.141-150         Nater, 47 cm ax density         57           1.4         Hay and Straw         balles         20         -         Water, 47 cm ax density         57           2.3         Caterals, when         58         0.47-150         Water, 47 cm ax density         23           7         Fais.         Catera, Fais, hern         58         0.40-050         Water, 67 cm ax density         25428           7         Fais.         Octon, Fais, hern         58         0.40-050         Water, 67 cm ax density         25428           7         Cates         200-057         Water, 67 cm ax density         25434           7         2.40-2.50         Water, 67 cm ax density         25434           7         2.40-2.50         Water, 67 cm ax density         25434           7         2.40-2.50         Water, 67 cm ax density         25434           64         2.40-2.50         Water, 67 cm ax density         25434           7         2.40-2.50         Water, 67 cm and fraiter         242           8         Water, 67 cm and fraiter         242         240-2.50           9         0.50-115         Armonia         240-2.50         04070 <td>Clay and gravel, dry</td> <td>100</td> <td>I</td> <td>Coal, peat, turf, dry</td> <td>47</td> <td>0.65-0.85</td> <th>:</th> <td></td> <td>I</td> <td>Oils, vegetable</td> <td>58</td> <td>0.91-0.9</td>	Clay and gravel, dry	100	I	Coal, peat, turf, dry	47	0.65-0.85	:		I	Oils, vegetable	58	0.91-0.9
1.4       Hay and Straw       20       -       -       Water, too? C       59.830       0         2.3       1.47-1.50       Water, too? C       59.830       0       56       0       56       56       0       56       240-2.50       0       0       56       13       12       12       56       240-2.50       0       0       56       13       56       13       56       13       56       13       56       13       56       13       56       13       56       13       54       10       54       10       57       54       10       54	Earth, dry, pocked	95	1	Coal, charcoal, pine	83	0.47-0.57	1			Oils, mineral, lubricants Water 4°C max, density	5/ 62.428	0.90-0.1
2.3         Catton, Flax, Hemp         53         1.47-1.50         Water, Ice         56	Earth, moist, loose	78	ı	Coal, coke	75	1.0-1.4			I,	Water, 100°C	59.830	0.9584
75         Flau:         58         0.90-0.97         Water, snow, restraten         64           225         Flour, pressed         47         0.70-0.80         Water, sea water         64           255         Glass, plate or crown         156         2.40-2.60         Water, sea water         64           115         Glass, plate or crown         161         2.45-2.70         00071         8           115         Glass, plate or crown         161         2.45-2.70         0.8071         9071           115         Class, crystal         161         2.45-2.70         0.8071         9071         9071           115         Class, plate or crown         161         2.45-2.70         0.8071         9071         9071           115         Class, crystal         184         2.90-300         GASES         0.8071         9071           115         Class, crystal         184         2.90-300         GASES         0.8071         0.8071           115         Class, crystal         14         1.0-2.0         0.8071         0.8071           115         Paper         2.80-300         0.81000000         0.221-005         0.7131           110-2.5         Glass, nutrial         0.22-00	Earth, moist, packed	96	I	Graphite	131	1.9-2.3	Cotton, Flax, Hemp		1.47-1.50	Water, ice	56	0.88-0.0
Discrete         From common         15         0.70-080 <t< td=""><td>Earth, mud, nowing</td><td>115</td><td>1</td><td>Petroleum</td><td>56</td><td>0.87</td><th>Fats Flour loose</th><td>58</td><td>0.90-0.97</td><td>Water, snow, fresh fallen Water sea water</td><td>8</td><td>1 02-1 (</td></t<>	Earth, mud, nowing	115	1	Petroleum	56	0.87	Fats Flour loose	58	0.90-0.97	Water, snow, fresh fallen Water sea water	8	1 02-1 (
0.75         Class, common         156         2.40-2.60         Class, common         161         2.46-2.72           0         Glass, prystal         Class, prystal         0.08071         0.00071           1.15         Class, prystal         0.08071         2.45-272         0.00071           1.16         2.45-272         Class, prystal         0.00071         0.00071           Paper         55         0.20-115         Arr, 0°C 760 mm         0.0478           Pubber goods         0.20-056         Carbon dioxide         0.0781           Salt, granulated, plied         42         0.92-0.96         Carbon dioxide         0.038-039           Salt, granulated, plied         6         1.53         Hydrogen         0.038-039         0.038-039           Salt, granulated, plied         6         1.32         Nitrogen         0.038-039         0.038-039           Salt, granulated, plied <td>Riprap, limestone</td> <td>80-85</td> <td>I</td> <td>Petroleum, refined</td> <td>50</td> <td>0.79-0.82</td> <th>Flour, pressed</th> <td>47</td> <td>0.70-0.80</td> <td></td> <td></td> <td></td>	Riprap, limestone	80-85	I	Petroleum, refined	50	0.79-0.82	Flour, pressed	47	0.70-0.80			
1.15         Class, crystal         100         2-59-3.05         Class         09071           Class, crystal         Class, crystal         0.06-1.02         0.06-1.02         0.0071         0.0071           Pater         Class, crystal         0.06-1.02         0.06-1.02         0.0671         0.0071           Pater         Class, crystal         0.06-1.02         0.06-1.02         0.0071         0.0071           Pater         Class, crystal         0.06-1.02         0.06-1.02         0.0671         0.0731           Pater         Class, crystal         0.02-0.05         0.02-0.05         0.0731         0.0731           Pater         Class, crystal         0.02-0.05         0.028-0.055         0.038-005         0.038-005           Saft, granulated, plied         48         1.0-2.0         Cashon moxide         0.038-005         0.038-005           Saft, granulated, plied         6         1.53         Nitrogen         0.038-005         0.038-005           Suphur         1.25         1.92-2.07         Nitrogen         0.038-005         0.038-005           Suphur         1.25         1.32         0.0794         0.038-005         0.038-005           Vicola         1.32         0.0794         0.070	Riprap, sandstone	90 705	1	Petroleum, benzine	46	c/.0-23-0.73	Glass, common		2.40-2.60			
0         Leather         59         0.86-1.02         GASES         0.00071           Paper         58         0.70-1.15         Att. 0.0 7.90 mm         0.00071           Paper         58         0.70-1.15         Att. 0.0 7.90 mm         0.0071           Paper         58         0.70-1.15         Att. 0.0 7.90 mm         0.0071           Paper         58         0.70-1.15         Att. 0.0 7.90 mm         0.0071           Paber         59         0.92-0.96         Carbon dioxide         0.039-0.039           Rubber         59         0.92-0.96         Carbon dioxide         0.734           Satipeter         94         1.0-2.0         Carbon dioxide         0.734           Satipeter         94         1.0-2.0         Carbon dioxide         0.734           Satipeter         94         1.0-2.0         Carbon dioxide         0.784           Satipeter         67         1.32         Hytorgen         0.058         0.058           Vool         1.132         1.32         Oxygen         0.0582         0.0582         0.0582           Mutioper cubic foot are derived from writer at 4^C, those of gases to air at 0°C and 760 mm pressure. The weights are for bulk, heaper         0.0892         0.0992         0	Sand, gravel, dry, loose	90-105	1	Pitch	69	1.07-1.15	Glass, crystal		2.90-3.00			
Paper         0.07-115         Nit 0.7 70 mm.         0.80071           Paper         Ammonia	Sand, gravel, dry, packed	100-120	I	Tar, bituminous	75	1.20	Leather		0.86-1.02	GASES		
Rubber, caouthouc     59     0.92-0.96     Carbon monoide     1234       Rubber, caouthouc     59     0.92-0.96     Carbon monoide     1234       Salt, granulated, plied     67     1.0-2.0     Carbon monoide     0781       Salt, granulated, plied     67     -     6as, natural     0.039-036     0.784       Salter     67     -     6as, natural     0.0559     0.784       Subhur     125     1.332     Hydrogen     0.0559     0.0559       Nool     125     1.322     Nitrogen     0.0559     0.0559       Wool     125     1.322     Nitrogen     0.0559     0.0559       Wool     125     1.322     Oxygen     0.0559     0.0569       Wool     125     1.32     Oxygen     0.0559     0.0582       Wool     125     1.32     Oxygen     0.0589     0.0584       Wool     125     1.32     Oxygen     0.0584     0.0584       Wool     1.32     0xygen     0.0584     0.0584       Wool     1.32     0xygen     0.0584     0.0582       Wool     1.32     0xygen     0.0564     0.0582       Wool     1.32     0xygen     0.0564     0.0582 <t< td=""><td>Sand, gravei, wei</td><td>118-120</td><td>1</td><td></td><td></td><td></td><th>Paper Potatoes piled</th><td></td><td>0.70-1.15</td><td>Air, 0°C 760 mm Ammonia</td><td>08071</td><td>1.0</td></t<>	Sand, gravei, wei	118-120	1				Paper Potatoes piled		0.70-1.15	Air, 0°C 760 mm Ammonia	08071	1.0
Thuber goods         94         1.0-2.0         Cathon monxide         0.781           Salt granulated, plied         67         -         Cas, illuminating         0.781         0.784           Salter         5         -         Cas, illuminating         0.781         0.784         0.784           Salter         -         67         -         Cas, illuminating         0.038-039         0           Salter         -         67         1.53         Hydrogen         0.056         0.058-039         0           Suphur         125         1.93-2.07         Nitrogen         0.058         0.0584         0           Wool         11.25         1.322         Nitrogen         0.0584         0         0.0584         0           Wool         11.25         1.322         Oxygen         0.0584         0         0         0.0584         0           Wool         11.25         1.32         0xygen         0.0784         0 <t< td=""><td>EXCAVATIONS IN WATER</td><td>0</td><td></td><td>COAL AND COVE BILED</td><td></td><td></td><th>Rubber, caoutchouc</th><td>: :</td><td>0.92-0.96</td><td>Carbon dioxide</td><td>.1234</td><td>1.5291</td></t<>	EXCAVATIONS IN WATER	0		COAL AND COVE BILED			Rubber, caoutchouc	: :	0.92-0.96	Carbon dioxide	.1234	1.5291
Salt, granulated, pied     48     -     0.35, naturaling     0.25-0.00       Salter     67     -     68, naturaling     0.25-0.00       Starch     96     1.33     Hydrogen     0.35-0.00       Suphur     125     1.33-0.00     Ninogen     0.0559       Wool     125     1.32     Ninogen     0.0559       The specific gravities of solids and liquids refer to water at 4°C, those of gases to at at 0°C and 760 mm pressure. Th     0.892       Weights per cubic foot are derived from average specific gravities, except where stated that weights are for bulk, heaptle.	Sand or gravel and clav	90	1 1	COAL AND CONE, FILED Coal anthracite	47-58	1	Rubber goods	94	1.0-2.0	Carbon monoxide	.0781	0.9673
Starch     96     1.53     Hydrogen     .00559       Suphur     125     1.93-2.07     Nincgen     .0784       Wool     125     1.32     Oxygen     .0784       The specific gravities of solids and liquids refer to water at 4°C, those of gases to air at 0°C and 760 mm pressure. Th weights are for bulk, heaptloose material, etc.     No	Clay	80	ı	Coal, bituminous, lignite	40-54	1	Saltoeter		1 1	Gas, natural	038039	0.47-0.4
Suphur         125         1.33-2.07         Nitrogen         .0784           Wool	River mud	06	I	Coal, peat, turf	20-26	١	Starch		1.53	Hydrogen	.00559	0.0693
Wool	Stone riprap	0/		Coal charcoal Coal coke	23-32	1 1	Sulphur		1.93-2.07	Nitrogen	.0784	0.9714
		3					Wool		1.32	Oxygen	7690.	DCU1.1
	The specific gravities of solids and	liquids refer to	water at 4°C, t	those of gases to air at 0°C and 760 n	nm pressure.	The	The snarific gravities of solids	and liquids refer	to water at 4°C. t	hose of pases to air at 0°C and 760	mm pressure. T	he
]	weights per cubic foot are derived	from average st	pecific gravities	s, except where stated that weights an	e for bulk, he	aped, or	weights per cubic foot are der	ived from average	specific gravities	, except where stated that weights a	re for bulk, hear	bed, or
	loose material, etc.						loose material, etc.					

1.0 0.5920 1.5291 0.9673 0.35-0.45 0.47-0.48 0.0693 0.0693 1.1056

Specific Gravity

### AMERICAN INSTITUTE OF STEEL CONSTRUCTION

# AMERICAN INSTITUTE OF STEEL CONSTRUCTION

Matrix         Matrix<	Monta         Work         Luter, and kalsene         Monta         France         France <th< th=""><th>Mode         Work         Mode         <th< th=""><th></th><th>Tab Weights of E</th><th>Table 17-13. Weights of Building Materials</th><th></th><th>Table 17-14. Weights and Measures United States System</th></th<></th></th<>	Mode         Work         Mode         Mode <th< th=""><th></th><th>Tab Weights of E</th><th>Table 17-13. Weights of Building Materials</th><th></th><th>Table 17-14. Weights and Measures United States System</th></th<>		Tab Weights of E	Table 17-13. Weights of Building Materials		Table 17-14. Weights and Measures United States System
$ \begin{array}{c ccccccccccccccccccccccccccccccccccc$	C         Control         Control <thcontrol< th=""> <thcontrol< th=""> <thcontrol< th=""><th>Structure         Structure         <t< th=""><th>Materials</th><th>Weight Ib per sa ft</th><th>Materials</th><th>Weight</th><th></th></t<></th></thcontrol<></thcontrol<></thcontrol<>	Structure         Structure <t< th=""><th>Materials</th><th>Weight Ib per sa ft</th><th>Materials</th><th>Weight</th><th></th></t<>	Materials	Weight Ib per sa ft	Materials	Weight	
1000         1000 <th< td=""><td>1000000000000000000000000000000000000</td><td>Model         Table         Model         <th< td=""><td></td><td></td><td>1.44</td><td>the solution</td><td>reel rards Hods Furiongs</td></th<></td></th<>	1000000000000000000000000000000000000	Model         Table         Model         Model <th< td=""><td></td><td></td><td>1.44</td><td>the solution</td><td>reel rards Hods Furiongs</td></th<>			1.44	the solution	reel rards Hods Furiongs
Model         17         Towast = 10         17         1700 = 200         17000         17000         1700	Model         Total         Total <th< td=""><td>Mode:         Total:         <thtota:< th=""> <thtota:< th="">         Total:</thtota:<></thtota:<></td><td>Channel suspended system</td><td></td><td>Clay tile</td><td></td><td>.08333 = .02778 = .0050505 = .00012626 1.0 = .33333 = .0606061 = .00151515</td></th<>	Mode:         Total:         Total: <thtota:< th=""> <thtota:< th="">         Total:</thtota:<></thtota:<>	Channel suspended system		Clay tile		.08333 = .02778 = .0050505 = .00012626 1.0 = .33333 = .0606061 = .00151515
64         200         500	Bits         7,3000 = 5000 = 1,7000 = 2000 = 100 = 10         100 = 1,7000 = 2000 = 100 = 10         100 = 1,7000 = 2000 = 10         100 = 1,7000 = 2000 = 10         100 = 1,7000 = 2000 = 10         100 = 1,7000 = 2000 = 10         100 = 1,7000 = 2000 = 10         100 = 1,7000 = 2000 = 10         100 = 1,7000 = 2000 = 10         100 = 1,7000 = 2000 = 10         100 = 1,7000 = 2000 = 10         100 = 1,7000 = 2000 = 10         100 = 1,7000 = 2000 = 10         100 = 1,7000 = 2000 = 10         100 = 1,7000 = 2000 = 10         100 = 1,7000 = 2000 = 10         100 = 1,7000 = 2000 = 10         100 = 1,7000 = 2000 = 10         100 = 1,7000 = 2000         100 = 1,7000 = 2000         100 = 1,7000 = 2000         100 = 1,7000 = 2000         100 = 1,7000 = 1,7000         100 = 1,7000 = 1,7000         100000         100 = 1,7000<	64.         2000         5000         5000         5000         5000         5000         5000         500	Lauring and plastering Acoustical fiber tile	See Partitions	GIN. A in	17	3.0 = 1.0 = .1818182 = .00454545 16.5 = 5.5 = 1.0 = 0.25
Oct $\frac{1}{100}$ $\frac{1}{100}$ $\frac{1}{100}$ $\frac{1}{100}$ $\frac{1}{1000}$	$ \begin{array}{cccccccccccccccccccccccccccccccccccc$	Oct $\frac{3}{10}$ GGR00 = 5200 $=1700$ $=200$ $=00$ <td></td> <td></td> <td>Ľ.</td> <td>18</td> <td>660.0 = 220.0 = 40.0 = 1.0</td>			Ľ.	18	660.0 = 220.0 = 40.0 = 1.0
0.04         40           0.05         01/2         SOUNE AND LAYD MEASURE           01/2         01/2         01/2         Out         Source And Auge         And Auge           01/2         01/2         01/2         01/2         01/2         01/2         00/2           01/2         01/2         01/2         01/2         01/2         01/2         00/2	40         40           65.4         91, 10, 10, 10, 10, 10, 10, 10, 10, 10, 1	Oct         0         0           0.0.4         0.3         0.0.4         AND LATON MEASURE         Source FAID LATON MEASURE			8 in.	8 8	5,280.0 = 1,760.0 = 320.0 = 8.0
Olds         91, 10, 10, 11, 11, 11, 11, 11, 11, 11, 1	All         Source Fact         Source Fact         Source Fact         Source Fact         Source Fact         Source Fact         Constance         Acces           66.5.4         21,15         20,15         20,16         20,000 <td>All         Source And (1)         Source And (1)<td></td><td></td><td>10 in.</td><td>40</td><td></td></td>	All         Source And (1)         Source And (1) <td></td> <td></td> <td>10 in.</td> <td>40</td> <td></td>			10 in.	40	
00:00 1	9/2 10/2 10/2 10/2 10/2 10/2 10/2 10/2 10	000 000 000 000 000 000 000 000 000 00	FLOORS		Gypsum block		
1000 1000 1000 1000 1000 1000 1000 100	1000 1000 1000 1000 1000 1000 1000 100	000 06.2:4 (10.2) 00000         000 00000         COMME AND MASUNE (10.2) 00000         COME AND MASUNE (10.2) 00000         COMME AND MASUNE (10.2) 00000         COMME AND MASUNE (10.2) 000000         COME AND MASUNE (10.2) 00000	Steel deck	See Manufacturer	É S	91/2	
$10^{12}$ <	$10^{1/2}_{1/2}$ Starte Feet         Starte Feet         Starte Feet         Starte France         Acres         Acres </td <td><math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math> (<math>10^{12}</math></td> <td>Concrete-Reinforced 1 in</td> <td></td> <td></td> <td>101/2</td> <td></td>	$10^{12}$ ( $10^{12}$	Concrete-Reinforced 1 in			101/2	
65.24         10/3 10         53 and Feet         Square Plots         Square Plots         Acres           65.24         2         1         0         <	62.24         10/3         53, Inches         Square Plots         Square Plots         Acres           0005         4         10         000444         300773         000773         400000         400000         400000	62.2.4         10/3         53, inches         Spante Frei         Spante	Stone	121/2	i c	121/2	SOUARE AND LAND MEASURE
66.2-4 $0_{12}$ $0_{12}$ $0_{12}$ $0_{12}$ $0_{1111111}$ $0_{1111111}$ $0_{1111111}$ $0_{1111111}$ $0_{11111111}$ $0_{11111111}$ $0_{111111111111111111111111111111111111$	66.2.4 $0.2$ $0.2$ $0.0000$ $0.00000$ $0.00000$ $0.00000$ $0.00000$ $0.00000$ $0.00000$ $0.00000$ $0.00000$ $0.00000$ $0.00000$ $0.00000$ $0.00000$ $0.00000$ $0.00000$ $0.00000$ $0.00000$ $0.00000$ $0.000000$ $0.000000$ $0.000000$ $0.000000$ $0.000000$ $0.000000$ $0.000000$ $0.000000$ $0.000000$ $0.000000$ $0.0000000$ $0.0000000$ $0.0000000$ $0.0000000$ $0.0000000$ $0.0000000$ $0.00000000$ $0.00000000$ $0.00000000$ $0.00000000$ $0.00000000$ $0.000000000$ $0.000000000$ $0.000000000$ $0.000000000$ $0.000000000$ $0.00000000000000000000000000000000000$	66.2.4         10.2         1.0.00 <th1.0.00< td="" th<=""><td>Slad</td><td>111/2</td><td></td><td>14</td><td>Sourara East Sourara Varde Sourara Bode Acrae</td></th1.0.00<>	Slad	111/2		14	Sourara East Sourara Varde Sourara Bode Acrae
No. $0.00000$ $0.000000$ $0.000000$ $0.000000$ $0.000000$ $0.000000$ $0.000000$ $0.000000$ $0.000000$ $0.0000000$ $0.0000000$ $0.0000000$ $0.0000000$ $0.0000000$ $0.0000000$ $0.00000000000000000000000000000000000$	No.ci         2         10.000 $0.00044$ $0.00075$ $0.0007$ $0.0$	0.0000 1000         2 2000000         100000 20000000         000000 20000000         000000 20000000         000000 20000000         000000 2000000         0000000 2000000         0000000 2000000         0000000 2000000         0000000 2000000         0000000 2000000         000000000 2000000         00000000000000000         000000000000000000000000000000000000	Lightweight	6 to 10	Wood studs 2×4	2/0	
Increase         4         1,286.0         5         4,400.0         5,100.0         5,000.0 </td <td><math display="block"> \begin{array}{c ccccccccccccccccccccccccccccccccccc</math></td> <td>Incom         4         1.286.3         5         3.007/60.00         1.00.00         5.0006</td> <td>8</td> <td></td> <td>12-16 in. o.c.</td> <td>N</td> <td>.006944 =</td>	$ \begin{array}{c ccccccccccccccccccccccccccccccccccc$	Incom         4         1.286.3         5         3.007/60.00         1.00.00         5.0006	8		12-16 in. o.c.	N	.006944 =
m.         10         32.04.0 $= 732.03$ $= 43.03.5$ $= 10.0$ $= 10.0$ n $= 7.00$ $= 3.03.5$ $= 10.0$ $= -10.0$ $= -10.0$ $= -10.0$ n $= 7.00$ $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$ n $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$ n $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$ n $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$ n $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$ n $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$ n $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$ n $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$ n $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$ $= -10.0$	m.         32.04.0 $= 725.02$ $= 4,80.0$ $= 100$ $= 0.065$ nound $\gamma_2$ n, $\frac{1}{2}$	m.         33.204.0         = 272.25         = 3.02.5         = 10.0         = 10.	Concrete-Plain 1 in.		Steel partitions	4	9.0 = 1.0 = 0.03306 = .000207
It         10         Name         10         Name         100 $= 102,4000$ $= 4000$ $= 4000$ $= 102,4000$ $= 4000$ $= 4000$ $= 102,4000$ $= 4000$ $= 4000$ $= 102,4000$ $= 4000$ $= 102,4000$ $= 4000$ $= 102,4000$ $= 4000$ $= 4000$ $= 102,4000$ $= 4000$ $= 4000$ $= 100,4000$ $= 4000$ $= 4000$ $= 100,4000$ $= 4000$ $= 4000$ $= 100,4000$ $= 4000$ $= 4000$ $= 4000$ $= 4000$ $= 4000$ $= 4000$ $= 4000$ $= 100,400$ $= 4000$ $= 100,400$ $= 4000$ $= 100,400$ $= 4000,400$ $= 100,400$ $= 4000,400$ $= 100,400$ $= 4000,400$ $= 4000,400$ $= 4000,400$ $= 4000,400$ $= 400,400$ </td <td>1         10         10         10         10         100</td> <td>1         10         10         10         10         1000000000000000000000000000000000000</td> <td>Stone</td> <td>12</td> <td>Plaster 1 in.</td> <td></td> <td>272.25 = 30.25 = 1.0 = .00625</td>	1         10         10         10         10         100	1         10         10         10         10         1000000000000000000000000000000000000	Stone	12	Plaster 1 in.		272.25 = 30.25 = 1.0 = .00625
n         5         NORDUPOS WEIGHTS           1/2         Noneout 1/2 in.         2           nbourd 1/2 in.         2         NORDUPOS WEIGHTS           1/2         Noneout 2         00045           1/2         Dame         00005           1/2         Dames         00005           1/2	n         5         NORROUPOIS WEIGHTS $1_{12}^{12}$ nound $1_{12}^{12}$ in the second se	n         5         NORDUPOIS WEIGHTS           1/2         2         AVORDUPOIS WEIGHTS           1/2         2         00657         00258           1/2         2         00677         00258         00044           1/2         2         00677         00258         00044           1/2         2         00677         00258         00045           1/2         2         2         00057         00258         00045           1/2         2         2         00057         00258         0005         100255         00014         100255         100255         00014         100255         100255         00016         100255         100255         00016         100255         100255         0016         001255         0016         001255         0016         001255         00110         100255         00116         001255         001110         00023         001155	Slag	=	Cement	10	4,040.0 = 102,400.0 = 640.0
noend 1/2 m.         2         Aronsources weights           2         Aronsources weights         Aronsources means           40	nbound $1_{i_{2}}$ in, $\frac{1}{2}$ Anonsources weichts           anonsources block         2<	nound V <sub>2</sub> In         2         AOORDUFOIS WEIGHTS           A MORDUFOIS WEIGHTS         A MORDUFOIS WEIGHTS         A MORDUFOIS WEIGHTS           A diagram         Damins         Damins         Damins         Damins         Damins           A diagram         Damins	Lightweight	3 to 9	Gypsum	5	
Thosed 1/2 mb         1/2 mb         AvoisDupois Weights           AvoisDupois Weights         AvoisDupois Weights         AvoisDupois Weights           Avois Agregatel         20         20         2000           Avois Agregatel         20         20000         20000           Avois Agregatel         20         20000         20000         20000           Avois Agregatel         20         20         20         20000         20000           Avois Agregatel         20         20         20         20         20 </td <td>Thomotol <math>\gamma_2</math> in,         <math>\gamma_2</math>         Avonsources velocits           <math>\gamma_2</math> <math>\gamma_2</math><!--</td--><td>nbourd 1/2 m.         2/2 2         montonors vents agregation         montonors vents bunds         montonors vents bunds           40</td><td>Fille 1 inch</td><td></td><td>Lathing</td><td>-</td><td></td></td>	Thomotol $\gamma_2$ in, $\gamma_2$ Avonsources velocits $\gamma_2$ </td <td>nbourd 1/2 m.         2/2 2         montonors vents agregation         montonors vents bunds         montonors vents bunds           40</td> <td>Fille 1 inch</td> <td></td> <td>Lathing</td> <td>-</td> <td></td>	nbourd 1/2 m.         2/2 2         montonors vents agregation         montonors vents bunds         montonors vents bunds           40	Fille 1 inch		Lathing	-	
$ \begin{array}{c ccccccccccccccccccccccccccccccccccc$	Avoisouros (kilos)         Avoisouros weights           Avoisouros (kilos)         Avoisouros weights           40         Avoisouros (kilos)         Avoisouros (kilos) <td>Control 2, R.N.         Z         MOREUPOIS WEIGHTS           40         Amis         Damis         Omnes         Pounds           40         40         23435         0.0657         0.02266         0.0014           40         40         40         2.34355         0.00657         0.02266         0.0014           40</td> <td></td> <td>ų</td> <td>1</td> <td>/2</td> <td></td>	Control 2, R.N.         Z         MOREUPOIS WEIGHTS           40         Amis         Damis         Omnes         Pounds           40         40         23435         0.0657         0.02266         0.0014           40         40         40         2.34355         0.00657         0.02266         0.0014           40		ų	1	/2	
AVOIRDUPOIS WEIGHTS         AVOIRDUPOIS WEIGHTS           Carairs         Drams         Ourcess         Pounds           40         80         00557         002565         000000           90         90         90         90         90         90           0000         512,0000         512,0000         52,0000         2,0000         2,0000           120         00557         00255         00255         00256         00256           0000         512,0000         512,0000         52,0000         2,0000         2,0000           120         005         005         00000         2,0000         2,0000         2,0000           120         005         007         2,0000         2,0000         2,0000         2,0000           120         005         007         2,0000         2,0000         2,0000         2,0000         2,0000         1,005	Anomenono witchers         Anomenono witchers           addition	Anomenone with the second se	Sand			N	
AVOIRDUPOIS         MOIRDUPOIS         MOIRDU	Anotechols Weichts         Carins         Damis         Curves         Punds $40$ $00014$ $00014$ $00014$ $00014$ $00014$ $40$ $00014$ $00014$ $00014$ $00014$ $00014$ $00014$ $00014$ $00014$ $00014$ $00014$ $00014$ $00014$ $0000000$ $00017$ $000000$ $00014$ $00010$ $00014$ $00014$ $0000000$ $00014$ $000000$ $00014$ $00014$ $000000$ $000100000$ $0001000000$ $0001000000$ $0000000$ $0000000$ $0000000$ $0000000$ $0000000$ $0000000$ $0000000$ $0000000$ $0000000$ $0000000$ $0000000$ $00000000$ $00000000$ $00000000$ $00000000$ $0000000000000$ $000000000000000000000000000000000000$	Aconsolutions Weights         Aconsolutions Weights           40 <td>Cinders</td> <td>) 4</td> <td></td> <td></td> <td></td>	Cinders	) 4			
Carins         Drants         Ounces         Pounds           10 $232375$ $100547$ $002266$ $00010$ 120 $120$ $00657$ $002266$ $00010$ agregation $2320000$ $= 20000$ $= 20000$ agregation $20000$ $= 512,0000$ $= 20000$ $= 20000$ agregation $20000$ $= 512,0000$ $= 20000$ $= 20000$ agregation $20000$ $= 512,0000$ $= 20000$ $= 20000$ agregation $20000$ $= 20000$ $= 20000$ $= 20000$ agregation $20000$ $= 210000$ $= 20000$ $= 20000$ add baring $20000$ $= 210000$ $= 20000$ $= 20000$ add baring $20000$ $= 200451$ $010114141$ $01112$ $= 11025$ $01016$ add baring $20000$ $= 2200$ $= 1245$ $01010$ $= 2200$ $= 1244$ $= 10025$ add baring $20000$ $= 2200$ $= 12445$ $= 1000000$	Carins         Drams         Ounces         Pounds           40         40         10         273.5         100357         000266         00010           274375         100         274375         100357         000266         00010           80         80         17000         512,0000         32,0000         2,0000         2,0000           80         74755         100         1,000         2,0000         2,0000         1,000           80         17000         512,0000         512,0000         2,0000         1,000	Carries         Drames         Concess         Pounds           40         80         40         80 <td></td> <td></td> <td></td> <td></td> <td>AVOIRDUPOIS WEIGHTS</td>					AVOIRDUPOIS WEIGHTS
40         10<	40         10         512.0000         32.000         32.0000         32.0000         32.0000         32.0000         32.0000         32.0000         32.0000         32.0000         32.0000         32.0000         32.0000         32.0000         32.0000<	40         27.3375         5.0060         2.002266         00014           aggregate)         80         10         80.001         10         8655         00000           aggregate)         80         10         80.001         10         80.001         10         80.000         10         80.000         10         80.000         10         80.000         10         80.000         10         80.000         10         80.000         10         80.000         10         80.000         10         80.000         10         80.000         10         80.000         10         80.000         10         80.000         10         80.000         10         80.000         10         80.000         10 <td>Finishes Terrazzo 1 in</td> <td>ç</td> <td></td> <td></td> <td>Drams Ounces Pounds</td>	Finishes Terrazzo 1 in	ç			Drams Ounces Pounds
40         273-3475         10 $=$ 0625 $=$ 00300           90         100         273-375         10 $=$ 0625 $=$ 00300           120         120         120 $=$ 100 $=$ 0625 $=$ 00300           120         120         14,000,0000 $=$ 512,0000 $=$ 22,0000 $=$ 20000           120         0 $=$ 055         0 $=$ 0625 $=$ 00301           120         0 $=$ 10 $=$ 050 $=$ 0030 $=$ 0030 $=$ 0030 $=$ 0030 $=$ 0030 $=$ 0000 $=$ 0000 $=$ 0000 $=$ 0000 $=$ 0000 $=$ 0000 $=$ 0000 $=$ 0000 $=$ 0000 $=$ 0000 $=$ 0000 $=$ 0000 $=$ 0000 $=$ 0000 $=$ 0000 $=$ 000	40         27,3437         5         10         =         0625         =         0000           80         120         120         120         100         120         100         100         100         100         100         100         100         100         100         1000         1000         100         100         100         100         100         100         100         100         1000	40     27,34375     510     50036     20235     200300       120     120     120     20030     2,0000     2,0000     2,0000       120     120     14,000,0000     512,0000     22,0000     2,0000       120     120     14,000,0000     512,0000     2,0000     2,0000       120     14,000,0000     512,0000     2,0000     2,0000       120     14,000,0000     14,000,0000     14,000,0000     2,000       120     14,000,0000     14,000,0000     14,000,0000     12,000     100       120     14,000,0000     14,000,0000     14,000,0000     14,000,0000     14,000,0000       120     14,000,0000     14,000,0000     14,000,0000     14,000,0000     14,000,0000       120     14,000,0000     14,000,0000     14,000,0000     14,000,0000     14,000,0000       120     14,000,0000     14,000     14,000,0000     14,000,0000     14,000,000       120     14,000,0000     14,000,0000     14,000,0000     14,000,000     14,000,0000       120     14,000,000     14,000,0000     14,000,000     14,000,000     14,000,000       120     14,000,000     14,000,000     14,000,000     14,000,000     14,000,000       120	Ceramic or Otarry Tile 3/in	2 0	WALLS.		.03657 = .002286 = .000145
40         40         40         7,0000         512,0000         512,0000         522,0000         520,000         500,000 <td>40         40         40         40         40         40         40         40         40         40         40         40         40         40         40         40         40         40         400         40         40         40         400         40         400         40         400         400         400         4000         400         400         400         4000         4000         4000         4000         4000         4000         4000         400         400         400         400         400         400         400         400         400         400         400         400         400         4</td> <td>40         7,42/3         = 7,52,000.0         = 1,0,0         = 2,000.0         = 2,000</td> <td>Linoleum 1/4 -in.</td> <td>2 -</td> <td>Brick</td> <td></td> <td>1.0 = .0625 = .003906</td>	40         40         40         40         40         40         40         40         40         40         40         40         40         40         40         40         40         40         400         40         40         40         400         40         400         40         400         400         400         4000         400         400         400         4000         4000         4000         4000         4000         4000         4000         400         400         400         400         400         400         400         400         400         400         400         400         400         4	40         7,42/3         = 7,52,000.0         = 1,0,0         = 2,000.0         = 2,000	Linoleum 1/4 -in.	2 -	Brick		1.0 = .0625 = .003906
80 morete block         80 120 morete block         14,000,000 200         512,0000         50,0000         50,0000	80         120         14,000,000         512,0000         50,0000         50,	model         model <th< td=""><td>Mastic 3/4-in.</td><td>- 6</td><td>4 in.</td><td>40</td><td>16.0 = 1.0 = .0625 256.0 = 16.0 = 1.0</td></th<>	Mastic 3/4-in.	- 6	4 in.	40	16.0 = 1.0 = .0625 256.0 = 16.0 = 1.0
120         120           ncrete block         30           aggregate)         30           43         43           55         43           65         60           63         60           743         60           743         60           743         60           744         60           745         7045           744         70           745         7045           744         70           745         7045           744         70           744         70           744         70           744         70           744         70           744         70           744         70           74405         70           74405         70           74405         70465	120         120           ncrete block         30           aggregate)         30           30         30           43         55           55         55           56         56           57         56           56         56           57         56           58         50           59         50           50         50           50         50           55         50           56         50           57         50           58         51,42657           59         50,144           50         30           50         30           56         50           57         50           58         51,42657           59         51,42657           50         30           50         30           58         51,446           50         30           50         30           51         50           53         51,42657           53         51,446           50	120         120           ncrete block         30           aggregate)         30           35         55           55         55           55         55           56         56           57         56           58         56           59         56           56         56           57         56           58         56           59         56           50         56           56         56           56         57           56         57           56         57           56         57           56         57           56         57           56         57           56         57           56         57           56         57           57         57           58         51           58         54           58         54           58         54           58         58           58         58           58         58           <	Hardwood 7/8-in.	4	8 in.	80	12,000.0 = 32,000.0 = 2,000.0
Acrete block         30         30           aggregate)         33         43           55         55         55           61         61         61         61           62         38         10         725         53           90         21         20         10         55         55           90         38         55         56         10         57         10         51           64         0         10         5         57         257         134         32         54         10         56         10         56         10         56         57         10         57	Acrete block         30         30           aggregate)         33         43           A         55         60           A         65         55           A         60         60           A         60         60         60           A         60         60         60         60         60           B         60         60         60         60         60         60           A         60         60         60         60         60         60         60	Acrete block         30         30           aggregate)         30         43           Aggregate)         55         0hr MEASURE           Finance         55         0hr MEASURE           Acrete block         55         55           Ggregate)         21         55         56           Ggregate)         21         10         5         56           add bearing)         25         30         55         57/1314         32/1414           Sea         30         30         55         52/1314         32/1414         32/1414           Coad bearing)         25         30         8,0         10/2         5/1426/27         22/1314         3/1414           Coad bearing)         25         30         30         3/1414 </td <td>Softwood 3/4-in.</td> <td>21/2</td> <td>12 in.</td> <td>120</td> <td></td>	Softwood 3/4-in.	21/2	12 in.	120	
agregate) agregate) agregate) agregate) agregate) agregate) agregate) agregate) as a set of the set	agregate) agregate) Acrete block ggregate) ggregate) ggregate) ggregate) agregate) gas frame, & Sash alls,	agregate) agregate)			Hollow concrete block		
30 br         3112 br	r rorere block ggregate) ggregate) 21 21 23 23 23 25 55 55 55 55 55 55 55 55 55 55 55 55	tr crete block gregate) gregate) 21 21 23 25 55 55 55 55 55 55 55 55 55 55 55 55					
43         55         0nv MEASURE           65         6         0           66         0         0           67         0         0           68         0         0           69         0         0           69         0         0           69         0         0           69         0         0           7466         0         10         0           7460         0         10         0         1046           64         0         10         0         1046         0           745         5         0         0         1046         0         12445         0           745         5         0         0         0         1245         0         1245         0         1046         0         1046         0         1012         0         1046         0         1046         0         1046         0         1046         0         1046         0         1046         0         1046         0         1046         0         1046         0         1046         0         1046         1046         1046         104	t t agregate) gregate) agregate) agregate) 21 21 22 25 55 55 55 55 55 55 55 55	t norete block ggregate) ggregate) 2 5 2 2 2 2 2 3 3 3 2 4 5 5 5 5 5 5 5 5 5 5 5 5 5 5 5	ROOFS		4 in.	30	
L         55         DRY MEASURE           ncrete block         21         20         21         20 <td>t 65 brorete block 80 ggregate) 21 21 23 24 ced bearing) 25 55 55 33 33 45 45 45 33 33 45 55 33 33 45 55 33 33 45 55 33 33 45 55 33 45 55 33 33 45 55 33 45 55 33 33 45 55 33 45 55 33 45 55 33 45 55 55 55 55 55 55 55 55 55 55 55 55</td> <td>t for the set of the</td> <td>Copper or tin</td> <td>-</td> <td>6 in.</td> <td>43</td> <td></td>	t 65 brorete block 80 ggregate) 21 21 23 24 ced bearing) 25 55 55 33 33 45 45 45 33 33 45 55 33 33 45 55 33 33 45 55 33 33 45 55 33 45 55 33 33 45 55 33 45 55 33 33 45 55 33 45 55 33 45 55 33 45 55 55 55 55 55 55 55 55 55 55 55 55	t for the set of the	Copper or tin	-	6 in.	43	
Normete block         B0         Cubic         Pints         Quarts         Pecks         Feet           ggregate()         21         21         21         21         22         203845         2044         20         2014         20         2014         20         2014         20         2014         20         2014         2014         2014         2014         2044	n freete block ggregate) 21 29 21 23 25 25 25 25 25 25 25 25 25 25	n crete block ggregate) 21 29regate) 21 28. coad bearing) 21 33 33 33 45 45 45 55 33 33 33 45 55 45 55 33 33 33 45 55 55 45 55 55 55 55 55 55 55 55 55	Corrugated steel	See Manufactuer	8 in.	55	DRY MEASURE
Corder book         21         21         21         21         21         21         21         21         21         21         21         23         23         23         23         23         23         23         23         23         23         23         23         23         23         23         21         21         21         21         21         21         21         21         21         21         21         21         21         21         21         23         23         23         23         23         23         23         21         44         10         112	rocere bock ggregate) 21 20ad bearing) 21 38 55 55 55 55 25 33 33 36 45 55 45 55 45 55 45 55 45 55 45 55 45 55 45 55 45 55 45 55 45 55 33 33 33 33 45 55 45 55 33 33 33 33 33 33 33 33 33 33 33 33	rocere bock ggregate) 21 20ad bearing) 25 55 55 55 55 4 4 in. 18 30 33 33 33 33 33 35 55 4 5 55 4 5 55 4 1. 18 8 8 10 55 55 30 33 30 33 30 25 55 55 4 1. 18 8 8 8 18 8 8 8 10 10 10 10 10 10 10 10 10 10 10 10 10	2 of the cost control	Ť	12//2 IN.	80	Cubic
ggregate)         21         21         21         21         21         21         21         21         21         21         21         21         23         333         333         333         33112         3333         33112         3333         3112         3333         3112         3333         3112         3333         3112         33112         33112         33112         33112         33112         3112         33112         3112         3112         3112         3112 <td>90regate) 21 30 55 55 55 55 55 55 7 4 chin, 25 25 33 33 33 33 33 33 33 33 33 33 35 45 55 45 55 55 45 55 45 55 33 33 33 33 33 33 33 33 33 33 33 33</td> <td>90regate) 21 30 38 55 55 55 55 55 44 10, 25 33 33 33 33 33 35 55 45 55 33 33 36 33 30 33 30 33 30 33 30 33 30 33 30 33 30 33 30 33 30 33 30 33 30 30</td> <td>5-phy reit and gravel</td> <td>5//2 6</td> <td>Hollow concrete block</td> <td></td> <td>Quarts Pecks Feet</td>	90regate) 21 30 55 55 55 55 55 55 7 4 chin, 25 25 33 33 33 33 33 33 33 33 33 33 35 45 55 45 55 55 45 55 45 55 33 33 33 33 33 33 33 33 33 33 33 33	90regate) 21 30 38 55 55 55 55 55 44 10, 25 33 33 33 33 33 35 55 45 55 33 33 36 33 30 33 30 33 30 33 30 33 30 33 30 33 30 33 30 33 30 33 30 33 30 30	5-phy reit and gravel	5//2 6	Hollow concrete block		Quarts Pecks Feet
30 bit         30 bit         3112 bit         3112 bit <th< td=""><td>coad bearing) 30 55 55 55 55 55 55 25 24 4 In. 25 23 33 33 33 33 33 33 33 33 33 33 33 33</td><td>.coad bearing)         30           .coad bearing)         36           .55         55           .55         55            25            25            33            55            33            55            55            18            18            16            15            3            15            3            15            3            3            3            3            3            3            3            3            3            3            3            3            3            3           3     &lt;</td><td></td><td>Þ</td><td>(Light aggregate) 4 in</td><td>51</td><td>= 12</td></th<>	coad bearing) 30 55 55 55 55 55 55 25 24 4 In. 25 23 33 33 33 33 33 33 33 33 33 33 33 33	.coad bearing)         30           .coad bearing)         36           .55         55           .55         55            25            25            33            55            33            55            55            18            18            16            15            3            15            3            15            3            3            3            3            3            3            3            3            3            3            3            3            3            3           3     <		Þ	(Light aggregate) 4 in	51	= 12
36         36         310         51.01         5.011/2         5.016         9.015         9.016         9.015         9.016         9	ad bearing) 38 55 55 55 55 30 33 33 33 33 33 33 33 33 33 33 33 33	38         35           Load bearing)         55           55         55           56         55           57         30           28         33           28         33           28         33           29         33           21         55           23         33           33         45           33         55           33         55           33         55           33         55           33         55           33         55           33         55           33         55           33         55           33         55           33         55           33         55           33         55           34         10           35         55           36         56           38         56           38         56           38         56           38         56           38         56           38         56           38 <td>Shingles</td> <td></td> <td>6 in</td> <td>30</td> <td>=</td>	Shingles		6 in	30	=
55         64.0         = 32.0         = 4.0         = 1.2445         =           0.ad baaring)         25         30         33         33         33         33         33         33         33         34         45         10000 MEASURE         100000 MEASURE         10000 MEASURE         100000 MEASURE <t< td=""><td>.oad bearing) 55 .oad bearing) 25         </td><td>55         55           coad bearing)         25           2         30           2         30           3         33           4         1           3         45           4         1           3         33           3         33           3         33           3         45           4         1           8         8           9         15           9         3           4         1           3         3           4         1           6         6           A Cement Asbestos 1/4 in.         3           3         3           2000000000000000000000000000000000000</td><td>Mood</td><td>0</td><td>8 in.</td><td>38</td><td>      N</td></t<>	.oad bearing) 55 .oad bearing) 25         	55         55           coad bearing)         25           2         30           2         30           3         33           4         1           3         45           4         1           3         33           3         33           3         33           3         45           4         1           8         8           9         15           9         3           4         1           3         3           4         1           6         6           A Cement Asbestos 1/4 in.         3           3         3           2000000000000000000000000000000000000	Mood	0	8 in.	38	 N
Load bearing)         25         25           0.         30         33           3.         3.3         3.3           45         45         10           1.         55         10           3.         55         10           3.         5         10           3.         5         10           3.         5         10           3.         5         10           3.         5         10           3.         5         10           3.         5         10           3.         5         10           3.         3.0         8.0         10           3.         3.0         8.0         1.0         1.0           3.         3.0         8.0         1.0         1.0           3.         3.0         8.0         1.0         1.0           3.         3.0         8.0         1.0         1.0	Load bearing) 25 25 30 33 45 45 55 45 55 45 55 45 55 45 55 45 55 5	Load bearing) 25 25 30 33 45 55 45 55 55 55 55 55 55 55	Asphalt	e	12 in.	55	1 11
L LIQUID MEASURE 25 24 11. 55 24 15. 55 24 11. 18 24 11. 18 33 3 33 3 33 45 3135, Frame, & Sash 3135, Frame, & Sash 3145, Frame, & Sash 32, O = 2, O = 1, O = 1, O = 2, O = 1, O = 1, O = 2, O = 1, O = 1, O = 2, O = 1, O = 1, O = 2, O = 1, O = 1, O = 2, O = 1, O = 1, O = 2, O = 1, O = 1, O = 2, O = 1, O = 1, O = 2, O = 1, O = 1, O = 2, O = 1, O = 1, O = 2, O = 1, O = 1, O = 2, O = 1, O = 1, O = 2, O = 1, O = 1, O = 2, O = 1, O =	25 24 24 in. 25 24 55 25 25 25 25 25 25 25 25 25	25 24 24 24 25 25 25 25 25 25 25 25 25 25	Clay tile	9 to 14	Clay tile (Load bearing)		
30         30           33         45           54         55           55         45           56         6/// 10           30         18           31         5           31         5           31         5           31         5           31         5           31         5           31         5           31         5           31         5           31         5           31         5           32         5           32         5           32         5           32         5           32         5           32         5           32         5           32         5           32         5           32         5           32         5           32         5           32         5           32         5           32         5           32         5           32         5      32     32          32 <td>r 23 24 In. 55 24 In. 55 55 55 55 56 81 8 81 8 81 8 81 8 81 8</td> <td></td> <td>Slate 1/4 in.</td> <td>10</td> <td>4 in.</td> <td>25</td> <td></td>	r 23 24 In. 55 24 In. 55 55 55 55 56 81 8 81 8 81 8 81 8 81 8		Slate 1/4 in.	10	4 in.	25	
1         1	k 4 in. 55 55 Slass, Frame, & Sash Blass Frame, & Sash Blass 1 in. 56e Manufacturer 15 d Cement Asbestos 1/4 in. 3	k 1 2 45 2 45 3 55 3 18 3 18 3 18 3 18 3 18 3 18 3 15 4 15 4 3 4 15 4 3 4 15 4 3 4 15 4 3 4 15 4 16 4 16 4 16 4 18 4 19 4 19 4 19 4 19 4 10 4 10 5 10			6 in.	30	
A         S5         LIOUID MEASURE           x4 in.         55         U.S.           alss. Frame, & Sash         8         U.S.           alass. Frame, & Sash         8         U.S.           alas         Gills         Pints         U.S.           alas         10         25         125         30125           glass 1 in.         1         3         40         10         2         5         125         5           d Cement Asbestos 1/ <sub>4</sub> in.         3         32.0         8.0         4.0         1.0         2.25         1.25         5         1.26         1.25         5         1.26         1.25         5         1.26         2         30.0         8.0         2.0         1.0         2.26         1.25         5         1.26         5         1.25         5         3         32.0         8.0         2.0         1.0         2.0         1.0         2.0         1.0         2.0         1.0         2.0         1.0         2.0         2.0         1.0         2.0         2.0         2.0         1.0         2.0         2.0         2.0         2.0         2.0         2.0         2.0         2.0         2.0 <t< td=""><td>k 4 in. 55 k 4 in. 55 lass, Frame, &amp; Sash 8 alls See Manufacturer glass 1 in. 15 d Cement Asbestos 1/4 in. 3</td><td>k, 4 in. 55 3iss, Frame, &amp; Sash 8 3iss, Frame, &amp; Sash 8 alass, frame, &amp; Sash 3 alass frame, a Sash 3 alass frame, a Sash 3 3iss, fra</td><td>Sheathing Wood 3/ in</td><td>c</td><td>8 in.</td><td>33 4F</td><td></td></t<>	k 4 in. 55 k 4 in. 55 lass, Frame, & Sash 8 alls See Manufacturer glass 1 in. 15 d Cement Asbestos 1/4 in. 3	k, 4 in. 55 3iss, Frame, & Sash 8 3iss, Frame, & Sash 8 alass, frame, & Sash 3 alass frame, a Sash 3 alass frame, a Sash 3 3iss, fra	Sheathing Wood 3/ in	c	8 in.	33 4F	
A In. 18 Slass, Frame, & Sash 8 Slass, Frame, & Sash 8 See Manufacturer 15 16 16 16 16 16 16 10 10 15 10 10 15 10 15 10 10 15 10 15 10 15 10 15 10 10 15 10 10 10 10 10 10 10 10 10 10	A In. 18 Jass, Fame, & Sash 8 allss, Fame, & Sash 8 glass I in. 15 d Cement Asbestos 1/4 in. 3	A In. 18 Jass. Frame, & Sash 8 alls. Frame, & Sash 8 alls See Manufacturer glass I in. 3 d Cement Aspestos 1/4 in. 3 ONSTRUCTION	Guneric 1 in	0.4		0 U	
Bills         Prints         Cuarts         Callos         Pints         Cuarts         Gallons           Bills         See Manufacturer         8         See Manufacturer         10         25         125         03125           Bills         10         25         11         10         25         125         03125           Bills         10         25         10         10         25         125         250           Bills         10         20         20         10         10         25         10         250           A Cement Asbestos 1/4 in.         3         32.0         8.0         1.0         1.0         2.50         1	alss. Frame, & Sash 8 alls s. Frame, & Sash 8 alls s. I.n. 5 d Cement Asbestos 1/4 in. 3 d Cement Asbestos 1/4 in. 3	allss, Frame, & Sash 8 alls Sash 8 glass 1 in. 15 d Cement Asbestos 1/4 in. 3 ONSTRUCTION		•		18	LIQUID MEASURE
alls See Manufacturer Garons Garons See Manufacturer 15 See Manufacturer 15 See 101 See 03125 See 101 See 03125 See 1125 See 03125 See 1125 See 112	als See Manufacturer glass 1 m. 15 d Cement Asbestos 1/4 in. 3	alls See Manufacturer glass 1 in. 15 d Cement Asbestos 1/ <sub>4</sub> in. 3 ONSTRUCTION	Insulation 1 in.		Window, Glass, Frame, & Sash	8	U.S.
glass 1 in. 15 10 = 25 = .125 = .03125	glass 1 in. 15 d Cement Asbestos 1/4 in. 3	glas 1 in. 15 d Cement Asbestos 1/4 in. 3 CONSTRUCTION	Loose	1/2	Curtain walls	See Manufacturer	Quarts Gallons
d Cement Asbestos 1/4 in. 3 d Cement Asbestos 1/4 in. 3 8.0 = 2.50 = 1.0 = 1.5 = 2.50 = 2.50 = 1.0 = 1	d Cement Asbestos 1/4 in. 3	d Cernent Asbestos V,4 in. 3 ONSTRUCTION	Poured	5	Structural glass 1 in.	15	125 = .03125 =
32.0 = 8.0 = 4.0 = 1.0 = 7.48052 = 7.480552 = 7.480552 = 7.480552 = 7.4805552 = 7.4805552 = 7.48055552 = 7.48055552 = 7.48055555		ONSTRUCTION	Rigid	11/2	Corrugated Cement Asbestos 1/4 in.	3	= .5 = .125 = = 1.0 = .250 =
		ONSTRUCTION					= 4.0 = 1.0 = 1.0
			or weights of other materials used in	n building construction, s	see Table 17-12.	5	0.1 = 20001.7

### Example 1

Determine the controlling load combinations(s) using AISC-LRFD for a building column subject to the following service or nominal (unfactored) axial compressive loads: D = 30 k, L = 50 k,  $L_r = 10$  k, W = 25 k, E = 40 k

Using a spreadsheet analysis:		
LRFD (ASCE-7)		FACTORED LOAD
1.4D		
1.4D	=	42 kips
$1.2D + 1.6L + 0.5(L_r \text{ or } S \text{ or } R)$		
$1.2D + 1.6L + 0.5L_r$	=	121
$1.2D + 1.6(L_r \text{ or } S \text{ or } R) + (L \text{ or } 0.5W)$		
$1.2D + 1.6L_r + L$	=	102
$1.2D + 1.6L_r + 0.5W$	=	64.5
$1.2D + 1.6L_r - 0.5W$	=	39.5
$1.2D + 1.0W + L + 0.5(L_r \text{ or } S \text{ or } R)$		
$1.2D + 1.0W + L + 0.5L_r$	=	116
$1.2D - 1.0W + L + 0.5L_r$	=	66
1.2D + 1.0E + L + 0.2S		
1.2D + 1.0E + L	=	126
1.2D - 1.0E + L	=	46
0.9D + 1.0W		
0.9D + 1.0W	=	52
0.9D - 1.0W	=	2
0.9D + 1.0E		
0.9D + 1.0E	=	67
0.9D - 1.0E	=	-13
	Critical Factored Load	126 kips (C) -13 kips (T)

### Example 2

### **EXAMPLE 2-4**

Determine factored loads for the beam shown in Figure 2–16.


### Solution

For the left half of the beam:

$$w_{u1} = 1.2w_D + 1.6w_L$$
  
 $w_{u1} = 1.2 \times 1.0 + 1.6 \times 2.0 = 4.4 \text{ kip/ft}$ 

For the right half of the beam:

$$w_{u2} = 1.2w_D + 1.6w_L$$
  
 $w_{u2} = 1.2 \times 1.0 + 1.6 \times 0 = 1.2 \text{ kip/ft}$ 

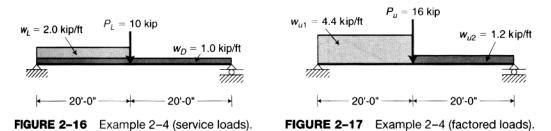

The concentrated load is a live load only:

$$P_u = 1.2P_D + 1.6P_L$$
  
 $P_u = 1.2 \times 0 + 1.6 \times 10 = 16 \text{ kip}$ 

The factored loads on the beam are shown in Figure 2–17.

×

	UNIFORM	CONCENTRATED	W
	(psf)	(lbs.)	occu
1. Apartments (see residential)		1	73 Band inctity
2. Access floor systems	20		Cell blocks
Computer use	80	2,000	Corridors
3. Armories and drill rooms	150 m	1	24. Recreational
4. Assembly areas			
en	e0 "		Dance halls
apot, projections of rooms	50		Gymnasiur
Lobbies	001	1	Keviewing
MUVADIE SEALS Stage floors	- 001 1 50 -		Stadiums a
Platforms (assembly)	u ()()		(fastened
Other assembly areas	- 101		25. Residential
5. Balconies and decks <sup>h</sup>	Same as occupancy served	1	One- and tw Uninhabita Uninhabita
6. Catwalks	40	300	Habitable a
7. Cornices	60	-	Hotels and n
8. Corridors			Private roo
First floor	100		them Dublic root
	occumancy		them
	served		
	except as indicated		26. Roofs All roof su
9. Dining rooms and restaurants	100		
10. Dwellings (see residential)	1		Awnings and Fabric cons
11. Elevator machine room grating		300	skeleton
(on area of 2 inches by 2 inches)		one	All other co
12. Finish light floor plate construction (on area of 1 inch by 1 inch)	I	200	, Ĕ
13. Fire escapes	00 \$		exposed to
	f		panet point
14. Garages (passenger vehicles only) Trucks and buses	40 " See Se	Res Section 1607.7	di Mari
15. Handrails, guards and grab bars	See Se	See Section 1607.8	houses, a
16. Helipads	See Se	See Section 1607.6	All other p Occumiable r
17. Hospitals Corridors above first floor Operation rooms. Jahoratories	08		
	40	000	77 Schools
18. Hotels (see residential)	1	1	Classrooms
19. Libraries Corridors above first floor Beading rooms	80	000	
Stack rooms	00 150 <sup>h. m</sup>	1,000	28. Scuttles, sky ceilings
20. Manufacturing Heavy Liehy	250 m 1 25 m	3,000	29. Sidewalks, v yards, subj
21. Marquees	75		
22. Office buildings			
File and computer rooms shall	<u>8</u>	2,000	
be designed for heavier loads			
Lobbies and First-floor corridors	001	2,000	
Offices	50	2,000	

# TABLE 1607.1—continued

		2			
CUPANCY OR USE	UNIFORM (psf)	CONCENTRATED (Ibs.)	OCCUPANCY OR USE	UNIFORM (psf)	CONCENTRATED (Ibs.)
itutions cks s	40 100	I	30. Stairs and exits One- and two-family dwellings All other	40 100	300 <sup>f</sup> 300 <sup>f</sup>
nal uses: alleys, poolrooms and r uses alls and ballrooms auts	75" 100" 100"		<ol> <li>Storage warehouses (shall be designed for heavier loads if required for anticipated storage) Heavy Light</li> </ol>	250 <sup>m</sup> 125 <sup>m</sup>	I
ng stands, grandstands and ters and arenas with fixed seats ned to floor)	100 <sup>с. т</sup> 60 <sup>с. т</sup>		3.2. Stores Retail First floor Upper floors Weddarala all floore	100 75	0000
al two-family dwellines			33. Vehicle barriers	See Sec	See Section 1607.8.3
itable attics without storage itable attics with storage <sup>[1], k</sup>	10		34. Walkways and elevated platforms (other than exitways)	90	I
e attics and sleeping areas <sup>k</sup>	30	1	35. Yards and terraces, pedestrians	100 <sup>m</sup>	1
d multifamily dwellings ooms and corridors serving	2		For SI: 1 inch = $25.4$ mm, 1 square inch = $645.16$ mm <sup>2</sup> 1 square foot = $0.0929$ m <sup>2</sup> ,	5.16 mm²,	
oms <sup>m</sup> and corridors serving	0 <sub>0</sub>		I pound per square foot = 0.0479 kN/m <sup>2</sup> , 1 pound = 0.00448 kN, 1 pound per cubic foot = 16 kg/m <sup>2</sup> .	m², 1 pound	= 0.004448 kN,
surfaces subject to main-		300	vertices shall be designed for the uniformly distributed live loads of Table 1607.1 or the following concentre and loads: (1) for garages restricted to messencer whiches accommodation not more than nine messences 3 000	/ distributed ls: (1) for g	live loads of Table arages restricted to
workers and canopies: instruction supported by a	ъ		personger ventions accommonating not note with the persongers, your pounds acting on an area of 4.5 inches by 4.5 inches; (2) for mechanical parking structures without slab or deck that are used for storing passenger vehicles only 2 550 nonder per whool	4.5 inches; t are used fo	<ol> <li>(2) for mechanical</li> <li>r storing passenger</li> </ol>
n structure construction flat, pitched, and curved	nonreducible 20 20		<ol> <li>The loading applies to stack room floors that support nonmobile, double-faced library book stacks, subject to the following limitations:</li> <li>The nonviral hookstack, subject to the following limitations:</li> </ol>	lat support 1 lowing limit	oonmobile, double- ations: 1 00 inches:
at are not occuptable) imary roof members are to a work floor, at single			<ol> <li>The nominal solutions will not exceed 12 inclusion of another and The nominal solution of the post shall not exceed 12 inclusion for each and 3. Parallel rows of double-faced book stacks shall be separated face; and</li> </ol>	ed 12 inches cks shall be	for each face; and separated by aisles
ant of lower chord of root r any point along primary			not less than 36 inches wide. c. Design in accordance with ICC 300.		
anufacturing, storage ware- stand renair garages		000 6		n approved onsidered w	method containing here appropriate.
r primary roof members e roofs:		300	e. The concentrated wheel load shall be applied on an area of 4.5 inches by 4.5 inches.	ed on an ar	ea of 4.5 inches by
dens	100		f. The minimum concentrated load on stair treads shall be applied on an area	ads shall be	applied on an area
similar areas	Note 1	Note 1	or $z$ increas by z increas. This load need not be assumed to act concurrently with the uniform load.	De assumed	to act concurrently
SE SE	40	1,000	g. Where snow loads occur that are in excess of the design conditions, the structure shall be designed to support the loads due to the increased loads caused by drift buildup or a greater snow design determined by the	s of the des bads due to bw design	ign conditions, the the increased loads determined by the
s above first floor r corridors	001	1,000			
kylight ribs and accessible	I	200	<ol> <li>be section 1004.6.5 for decks attacted to exterior waits.</li> <li>Uninhabitable attics without storage are those where the maximum clear height bettern whomen the pricer so do more is here then A1 shows or whose there</li> </ol>	ose where t	be maximum clear
, vehicular drive ways and ubject to trucking	250 <sup>d. m</sup>	8,000 <sup>¢</sup>	are not two or more adjacent trusses with web configurations capable of accommodating an assumed rectangle 42 inches in height by 24 inches in with	web configu	rations capable of ght by 24 inches in
			width, or greater, within the plane of the trustes. This live load need not be assumed to act concurrently with any other live load requirements.	usses. Inis ner live load	nve toad need not requirements.

## TABLE 1607.1—continued FORMLY DISTRIBUTED LIVE LOADS, Lo, AND

MINIMUM CONCENTRATED LIVE LOADS <sup>®</sup>	D LIVE LO	ADS <sup>4</sup>	
OCCUPANCY OR USE	UNIFORM (psf)	CONCENTRATED (lbs.)	
. Stairs and exits One- and two-family dwellings All other	40 100	300 <sup>f</sup> 300 <sup>f</sup>	•
. Storage warehouses (shall be designed for heavier loads if required for anticipated storage) Heavy Light	250 <sup>m</sup> 125 <sup>m</sup>	I	
. Stores Retail First floor Upper floors Wholesale, all floors	100 75 125 <sup>m</sup>	1,000 1,000 1,000	-
. Vehicle barriers	See See	See Section 1607.8.3	
. Walkways and elevated platforms (other than exitways)	60	I	<u>111</u>
. Yards and terraces, pedestrians	100 <sup>m</sup>	I	-
<ul> <li>SI: 1 inch = 25.4 mm, 1 square inch = 645.16 mm<sup>2</sup>, 1 square foot = 0.0929 m<sup>2</sup>, 1 square foot = 0.0929 m<sup>2</sup>, 1 pound per cubic foot = 0.0479 kN/m<sup>2</sup>, 1 pound = 0.004448 kN, 1 pound per cubic foot = 16 kg/m<sup>2</sup>.</li> <li>Name and the square foot = 0.0479 kN/m<sup>2</sup>, 1 pound = 0.004448 kN, 1 pound per cubic foot = 16 kg/m<sup>2</sup>.</li> <li>I on the following concentrated loads: (1) for garages of motor cehicles shall be designed for the uniformly distributed live loads of Table 1607.1 or the following concentrated loads: (1) for garages restricted to assenger vehicles accommodating not more than nine passengers, 3.000 ounds acting on an area of 4.5 inches; (2) for mechanical arking structures without slab or deck that are used for storing passengers accellorancy 2.250 pounds per whcel.</li> <li>The loading applies to stack room floors that support nonmobile, double-teicles only. 2.250 pounds per whcel.</li> <li>The noninal bookstack unit height shall not exceed 90 inches:</li> <li>The noninal shelf depth shall not exceed 12 inches for each face; and 3. Parallel rows of double-faced book stacks shall be separated by aisles not less than 36 inches wide.</li> <li>Design in accordance with C.300.</li> <li>Design in accordance with a approved method containing provisions for truck loadings shall also be considered where appropriate.</li> </ul>	$(m^2, 16 \text{ mm}^2, 15.16 \text{ mm}^2, 15.16 \text{ mm}^2, 15.16 \text{ mm}^2, 15.16 \text{ mm}^2, 15.00  $	= 0.00448 kN, e storage of motor live loads of Table arages restricted to e passengers, 3,000 (2) for mechanical artoring passenger ations: a for each face; and separated by aisles method containing there appropriate.	
.5 inches.			

### Structural Load Requirements International Building Code (2012)

Note Set 13.2

### Live Loads & Allowed Reductions

1607.10 Reduction in uniform live loads. Except for uniform live loads at roofs, all other minimum uniformly distributed live loads, Lo, in Table 1607.1 are permitted to be reduced in accordance with Section 1607.10.1 or 1607.10.2. Uniform live loads at roofs are permitted to be reduced in accordance with Section 1607.12.2.

1607.10.1 Basic uniform live load reduction. Subject to the limitations of Sections 1607.10.1.1 through 1607.10.1.3 and Table 1607.1, members for which a value of  $K_{\mu}A_{\tau}$  is 400 square feet (37.16 m<sup>2</sup>) or more are permitted to be designed for a reduced uniformly distributed live load, L, in accordance with the following equation:

$$L = L_o \left( 0.25 + \frac{15}{\sqrt{K_{LL}A_T}} \right)$$
 (Equation 16-23)

For SI:  $L = L_o \left( 0.25 + \frac{4.57}{\sqrt{K_{LL}A_T}} \right)$ 

where:

- L = Reduced design live load per square foot (m<sup>2</sup>) of area supported by the member.
- $L_0$  = Unreduced design live load per square foot (m<sup>2</sup>) of area supported by the member (see Table 1607.1).
- $K_{II}$  = Live load element factor (see Table 1607.10.1).

 $A_T$  = Tributary area, in square feet (m<sup>2</sup>).

L shall not be less than 0.50L, for members supporting one floor and L shall not be less than 0.40L, for members supporting two or more floors.

TABLE 1607.10.1

LIVE LOAD ELEMENT FACTOR, K.,

ELEMENT	KLL
Interior columns Exterior columns without cantilever slabs	44
Edge columns with cantilever slabs	3
Corner columns with cantilever slabs Edge beams without cantilever slabs Interior beams	2 2 2
All other members not identified above including: Edge beams with cantilever slabs Cantilever beams One-way slabs Two-way slabs Members without provisions for continuous shear transfer normal to their span	1

1607.10.1.1 One-way slabs. The tributary area,  $A_T$ , for use in Equation 16-23 for one-way slabs shall not exceed an area defined by the slab span times a width normal to the span of 1.5 times the slab span.

1607.10.1.2 Heavy live loads. Live loads that exceed 100 psf (4.79 kN/m<sup>2</sup>) shall not be reduced.

### Exceptions:

- 1. The live loads for members supporting two or more floors are permitted to be reduced by a maximum of 20 percent, but the live load shall not be less than L as calculated in Section 1607.10.1.
- 2. For uses other than storage, where approved, additional live load reductions shall be permitted where shown by the registered design professional that a rational approach has been used and that such reductions are warranted.

1607.10.1.3 Passenger vehicle garages. The live loads shall not be reduced in passenger vehicle garages.

Exception: The live loads for members supporting two or more floors are permitted to be reduced by a maximum of 20 percent, but the live load shall not be less than L as calculated in Section 1607.10.1.

1607.10.2 Alternative uniform live load reduction. As an alternative to Section 1607.10.1 and subject to the limitations of Table 1607.1, uniformly distributed live loads are permitted to be reduced in accordance with the following provisions. Such reductions shall apply to slab systems, beams, girders, columns, piers, walls and foundations.

1. A reduction shall not be permitted where the live load exceeds 100 psf (4.79 kN/m<sup>2</sup>) except that the design live load for members supporting two or more floors is permitted to be reduced by a maximum of 20 percent.

> Exception: For uses other than storage, where approved, additional live load reductions shall be permitted where shown by the registered design professional that a rational approach has been used and that such reductions are warranted.

- 2. A reduction shall not be permitted in passenger vehicle parking garages except that the live loads for members supporting two or more floors are permitted to be reduced by a maximum of 20 percent.
- 3. For live loads not exceeding 100 psf (4.79 kN/m<sup>2</sup>), the design live load for any structural member supporting 150 square feet (13.94 m<sup>2</sup>) or more is permitted to be reduced in accordance with Equation 16-24.
- 4. For one-way slabs, the area, A, for use in Equation 16-24 shall not exceed the product of the slab span and a width normal to the span of 0.5 times the slab span.

(Equation 16-24)

R = 0.08(A - 150)For SI: R = 0.861(A - 13.94)

Such reduction shall not exceed the smallest of:

- 1. 40 percent for horizontal members;
- 2. 60 percent for vertical members; or
- 3. R as determined by the following equation.

 $R = 23.1(1 + D/L_o)$ (Equation 16-25) where:

- A = Area of floor supported by the member, square feet (m<sup>2</sup>).
- D = Dead load per square foot (m<sup>2</sup>) of areasupported.
- $L_0$  = Unreduced live load per square foot (m<sup>2</sup>) of area supported.
- R =Reduction in percent.

1607.11 Distribution of floor loads. Where uniform floor live loads are involved in the design of structural members arranged so as to create continuity, the minimum applied loads shall be the full dead loads on all spans in combination with the floor live loads on spans selected to produce the greatest load effect at each location under consideration. Floor live loads are permitted to be reduced in accordance with Section 1607.10.

### **Minimum Roof Loads**

**1607.12 Roof loads.** The structural supports of roofs and marquees shall be designed to resist wind and, where applicable, snow and earthquake loads, in addition to the dead load of construction and the appropriate live loads as prescribed in this section, or as set forth in Table 1607.1. The live loads acting on a sloping surface shall be assumed to act vertically on the horizontal projection of that surface.

**1607.12.1 Distribution of roof loads.** Where uniform roof live loads are reduced to less than 20 psf  $(0.96 \text{ kN/m}^2)$  in accordance with Section 1607.12.2.1 and are applied to the design of structural members arranged so as to create continuity, the reduced roof live load shall be applied to adjacent spans or to alternate spans, whichever produces the most unfavorable *load effect*. See Section 1607.12.2 for reductions in minimum roof live loads and Section 7.5 of ASCE 7 for partial snow loading.

**1607.12.2 General.** The minimum uniformly distributed live loads of roofs and marquees,  $L_o$ , in Table 1607.1 are permitted to be reduced in accordance with Section 1607.12.2.1.

1607.12.2.1 Ordinary roofs, awnings and canopies. Ordinary flat, pitched and curved roofs, and awnings and canopies other than of fabric construction supported by a skeleton structure, are permitted to be designed for a reduced uniformly distributed roof live load,  $L_r$ , as specified in the following equations or other controlling combinations of loads as specified in Section 1605, whichever produces the greater load effect.

In structures such as greenhouses, where special scaffolding is used as a work surface for workers and materials during maintenance and repair operations, a lower roof load than specified in the following equations shall not be used unless *approved* by the *building official*. Such structures shall be designed for a minimum roof live load of 12 psf (0.58 kN/m<sup>2</sup>).

$$L_r = L_a R_1 R_2$$

(Equation 16-26)

where:  $12 \le L_r \le 20$ 

For SI:  $L_r = L_0 R_1 R_2$ 

where:  $0.58 \le L_r \le 0.96$ 

- $L_o$  = Unreduced roof live load per square foot (m<sup>2</sup>) of horizontal projection supported by the member (see Table 1607.1).
- $L_r$  = Reduced roof live load per square foot (m<sup>2</sup>) of horizontal projection supported by the member.

The reduction factors  $R_1$  and  $R_2$  shall be determined as follows:

$$R_1 = 1$$
 for  $A_1 \le 200$  square feet (18.58 m<sup>2</sup>)

 $R_1 = 1.2 - 0.001A$ , for 200 square feet < $A_1 < 600$  square feet (Equation 16-28)

For SI: 1.2 - 0.011 $A_r$ , for 18.58 square meters  $< A_r < 55.74$  square meters

 $R_1 = 0.6$  for  $A_1 \ge 600$  square feet (55.74 m<sup>2</sup>)

(Equation 16-29)

where:

 $A_r$  = Tributary area (span length multiplied by effective width) in square feet (m<sup>2</sup>) supported by the member, and

$R_2 = 1$ for $F \le 4$	(Equation 16-30)
$R_2 = 1.2 - 0.05 F$ for $4 < F < 12$	(Equation 16-31)
$R_2 = 0.6$ for $F \ge 12$	(Equation 16-32)

where:


F = For a sloped roof, the number of inches of rise per foot (for SI:  $F = 0.12 \times$  slope, with slope expressed as a percentage), or for an arch or dome, the rise-to-span ratio multiplied by 32.

**1607.12.3 Occupiable roofs.** Areas of roofs that are occupiable, such as roof gardens, or for assembly or other similar purposes, and marquees are permitted to have their uniformly distributed live loads reduced in accordance with Section 1607.10.

**1607.12.3.1 Landscaped roofs.** The uniform design live load in unoccupied landscaped areas on roofs shall be 20 psf  $(0.958 \text{ kN/m}^2)$ . The weight of all landscaping materials shall be considered as dead load and shall be computed on the basis of saturation of the soil.

**1607.12.4** Awnings and canopies. Awnings and canopies shall be designed for uniform live loads as required in Table 1607.1 as well as for snow loads and wind loads as specified in Sections 1608 and 1609.

### Minimum Snow Loads

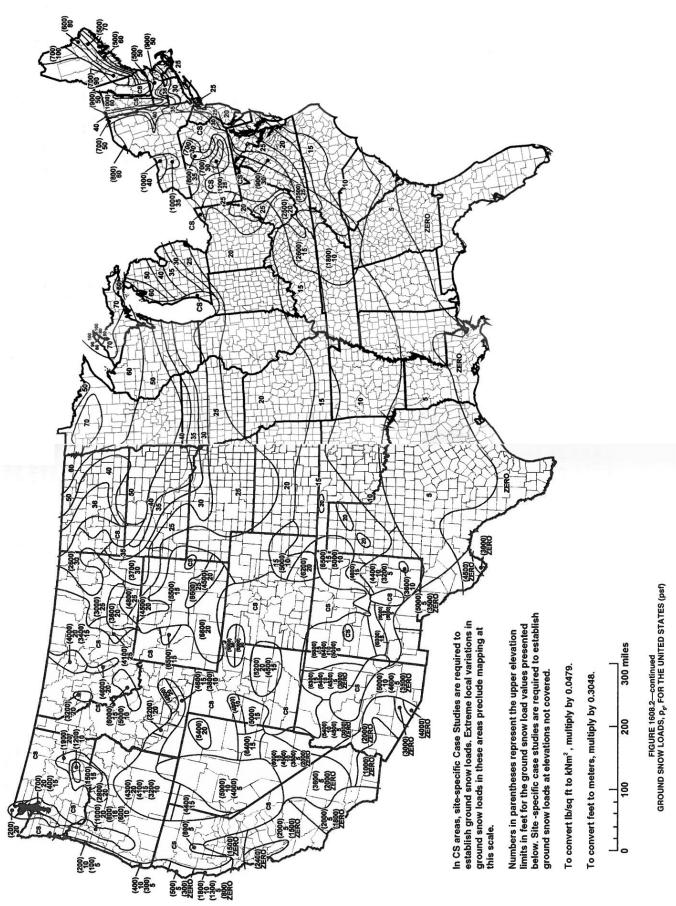

### **Documentation of Loads**

### SECTION 1603 CONSTRUCTION DOCUMENTS

**1603.1 General.** Construction documents shall show the size, section and relative locations of structural members with floor levels, column centers and offsets dimensioned. The design loads and other information pertinent to the structural design required by Sections 1603.1.1 through 1603.1.9 shall be indicated on the construction documents.

**Exception:** Construction documents for buildings constructed in accordance with the conventional light-frame construction provisions of Section 2308 shall indicate the following structural design information:

- 1. Floor and roof live loads.
- 2. Ground snow load, Pg.
- Ultimate design wind speed, V<sub>ult</sub>, (3-second gust), miles per hour (mph) (km/hr) and nominal design wind speed, V<sub>ast</sub>, as determined in accordance with Section 1609.3.1 and wind exposure.
- 4. Seismic design category and site class.
- 5. Flood design data, if located in *flood hazard areas* established in Section 1612.3.
- 6. Design load-bearing values of soils.

**1603.1.1 Floor live load.** The uniformly distributed, concentrated and impact floor live load used in the design shall be indicated for floor areas. Use of live load reduction in accordance with Section 1607.10 shall be indicated for each type of live load used in the design.

**1603.1.2 Roof live load.** The roof live load used in the design shall be indicated for roof areas (Section 1607.12).

- **1603.1.3 Roof snow load data.** The ground snow load,  $P_g$ , shall be indicated. In areas where the ground snow load,  $P_g$ , exceeds 10 pounds per square foot (psf) (0.479 kN/m<sup>2</sup>), the following additional information shall also be provided, regardless of whether snow loads govern the design of the roof:
  - 1. Flat-roof snow load,  $P_f$
  - 2. Snow exposure factor,  $C_e$ .
  - 3. Snow load importance factor, I.
  - 4. Thermal factor,  $C_r$ .

**1603.1.4 Wind design data.** The following information related to wind loads shall be shown, regardless of whether wind loads govern the design of the lateral force-resisting system of the structure:

- Ultimate design wind speed, V<sub>ult</sub>, (3-second gust), miles per hour (km/hr) and nominal design wind speed, V<sub>axt</sub>, as determined in accordance with Section 1609.3.1.
- 2. Risk category.
- Wind exposure. Where more than one wind exposure is utilized, the wind exposure and applicable wind direction shall be indicated.
- 4. The applicable internal pressure coefficient.
- Components and cladding. The design wind pressures in terms of psf (kN/m<sup>2</sup>) to be used for the design of exterior component and cladding materials not specifically designed by the *registered design professional*.

**1603.1.5 Earthquake design data.** The following information related to seismic loads shall be shown, regardless of whether seismic loads govern the design of the lateral force-resisting system of the structure:

- 1. Risk category.
- 2. Seismic importance factor,  $I_e$ .
- 3. Mapped spectral response acceleration parameters,  $S_s$  and  $S_l$ .
- 4. Site class.
- 5. Design spectral response acceleration parameters,  $S_{DS}$  and  $S_{DI}$ .
- 6. Seismic design category.
- 7. Basic seismic force-resisting system(s).
- 8. Design base shear(s).
- 9. Seismic response coefficient(s),  $C_s$ .
- 10. Response modification coefficient(s), R.
- 11. Analysis procedure used.

**1603.1.6 Geotechnical information.** The design loadbearing values of soils shall be shown on the *construction documents*.

**1603.1.7 Flood design data.** For buildings located in whole or in part in *flood hazard areas* as established in Section 1612.3, the documentation pertaining to design, if required in Section 1612.5, shall be included and the following information, referenced to the datum on the community's Flood Insurance Rate Map (FIRM), shall be shown, regardless of whether flood loads govern the design of the building:


- In *flood hazard areas* not subject to high-velocity wave action, the elevation of the proposed lowest floor, including the basement.
- In flood hazard areas not subject to high-velocity wave action, the elevation to which any nonresidential building will be dry flood proofed.
- In flood hazard areas subject to high-velocity wave action, the proposed elevation of the bottom of the lowest horizontal structural member of the lowest floor, including the basement.

**1603.1.8 Special loads.** Special loads that are applicable to the design of the building, structure or portions thereof shall be indicated along with the specified section of this code that addresses the special loading condition.

1603.1.9 Systems and components requiring special inspections for seismic resistance. Construction documents or specifications shall be prepared for those systems and components requiring special inspection for seismic resistance as specified in Section 1705.11 by the registered design professional responsible for their design and shall be submitted for approval in accordance with Section 107.1. Reference to seismic standards in lieu of detailed drawings is acceptable.

### Design Wind Pressures – Envelope Procedure <u>SEI/ASCE 7-10:</u>

Velocity pressure, p, irrespective of terrain and height above ground or recurrence probability is related to the wind speed, V, by  $p = 0.00256V^2$ . Wind codes also consider the effect of the geometry of the building and location on the surface, wind gusts or turbulence, the local terrain, and annual probability of exceeding the design wind speed.

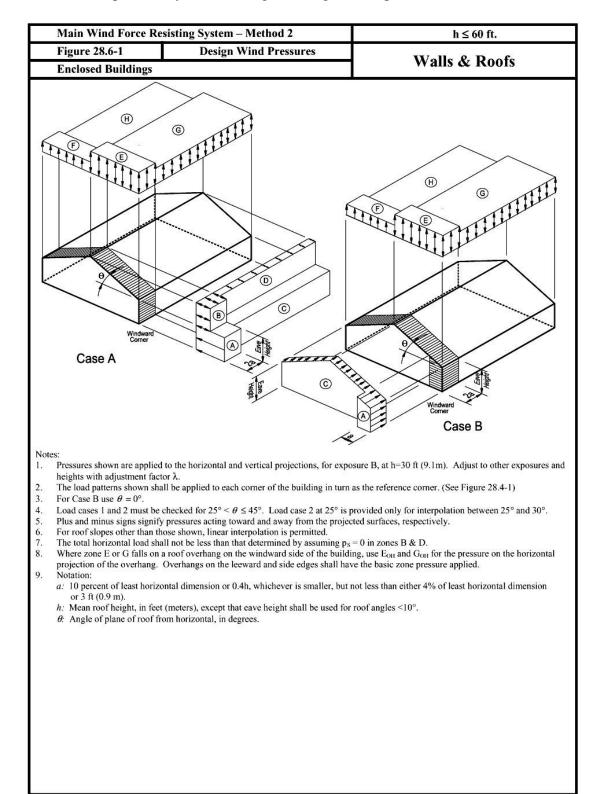

Main Wind Force Resisting System – Method 2         ure 28.6-1 (cont'd)       Design Wind Pressures         Enclosed Buildings								h≤60 ft. Walls & Roofs						
Si	mplified	Des	ign W	ind Pre	essure	, p <sub>s 30</sub>	( <b>psf)</b> (E	xposure	Bath=	30 ft. wi	ith I = 1.0	))		
Basic Wind Roof 0 Horizontal Pressures Vertical Pressures Overhai														
Speed	Angle		Horizontal Pressures					Vertical Pressures Overhangs						
(mph)	(degrees)	Load	А	В	С	D	E	F	G	Н	Еон	Goh		
	0 to 5°	1	19.2	-10.0	12.7	-5.9	-23.1	-13.1	-16.0	-10.1	-32.3	-25.3		
	10°	1	21.6	-9.0	14.4	-5.2	-23.1	-14.1	-16.0	-10.8	-32.3	-25.3		
	15° 20°	1	24.1 26.6	-8.0 -7.0	16.0 17.7	-4.6 -3.9	-23.1 -23.1	-15.1 -16.0	-16.0 -16.0	-11.5 -12.2	-32.3 -32.3	-25.3 -25.3		
110	20 25°	1	20.0	3.9	17.4	4.0	-23.1	-14.6	-16.0	-12.2	-32.5	-25.5		
		2					-4.1	-7.9	-1.1	-5.1				
	30 to 45	1	21.6	14.8	17.2	11.8	1.7	-13.1	0.6	-11.3	-7.6	-8.7		
		2	21.6	14.8	17.2	11.8	8.3	-6.5	7.2	-4.6	-7.6	-8.7		
	0 to 5°	1	21.0	-10.9	13.9	-6.5	-25.2	-14.3	-17.5	-11.1	-35.3	-27.6		
	10°	1	23.7	-9.8	15.7	-5.7	-25.2	-15.4	-17.5	-11.8	-35.3	-27.6		
	15° 20°	1	26.3 29.0	-8.7 -7.7	17.5 19.4	-5.0 -4.2	-25.2 -25.2	-16.5	-17.5 -17.5	-12.6 -13.3	-35.3 -35.3	-27.6		
115	20 25°	1	29.0	4.2	19.4	4.2	-25.2	-17.5 -15.9	-17.5	-13.3	-35.3	-27.6		
	20	2	20.0				-4.4	-8.7	-1.2	-5.5	-21.0	-10.0		
	30 to 45	1	23.6	16.1	18.8	12.9	1.8	-14.3	0.6	-12.3	-8.3	-9.5		
		2	23.6	16.1	18.8	12.9	9.1	-7.1	7.9	-5.0	-8.3	-9.5		
	0 to 5°	1	22.8	-11.9	15.1	-7.0	-27.4	-15.6	-19.1	-12.1	-38.4	-30.1		
	10°	1	25.8	-10.7	17.1	-6.2	-27.4	-16.8	-19.1	-12.9	-38.4	-30.1		
	15°	1	28.7	-9.5	19.1	-5.4	-27.4	-17.9	-19.1	-13.7	-38.4	-30.1		
120	20° 25°	1	31.6 28.6	-8.3 4.6	21.1 20.7	-4.6 4.7	-27.4 -12.7	-19.1 -17.3	-19.1 -9.2	-14.5 -13.9	-38.4 -23.7	-30.1		
	25	2	20.0	4.0	20.7	4.7	-4.8	-9.4	-5.2	-6.0	-23.1	-20.2		
	30 to 45	1	25.7	17.6	20.4	14.0	2.0	-15.6	0.7	-13.4	-9.0	-10.3		
	185075 (02078-04502) V	2	25.7	17.6	20.4	14.0	9.9	-7.7	8.6	-5.5	-9.0	-10.3		
	0 to 5°	1	26.8	-13.9	17.8	-8.2	-32.2	-18.3	-22.4	-14.2	-45.1	-35.3		
	10° 15°	1	30.2 33.7	-12.5 -11.2	20.1 22.4	-7.3 -6.4	-32.2 -32.2	-19.7 -21.0	-22.4 -22.4	-15.1 -16.1	-45.1 -45.1	-35.3 -35.3		
	20°	1	37.1	-9.8	24.7	-5.4	-32.2	-21.0	-22.4	-17.0	-45.1	-35.3		
130	25°	1	33.6	5.4	24.7	5.5	-14.9	-20.4	-10.8	-16.4	-43.1	-23.7		
		2					-5.7	-11.1	-1.5	-7.1				
	30 to 45	1	30.1	20.6	24.0	16.5	2.3	-18.3	0.8	-15.7	-10.6	-12.1		
		2	30.1	20.6	24.0	16.5	11.6	-9.0	10.0	-6.4	-10.6	-12.1		
	0 to 5°	1	31.1	-16.1	20.6	-9.6	-37.3	-21.2	-26.0	-16.4	-52.3	-40.9		
	10°	1	35.1	-14.5	23.3	-8.5	-37.3	-22.8	-26.0	-17.5	-52.3	-40.9		
	15° 20°	1	39.0 43.0	-12.9 -11.4	26.0 28.7	-7.4 -6.3	-37.3 -37.3	-24.4 -26.0	-26.0 -26.0	-18.6 -19.7	-52.3 -52.3	-40.9 -40.9		
140	20 25°	1	39.0	6.3	28.2	-0.3	-37.3	-20.0	-20.0	-19.7	-32.3	-40.9		
		2	-				-6.6	-12.8	-1.8	-8.2				
	30 to 45	1	35.0	23.9	27.8	19.1	2.7	-21.2	0.9	-18.2	-12.3	-14.0		
		2	35.0	23.9	27.8	19.1	13.4	-10.5	11.7	-7.5	-12.3	-14.0		
	0 to 5°	1	35.7	-18.5	23.7	-11.0	-42.9	-24.4	-29.8	-18.9	-60.0	-47.0		
	10°	1	40.2	-16.7	26.8	-9.7	-42.9	-26.2	-29.8	-20.1	-60.0	-47.0		
	15° 20°	1	44.8 49.4	-14.9 -13.0	29.8 32.9	-8.5 -7.2	-42.9 -42.9	-28.0 -29.8	-29.8 -29.8	-21.4 -22.6	-60.0 -60.0	-47.0 -47.0		
150	25°	1	44.8	7.2	32.4	7.4	-19.9	-27.1	-14.4	-21.8	-37.0	-31.6		
		2					-7.5	-14.7	-2.1	-9.4				
	30 to 45	1	40.1	27.4	31.9	22.0	3.1	-24.4	1.0	-20.9	-14.1	-16.1		
		2	40.1	27.4	31.9	22.0	15.4	-12.0	13.4	-8.6	-14.1	-16.1		

Main Wind Force Resisting System – Method 2										h ≤ 6	0 ft.		
ure 28.6-1 (cont'd) Design Wind Pressures								Walls & Doofs					
Enclosed Buildings								Walls & Roofs					
	Simpli	fied	Desig	gn Win	d Pres	sure , j	o <sub>s30</sub> (p	<b>sf)</b> (Exp	osure B	at h = 3	0 ft.)		
Basic Wind	Roof	id Case					Zo	Zones					
Speed	Angle		Horizontal Pressures					Vertical F	ressures		O vert	angs	
(mph)	(degrees)	Load	A	В	С	D	E	F	G	н	Еон	GOH	
	0 to 5°	1	40.6	-21.1	26.9	-12.5	-48.8	-27.7	-34.0	-21.5	-68.3	-53.5	
1 1	10°	1	45.8	-19.0	30.4	-11.1	-48.8	-29.8	-34.0	-22.9	-68.3	-53.5	
	15°	1	51.0	-16.9	34.0	-9.6	-48.8	-31.9	-34.0	-24.3	-68.3	-53.5	
160	20°	1	56.2	-14.8	37.5	-8.2	-48.8	-34.0	-34.0	-25.8	-68.3	-53.5	
100	25°	1	50.9	8.2	36.9	8.4	-22.6	-30.8	-16.4	-24.8	-42.1	-35.9	
		2					-8.6	-16.8	-2.3	-10.7			
	30 to 45	1	45.7	31.2	36.3	25.0	3.5	-27.7	1.2	-23.8	-16.0	-18.3	
		2	45.7	31.2	36.3	25.0	17.6	-13.7	15.2	-9.8	-16.0	-18.3	
	0 to 5°	1	51.4	-26.7	34.1	-15.8	-61.7	-35.1	-43.0	-27.2	-86.4	-67.7	
	10°	1	58.0	-24.0	38.5	-14.0	-61.7	-37.7	-43.0	-29.0	-86.4	-67.7	
	15°	1	64.5	-21.4	43.0	-12.2	-61.7	-40.3	-43.0	-30.8	-86.4	-67.7	
400	20°	1	71.1	-18.8	47.4	-10.4	-61.7	-43.0	-43.0	-32.6	-86.4	-67.7	
180	25°	1	64.5	10.4	46.7	10.6	-28.6	-39.0	-20.7	-31.4	-53.3	-45.4	
		2					-10.9	-21.2	-3.0	-13.6			
	30 to 45	1	57.8	39.5	45.9	31.6	4.4	-35.1	1.5	-30.1	-20.3	-23.2	
		2	57.8	39.5	45.9	31.6	22.2	-17.3	19.3	-12.3	-20.3	-23.2	
	0 to 5°	1	63.4	-32.9	42.1	-19.5	-76.2	-43.3	-53.1	-33.5	-106.7	-83.5	
	10°	1	71.5	-29.7	47.6	-17.3	-76.2	-46.5	-53.1	-35.8	-106.7	-83.5	
	15°	1	79.7	-26.4	53.1	-15.0	-76.2	-49.8	-53.1	-38.0	-106.7	-83.5	
	20°	1	87.8	-23.2	58.5	-12.8	-76.2	-53.1	-53.1	-40.2	-106.7	-83.5	
200	25°	1	79.6	12.8	57.6	13.1	-35.4	-48.2	-25.6	-38.7	-65.9	-56.1	
		2					-13.4	-26.2	-3.7	-16.8	(		
1 1	30 to 45	1	71.3	48.8	56.7	39.0	5.5	-43.3	1.8	-37.2	-25.0	-28.7	

### Adjustment Factor


Mean roof	Exposure						
height (ft)	в	С	D				
15	1.00	1.21	1.47				
20	1.00	1.29	1.55				
25	1.00	1.35	1.61				
30	1.00	1.40	1.66				
35	1.05	1.45	1.70				
40	1.09	1.49	1.74				
45	1.12	1.53	1.78				
50	1.16	1.56	1.81				
55	1.19	1.59	1.84				
60	1.22	1.62	1.87				

### for Building Height and Exposure, $\lambda$

### Unit Conversions – 1.0 ft = 0.3048 m; 1.0 psf = 0.0479 kN/m<sup>2</sup>

### Table 1.5-1 Risk Category of Buildings and Other Structures for Flood, Wind, Snow, Earthquake, and Ice Loads

Use or Occupancy of Buildings and Structures	Risk Category
Buildings and other structures that represent a low risk to human life in the event of failure	Ι
All buildings and other structures except those listed in Risk Categories I, III, and IV	п
Buildings and other structures, the failure of which could pose a substantial risk to human life.	III
Buildings and other structures, not included in Risk Category IV, with potential to cause a substantial economic impact and/or mass disruption of day-to-day civilian life in the event of failure.	
Buildings and other structures not included in Risk Category IV (including, but not limited to, facilities that manufacture, process, handle, store, use, or dispose of such substances as hazardous fuels, hazardous chemicals, hazardous waste, or explosives) containing toxic or explosive substances where their quantity exceeds a threshold quantity established by the authority having jurisdiction and is sufficient to pose a threat to the public if released.	
Buildings and other structures designated as essential facilities.	IV
Buildings and other structures, the failure of which could pose a substantial hazard to the community.	
Buildings and other structures (including, but not limited to, facilities that manufacture, process, handle, store, use, or dispose of such substances as hazardous fuels, hazardous chemicals, or hazardous waste) containing sufficient quantities of highly toxic substances where the quantity exceeds a threshold quantity established by the authority having jurisdiction to be dangerous to the public if released and is sufficient to pose a threat to the public if released. <sup><i>a</i></sup>	
Buildings and other structures required to maintain the functionality of other Risk Category IV structures.	
<sup>a</sup> Buildings and other structures containing toxic, highly toxic, or explosive substances shall be eligible for classification to a lo if it can be demonstrated to the satisfaction of the authority having jurisdiction by a hazard assessment as described in Section release of the substances is commensurate with the risk associated with that Risk Category.	

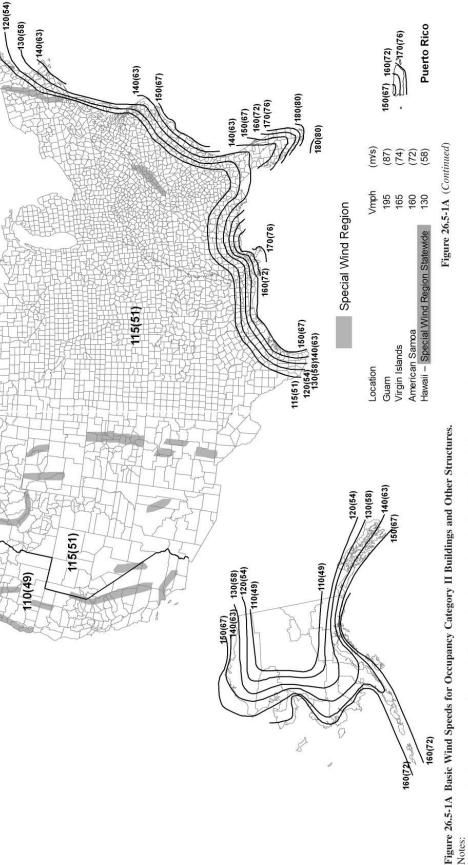

5




<sup>1.</sup> Values are nominal design 3-second gust wind speeds in miles per hour (m/s) at 33 ft (10m) above ground for

- 2. Linear interpolation between contours is permitted.
- Islands and coastal areas outside the last contour shall use the last wind speed contour of the coastal area.
   Mountainous terrain, gorges, ocean promontories, and special wind regions shall be examined for unusual wind
  - Wind speeds correspond to approximately a 7% probability of exceedance in 50 years (Annual Exceedance Probability = 0.00143, MRI = 700 Years). conditions.

115(51)

Exposure C category.

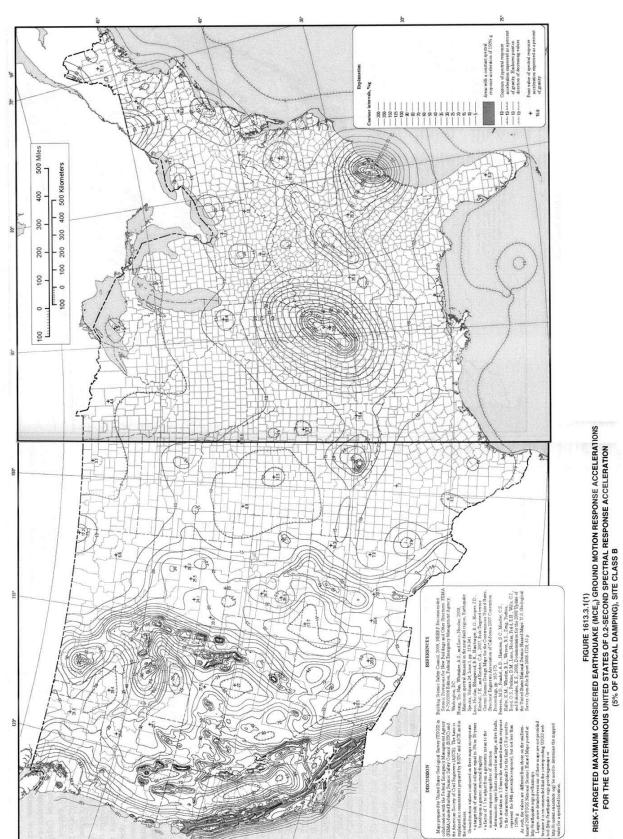

Earthquake Ground Motion, 0.2 Second Spectral Response International Building Code 2012:

#### US Geological Survey, Earthquake Hazards Program, ShakeMap Scientific Background at http://earthquake.usgs.gov/eqcenter/shakemap/background.php

#### Spectral Response Maps

Following earthquakes larger than magnitude 5.5, spectral response maps are made. Response spectra portray the response of a damped, single-degree-of-freedom oscillator to the recorded ground motions. This data representation is useful for engineers determining how a structure will react to ground motions. The response is calculated for a range of periods. Within that range, the International Building Code (IBC) refers to particular reference periods that help define the shape of the "design spectra" that reflects the building code.

#### **Building Code Requirements for Masonry Structures (2011)**

BUILDING CODE REQUIREMENTS FOR MASONRY STRUCTURES AND COMMENTARY

C-77

#### CHAPTER 2 ALLOWABLE STRESS DESIGN OF MASONRY

#### CODE

#### 2.1 — General

2.1.1 Scope

This chapter provides requirements for allowable stress design of masonry. Masonry design in accordance with this chapter shall comply with the requirements of Chapter 1, Sections 2.1.2 through 2.1.7, and either Section 2.2 or 2.3.

#### 2.1.2 Load combinations

When the legally adopted building code does not provide allowable stress load combinations, structures and members shall be designed to resist the combinations of load specified by the building official.

2.1.3 Design strength

**2.1.3.1** Project drawings shall show the specified compressive strength of masonry,  $f'_m$ , for each part of the structure.

2.1.3.2 Each portion of the structure shall be designed based on the specified compressive strength of masonry,  $f'_m$ , for that part of the work.

**2.1.3.3** Computed stresses shall not exceed the allowable stress requirements of this Chapter.

2.1.4 Anchor bolts embedded in grout

**2.1.4.1** Design requirements — Anchor bolts shall be designed using either the provisions of Section 2.1.4.2 or, for headed and bent-bar anchor bolts, by the

#### 2.1 — General

#### 2.1.1 Scope

Historically, a one-third increase in allowable stress has been permitted for load combinations that include wind or seismic loads. The origin and the reason for the one-third stress increase are unclear <sup>2.1</sup>. From a structural reliability standpoint, the one-third stress increase is a poor way to handle load combination effects. Therefore, the one-third stress increase is no longer permitted in this Code. The allowable stresses of this Chapter should not be increased by one-third for wind and load combinations.

COMMENTARY

#### 2.1.2 Load combinations

When there is no legally adopted building code or the legally adopted building code does not have allowable stress load combinations, possible sources of allowable stress load combinations are ASCE  $7^{2.2}$  and IBC<sup>2.3</sup>.

#### 2.1.3 Design strength

The structural adequacy of masonry construction requires that the compressive strength of masonry equal or exceed the specified strength. The specified compressive strength  $f'_m$  on which design is based for each part of the structure must be shown on the project drawings.

The 1995, 1999, 2002, and 2005 editions of the Code contained provisions to permit use of strength-level load combinations in allowable stress design, to compensate for lack of service-level load combinations in previously referenced load standards. This procedure, which enabled the calculation of 'pseudo-strengths' on the basis of allowable stresses, is no longer included in the Code because recent editions of ASCE 7 include both service-level and strength-level load combinations. The 2005 edition of the Code provides guidance for using strength-level load combinations whenever the legally adopted building code does not provide service-level load combinations.

#### 2.1.4 Anchor bolts embedded in grout

Allowable Stress Design anchor bolt provisions were obtained by calibrating corresponding Strength Design provisions to produce similar results. See Code

m	
œ	
ш	
A	
-	
さ	

## DESIGN REQUIREMENTS

The general requirements for the analysis and design of steel structures that are applica ble to all chapters of the specification are given in this chapter.

The chapter is organized as follows:

- General Provisions B1. B2.
- Loads and Load Combinations
  - Design Basis B3.
- Classification of Sections for Local Buckling B4.
- Fabrication, Erection and Quality Control
- Evaluation of Existing Structures B5. B6.

## **GENERAL PROVISIONS** B1.

The design of members and connections shall be consistent with the intended behavior of the framing system and the assumptions made in the structural analysis. Unless restricted by the applicable building code, lateral load resistance and stability may be provided by any combination of members and connections.

2

## LOADS AND LOAD COMBINATIONS B2.

code. In the absence of a building code, the loads and load combinations shall be those stipulated in SEI/ASCE 7. For design purposes, the nominal loads shall be The loads and load combinations shall be as stipulated by the applicable building taken as the loads stipulated by the applicable building code.

User Note: For LRFD designs, the load combinations in SEI/ASCE 7, Section 2.3 apply. For ASD designs, the load combinations in SEI/ASCE 7, Section 2.4 apply.

### DESIGN BASIS B3.

Designs shall be made according to the provisions for Load and Resistance Factor Design (LRFD) or to the provisions for Allowable Strength Design (ASD)

## **Required Strength** -

The required strength of structural members and connections shall be determined by structural analysis for the appropriate load combinations as stipulated in Section B2.

Design by elastic, inelastic or plastic analysis is permitted. Provisions for inelastic The provisions for moment redistribution in continuous beams in Appendix 1, and plastic analysis are as stipulated in Appendix 1, Inelastic Analysis and Design. Section 1.3 are permitted for elastic analysis only.

## Limit States

d

Design shall be based on the principle that no applicable strength or serviceability limit state shall be exceeded when the structure is subjected to all appropriate load combinations.

## **Design for Strength Using Load and Resistance Factor Design** LRFD) ÷

satisfies the requirements of this Specification when the design strength of each structural component equals or exceeds the required strength determined on the Design according to the provisions for Load and Resistance Factor Design (LRFD) basis of the LRFD load combinations. All provisions of this Specification, except for those in Section B3.4, shall apply.

Design shall be performed in accordance with Equation B3-1:

$$R_u \leq \phi R_n$$

(B3-1)

where

- = required strength (LRFD) Ru R
- = nominal strength, specified in Chapters B through K = resistance factor, specified in Chapters B through K
  - $\phi R_n = \text{design strength}$

# Design for Strength Using Allowable Strength Design (ASD)

4

Design according to the provisions for Allowable Strength Design (ASD) satisfies tural component equals or exceeds the required strength determined on the basis the requirements of this Specification when the allowable strength of each strucof the ASD load combinations. All provisions of this Specification, except those of Section B3.3, shall apply.

Design shall be performed in accordance with Equation B3-2:

ed.

$$\leq R_n/\Omega$$

Ra

(B3-2)

where

= required strength (ASD)

 $R_a$ 

- = nominal strength, specified in Chapters B through K
- = safety factor, specified in Chapters B through K N" N
  - $R_n/\Omega =$  allowable strength

**Code Requirements for Structural Concrete, ACI 318-11** 

#### CHAPTER 9 — STRENGTH AND SERVICEABILITY REQUIREMENTS

#### CODE

#### 9.1 — General

9.1.1 — Structures and structural members shall be designed to have design strengths at all sections at least equal to the required strengths calculated for the factored loads and forces in such combinations as are stipulated in this Code.

9.1.2 — Members also shall meet all other requirements of this Code to ensure adequate performance at service load levels.

9.1.3 — Design of structures and structural members using the load factor combinations and strength reduction factors of Appendix C shall be permitted. Use of load factor combinations from this chapter in conjunction with strength reduction factors of Appendix C shall not be permitted.

#### COMMENTARY

#### R9.1 — General

In the 2002 Code, the factored load combinations and strength reduction factors of the 1999 Code were revised and moved to Appendix C. The 1999 combinations were replaced with those of SEI/ASCE 7-02.<sup>9.1</sup> The strength reduction factors were replaced with those of the 1999 Appendix C, except that the factor for flexure was increased. In the 2011 Code, the factored load combinations were revised for consistency with ASCE/SEI 7-10.<sup>9.2</sup>

The changes were made to further unify the design profession on one set of load factors and combinations, and to facilitate the proportioning of concrete building structures that include members of materials other than concrete. When used with the strength reduction factors in 9.3, the designs for gravity loads will be comparable to those obtained using the strength reduction and load factors of the 1999 and earlier Codes. For combinations with lateral loads, some designs will be different, but the results of either set of load factors are considered acceptable.

Chapter 9 defines the basic strength and serviceability conditions for proportioning structural concrete members.

The basic requirement for strength design may be expressed as follows:

Design Strength ≥ Required Strength

 $\phi$  (Nominal Strength)  $\geq U$ 

In the strength design procedure, the margin of safety is provided by multiplying the service load by a load factor and the nominal strength by a strength reduction factor.

#### **R9.2** — Required strength

The required strength U is expressed in terms of factored loads, or related internal moments and forces. Factored loads are the loads specified in the general building code multiplied by appropriate load factors.

The factor assigned to each load is influenced by the degree of accuracy to which the load effect usually can be calculated and the variation that might be expected in the load during the lifetime of the structure. Dead loads, because they are more accurately determined and less variable, are assigned a lower load factor than live loads. Load factors also account for variability in the structural analysis used to compute moments and shears.

#### 9.2 — Required strength

**9.2.1** — Required strength U shall be at least equal to the effects of factored loads in Eq. (9-1) through (9-7). The effect of one or more loads not acting simultaneously shall be investigated.

$$U = 1.2D + 1.6L + 0.5(L_r \text{ or } S \text{ or } R)$$
 (9-2)

$$U = 1.2D + 1.6(L_r \text{ or } S \text{ or } R) + (1.0L \text{ or } 0.5W)$$
 (9-3)

 $U = 1.2D + 1.0W + 1.0L + 0.5(L_r \text{ or } S \text{ or } R)$  (9-4)

#### Code Requirements for Structural Concrete, ACI 318-11 (continued)

#### CODE

except as follows:

(a) The load factor on the live load L in Eq. (9-3) to (9-5) shall be permitted to be reduced to 0.5 except for garages, areas occupied as places of public assembly, and all areas where L is greater than 100 lb/ft<sup>2</sup>.

(b) Where W is based on service-level wind loads, **1.6**W shall be used in place of **1.0**W in Eq. (9-4) and (9-6), and **0.8**W shall be used in place of **0.5**W in Eq. (9-3).

(c) Where *E* is based on service-level forces, **1.4***E* shall be used in place of **1.0***E* in Eq. (9-5) and (9-7).

#### COMMENTARY

The Code gives load factors for specific combinations of loads. In assigning factors to combinations of loading, some consideration is given to the probability of simultaneous occurrence. While most of the usual combinations of loadings are included, it should not be assumed that all cases are covered.

Due regard is to be given to sign in determining U for combinations of loadings, as one type of loading may produce effects of opposite sense to that produced by another type. The load combinations with **0.9D** are specifically included for the case where a higher dead load reduces the effects of other loads. The loading case may also be critical for tension-controlled column sections. In such a case, a reduction in axial load and an increase in moment may result in a critical load combination.

Consideration should be given to various combinations of loading to determine the most critical design condition. This is particularly true when strength is dependent on more than one load effect, such as strength for combined flexure and axial load or shear strength in members with axial load.

If unusual circumstances require greater reliance on the strength of particular members than encountered in usual practice, some reduction in the stipulated strength reduction factors  $\phi$  or increase in the stipulated load factors may be appropriate for such members.

In 2011, the Code removed the weight of soil and other fill materials as part of the definition of H. Consistent with ASCE/SEI 7-10, the weight of these materials is part of dead load, D. The load factors for D are appropriate provided the unit weight and thickness of earth or other fill materials are well controlled. If the weight of earth stabilizes the structure, a load factor of zero may be appropriate.

**R9.2.1(a)** — The load modification factor of 9.2.1(a) is different than the live load reductions based on the loaded area that may be allowed in the legally adopted general building code. The live load reduction, based on loaded area, adjusts the nominal live load ( $L_0$  in ASCE/SEI 7) to *L*. The live load reduction as specified in the legally adopted general building code can be used in combination with the 0.5 load factor specified in 9.2.1(a).

**R9.2.1(b)** — ASCE/SEI 7-10 has converted wind loads to strength level, and reduced the wind load factor to 1.0. ACI 318 requires use of the previous load factor for wind loads. 1.6, when service-level wind loads are used. For service-ability checks, the commentary to Appendix C of ASCE/SEI 7-10 provides service-level wind loads,  $W_a$ .

**R9.2.1(c)** — In 1993, ASCE  $7^{9.3}$  converted earthquake forces to strength level, and reduced the earthquake load factor to 1.0. Model building codes<sup>9.4-9.6</sup> followed. ACI 318 requires use of the previous load factor for earthquake effects, approximately 1.4, when service-level earthquake effects are used.

#### <u>SEI/ASCE 7-10:</u> <u>Minimum Design Loads for Buildings and Other Structures</u>

#### Chapter 1 GENERAL

#### 1.1 SCOPE

This standard provides minimum load requirements for the design of buildings and other structures that are subject to building code requirements. Loads and appropriate load combinations, which have been developed to be used together, are set forth for strength design and allowable stress design. For design strengths and allowable stress limits, design specifications for conventional structural materials used in buildings and modifications contained in this standard shall be followed.

#### 1.2 DEFINITIONS AND NOTATIONS

#### 1.2.1 Definitions

The following definitions apply to the provisions of the entire standard.

ALLOWABLE STRESS DESIGN: A method of proportioning structural members such that elastically computed stresses produced in the members by nominal loads do not exceed specified allowable stresses (also called "working stress design").

**AUTHORITY HAVING JURISDICTION:** The organization, political subdivision, office, or individual charged with the responsibility of administering and enforcing the provisions of this standard.

**BUILDINGS:** Structures, usually enclosed by walls and a roof, constructed to provide support or shelter for an intended occupancy.

**DESIGN STRENGTH:** The product of the nominal strength and a resistance factor.

**ESSENTIAL FACILITIES:** Buildings and other structures that are intended to remain operational in the event of extreme environmental loading from flood, wind, snow, or earthquakes.

FACTORED LOAD: The product of the nominal load and a load factor.

**HIGHLY TOXIC SUBSTANCE:** As defined in 29 CFR 1910.1200 Appendix A with Amendments as of February 1, 2000.

**IMPORTANCE FACTOR:** A factor that accounts for the degree of risk to human life, health, and welfare associated with damage to property or loss of use or functionality.

**LIMIT STATE:** A condition beyond which a structure or member becomes unfit for service and is

judged either to be no longer useful for its intended function (serviceability limit state) or to be unsafe (strength limit state).

**LOAD EFFECTS:** Forces and deformations produced in structural members by the applied loads.

**LOAD FACTOR:** A factor that accounts for deviations of the actual load from the nominal load, for uncertainties in the analysis that transforms the load into a load effect, and for the probability that more than one extreme load will occur simultaneously.

**LOADS:** Forces or other actions that result from the weight of all building materials, occupants and their possessions, environmental effects, differential movement, and restrained dimensional changes. Permanent loads are those loads in which variations over time are rare or of small magnitude. All other loads are variable loads (see also "nominal loads").

**NOMINAL LOADS:** The magnitudes of the loads specified in this standard for dead, live, soil, wind, snow, rain, flood, and earthquake.

**NOMINAL STRENGTH:** The capacity of a structure or member to resist the effects of loads, as determined by computations using specified material strengths and dimensions and formulas derived from accepted principles of structural mechanics or by field tests or laboratory tests of scaled models, allowing for modeling effects and differences between laboratory and field conditions.

**OCCUPANCY:** The purpose for which a building or other structure, or part thereof, is used or intended to be used.

**OTHER STRUCTURES:** Structures, other than buildings, for which loads are specified in this standard.

**P-DELTA EFFECT:** The second order effect on shears and moments of frame members induced by axial loads on a laterally displaced building frame.

**RESISTANCE FACTOR:** A factor that accounts for deviations of the actual strength from the nominal strength and the manner and consequences of failure (also called "strength reduction factor").

**RISK CATEGORY**: A categorization of buildings and other structures for determination of flood, wind, snow, ice, and earthquake loads based on the risk associated with unacceptable performance. See Table 1.5-1.

**STRENGTH DESIGN:** A method of proportioning structural members such that the computed forces produced in the members by the factored loads do not

1

#### CHAPTER 1 GENERAL

#### Table 1.5-1 Risk Category of Buildings and Other Structures for Flood, Wind, Snow, Earthquake, and Ice Loads Use or Occupancy of Buildings and Structures **Risk Category** Buildings and other structures that represent a low risk to human life in the event of failure I All buildings and other structures except those listed in Risk Categories I, III, and IV Π Buildings and other structures, the failure of which could pose a substantial risk to human life. III Buildings and other structures, not included in Risk Category IV, with potential to cause a substantial economic impact and/or mass disruption of day-to-day civilian life in the event of failure. Buildings and other structures not included in Risk Category IV (including, but not limited to, facilities that manufacture, process, handle, store, use, or dispose of such substances as hazardous fuels, hazardous chemicals, hazardous waste, or explosives) containing toxic or explosive substances where their quantity exceeds a threshold quantity established by the authority having jurisdiction and is sufficient to pose a threat to the public if released. Buildings and other structures designated as essential facilities. IV Buildings and other structures, the failure of which could pose a substantial hazard to the community. Buildings and other structures (including, but not limited to, facilities that manufacture, process, handle, store, use, or dispose of such substances as hazardous fuels, hazardous chemicals, or hazardous waste) containing sufficient quantities of highly toxic substances where the quantity exceeds a threshold quantity established by the authority having jurisdiction to be dangerous to the public if released and is sufficient to pose a threat to the public if released.<sup>a</sup> Buildings and other structures required to maintain the functionality of other Risk Category IV structures.

<sup>*a*</sup>Buildings and other structures containing toxic, highly toxic, or explosive substances shall be eligible for classification to a lower Risk Category if it can be demonstrated to the satisfaction of the authority having jurisdiction by a hazard assessment as described in Section 1.5.2 that a release of the substances is commensurate with the risk associated with that Risk Category.

exceed the member design strength (also called "load and resistance factor design").

**TEMPORARY FACILITIES:** Buildings or other structures that are to be in service for a limited time and have a limited exposure period for environmental loadings.

**TOXIC SUBSTANCE:** As defined in 29 CFR 1910.1200 Appendix A with Amendments as of February 1, 2000.

#### 1.1.2 Symbols and Notations

- $F_x$  A minimum design lateral force applied to level *x* of the structure and used for purposes of evaluating structural integrity in accordance with Section 1.4.2.
- $W_x$  The portion of the total dead load of the structure, *D*, located or assigned to Level *x*.
- D Dead load.
- L Live load.
- $L_r$  Roof live load.
- *N* Notional load used to evaluate conformance with minimum structural integrity criteria.

- **R** Rain load.
- S Snow load.

#### **1.3 BASIC REQUIREMENTS**

#### 1.3.1 Strength and Stiffness

Buildings and other structures, and all parts thereof, shall be designed and constructed with adequate strength and stiffness to provide structural stability, protect nonstructural components and systems from unacceptable damage, and meet the serviceability requirements of Section 1.3.2.

Acceptable strength shall be demonstrated using one or more of the following procedures:

- a. the Strength Procedures of Section 1.3.1.1,
- b. the Allowable Stress Procedures of Section 1.3.1.2, or
- c. subject to the approval of the authority having jurisdiction for individual projects, the Performance-Based Procedures of Section 1.3.1.3.

It shall be permitted to use alternative procedures for different parts of a structure and for different load combinations, subject to the limitations of Chapter 2. Where resistance to extraordinary events is considered, the procedures of Section 2.5 shall be used.

#### 1.3.1.1 Strength Procedures

Structural and nonstructural components and their connections shall have adequate strength to resist the applicable load combinations of Section 2.3 of this Standard without exceeding the applicable strength limit states for the materials of construction.

#### 1.3.1.2 Allowable Stress Procedures

Structural and nonstructural components and their connections shall have adequate strength to resist the applicable load combinations of Section 2.4 of this Standard without exceeding the applicable allowable stresses for the materials of construction.

#### 1.3.1.3 Performance-Based Procedures

Structural and nonstructural components and their connections shall be demonstrated by analysis or by a combination of analysis and testing to provide a reliability not less than that expected for similar components designed in accordance with the Strength Procedures of Section 1.3.1.1 when subject to the influence of dead, live, environmental, and other loads. Consideration shall be given to uncertainties in loading and resistance.

*1.3.1.3.1 Analysis* Analysis shall employ rational methods based on accepted principles of engineering mechanics and shall consider all significant sources of deformation and resistance. Assumptions of stiffness, strength, damping, and other properties of components and connections incorporated in the analysis shall be based on approved test data or referenced Standards.

1.3.1.3.2 Testing Testing used to substantiate the performance capability of structural and nonstructural components and their connections under load shall accurately represent the materials, configuration, construction, loading intensity, and boundary conditions anticipated in the structure. Where an approved industry standard or practice that governs the testing of similar components exists, the test program and determination of design values from the test program shall be in accordance with those industry standards and practices. Where such standards or practices do not exist, specimens shall be constructed to a scale similar to that of the intended application unless it can

#### MINIMUM DESIGN LOADS

be demonstrated that scale effects are not significant to the indicated performance. Evaluation of test results shall be made on the basis of the values obtained from not less than 3 tests, provided that the deviation of any value obtained from any single test does not vary from the average value for all tests by more than 15%. If such deviaton from the average value for any test exceeds 15%, then additional tests shall be performed until the deviation of any test from the average value does not exceed 15% or a minimum of 6 tests have been performed. No test shall be eliminated unless a rationale for its exclusion is given. Test reports shall document the location, the time and date of the test, the characteristics of the tested specimen, the laboratory facilities, the test configuration, the applied loading and deformation under load, and the occurrence of any damage sustained by the specimen, together with the loading and deformation at which such damage occurred.

*1.3.1.3.3 Documentation* The procedures used to demonstrate compliance with this section and the results of analysis and testing shall be documented in one or more reports submitted to the authority having jurisdiction and to an independent peer review.

1.3.1.3.4 Peer Review The procedures and results of analysis, testing, and calculation used to demonstrate compliance with the requirements of this section shall be subject to an independent peer review approved by the authority having jurisdiction. The peer review shall comprise one or more persons having the necessary expertise and knowledge to evaluate compliance, including knowledge of the expected performance, the structural and component behavior, the particular loads considered, structural analysis of the type performed, the materials of construction, and laboratory testing of elements and components to determine structural resistance and performance characteristics. The review shall include the assumptions, criteria, procedures, calculations, analytical models, test setup, test data, final drawings, and reports. Upon satisfactory completion, the peer review shall submit a letter to the authority having jurisdiction indicating the scope of their review and their findings.

#### 1.3.2 Serviceability

Structural systems, and members thereof, shall be designed to have adequate stiffness to limit deflections, lateral drift, vibration, or any other deformations that adversely affect the intended use and performance of buildings and other structures.

#### Chapter 2 COMBINATIONS OF LOADS

#### 2.1 GENERAL

Buildings and other structures shall be designed using the provisions of either Section 2.3 or 2.4. Where elements of a structure are designed by a particular material standard or specification, they shall be designed exclusively by either Section 2.3 or 2.4.

#### 2.2 SYMBOLS

- $A_k$  = load or load effect arising from extra ordinary event A
- D = dead load
- $D_i$  = weight of ice
- E = earthquake load
- F = load due to fluids with well-defined pressures and maximum heights
- $F_a$  = flood load
- H = load due to lateral earth pressure, ground water pressure, or pressure of bulk materials
- L = live load
- $L_r = \text{roof live load}$
- R = rain load
- S = snow load
- T = self-straining load
- W = wind load
- $W_i$  = wind-on-ice determined in accordance with Chapter 10

#### 2.3 COMBINING FACTORED LOADS USING STRENGTH DESIGN

#### 2.3.1 Applicability

The load combinations and load factors given in Section 2.3.2 shall be used only in those cases in which they are specifically authorized by the applicable material design standard.

#### 2.3.2 Basic Combinations

Structures, components, and foundations shall be designed so that their design strength equals or exceeds the effects of the factored loads in the following combinations:

- 1. 1.4D
- 2.  $1.2D + 1.6L + 0.5(L_r \text{ or } S \text{ or } R)$
- 3.  $1.2D + 1.6(L_r \text{ or } S \text{ or } R) + (L \text{ or } 0.5W)$
- 4.  $1.2D + 1.0W + L + 0.5(L_r \text{ or } S \text{ or } R)$

- 5. 1.2D + 1.0E + L + 0.2S
- 6. 0.9D + 1.0W
- 7. 0.9D + 1.0E

#### **EXCEPTIONS:**

- 1. The load factor on L in combinations 3, 4, and 5 is permitted to equal 0.5 for all occupancies in which  $L_o$  in Table 4-1 is less than or equal to 100 psf, with the exception of garages or areas occupied as places of public assembly.
- 2. In combinations 2, 4, and 5, the companion load *S* shall be taken as either the flat roof snow load  $(p_j)$  or the sloped roof snow load  $(p_s)$ .

Where fluid loads F are present, they shall be included with the same load factor as dead load D in combinations 1 through 5 and 7.

Where load *H* are present, they shall be included as follows:

- 1. where the effect of *H* adds to the primary variable load effect, include *H* with a load factor of 1.6;
- 2. where the effect of H resists the primary variable load effect, include H with a load factor of 0.9 where the load is permanent or a load factor of 0 for all other conditions.

Effects of one or more loads not acting shall be investigated. The most unfavorable effects from both wind and earthquake loads shall be investigated, where appropriate, but they need not be considered to act simultaneously. Refer to Section 12.4 for specific definition of the earthquake load effect E.<sup>1</sup>

Each relevant strength limit state shall be investigated.

#### 2.3.3 Load Combinations Including Flood Load

When a structure is located in a flood zone (Section 5.3.1), the following load combinations shall be considered in addition to the basic combinations in Section 2.3.2:

- 1. In V-Zones or Coastal A-Zones, 1.0W in combinations 4 and 6 shall be replaced by  $1.0W + 2.0F_a$ .
- 2. In noncoastal A-Zones, 1.0W in combinations 4 and 6 shall be replaced by  $0.5W + 1.0F_a$ .

<sup>&</sup>lt;sup>1</sup>The same *E* from Sections 1.4 and 12.4 is used for both Sections 2.3.2 and 2.4.1. Refer to the Chapter 11 Commentary for the Seismic Provisions.

#### CHAPTER 2 COMBINATIONS OF LOADS

#### 2.3.4. Load Combinations Including Atmospheric Ice Loads

When a structure is subjected to atmospheric ice and wind-on-ice loads, the following load combinations shall be considered:

- 1.  $0.5(L_r \text{ or } S \text{ or } R)$  in combination 2 shall be replaced by  $0.2D_i + 0.5S$ .
- 2.  $1.0W + 0.5(L_r \text{ or } S \text{ or } R)$  in combination 4 shall be replaced by  $D_i + W_i + 0.5S$ .
- 3. 1.0*W* in combination 6 shall be replaced by  $D_i + W_i$ .

#### 2.3.5 Load Combinations Including Self-Straining Loads

Where applicable, the structural effects of load T shall be considered in combination with other loads. The load factor on load T shall be established considering the uncertainty associated with the likely magnitude of the load, the probability that the maximum effect of T will occur simultaneously with other applied loadings, and the potential adverse consequences if the effect of T is greater than assumed. The load factor on T shall not have a value less than 1.0.

#### 2.3.6 Load Combinations for Nonspecified Loads

Where approved by the Authority Having Jurisdiction, the Responsible Design Professional is permitted to determine the combined load effect for strength design using a method that is consistent with the method on which the load combination requirements in Section 2.3.2 are based. Such a method must be probability-based and must be accompanied by documentation regarding the analysis and collection of supporting data that is acceptable to the Authority Having Jurisdiction.

#### 2.4 COMBINING NOMINAL LOADS USING ALLOWABLE STRESS DESIGN

#### 2.4.1 Basic Combinations

Loads listed herein shall be considered to act in the following combinations; whichever produces the most unfavorable effect in the building, foundation, or structural member being considered. Effects of one or more loads not acting shall be considered.

- 4.  $D + 0.75L + 0.75(L_r \text{ or } S \text{ or } R)$
- 5. D + (0.6W or 0.7E)
- 6a.  $D + 0.75L + 0.75(0.6W) + 0.75(L_r \text{ or } S \text{ or } R)$
- 6b. D + 0.75L + 0.75(0.7E) + 0.75S
- 7. 0.6D + 0.6W
- 8. 0.6D + 0.7E

#### **EXCEPTIONS:**

- 1. In combinations 4 and 6, the companion load *S* shall be taken as either the flat roof snow load  $(p_j)$  or the sloped roof snow load  $(p_s)$ .
- 2. For nonbuilding structures, in which the wind load is determined from force coefficients,  $C_f$ , identified in Figures 29.5-1, 29.5-2 and 29.5-3 and the projected area contributing wind force to a foundation element exceeds 1,000 square feet on either a vertical or a horizontal plane, it shall be permitted to replace *W* with 0.9*W* in combination 7 for design of the foundation, excluding anchorage of the structure to the foundation.
- 3. It shall be permitted to replace 0.6*D* with 0.9*D* in combination 8 for the design of Special Reinforced Masonry Shear Walls, where the walls satisfy the requirement of Section 14.4.2.

Where fluid loads F are present, they shall be included in combinations 1 through 6 and 8 with the same factor as that used for dead load D.

Where load H is present, it shall be included as follows:

- 1. where the effect of *H* adds to the primary variable load effect, include *H* with a load factor of 1.0;
- 2. where the effect of *H* resists the primary variable load effect, include *H* with a load factor of 0.6 where the load is permanent or a load factor of 0 for all other conditions.

The most unfavorable effects from both wind and earthquake loads shall be considered, where appropriate, but they need not be assumed to act simultaneously. Refer to Section 1.4 and 12.4 for the specific definition of the earthquake load effect E.<sup>2</sup>

Increases in allowable stress shall not be used with the loads or load combinations given in this standard unless it can be demonstrated that such an increase is justified by structural behavior caused by rate or duration of load.

<sup>1.</sup> D2. D + L3.  $D + (L_r \text{ or } S \text{ or } R)$ 

<sup>&</sup>lt;sup>2</sup>The same *E* from Sections 1.4 and 12.4 is used for both Sections 2.3.2 and 2.4.1. Refer to the Chapter 11 Commentary for the Seismic Provisions.

MINIMUM DESIGN LOADS

#### 2.4.2 Load Combinations Including Flood Load

When a structure is located in a flood zone, the following load combinations shall be considered in addition to the basic combinations in Section 2.4.1:

- In V-Zones or Coastal A-Zones (Section 5.3.1), 1.5F<sub>a</sub> shall be added to other loads in combinations 5, 6, and 7, and *E* shall be set equal to zero in 5 and 6.
- 2. In non-coastal A-Zones,  $0.75F_a$  shall be added to combinations 5, 6, and 7, and *E* shall be set equal to zero in 5 and 6.

#### 2.4.3 Load Combinations Including Atmospheric Ice Loads

When a structure is subjected to atmospheric ice and wind-on-ice loads, the following load combinations shall be considered:

- 1.  $0.7D_i$  shall be added to combination 2.
- 2.  $(L_r \text{ or } S \text{ or } R)$  in combination 3 shall be replaced by  $0.7D_i + 0.7W_i + S$ .
- 3. 0.6*W* in combination 7 shall be replaced by  $0.7D_i + 0.7W_i$ .

#### 2.4.4 Load Combinations Including Self-Straining Loads

Where applicable, the structural effects of load T shall be considered in combination with other loads. Where the maximum effect of load T is unlikely to occur simultaneously with the maximum effects of other variable loads, it shall be permitted to reduce the magnitude of T considered in combination with these other loads. The fraction of T considered in combination with other loads shall not be less than 0.75.

#### 2.5 LOAD COMBINATIONS FOR EXTRAORDINARY EVENTS

#### 2.5.1 Applicability

Where required by the owner or applicable code, strength and stability shall be checked to ensure that structures are capable of withstanding the effects of extraordinary (i.e., low-probability) events, such as fires, explosions, and vehicular impact without disproportionate collapse.

#### 2.5.2 Load Combinations

#### 2.5.2.1 Capacity

For checking the capacity of a structure or structural element to withstand the effect of an extraordinary event, the following gravity load combination shall be considered:

$$(0.9 \text{ or } 1.2)D + A_k + 0.5L + 0.2S$$
 (2.5-1)

in which  $A_k$  = the load or load effect resulting from extraordinary event A.

#### 2.5.2.2 Residual Capacity

For checking the residual load-carrying capacity of a structure or structural element following the occurrence of a damaging event, selected load-bearing elements identified by the Responsible Design Professional shall be notionally removed, and the capacity of the damaged structure shall be evaluated using the following gravity load combination:

$$(0.9 \text{ or } 1.2)D + 0.5L + 0.2(L_r \text{ or } S \text{ or } R)$$
 (2.5-2)

#### 2.5.3 Stability Requirements

Stability shall be provided for the structure as a whole and for each of its elements. Any method that considers the influence of second-order effects is permitted.

#### System Assemblies & Load Tracing

#### Notation:


a = name for a dimension	T = symbol for tension
C = symbol for compression	= name of a tension force
DL = shorthand for dead load	v = distributed shear
$F_{horizontal-resisting} = $ total force resisting	V = name for shear (horizontal) force
horizontal sliding	w = name for distributed load/length, as
$F_{sliding}$ = total sliding force	is $\omega$
$F_y$ = force component in the y direction	= name for distributed load/area
FBD = free body diagram	<i>w<sub>self wt</sub></i> = name for distributed load from self
h = name for height	weight of member
L = name for length	$w_{selfwt equiv}$ = name for equivalent distributed
LL = shorthand for live load	vertical load from self weight of
M = moment due to a force	slanted member
$M_{overturning}$ = total overturning moment	W = name for total force due to
$M_{resisting} =$ total moment resisting	distributed load
overturning about a point	= force due to a weight
N = name for normal force to a surface	x = horizontal distance
o.c. = shorthand for on center	$\mu$ = coefficient of static friction
p = pressure	$\gamma$ = density or unit weight
P = force due to a pressure	• •
SF = shorthand for factor of safety	$\omega' = $ equivalent fluid density of a soil
R = name for reaction force	$\Sigma$ = summation symbol


#### Load Tracing

- LOAD TRACING is the term used to describe how the loads on and in the structure are transferred through the members (*load paths*) to the foundation, and ultimately supported by the ground.
- It is a sequence of **actions**, NOT reactions. Reactions in statically determinate members (using FBD's) can be solved for to determine the actions on the next member in the hierarchy.
- The *tributary area* is a loaded area that contributes to the load on the member supporting that area, *ex.* the area from the center between two beams to the center of the next two beams for the full span is the load on the center beam
- The *tributary load* on the member is found by **concentrating** (or consolidating) the load into the center.

$$w = (\frac{load}{area})x(tributary width)$$

where w = distributed load in units of load/length.






tributary width plan

#### Distributed Loads

Distributed loads may be replaced by concentrated loads acting through the balance/center of the distribution or *load area*: THIS IS AN **EQUIVALENT** FORCE SYSTEM.

- *w* is the symbol used to describe the *load* per unit **length**. *Note: It can also represent a load per unit <u>area</u>.*
- W is the symbol used to describe the *total load*.

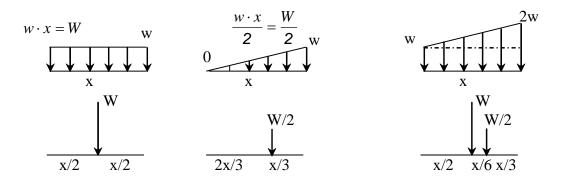

#### Framing Systems

Horizontal levels must transfer loads to vertical elements. There are many ways to configure the systems. The horizontal levels can be classified by how many elements transfer loads in the plane. Decking is not usually considered a level in a multiple level system because it isn't significantly load-bearing. It is considered a level when it is the only horizontal element and must resist loads.


#### **Foundations**

The final path of the load for the structure is to the foundation. The foundation must transfer the loads to the soil, which is a "natural" structural material. The soil conditions will determine if a shallow foundation (most economical an easy to construct) can be used, or a deep foundation (for larger loads or poorer soil capacities) must be considered.

#### Distribution of Loads with Irregular Configurations

When a bay (defined by the area bounded by vertical supports) is not rectangular, it is commonly constructed with parallel or non-parallel spanning members of non-uniform lengths. With parallel spanning members, the tributary width is uniform. With non-parallel members, the tributary width at each end is different, but still defined as half the distance (each side) to the next member. The resulting distribution will be linear (and not uniform).

The most efficient one-way systems have regular, rectangular bays. Two way systems are most efficient when they are square. With irregular bays, attempts are made to get as many parallel members as possible with similar lengths, resulting in an economy of scale.

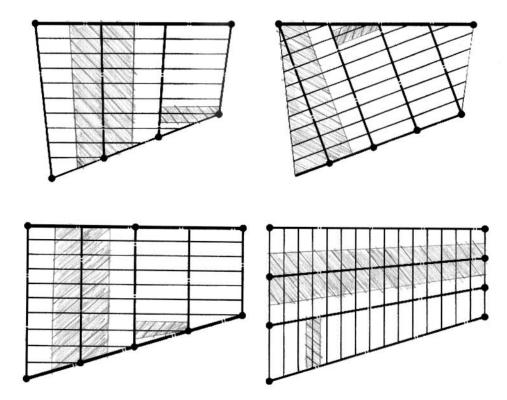

Distribution of Loads on Edge Supported Slabs

Distributed loads on two-way slabs (i.e. not one-way like beams) do not have obvious tributary "widths". The distribution is modeled using a 45 degree tributary "boundary" in addition to the tributary boundary that is half way between supporting elements, in this case, edge beams.

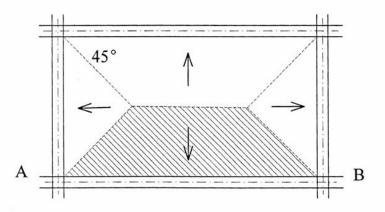


Figure 2-16: Supporting beams' contributing areas for reinforced concrete floor system.

The tributary distribution *from the area loads* result in a trapezoidal distribution. Self weight will be a uniform distributed load, and will also have to be included for design of beam AB.




Figure 2-17: Trapezoidal distributed load for Beam AB of Fig. 2-16.


#### Openings in Floor/Roof Plans

Openings in a horizontal system usually are framed on all sides. This provides for stiffness and limiting the deflection. The edge beams may not be supporting the flooring, however, so care needs to be taken to determine if an opening edge beam must support tributary area, or just itself.

• Any edge beam supporting a load has load <u>on only one side</u> to the next supporting element.


#### Beams Supported by Other Beams

Joists are commenly supported by beams with beam hangers. The reaction at the support is transferred to the beam as a single force. A beam, in turn, can be supported by a larger beam or girder, and the reaction from this beam having a uniform distributed self weight, and the forces, will be an action on the girder.



#### Horizontal Projection of Gravity Load on a Rafter

When an angled member, such as a rafter has a self weight per unit length, that weight is usually converted to a weight per horizontal length:

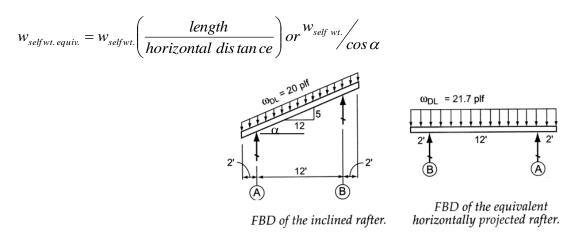


#### **Framing Plans**


Framing plans are diagrams representing the placement and organization of structural members. Until the final architecture has been determined, framing plans are often drawn freehand with respect to the floor plans, and quite often use the formal conventions for structural construction drawings.

Parts of the building are identified by letter symbols:

B-Beams	F-Footings	L-Lintels	U- Stirrups
<i>C</i> – Columns	G-Girders	S-Slabs	W-Walls
D-Dowels	J-Joists	T-Ties	


Other parts are represented with lines (beams and joists), dots, squares, rectangles or wide-flange shapes for columns. Column and footing locations in structural drawings are referred to by letters and numbers, with vertical lines at column centers given letters -A, B, C, etc., and horizontal lines at columns given numbers -1, 2, 3, etc. The designation *do* may be used to show like members (like *ditto*).

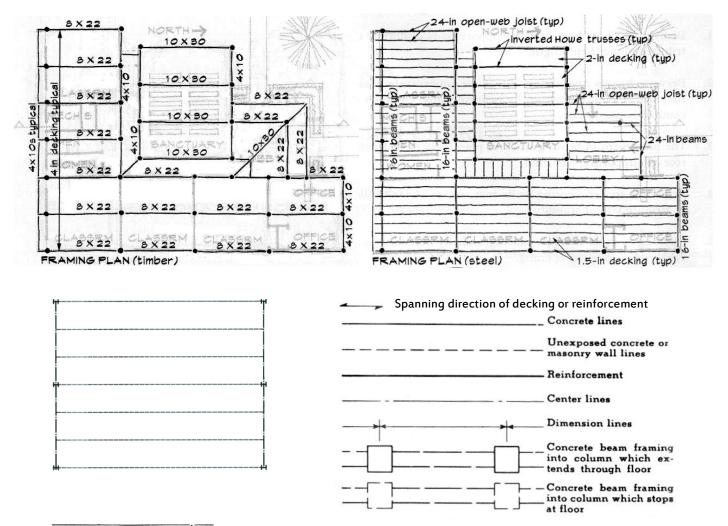



Breaks in the lines are commonly used to indicate the *end* of a beam that is supported by another member, such as a girder or column. Beams can span over a support (as a continuous beam) and therefore, there is no break shown at the column.

Joists can span over a supporting beam, and the lines will cross. (Looking for the ends of the crossing members give information about which is below and which is above.) Concrete systems often have slabs, ribs or drop panels or strips, which aren't easily represented by centerlines, so hidden lines represent the edges. Commonly isolated "patches" of repeated geometry are used for brevity.

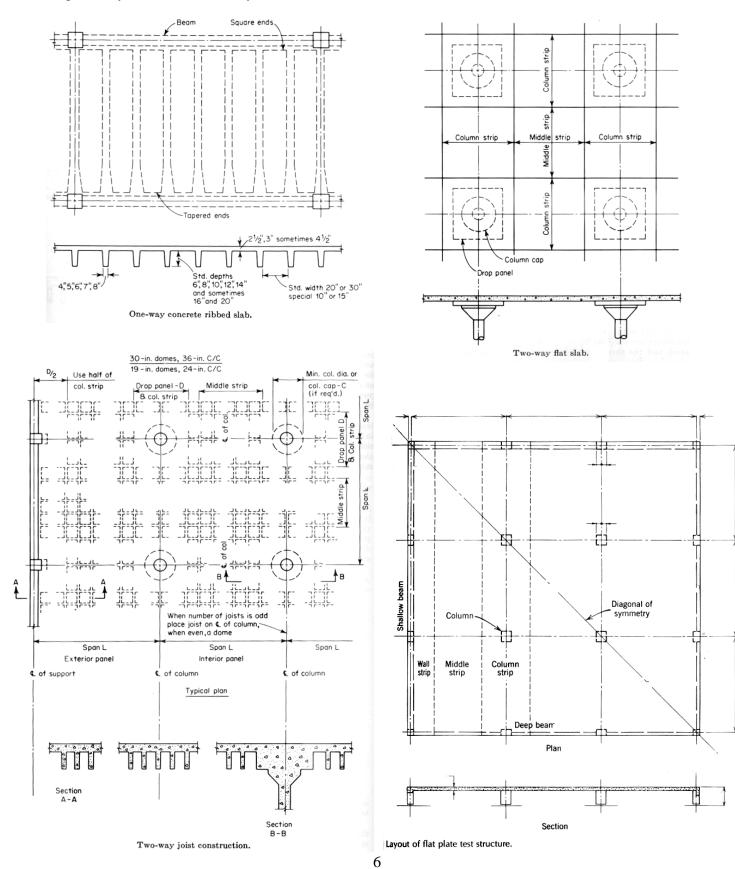

#### **Retaining Walls**

Retaining walls are used to hold back soil or other material with the wall. The other key components include bases, counterforts, buttresses or keys. Gravity loads help provide resistance to movement, while the walls with lateral loads behave like cantilever beams.

#### Loads

The design of retaining walls must consider overturning, settlement, sliding and bearing pressure. The water in the retained soil can significantly affect the loading and the active pressure of the soil. The lateral force, P, acting at a height of h/3 is determined from the equivalent fluid weight (density),  $\omega$ ', (in force/cubic area) as:

$$P = \frac{\omega' h^2}{2} \text{ or } \frac{ph}{2}$$

where p is the maximum pressure at the base:  $p = \omega' \cdot h$ 

Overturning is considered the same as for eccentric footings:

$$SF = \frac{M_{resist}}{M_{overturning}} \ge 1.5 - 2$$

where

 $M_{resist}$  = summation of moments about "o" to resist rotation, typically including the moment due to the weight of the stem and base and the moment due to the passive pressure.

 $M_{overturning}$  = moment due to the active pressure about the toe "o".


Sliding must also be avoided:


$$SF = rac{F_{horizontal-resist}}{F_{sliding}} \ge 1.25 - 2$$




 $F_{horizontal-resist}$  = summation of forces to resist sliding, typically including the force from the passive pressure and friction (F= $\mu$ ·N where .  $\mu$  is a constant for the materials in contact and N is the normal force to the ground acting down and is shown as R).

 $F_{\text{sliding}} = \text{sliding force as a result of active pressure.}$ 







#### Pressure Distribution

Because the resultant force from the gravity loads and pressure is not vertical, the vertical pressure distribution under the footing will not be uniform, but will be linearly distributed. The vertical component of the resultant <u>must be in the same horizontal location</u> as the pressure reaction force.

- There can never be a tensile pressure because the footing will not be in contact with the soil.
- To make certain all the area under the footing is used to distributed the load, the vertical resultant needs to be within the middle third of the base width. This area is called the *kern*.
- Soil pressure is most commonly called q in the design texts and codes.

To determine the size of the maximim pressure we find the equivalent location of the pressure reaction, P, at x using moment calculations when  $R_x = W$ :

W = P = 1/2p(3x)

p = 2W/3x

p = 2W/a

so

and

where x is the location of the resultant force and a is the width of the base.

when x = a/3


 $p = \frac{W}{a^2}(4a - 6x)$  when a/3 < x < 2a/3

when x < a/3

 $x = \frac{M_{\text{resisting}} - M_{\text{overturning}}}{W_{\text{total}}}$ 


#### Wind Load Tracing

For design purposes, wind loads are treated as static pressure distributions over the walls and roof. In the case of walls, the loads are traced just like those for horizontal surfaces. If there is a roof diaphragm, it is the "top" supporting element and the tributary boundary is half way "up" to the diaphragm. If the supporting elements are the side walls the tributary boundary is vertical and half way between sides. In either case, the traced action force at the top of the walls is a lateral *shear* force (V) that must be resisted. The shear over the width of a shear wall, *v*, is a *unit shear* used for determining the connection and framing capacity required.

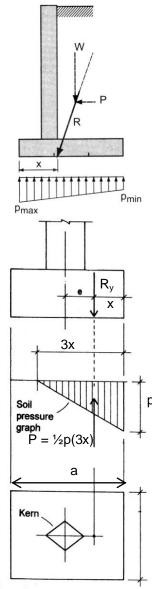

#### Lateral Resisting Systems

- Shear Walls
- Braced Frames
- Rigid Frames
- Diaphragms
- Cores
- Tubes

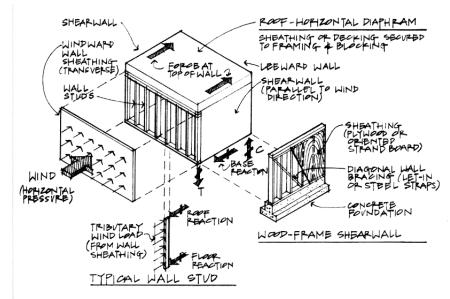

*Figure 4.48 Exploded view of a light-framed wood building showing the various lateral resisting components.* 

#### Bracing Configurations

Without proper arrangement of the lateral resisiting components, the system cannot transfer lateral loads that may come *from any direction*.


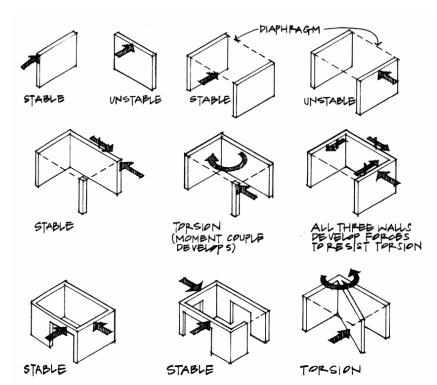


Figure 4.54 Various shearwall arrangements—some stable, others unstable.


#### Example 1 (pg 168) Example Problem 5.2

In the single-bay, post-and-beam deck illustrated, planks typically are available in nominal widths of 4" or 6", but for the purposes of analysis it is permissible to assume a unit width equal to one foot. Determine the plank, beam, and column reactions.

The loads are: 60 lb/ft<sup>2</sup> live load, 8 lb/ft<sup>2</sup> dead load, 10 lb/ft self weight of 12' beams, and 100 lb self weight of columns.

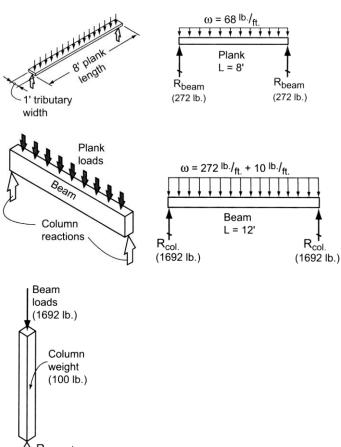






#### Example 2


#### EXAMPLE


Assume that the average dead plus live load on the structure shown in Figure 3.15 is 60 lbs/ft<sup>2</sup>. Determine the reactions for Beam D. This is the same structure as shown in Figure 3.1. ^ E, B and A Assuming all beams are weightless!

#### Solution:

Note carefully the directions of the decking span. Beam D carries floor loads from the **lecking to** the left (see the contributory area and load strip), but not to the right, since the

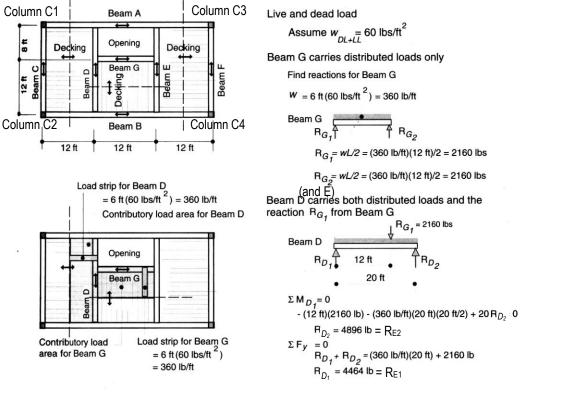





By symmetry;  $R_{CC1} = R_{CC3} = (4896 \text{ lb} + 4896 \text{ lb})/2 = 4896 \text{ lb}$ 

By symmetry;  $R_{CC2} = R_{CC4} = (4464 \text{ lb} + 4464 \text{ lb})/2 + (6 \text{ ft})(60 \text{ lb/ft}^2)(12 \text{ ft})/2 = 6624 \text{ lb}$ Additional loads are transferred to the column from the reactions on Beams C and F:  $R_{C1} = R_{C2} = R_{F1} = R_{F2} = wL/2 = (6 \text{ ft})(60 \text{ lb/ft}^2)(20 \text{ ft})/2 = 3600 \text{ lb}$ 

center decking runs parallel to Beam D and is not carried by it. Beam D also picks up the end of Beam G and thus also "carries" the reactive force from Beam G. It is therefore necessary to analyze Beam G first to determine the magnitude of this force. The analysis appears in Figure 3.15. The reactive force from Beam G of 2160 lbs is then treated as a downward force acting on Beam D. The load model for Beam D thus consists of distributed forces from the decking plus the 2160-lb force. It is then analyzed by means of the equations of statics to obtain reactive forces of 4896 lbs and 4464 lbs at its ends.


C1 = 4896 lb + 3600 lb = 8,496 lb C2 = 6624 lb + 3600 lb = 10,224 lb C3 = 4896 lb + 3600 lb = 8,496 lb C4 = 6624 lb + 3600 lb = 10,224 lb



Figure 3.1

#### Example 3


Determine the factor of safety for overturning and sliding on the 15 ft. retaining wall, 16 in. wide stem, 10 ft. wide x 16 in. high base, when the equivalent fluid pressure is  $30 \text{ lb/ft}^3$ , the weight of the stem of the footing is 4 kips, the weight of the pad is 5 kips, the passive pressure is ignored for this design, and the friction coefficient for sliding is 0.58. The center of the stem is located 3 ft. from the toe. Also find the maximum bearing pressure.




#### Example 4

**4.10** A beach cabin on the Washington coast (100 mph wind velocity) is required to resist a wind pressure of 35 psf. Assuming wood-frame construction, the cabin utilizes a roof diaphragm and four exterior shearwalls for its lateral resisting strategy.

Draw an exploded view of the building and perform a lateral load trace in the N-S direction. Show the magnitude of shear (V) and intensity of shear (v) for the roof and critical shearwall. Also, determine the theoretical tie-down force necessary to establish equilibrium of the shearwall. Note that the dead weight of the wall can be used to aid in the stabilizing of the wall.

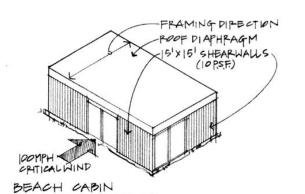

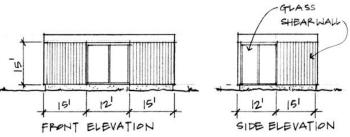

= 5513#

FBD

SHEARWALL

Solution:

 $\omega = 35 \text{ psf} \times 7.5' = 262.5 \text{ #/ft.}$ 

Examining the roof diaphragm as a deep beam spanning 42' between shearwalls:

$$V = \frac{\omega L}{2} = \frac{262.5 \ \#/ \ \text{ft.} \ (42')}{2} = 5,513 \ \#$$


An FBD of the shearwall shows a shear V' developing at the base (foundation) to equilibrate the shear V at the top of the wall. In addition to equilibrium in the horizontal direction, rotational equilibrium must be maintained by the development of a force couple T and C at the edges of the solid portion of wall.

v = V/shearwall length = 5,513 #/15' = 368 #/ft.

W = dead load of the wall

 $W = 10 \text{ psf} \times 15' \times 15' = 2,250 \#$ 

Tie-down force T is determined by writing a moment equation of equilibrium. Summing moments about point A:



7.5FT. TRIBUTARY WALL HEIGHT THAT LEAPS THE ROOF DIAPHRAGM.

#### Wood Design

#### Notation:

a	= name for width dimension
	2

A = name for area

- $A_{req'd-adj}$  = area required at allowable stress when shear is adjusted to include self weight
- b =width of a rectangle
  - = name for height dimension
- c = largest distance from the neutral axis to the top or bottom edge of a beam
- $c_1$  = coefficient for shear stress for a rectangular bar in torsion
- $C_C$  = curvature factor for laminated arches
- $C_D$  = load duration factor

$$C_{fu}$$
 = flat use factor for other than decks

 $C_F$  = size factor

- $C_H$  = shear stress factor
- $C_i$  = incising factor
- $C_L$  = beam stability factor
- $C_M$  = wet service factor
- $C_p$  = column stability factor for wood design
- $C_r$  = repetitive member factor for wood design
- $C_V$  = volume factor for glue laminated timber design
- $C_t$  = temperature factor for wood design
- d = name for depth
  - = calculus symbol for differentiation
- $d_{min}$  = dimension of timber critical for buckling
- D = shorthand for dead load = name for diameter

DL = shorthand for dead load

- E = modulus of elasticity
- f = stress (strength is a stress limit)
- $f_b$  = bending stress
- $f_{from \ table}$  = tabular strength (from table)
- $f_p$  = bearing stress
- $f_v$  = shear stress

 $f_{v-max}$  = maximum shear stress

- $F_{allow}$  = allowable stress
- $F_b$  = tabular bending strength
  - = allowable bending stress

- $F'_b$  = allowable bending stress (adjusted)  $F_c$  = tabular compression strength parallel to the grain
- $F'_c$  = allowable compressive stress (adjusted)

$$F_{c}^{*}$$
 intermediate compressive stress for dependant on load duration

- $F_{cE}$  = theoretical allowed buckling stress
- $F_{c\perp}$  = tabular compression strength perpendicular to the grain
- $F_{connector}$  = shear force capacity per connector
- $F_p$  = tabular bearing strength parallel to the grain
  - = allowable bearing stress
- $F_t$  = tabular tensile strength
- $F_u$  = ultimate strength
- $F_{v}$  = tabular bending strength
  - = allowable shear stress
- $F_y$  = yield strength
- h = height of a rectangle
- H = name for a horizontal force
- *I* = moment of inertia with respect to neutral axis bending
- $I_{trial}$  = moment of inertia of trial section
- $I_{req'd}$  = moment of inertia required at limiting deflection
- $I_y$  = moment of inertia with respect to an y-axis
- J =polar moment of inertia
- K = effective length factor for columns
- $L_e$  = effective length that can buckle for column design, as is  $\ell_e$
- L = name for length or span length
- *LL* = shorthand for live load

LRFD = load and resistance factor design

- M = internal bending moment
- $M_{max}$  = maximum internal bending moment
- $M_{max-adj}$  = maximum bending moment adjusted to include self weight
- n =number of connectors across a joint, as is N

р	= pitch of connector spacing	Т	= torque (axial moment)
•	= safe connector load parallel to the	V	= internal shear force
	grain	Vmax	= maximum internal shear force
Р	= name for axial force vector	V <sub>max-</sub>	adj = maximum internal shear force
$P_{allow}$	$_{able}$ = allowable axial force		adjusted to include self weight
q	= safe connector load perpendicular	W	= name for distributed load
-	to the grain	Wself v	$_{vt}$ = name for distributed load from self
$Q_{conn}$	ected = first moment area about a neutral	0	weight of member
	axis for the connected part	W	= shorthand for wind load
r	= radius of gyration	x	= horizontal distance
	= interior radius of a laminated arch	у	= vertical distance
R	= radius of curvature of a deformed	Ζ	= force capacity of a connector
	beam	$\varDelta_{active}$	$u_{al} = actual beam deflection$
	= radius of curvature of a laminated	$\varDelta$ allo	wable = allowable beam deflection
	arch	$\varDelta$ lim	$_{it}$ = allowable beam deflection limit
	= name for a reaction force	$\Delta_{max}$	x = maximum beam deflection
S	= section modulus	γ	= density or unit weight
Sreq'd	= section modulus required at	θ	= slope of the beam deflection curve
	allowable stress	U	= radial distance
Sreq'd-	adj = section modulus required at	$\rho$	
	allowable stress when moment is	J	= symbol for integration
	adjusted to include self weight	Σ	= summation symbol

#### Wood or Timber Design

Structural design standards for wood are established by the *National Design Specification (NDS)* published by the National Forest Products Association. There is a combined specification (from 2005) for **Allowable** Stress Design and limit state design (LRFD).

Tabulated wood strength values are used as the base allowable strength and modified by appropriate **adjustment** factors:  $F'_{1} = C_{1} + C_{2} + C_{3} + C_{4} + C_{5} + C_$ 

$$F' = C_D C_M C_F \dots \times F_{from table}$$

Size and Use Categories

Boards:	1 to $1\frac{1}{2}$ in. thick	2 in. and wider
Dimension lumber	2 to 4 in. thick	2 in. and wider
Timbers	5 in. and thicker	5 in. and wider

#### Adjustment Factors (partial list)

- C<sub>D</sub> load duration factor
- $C_M$  wet service factor (1.0 dry < 16% moisture content)
- $C_F$  size factor for visually graded sawn lumber and round timber > 12" depth

$$C_F = (12/d)^{\frac{1}{9}} \le 1.0$$

- C<sub>fu</sub> flat use factor (excluding decking)
- C<sub>i</sub> incising factor (from increasing the depth of pressure treatment)
- Ct temperature factor (at high temperatures strength decreases)
- C<sub>r</sub> repetitive member factor
- C<sub>H</sub> shear stress factor (amount of splitting)
- $C_V$  volume factor for glued laminated timber (similar to  $C_F$ )
- C<sub>L</sub> beam stability factor (for beams without full lateral support)
- C<sub>C</sub> curvature factor for laminated arches

#### Tabular Design Values

- $F_{b}$ : bending stress
- F<sub>t</sub>: tensile stress
- F<sub>v</sub>: horizontal shear stress
- $F_{c\perp}$ : compression stress (perpendicular to grain)
- F<sub>c</sub>: compression stress (parallel to grain)
- E: modulus of elasticity
- F<sub>p</sub>: bearing stress (parallel to grain)


Wood is significantly weakest in **shear** and strongest along the direction of the grain (tension and compression).

#### Load Combinations and Deflection

The critical load combination is determined by the largest of either:

$$\frac{dead \ load}{0.9} \ or \ \frac{(\ dead \ load \ + \ any \ combination \ of \ live \ load \ )}{C_D}$$

The deflection limits may be increased for less stiffness with total load: LL + 0.5(DL)



#### **Criteria for Design of Beams**

Allowable normal stress or normal stress from LRFD should not be  $F'_b \ge C_b$ .

Knowing M and F<sub>b</sub>, the minimum section modulus fitting the limit is:

$$F_b' \ge f_b = \frac{Mc}{I}$$
  
 $S_{req'd} \ge \frac{M}{F_b'}$ 

Besides strength, we also need to be concerned about *serviceability*. This involves things like limiting deflections & cracking, controlling noise and vibrations, preventing excessive settlements of foundations and durability. When we know about a beam section and its material, we can determine beam deformations.

#### Determining Maximum Bending Moment

Drawing V and M diagrams will show us the maximum values for design. Remember:

$$V = \Sigma(-w)dx$$
  

$$M = \Sigma(V)dx$$
  

$$\frac{dV}{dx} = -w$$
  

$$\frac{dM}{dx} = V$$

#### Determining Maximum Bending Stress

For a prismatic member (constant cross section), the maximum normal stress will occur at the maximum moment.

For a *non-prismatic* member, the stress varies with the cross section AND the moment.

#### **Deflections**

If the bending moment changes, M(x) across a beam of constant material and cross section then the curvature will change:

The slope of the n.a. of a beam,  $\theta$ , will be tangent to the radius of curvature, R:  $\frac{1}{R} = \frac{M(x)}{EI}$ 


$$\theta = slope = \frac{1}{EI} \int M(x) dx$$


The equation for deflection, y, along a beam is:

$$y = \frac{1}{EI} \int \theta dx = \frac{1}{EI} \iint M(x) dx$$

Elastic curve equations can be found in handbooks, textbooks, design manuals, etc.. Computer programs can be used as well (like *Multiframe*).

Elastic curve equations can be **superpositioned** ONLY if the stresses are in the elastic range. *The deflected shape is roughly the same shape flipped as the bending moment diagram but is constrained by supports and geometry.* 





#### **Boundary Conditions**

The boundary conditions are geometrical values that we know – slope or deflection – which may be restrained by supports or symmetry.


At Pins, Rollers, Fixed Supports: y = 0

At Fixed Supports:  $\theta = 0$ 

At Inflection Points From Symmetry:  $\theta = 0$ 

The Slope Is Zero At The Maximum Deflection y<sub>max</sub>:

$$\theta = \frac{dy}{dx} = slope = 0$$

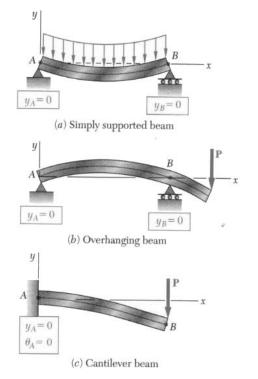

#### Allowable Deflection Limits

All building codes and design codes limit deflection for beam types and damage that could happen based on service condition and severity.

$$y_{\max}(x) = \Delta_{actual} \le \Delta_{allowable} = \frac{L}{value}$$

Use	LL only	DL+LL
Roof beams:		
Industrial	L/180	L/120
Commercial		
plaster ceiling	L/240	L/180
no plaster	L/360	L/240
Floor beams:		
Ordinary Usage	L/360	L/240
Roof or floor (damageable elements)		L/480

#### Lateral Buckling

With compression stresses in the top of a beam, a sudden "popping" or **buckling** can happen even at low stresses. In order to prevent it, we need to brace it along the top, or laterally brace it, or provide a bigger  $I_{v}$ .

#### Beam Loads & Load Tracing

In order to determine the loads on a beam (or girder, joist, column, frame, foundation...) we can start at the top of a structure and determine the *tributary area* that a load acts over and the beam needs to support. Loads come from material weights, people, and the environment. This area is assumed to be from half the distance to the next beam over to halfway to the next beam.

The reactions must be supported by the next lower structural element *ad infinitum*, to the ground.

#### **Design** Procedure

The intent is to find the most light weight member satisfying the section modulus size.

- 1. Know F' for the material or  $F_{\rm U}$  for LRFD.
- 2. Draw V & M, finding M<sub>max</sub>.
- 3. Calculate S<sub>req'd</sub>. This step is equivalent to determining  $f_b = \frac{M_{max}}{S} \le F'_b$ 4. For rectangular beams  $S = \frac{bh^2}{S}$
- - For timber: use the section charts to find S that will work and remember that the beam  $W_{self wt} = \gamma A$ self weight will increase S<sub>reg'd</sub>.

\*\*\*\*Determine the "updated" V<sub>max</sub> and M<sub>max</sub> including the beam self weight, and verify that the updated S<sub>rea'd</sub> has been met.\*\*\*\*\*

- 5. Consider lateral stability.
- 6. Evaluate horizontal shear stresses using V<sub>max</sub> to determine if  $f_v \leq F'_v$  or find A<sub>reg'd</sub>

For rectangular beams 
$$f_{v-max} = \frac{3V}{2A} = 1.5$$

$$f_{v-max} = \frac{3V}{2A} = 1.5 \frac{V}{A} \qquad \therefore A_{req'd} \le \frac{3V}{2F_v'}$$

 $f_p = \frac{P}{A} \leq F'_c \text{ or } F'_{c\perp}$ 

- 7. Provide adequate bearing area at supports:
- $f_{v} = \frac{T\rho}{J} \text{ or } \frac{T}{c_{v}ab^{2}} \leq F_{v}'$ 8. Evaluate shear due to torsion

(circular section or rectangular)

- 9. Evaluate the deflection to determine if  $\Delta_{maxLL} \leq \Delta_{LL-allowed}$  and/or  $\Delta_{maxTotal} \leq \Delta_{Total-allowed}$
- \*\*\*\* note: when  $\Delta_{calculated} > \Delta_{limit}$ ,  $I_{required}$  can be found with: and  $S_{req'd}$  will be satisfied for similar self weight \*\*\*\*\*  $I_{req'd} \geq \frac{\Delta_{too big}}{\Delta_{track}} I_{trial}$

#### FOR ANY EVALUATION:

Redesign (with a new section) at any point that a stress or serviceability criteria is NOT satisfied and re-evaluate each condition until it is satisfactory.

#### Load Tables for Uniformly Loaded Joists & Rafters

Tables exists for the common loading situation for joists and rafters – that of uniformly distributed load. The tables either provide the safe distributed load based on bending and deflection limits, they give the allowable span for specific live and dead loads. If the load is *not uniform*, an *equivalent distributed load* can be calculated from the maximum moment equation.

#### Decking

Flat panels or planks that span several joists or evenly spaced support behave as continuous beams. Design tables consider a "1 unit" wide strip across the supports and determine maximum bending moment and deflections in order to provide allowable loads depending on the depth of the material.

The other structural use of decking is to construct what is called a *diaphragm*, which is a horizontal or vertical (if the panels are used in a shear wall) unit tying the sheathing to the joists or studs that resists forces parallel to the surface of the diaphragm.

#### **Criteria for Design of Columns**

If we know the loads, we can select a section that is adequate for strength & buckling.

If we know the length, we can find the limiting load satisfying strength & buckling.

Any slenderness ratio,  $L_{e}/d \le 50$ :

$$f_{c} = \frac{P}{A} \le F_{c}' \qquad F_{c}' = F_{c}(C_{D})(C_{M})(C_{t})(C_{F})(C_{p})$$

The allowable stress equation uses factors to replicate the combination crushing-buckling curve:

where:

- $F_c$ ' = allowable compressive stress parallel to the grain
- $F_c$  = compressive strength parallel to the grain
- $C_D = load$  duration factor
- $C_M$  = wet service factor (1.0 for dry)
- $C_t$  = temperature factor

$$C_F = size factor$$

 $C_p$  = column stability factor off chart or equation:

$$C_{p} = \frac{1 + (F_{cE} / F_{c}^{*})}{2c} - \sqrt{\left[\frac{1 + F_{cE} / F_{c}^{*}}{2c}\right]^{2} - \frac{F_{cE} / F_{c}^{*}}{c}}$$

For preliminary column design:

$$F_c' = F_c^* C_p = (F_c C_D) C_p$$

#### Procedure for Analysis

- 1. Calculate L<sub>e</sub>/d<sub>min</sub> (KL/d for each axis and chose largest)
- 2. Obtain F'<sub>c</sub>

compute 
$$F_{cE} = \frac{K_{cE}E}{\binom{l_c}{d}^2}$$
 with  $K_{cE} = 0.3$  for sawn, = 0.418 for glu-lam

- 3. Compute  $F_c^* \cong F_c C_D$  with  $C_D = 1$ , normal,  $C_D = 1.25$  for 7 day roof, etc....
- 4. Calculate  $F_{cE}/F_c^*$  and get C<sub>p</sub> from table or calculation
- 5. Calculate  $F_c' = F_c^* C_p$
- 6. Compute  $P_{allowable} = F'_c \cdot A$  or alternatively compute  $f_{actual} = P/A$
- 7. Is the design satisfactory?

Is  $P \le P_{allowable}$ ?  $\Rightarrow$  yes, it is; no, it is no good

or Is  $f_{actual} \leq F'_c$ ?  $\Rightarrow$  yes, it is; no, it is no good

#### Procedure for Design

- 1. Guess a size by picking a section
- 2. Calculate L<sub>e</sub>/d<sub>min</sub> (KL/d for each axis and choose largest)
- 3. Obtain F'<sub>c</sub>

compute 
$$F_{cE} = \frac{K_{cE}E}{\binom{l_e}{d}^2}$$
 with  $K_{cE} = 0.3$  for sawn, = 0.418 for glu-lam

- 4. Compute  $F_c^* \cong F_c C_D$  with  $C_D = 1$ , normal,  $C_D = 1.25$  for 7 day roof...
- 5. Calculate  $F_{cE}/F_c^*$  and get C<sub>p</sub> from table or calculation
- 6. Calculate  $F'_c = F^*_c C_p$
- 7. Compute  $P_{allowable} = F'_{c} \cdot A$  or alternatively compute  $f_{actual} = P/A$
- 8. Is the design satisfactory?

Is  $P \le P_{allowable}$ ?  $\Rightarrow$  yes, it is; no, pick a bigger section and go back to step 2. or Is  $f_{actual} \le F'_c$ ?  $\Rightarrow$  yes, it is; no, pick a bigger section and go back to step 2.

#### Trusses

Timber trusses are commonly manufactured with continuous top or bottom chords, but the members are still design as compression and tension members (without the effect of bending.)

#### Stud Walls

Stud wall construction is often used in *light frame construction* together with joist and rafters. Studs are typically 2-in. nominal thickness and must be braced in the weak axis. Most wall coverings provide this function. Stud spacing is determined by the width of the panel material, and is usually 16 in. The lumber grade can be relatively low. The walls must be designed for a combination of wind load and bending, which means beam-column analysis.

Columns with Bending (Beam-Columns)

The modification factors are included in the form: where:

$$\left[\frac{f_c}{F'_c}\right]^2 + \frac{f_{bx}}{F'_{bx}\left[1 - \frac{f_c}{F_{cEx}}\right]} \le 1.0$$

 $1 - \frac{f_c}{F_{cEx}}$  = magnification factor accounting for P- $\Delta$  $F'_{bx}$  = allowable bending stress

 $f_{bx}$  = working stress from bending about x-x axis

In order to *design* an adequate section for allowable stress, we have to start somewhere:

- 1. Make assumptions about the limiting stress from:
  - buckling
  - axial stress
  - combined stress
- 2. See if we can find values for <u>r</u> or <u>A</u> or <u>S (=I/c<sub>max</sub>)</u>
- 3. Pick a trial section based on if we think r or A is going to govern the section size.
- 4. Analyze the stresses and compare to allowable using the allowable stress method or interaction formula for eccentric columns.
- 5. Did the section pass the stress test?
  - If not, do you *increase* r or A or S?
  - If so, is the difference really big so that you could *decrease* r or A or S to make it more efficient (economical)?
- 6. Change the section choice and go back to step 4. Repeat until the section meets the stress criteria.

#### Laminated Arches

The radius of curvature, R, is limited because of residual bending stresses between lams of thickness t to 100t for Southern pine and hardwoods and 250t for softwoods.


The allowable bending stress for combined stresses is  $F'_b = F_b (C_F C_C)$ 

where  $C_c = 1 - 2000 \left(\frac{t}{r}\right)^2$ 

and r is the radius to the inside of the lamination.

#### **Criteria for Design of Connections**

Connections for wood are typically mechanical fasteners. Shear plates and split ring connectors are common in trusses. Bolts of metal bear on holes in wood, and nails rely on shear resistance



Connections must be able to transfer any axial force, shear, or moment from member to member or from beam to column.

#### **Bolted Joints**

Stress must be evaluated in the member being connected using the load being transferred and the reduced cross section area called *net area*. Bolt capacities are usually provided in tables and take into account the allowable shearing stress across the diameter for *single* and *double shear*, and the allowable bearing stress of the connected material based on the direction of the load with respect to the grain. Problems, such as ripping of the bolt hole at the end of the member, are avoided by following code guidelines on minimum edge distances and spacing.

#### Nailed Joints

Because nails rely on shear resistance, a common problem when nailing is splitting of the wood at the end of the member, which is a shear failure. Tables list the shear force capacity per unit length of embedment per nail. Jointed members used for beams will have shear stress across the


connector, and the pitch spacing, p, can be determined from the shear stress equation when the capacity, F, is known:


$$nF_{connector} \ge \frac{VQ_{connected area}}{I} \cdot p$$


#### Example 1 (pg 328)

#### Example Problem 9.15 (Figures 9.73 to 9.75)

Design a Southern pine No. 1 beam to carry the loads shown (roof beam, no plaster). Assume the beam is supported at each end by an 8" block wall.  $F_b = 1550 \text{ psi}$ ;  $F_v = 110 \text{ psi}$ ;  $E = 1.6 \times 10^6 \text{ psi}$ .  $F_{c\perp} = 440 \text{ psi}$ ,  $\gamma = 36.3 \text{ lb/ft}^3$ 

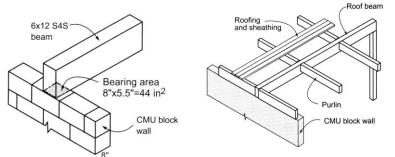





Example 1 (continued)

## Example 2 (pg 379)

#### Example Problem 10.18 (Figures 10.60 and 10.61)

An 18' tall 6×8 Southern pine column supports a roof load (dead load plus a 7-day live load) equal to 16 kips. The weak axis of buckling is braced at a point 9'6" from the bottom support. Determine the adequacy of the column.

$$F_c = 975 \text{ psi}, E = 1.6 \times 10^6 \text{ psi}$$

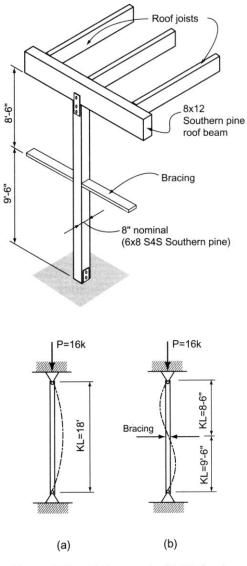


Figure 10.61 (a) Strong axis. (b) Weak axis.

#### Example 3 (pg 381) Example Problem 10.20: Design of Wood Columns(Figure 10.66)

A 22'-tall glu-lam column is required to support a roof load (including snow) of 40 kips. Assuming  $8\frac{3}{4}$ " in one dimension (to match the beam width above), determine the minimum column size if the top and bottom are pin supported.

Select from the following sizes:


 $F_c = 1650 \text{ psi}, E = 1.8 \text{ x } 10^6 \text{ psi}$ 

$$8^{3/4} \times 9^{"} (A = 78.75 \text{ in.}^{2})$$


Also verify with allowable load tables

 $8^{3}/_{4}$ "  $\times$  10<sup>1</sup>/<sub>2</sub>" (A = 91.88 in.<sup>2</sup>)

 $8^{3/4}$ " × 12" (A = 105.00 in.<sup>2</sup>)



#### Example 4

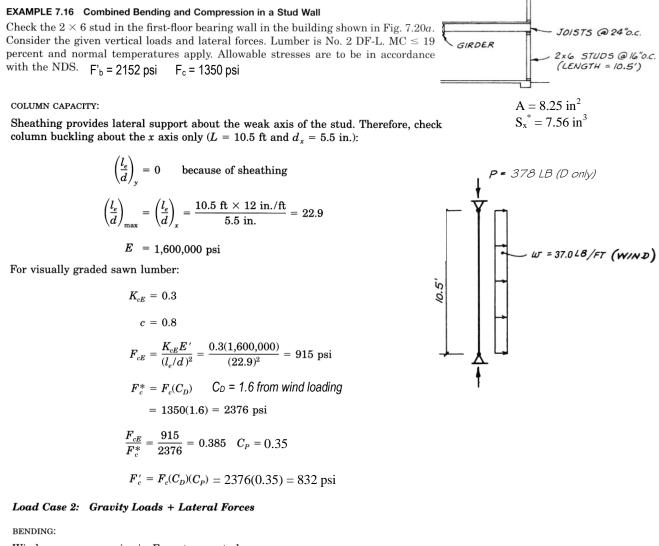

Wind governs over seismic. Force to one stud:

Wind = 27.8 psf  

$$w = 27.8 \text{ psf} \times \frac{16in}{12^{in/ft}} = 37.0 \text{ lb/ft}$$
  
 $M = \frac{wL^2}{8} = \frac{37.0(10.5)^2}{8} = 510 \text{ ft-lb} = 6115 \text{ in.-lb}$   
 $f_b = \frac{M}{S} = \frac{6115}{7.56} = 809 \text{ psi}$   $F'_b = 2152 \text{ psi}$ 

AXIAL:

COMBINED STRESS:

The simplified interaction formula from Example 7.13 (Sec. 7.12) applies:

$$\left(\frac{f_c}{F'_c}\right)^2 + \frac{f_{bx}}{F'_{bx}(1 - f_c/F_{cEx})} \leq 1.0$$

$$F_{cEx} = F_{cE} = 915 \text{ psi}$$

D + W:  $f_c = \frac{P}{A} = \frac{378}{8.25} = 46 \text{ psi}$ 

#### D + W:

In this load combination, D produces the axial stress  $f_c$  and W results in the bending stress  $f_{bx}$ .

$$\left(\frac{f_c}{F'_c}\right)^2 + \left(\frac{1}{1 - f_c/F_{cEx}}\right)\frac{f_{bx}}{F'_{bx}} = \left(\frac{46}{832}\right)^2 + \left(\frac{1}{1 - 46/915}\right)\frac{809}{2152} = 0.399 < 1.0$$

$$2 \times 6 \quad \text{No. 2} \quad \text{DF-L} \quad \text{exterior bearing wall} \quad OK$$

#### Example 5

**Example 2.** The truss heel joint shown in Figure 7.5 is made with 2-in. nominal thickness lumber and gusset plates of  $\frac{1}{2}$ -in.-thick plywood. Nails are 6d common wire with the nail layout shown occurring in both sides of the joint. Find the tension load capacity for the bottom chord member (load 3 in the figure).





TABLE 7.1 Reference Lateral Load Values for Common Wire Nails (lb/in.)

Side Member Thickness, t <sub>s</sub> (in.)	Nail Length, L (in.)	Nail Diameter, D (in.)	Nail Pennyweight	Load per Nail, Z (lb)
Part 1 - With Wo	od Structural Pa	nel Side Members	(G = 0.42)	
	2	0.113	6d	48
3/8	21/2	0.131	8d	63
, -	3	0.148	10d	76
	2	0.113	6d	50
	21/2	0.131	8d	65
15/32	3	0.148	10d	78
	31/2	0.162	16d	92

#### Example 6

A nominal 4 x 6 in. redwood beam is to be supported by two 2 x 6 in. members acting as a spaced column. The minimum spacing and edge distances for the  $\frac{1}{2}$  inch bolts are shown. How many  $\frac{1}{2}$  in. bolts will be required to safely carry a load of 1500 lb? Use the chart provided.

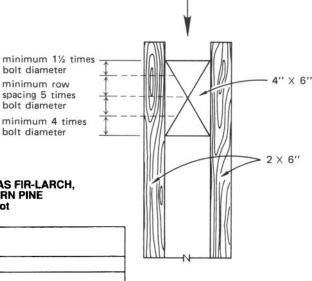

1,500 pounds

#### TABLE 23-I-F—HOLDING POWER OF BOLTS<sup>1,2,3</sup> FOR DOUGLAS FIR-LARCH, CALIFORNIA REDWOOD (CLOSE GRAIN) AND SOUTHERN PINE (See U.B.C. Standard 23-17 where members are not of equal size and for values in other species.)

			× 4.	45 for N			
	OF BOLT IN MAIN			DIAMETER (	F BOLT (inches	)	
wo	OD MEMBER <sup>4</sup> (inches)	3/8	1/2	5/8	3/4	7/8	1
			× 25.	4 for mm			
21/	Single p Shear q		630 360	910 405	1,155 450	1.370 495	1,575 540
2 <sup>1</sup> / <sub>2</sub>	Double p Shear q	710 620	1,260 720	1,820 810	2,310 900	2,740 990	3,150 1,080
21/	Single p Shear q			990 565	1,400 630	1,790 695	2,135 760
31/2	Double $p$ Shear $q$	710 640	1,270 980	1,980 1,130	2,800 1,260	3,580 1,390	4,270 1,520

<sup>1</sup>Tabulated values are on a normal load-duration basis and apply to joints made of seasoned lumber used in dry locations. See Division III for other service conditions.

<sup>2</sup>Double shear values are for joints consisting of three wood members in which the side members are one half the thickness of the main member. Single shear values are for joints consisting of two wood members having a minimum thickness not less than that specified.

<sup>3</sup>See Division III for wood-to-metal bolted joints.

p = safe loads parallel to grain, in pounds.

<sup>4</sup>The length specified is the length of the bolt in the main member of double shear joints or the length of the bolt in the thinner member of single shear joints.

R= 836 LB

#### Example 7

#### EXAMPLE 12.8 Knee Brace Connection

The carport shown in Fig. 12.13*a* uses  $2 \times 6$  knee braces to resist the longitudinal seismic force. Determine the number of 16d common nails required for the connection of the brace to the  $4 \times 4$  post. Material is Southern Pine lumber that is dry at the time of construction. Normal temperatures apply.

Force to one row of braces:

$$R = \frac{wL}{2} = 76\left(\frac{22}{2}\right) = 836 \text{ lb}$$

Assume the force is shared equally by all braces.

$$\Sigma M_0 = 0$$
  
 $3H - 209(10) = 0$   
 $H = 697 \text{ lb}$ 

$$B = \sqrt{2}H = \sqrt{2}(697)$$


= 985 lb axial force in knee brace


= force on nailed connection

The nominal design value for a 16d common nail in Southern Pine can be evaluated using the yield equations (Sec. 12.4), or it can be obtained from NDS Table 12.3B.


Nominal design value from NDS Table 12.3B

$$Z = 154 \text{ lb/nail}$$

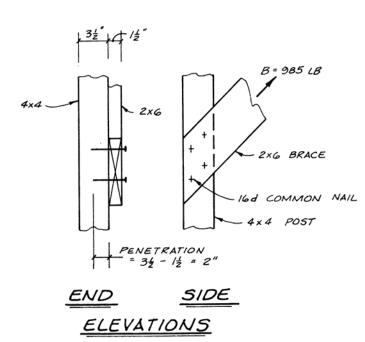

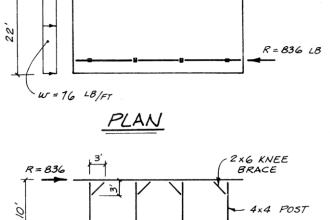

40'





#### Example 7 (continued)

#### **Adjustment Factors**

Penetration

Required penetration to use the full value of Z

$$12D = 12(0.162) = 1.94$$
 in. < 2.0

: Penetration depth factor is

 $C_d = 1.0$ 

#### Moisture content

Because the building is "unenclosed," the brace connection may be exposed to the weather, and the severity of this exposure must be judged by the designer. Assume that a reduction for high moisture content is deemed appropriate, and the wet service factor  $C_M$  is obtained from NDS Table 7.3.3.

 $C_{M} = 0.7$ 

#### Load duration

The load duration factor recommended in the NDS for seismic forces is  $C_D = 1.6$ . The designer is cautioned to verify local code acceptance before using this value in practice.

#### Other adjustment factors

All other adjustment factors for allowable nail capacity do not apply to the given problem, and each can be set equal to unity:

 $C_t = 1.0$  because normal temperature range is assumed

 $C_{eg} = 1.0$  because nails are driven into side grain of holding member

 $C_{di} = 1.0$  because connection is not part of nailing for diaphragm or shearwall

 $C_{tn} = 1.0$  because nails are not toenailed

Allowable load for 16d common nail in Southern Pine:

$$Z' = Z(C_D C_M C_t C_d C_{eg} C_{di} C_{tn})$$

= 154(1.6)(0.7)(1.0)(1.0)(1.0)(1.0)(1.0) = 172 lb/nail

Required number of nails:  $N = \frac{B}{Z'} = \frac{985}{172} = 5.73$ 


Use six 16d common nails each end of knee brace for high-moisture conditions.\*

If the reduction for wet service is not required,  $C_M = 1.0$ . The revised connection is

$$Z' = 154(1.6)(1.0) = 246$$
 lb/nail $N = \frac{985}{246} = 4.00$ 

Use four 16d common nails each end of knee brace if moisture is not a concern.

## **ASD Beam Design Flow Chart**

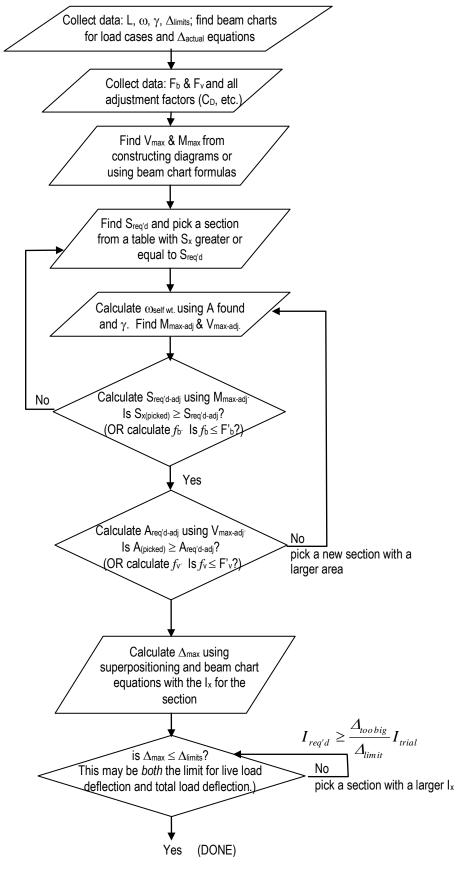

# **Beam Design and Deflections**

## Notation:

<i>a</i> = name for width dimension	$M_{max-adj}$ = maximum bending moment
A = name for area	adjusted to include self weight
$A_{req'd-adj}$ = area required at allowable stress	$M_n$ nominal flexure strength with the full
when shear is adjusted to include	section at the yield stress for LRFD
self weight	$M_{\mu}$ = maximum moment from factored
$A_{\text{web}}$ = area of the web of a wide flange	loads for LRFD
section	P = name for axial force vector
b = width of a rectangle	Q = first moment area about a neutral
= total width of material at a	∼ axis
horizontal section	R = radius of curvature of a deformed
= name for height dimension	beam
c = largest distance from the neutral	S = section modulus
axis to the top or bottom edge of a	$S_{req'd}$ = section modulus required at
beam	allowable stress
$c_1$ = coefficient for shear stress for a	T = torque (axial moment)
rectangular bar in torsion	V = internal shear force
d = calculus symbol for differentiation	$V_{max}$ = maximum internal shear force
DL = shorthand for dead load	$V_{max-adj}$ = maximum internal shear force
E = modulus of elasticity	adjusted to include self weight
$f_b$ = bending stress	$V_u$ = maximum shear from factored loads
$f_p$ = bearing stress (see P)	for LRFD
$f_v = \text{shear stress}$	w = name for distributed load
$f_{v-max}$ = maximum shear stress	$w_{self wt}$ = name for distributed load from self
$F_b$ = allowable bending stress	weight of member
$F_v$ = allowable shear stress	x = horizontal distance
$F_p$ = allowable bearing stress	y = vertical distance
$F_y$ = yield strength	$\Delta_{actual} =$ actual beam deflection
$F_{yweb}$ = yield strength of the web material	$\Delta_{allowable} =$ allowable beam deflection
$h^{\mu\nu}$ = height of a rectangle	$\Delta_{limit}$ = allowable beam deflection limit
I = moment of inertia with respect to	$\Delta_{max}$ = maximum beam deflection
neutral axis bending	$\phi_{b}$ = resistance factor for flexure in
$I_{trial}$ = moment of inertia of trial section	LRFD design
$I_{reg'd}$ = moment of inertia required at	
limiting deflection	$\phi_v$ = resistance factor for shear for
J = polar moment of inertia	LRFD
L = name for span length	$\gamma$ = density or unit weight
LL = shorthand for live load	$\theta$ = slope of the beam deflection curve
LRFD = load and resistance factor design	$\rho$ = radial distance
M = internal bending moment	f = symbol for integration
$M_{max}$ = maximum internal bending moment	$\Sigma$ = summation symbol
<b>C</b>	2 -  summation symbol

## **Criteria for Design**

Allowable bending stress or bending stress from LRFD should not be  $F_b \ge f_b$  exceeded:

Knowing M and F<sub>b</sub>, the minimum section modulus fitting the limit is:

 $F_{b} \geq f_{b} = \frac{Mc}{I}$  $S_{req'd} \geq \frac{M}{F_{b}}$ 

Besides strength, we also need to be concerned about *serviceability*. This involves things like limiting deflections & cracking, controlling noise and vibrations, preventing excessive settlements of foundations and durability. When we know about a beam section and its material, we can determine beam deformations.

#### Determining Maximum Bending Moment

Drawing V and M diagrams will show us the maximum values for design. Remember:

$$V = \Sigma(-w)dx$$
  

$$M = \Sigma(V)dx$$
  

$$\frac{dV}{dx} = -w$$
  

$$\frac{dM}{dx} = V$$

#### Determining Maximum Bending Stress

For a prismatic member (constant cross section), the maximum normal stress will occur at the maximum moment.

For a *non-prismatic* member, the stress varies with the cross section AND the moment.

#### Deflections

If the bending moment changes, M(x) across a beam of constant material and cross section then the curvature will change:  $\frac{1}{R} = \frac{M(x)}{EI}$ 

The slope of the n.a. of a beam,  $\theta$ , will be tangent to the radius of curvature, R:

$$\theta = slope = \frac{1}{EI} \int M(x) dx$$


The equation for deflection, y, along a beam is:


$$y = \frac{1}{EI} \int \theta dx = \frac{1}{EI} \iint M(x) dx$$

Elastic curve equations can be found in handbooks, textbooks, design manuals, etc...Computer programs can be used as well. (BigBoy Beam freeware: <u>http://forum.simtel.net/pub/pd/33994.html</u>)

Elastic curve equations can be **superpositioned** ONLY if the stresses are in the elastic range.

The deflected shape is roughly the shame shape as the bending moment diagram flipped but is constrained by supports and geometry.





## **Boundary Conditions**

The boundary conditions are geometrical values that we know – slope or deflection – which may be restrained by supports or symmetry.

At Pins, Rollers, Fixed Supports: y = 0

At Fixed Supports:  $\theta = 0$ 

At Inflection Points From Symmetry:  $\theta = 0$ 


The Slope Is Zero At The Maximum Deflection y<sub>max</sub>:.

$$\theta = \frac{dy}{dx} = slope = 0$$

Allowable Deflection Limits

All building codes and design codes limit deflection for beam types and damage that could happen based on service condition and severity.  $y_{max}(x) = \Delta_{actual} \leq \Delta_{allowable} = \frac{L}{value}$ 

Use	LL only	DL+LL
Roof beams:		
Industrial	L/180	L/120
Commercial		
plaster ceiling	L/240	L/180
no plaster	L/360	L/240
Floor beams:		
Ordinary Usage	L/360	L/240
Roof or floor (damageable element	nts)	L/480

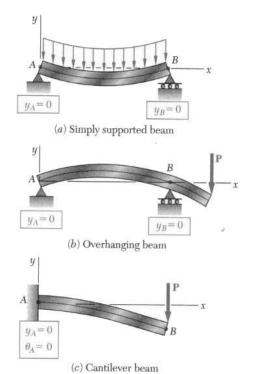

#### Beam Loads & Load Tracing

In order to determine the loads on a beam (or girder, joist, column, frame, foundation...) we can start at the top of a structure and determine the *tributary area* that a load acts over and the beam needs to support. Loads come from material weights, people, and the environment. This area is assumed to be from half the distance to the next beam over to halfway to the next beam.

The reactions must be supported by the next lower structural element *ad infinitum*, to the ground.

#### Design Procedure

The intent is to find the most light weight member satisfying the section modulus size.

- 1. Know  $F_b$  (allowable stress) for the material or  $F_y$  &  $F_u$  for LRFD.
- 2. Draw V & M, finding M<sub>max</sub>.
- 3. Calculate  $S_{req'd}$ . This step is equivalent to determining  $f_b = \frac{M_{max}}{S} \leq F_b$
- 4. For rectangular beams  $S = \frac{bh^2}{6}$ 
  - For steel or timber: use the section charts to find S that will work *and remember that* the beam self weight will increase  $S_{req'd}$ . And for steel, the design charts show the lightest section within a grouping of similar S's.  $W_{self wt} = \gamma A$
  - For any thing else, try a nice value for b, and calculate h or the other way around.

\*\*\*\*Determine the "updated"  $V_{max}$  and  $M_{max}$  including the beam self weight, and verify that the updated  $S_{req'd}$  has been met. \*\*\*\*\*

- 5. Consider lateral stability
- 6. Evaluate horizontal shear stresses using  $V_{max}$  to determine if  $f_v \leq F_v$ 
  - For rectangular beams, W's, and others:  $f_{v-max} = \frac{3V}{2A} \approx \frac{V}{A_{web}} \text{ or } \frac{VQ}{Ib}$
- 7. Provide adequate bearing area at supports:
- 8. Evaluate shear due to torsion

$$f_{v} = \frac{T\rho}{J} \text{ or } \frac{T}{c_{1}ab^{2}} \le F_{v}$$

(circular section or rectangular)

9. Evaluate the deflection to determine if  $\Delta_{maxLL} \leq \Delta_{LL-allowed}$  and/or  $\Delta_{maxTotal} \leq \Delta_{T-allowed}$ 

\*\*\*\* note: when  $\Delta_{calculated} > \Delta_{limit}$ ,  $I_{required}$  can be found with: and  $S_{req'd}$  will be satisfied for similar self weight \*\*\*\*\*


 $I_{req'd} \ge \frac{\Delta_{toobig}}{\Delta_{limit}} I_{trial}$ 

 $f_p = \frac{P}{\Lambda} \le F_p$ 

FOR ANY EVALUATION:

Redesign (with a new section) at any point that a stress or serviceability criteria is NOT satisfied and re-evaluate each condition until it is satisfactory.

## **Beam Design Flow Chart**

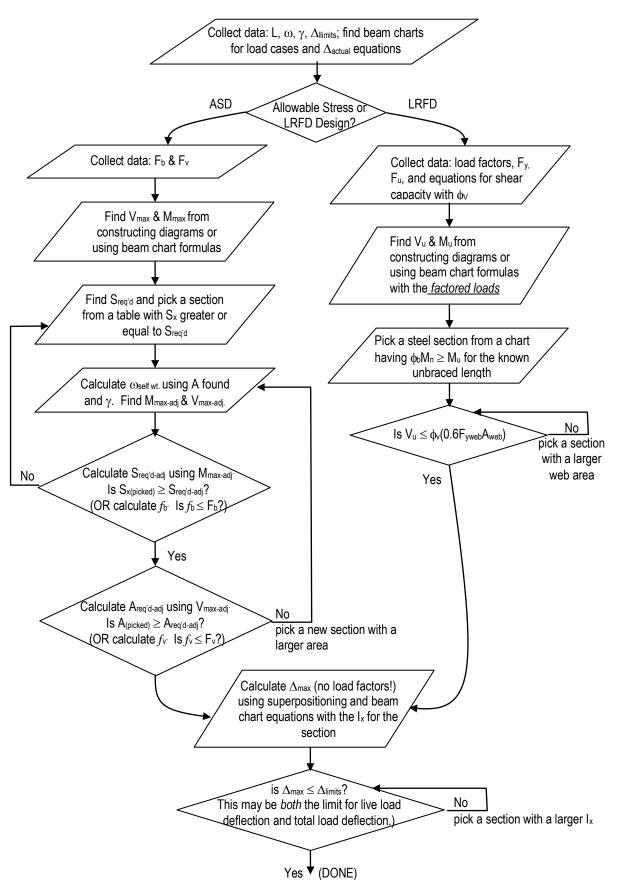

## **Steel Design**

#### Notation:

1.000		
a	=	name for width dimension
Α	=	name for area
$A_{b}$	=	area of a bolt
$A_e$	=	effective net area found from the
e		product of the net area $A_n$ by the
		shear lag factor $U$
$A_g$	=	gross area, equal to the total area
1 g		ignoring any holes
$A_{gv}$	_	gross area subjected to shear for
Igv		block shear rupture
$A_n$	_	net area, equal to the gross area
$\Lambda_n$	_	subtracting any holes, as is $A_{net}$
$A_{nt}$	_	net area subjected to tension for
$A_{nt}$	=	•
٨	_	block shear rupture
$A_{nv}$	=	net area subjected to shear for block
		shear rupture
$A_w$	=	area of the web of a wide flange
1100		section
AISC	=	American Institute of Steel
		Construction
-		allowable stress design
b		name for a (base) width
	=	total width of material at a
		horizontal section
		name for height dimension
$b_{f}$	=	width of the flange of a steel beam
		cross section
$B_1$	=	factor for determining $M_u$ for
		combined bending and compression
С	=	largest distance from the neutral
		axis to the top or bottom edge of a
		beam
$c_1$	=	coefficient for shear stress for a
		rectangular bar in torsion
$C_{h}$	=	modification factor for moment in
- 0		ASD & LRFD steel beam design
$C_{c}$	=	column slenderness classification
οı		constant for steel column design
$C_m$	_	modification factor accounting for
Cm		combined stress in steel design
$C_{v}$	_	web shear coefficient
$\frac{c_v}{d}$		calculus symbol for differentiation
и		depth of a wide flange section
		nominal bolt diameter
d.		nominal bolt diameter
$d_b$	=	nominal boit diameter

- DL= shorthand for dead load
- = eccentricity е
- Ε = shorthand for earthquake load
  - = modulus of elasticity
- = axial compressive stress  $f_c$
- = bending stress  $f_b$
- = bearing stress  $f_p$
- = shear stress  $f_v$
- $f_{v-max}$  = maximum shear stress
- = vield stress  $f_v$

F

- = shorthand for fluid load
- $F_{allow(able)}$  = allowable stress
- = allowable axial (compressive) stress  $F_a$
- = allowable bending stress  $F_{h}$
- = flexural buckling stress  $F_{cr}$
- $F_{e}$ = elastic critical buckling stress
- $F_{EXX}$  = yield strength of weld material
- = nominal strength in LRFD  $F_n$ 
  - = nominal tension or shear strength of a bolt
- $F_p$ = allowable bearing stress
- = allowable tensile stress  $F_t$
- = ultimate stress prior to failure  $F_{u}$
- $F_{v}$ = allowable shear stress
- = vield strength  $F_{v}$
- $F_{yw}$ = yield strength of web material
- = factor of safety *F.S.*
- = gage spacing of staggered bolt g holes
- G = relative stiffness of columns to beams in a rigid connection, as is  $\Psi$
- h = name for a height
- = height of the web of a wide flange  $h_c$ steel section
- Η = shorthand for lateral pressure load
- Ι = moment of inertia with respect to neutral axis bending
- = moment of inertia of trial section I<sub>trial</sub>
- $I_{req'd}$  = moment of inertia required at limiting deflection
- = moment of inertia about the y axis  $I_{y}$
- J = polar moment of inertia

- k = distance from outer face of W flange to the web toe of fillet
  - = shape factor for plastic design of steel beams
- K = effective length factor for columns, as is k
- l = name for length
- $\ell_b$  = length of beam in rigid joint
- $\ell_c$  = length of column in rigid joint
- L = name for length or span length = shorthand for live load
- $L_b$  = unbraced length of a steel beam
- $L_c$  = clear distance between the edge of a hole and edge of next hole or edge of the connected steel plate in the direction of the load
- $L_e$  = effective length that can buckle for column design, as is  $\ell_e$
- L<sub>r</sub> = shorthand for live roof load
   = maximum unbraced length of a steel beam in LRFD design for inelastic lateral-torsional buckling
- $L_p$  = maximum unbraced length of a steel beam in LRFD design for full plastic flexural strength
- L' = length of an angle in a connector with staggered holes
- LL = shorthand for live load
- LRFD =load and resistance factor design
- M = internal bending moment
- $M_a$  = required bending moment (ASD)
- $M_n$  = nominal flexure strength with the full section at the yield stress for LRFD beam design
- $M_{max}$  = maximum internal bending moment
- $M_{max-adj}$  = maximum bending moment adjusted to include self weight
- $M_p$  = internal bending moment when all fibers in a cross section reach the yield stress
- $M_u$  = maximum moment from factored loads for LRFD beam design
- $M_y$  = internal bending moment when the extreme fibers in a cross section reach the yield stress
- n = number of bolts
- n.a. = shorthand for neutral axis

- *N* = bearing length on a wide flange steel section
  - = bearing type connection with threads included in shear plane
- p = bolt hole spacing (pitch)
- P = name for load or axial force vector
- $P_a$  = allowable axial force
  - = required axial force (ASD)


 $P_{allowable}$  = allowable axial force

- $P_c$  = available axial strength
- $P_{e1}$  = Euler buckling strength
- $P_n$  = nominal column load capacity in LRFD steel design
- $P_r$  = required axial force
- $P_u$  = factored column load calculated from load factors in LRFD steel design
- Q = first moment area about a neutral axis
  - = generic axial load quantity for LRFD design
- r = radius of gyration
- $r_y$  = radius of gyration with respect to a y-axis
- R = generic load quantity (force, shear, moment, etc.) for LRFD design
  - = shorthand for rain or ice load
  - = radius of curvature of a deformed beam
- $R_a$  = required strength (ASD)
- $R_n$  = nominal value (capacity) to be multiplied by  $\phi$  in LRFD and divided by the safety factor  $\Omega$  in ASD
- $R_u$  = factored design value for LRFD design
- s = longitudinal center-to-center spacing of any two consecutive holes
- S = shorthand for snow load
  - = section modulus
  - = allowable strength per length of a weld for a given size
- $S_{req'd}$  = section modulus required at allowable stress
- $S_{req'd-adj}$  = section modulus required at allowable stress when moment is adjusted to include self weight
- SC = slip critical bolted connection

$t$ = thickness of the connected math $t_f$ = thickness of flange of wide flang $T$ = torque (axial moment)= shorthand for thermal load= throat size of a weld $U$ = shear lag factor for steel tensionmember design $U_{bs}$ = reduction coefficient for blockshear rupture $V$ = internal shear force $V_a$ = required shear (ASD) $V_{max}$ = maximum internal shear force $V_{max}$ = maximum internal shear force $V_{max}$ = maximum internal shear force $V_{max-adj}$ = maximum shear strength capacitLRFD beam designW $W$ = nominal shear form factoredfor LRFD beam designW $W$ = adjusted distributed load $w_{adjusted}$ = adjusted distributed load forequivalent= the equivalent distributed load $w_{selfwt}$ = name for distributed load from weight of member $W$ = shorthand for wind load $x$ = bearing type connection with threads excluded from the shear plane	nge $Z$ = plastic section modulus of a steel beamge $Z_x$ = plastic section modulus of a steel beam with respect to the x axis $\Delta_{actual}$ = actual beam deflectionon $\Delta_{allowable}$ = allowable beam deflection $\Delta_{limit}$ = allowable beam deflection $\Delta_{max}$ = maximum beam deflection $\omega_{max}$ = maximum beam deflection $\varepsilon_y$ = yield strain (no units) $\phi$ = resistance factor= diameter symbol $\phi_b$ = resistance factor for bending for LRFD $\Delta_{r}$ = resistance factor for tension for LRFDloads $\phi_t$ = resistance factor for tension for LRFD $\phi_v$ = resistance factor in LRFD design nding $\pi$ = pi (3.1415 radians or 180°) $\theta$ = slope of the beam deflection curve $\rho$ $\alpha$ = safety factor for ASD $\beta$ $\beta$ = symbol for integration $\Sigma$
	W 18 x 50

## **Steel Design**

Structural design standards for steel are established by the *Manual of Steel Construction* published by the American Institute of Steel Construction, and uses Allowable Stress Design and Load and Factor **Resistance Design**. With the 13<sup>th</sup> edition, both methods are combined in one volume which provides common requirements for analyses and design and requires the application of the same set of specifications.



#### Materials

American Society for Testing Materials (ASTM) is the organization responsible for material and other standards related to manufacturing. Materials meeting their standards are guaranteed to have the published strength and material properties for a designation.

A36 - carbon steel used for plates, angles $F_y = 36 \text{ ksi}, F_u = 58 \text{ ksi}, E = 29,000 \text{ ksi}$ A572 - high strength low-alloy use for some beams $F_y = 60 \text{ ksi}, F_u = 75 \text{ ksi}, E = 30,000 \text{ ksi}$ A992 - for building framing used for most beams $F_y = 50 \text{ ksi}, F_u = 65 \text{ ksi}, E = 30,000 \text{ ksi}$ (A572 Grade 50 has the same properties as A992) $F_y = 50 \text{ ksi}, F_u = 65 \text{ ksi}, E = 30,000 \text{ ksi}$ 

ASD 
$$R_a \leq \frac{R_n}{\Omega}$$

where  $R_a$  = required strength (dead or live; force, moment or stress)  $R_n$  = nominal strength specified for ASD  $\Omega$  = safety factor

Factors of Safety are applied to the limit stresses for allowable stress values:

bending (braced, $L_b < L_p$ )	$\Omega = 1.67$
bending (unbraced, $L_p < L_b$ and $L_b > L_r$ )	$\Omega = 1.67$ (nominal moment reduces)
shear (beams)	$\Omega = 1.5 \text{ or } 1.67$
shear (bolts)	$\Omega = 2.00$ (tabular nominal strength)
shear (welds)	$\Omega = 2.00$

- L<sub>b</sub> is the unbraced length between bracing points, laterally

- L<sub>p</sub> is the limiting laterally unbraced length for the limit state of yielding
- $L_r$  is the limiting laterally unbraced length for the limit state of inelastic lateral-torsional buckling

<u>LRFD</u>

 $R_{u} \leq \phi R_{n} \qquad \text{where} \cdots R_{u} = \Sigma \gamma_{i} R_{i}$ where  $\phi = \text{resistance factor}$   $\gamma = \text{load factor for the type of load}$  R = load (dead or live; force, moment or stress)  $R_{u} = \text{factored load (moment or stress)}$   $R_{n} = \text{nominal load (ultimate capacity; force, moment or stress)}$ 

#### Nominal strength is defined as the

capacity of a structure or component to resist the effects of loads, as determined by computations using specified material strengths (such as yield strength,  $F_y$ , or ultimate strength,  $F_u$ ) and dimensions and formulas derived from accepted principles of structural mechanics or by field tests or laboratory tests of scaled models, allowing for modeling effects and differences between laboratory and field conditions

#### Note Set 18

#### F2013abn

## Factored Load Combinations

The design strength,  $\phi R_n$ , of each structural element or structural assembly must equal or exceed the design strength based on the ASCE-7 (2010) combinations of factored nominal loads:

 $\begin{array}{l} 1.4D \\ 1.2D + 1.6L + 0.5(L_r \ or \ S \ or \ R) \\ 1.2D + 1.6(L_r \ or \ S \ or \ R) + (L \ or \ 0.5W) \\ 1.2D + 1.0W + L + 0.5(L_r \ or \ S \ or \ R) \\ 1.2D + 1.0E + L + 0.2S \\ 0.9D + 1.0W \\ 0.9D + 1.0E \end{array}$ 

## **Criteria for Design of Beams**

Allowable normal stress or normal stress from LRFD should not be exceeded:

$$F_{b} \text{ or } \phi F_{n} \geq f_{b} = \frac{Mc}{I}$$

$$(M_{a} \leq M_{n} / \Omega \text{ or } M_{u} \leq \phi_{b} M_{n})$$

$$S_{req'd} \geq \frac{M}{F_{b}}$$

Knowing M and F<sub>b</sub>, the minimum section modulus fitting the limit is:

#### Determining Maximum Bending Moment

Drawing V and M diagrams will show us the maximum values for design. Remember:

$$V = \Sigma(-w)dx$$
  

$$M = \Sigma(V)dx$$
  

$$\frac{dV}{dx} = -w$$
  

$$\frac{dM}{dx} = V$$

#### Determining Maximum Bending Stress

For a prismatic member (constant cross section), the maximum normal stress will occur at the maximum moment.

For a non-prismatic member, the stress varies with the cross section AND the moment.

#### Deflections

If the bending moment changes, M(x) across a beam of constant material and cross  $\frac{1}{R} = \frac{M(x)}{EI}$ 

The slope of the n.a. of a beam,  $\theta$ , will be tangent to the radius of curvature, R:

$$y = \frac{1}{EI} \int \theta dx = \frac{1}{EI} \iint M(x) dx$$

 $\theta = slope = \frac{1}{FI} \int M(x) dx$ 

Elastic curve equations can be found in handbooks, textbooks, design manuals, etc...Computer programs can be used as well. Elastic curve equations can be superimposed ONLY if the stresses are in the elastic range.

The deflected shape is roughly the same shape flipped as the bending moment diagram but is constrained by supports and geometry.

## Allowable Deflection Limits

All building codes and design codes limit deflection for beam types and damage that could happen based on service condition and severity.

$$y_{\max}(x) = \Delta_{actual} \le \Delta_{allowable} = \frac{L}{value}$$


Use	LL only	DL+LL
Roof beams:		
Industrial	L/180	L/120
Commercial		
plaster ceiling	L/240	L/180
no plaster	L/360	L/240
Floor beams:		
Ordinary Usage	L/360	L/240
Roof or floor (damageable	e elements)	L/480

#### Lateral Buckling

With compression stresses in the top of a beam, a sudden "popping" or buckling can happen even at low stresses. In order to prevent it, we need to brace it along the top, or laterally brace it, or provide a bigger  $I_y$ .

## Local Buckling in Steel Wide-flange Beams- Web Crippling or Flange Buckling

Concentrated forces on a steel beam can cause the web to buckle (called **web crippling**). Web stiffeners under the beam loads and bearing plates at the supports reduce that tendency. Web stiffeners also prevent the web from shearing in plate girders.

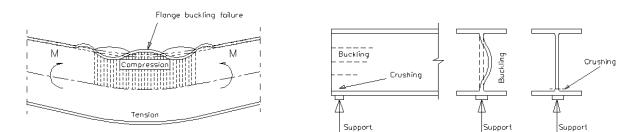


The maximum support load and interior load can be determined from:

$$P_{n(\text{max}-\text{end})} = (2.5k + N)F_{yw}t_w$$

$$P_{n(\text{interior})} = (5k + N)F_{yw}t_w$$
where
$$t_w = \text{thickness of the web}$$

$$F_{yw} = \text{yield strength of the}$$

$$N = \text{bearing length}$$

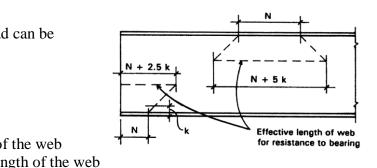

k = dimension to fillet found in beam section tables

$$\phi = 1.00 (LRFD)$$
  $\Omega = 1.50 (ASD)$ 

#### Beam Loads & Load Tracing

In order to determine the loads on a beam (or girder, joist, column, frame, foundation...) we can start at the top of a structure and determine the *tributary area* that a load acts over and the beam needs to support. Loads come from material weights, people, and the environment. This area is assumed to be from half the distance to the next beam over to halfway to the next beam.

The reactions must be supported by the next lower structural element *ad infinitum*, to the ground.

#### LRFD - Bending or Flexure


For determining the flexural design strength,  $\phi_b M_n$ , for resistance to pure bending (no axial load) in most flexural members where the following conditions exist, a single calculation will suffice:


$$\Sigma \gamma_i R_i = M_\mu \leq \phi_b M_\mu = 0.9 F_\nu Z$$

where  $M_u = maximum moment from factored loads$   $\phi_b = resistance factor for bending = 0.9$   $M_n = nominal moment (ultimate capacity)$   $F_y = yield strength of the steel$ Z = plastic section modulus

#### Plastic Section Modulus

Plastic behavior is characterized by a yield point and an increase in strain with no increase in stress.





#### Internal Moments and Plastic Hinges

Plastic hinges can develop when all of the material in a cross section sees the yield stress. Because all the material at that section can strain without any additional load, the member segments on either side of the hinge can rotate, possibly causing instability.


For a rectangular section:

Elastic to 
$$f_y$$
:  $M_y = \frac{I}{c} f_y = \frac{bh^2}{6} f_y = \frac{b(2c)^2}{6} f_y = \frac{2bc^2}{3} f_y$ 

Fully Plastic:

 $M_{ult}$  or  $M_p = bc^2 f_y = \frac{3}{2} M_y$ 

For a non-rectangular section and internal equilibrium at  $\sigma_y$ , the n.a. *will not necessarily be at the centroid*. The n.a. occurs where the A<sub>tension</sub> = A<sub>compression</sub>. The reactions occur at the centroids of the tension and compression areas.





OY

*(b)* 

 $A_{\text{tension}} = A_{\text{compression}}$ 

Instability from Plastic Hinges





#### Shape Factor:

The ratio of the plastic moment to the elastic moment at yield:

$$k = \frac{M_p}{M_y} \qquad \qquad k = 3/2 \text{ for a rectangle} \\ k \approx 1.1 \text{ for an I beam}$$

Plastic Section Modulus

$$Z = \frac{M_p}{f_y} \qquad and \qquad k = \frac{Z}{S}$$

c/2

c/2

 $\mathbf{R}'_p$ 

Design for Shear

 $V_a \leq V_n / \Omega$  or  $V_u \leq \phi_v V_n$ 

The nominal shear strength is dependent on the cross section shape. Case 1: With a thick or stiff web, the shear stress is resisted by the web of a wide flange shape (with the exception of a handful of W's). Case 2: When the web is not stiff for doubly symmetric shapes, singly symmetric shapes (like channels) (excluding round high strength steel shapes), inelastic web buckling occurs. When the web is very slender, elastic web buckling occurs, reducing the capacity even more:

Case 1) For 
$$h/t_{w} \le 2.24 \sqrt{\frac{E}{F_{y}}}$$
  $V_{n} = 0.6F_{yw}A_{w}$   $\phi_{v} = 1.00$  (LRFD)  $\Omega = 1.50$  (ASD)

where *h* equals the clear distance between flanges less the fillet or corner radius for rolled shapes

 $V_n$  = nominal shear strength  $F_{yw}$  = yield strength of the steel in the web  $A_w = t_w d$  = area of the web

Case 2) For 
$$h/t_w > 2.24 \sqrt{\frac{E}{F_y}}$$
  $V_n = 0.6F_{yw}A_wC_v$   $\phi_v = 0.9$  (LRFD)  $\Omega = 1.67$  (ASD)

where  $C_v$  is a reduction factor (1.0 or less by equation)

Design for Flexure

$$M_a \le M_n / \Omega$$
 or  $M_u \le \phi_b M_n$   $\phi_b = 0.90 (LRFD)$   $\Omega = 1.67 (ASD)$ 

The nominal flexural strength M<sub>n</sub> is the *lowest* value obtained according to the limit states of

- 1. yielding, limited at length  $L_p = 1.76r_y \sqrt{\frac{E}{F_y}}$ , where  $r_y$  is the radius of gyration in y
- 2. lateral-torsional buckling limited at length  $L_r$
- 3. flange local buckling
- 4. web local buckling

Beam design charts show available moment,  $M_n/\Omega$  and  $\phi_b M_n$ , for unbraced length,  $L_b$ , of the compression flange in one-foot increments from 1 to 50 ft. for values of the bending coefficient  $C_b = 1$ . For values of  $1 < C_b \le 2.3$ , the required flexural strength  $M_u$  can be reduced by dividing it by  $C_b$ . ( $C_b = 1$  when the bending moment at any point within an unbraced length is larger than that at both ends of the length.  $C_b$  of 1 is conservative and permitted to be used in any case. When the free end is unbraced in a cantilever or overhang,  $C_b = 1$ . The full formula is provided below.)

*NOTE:* the self weight <u>is not</u> included in determination of  $M_n/\Omega \phi_b M_n$ 

#### Note Set 18

#### Compact Sections

For a laterally braced *compact* section (one for which the plastic moment can be reached before local buckling) only the limit state of yielding is applicable. For unbraced compact beams and non-compact tees and double angles, only the limit states of yielding and lateral-torsional buckling are applicable.


Compact sections meet the following criteria: 
$$\frac{b_f}{2t_f} \le 0.38 \sqrt{\frac{E}{F_y}}$$
 and  $\frac{h_c}{t_w} \le 3.76 \sqrt{\frac{E}{F_y}}$ 

where:

 $b_f$  = flange width in inches  $t_f$  = flange thickness in inches E = modulus of elasticity in ksi  $F_y$  = minimum yield stress in ksi  $h_c$  = height of the web in inches  $t_w$  = web thickness in inches

With lateral-torsional buckling the nominal flexural strength is

$$M_{n} = C_{b} \left[ M_{p} - (M_{p} - 0.7F_{y}S_{x}) \left( \frac{L_{b} - L_{p}}{L_{r} - L_{p}} \right) \right] \le M_{p}$$



where C<sub>b</sub> is a modification factor for non-uniform moment


diagrams where, when both ends of the beam segment are braced:

$$C_{b} = \frac{12.5M_{max}}{2.5M_{max} + 3M_{A} + 4M_{B} + 3M_{C}}$$

 $M_{max}$  = absolute value of the maximum moment in the unbraced beam segment  $M_A$  = absolute value of the moment at the quarter point of the unbraced beam segment  $M_B$  = absolute value of the moment at the center point of the unbraced beam segment  $M_C$  = absolute value of the moment at the three quarter point of the unbraced beam segment length.

#### Available Flexural Strength Plots

Plots of the available moment for the unbraced length for wide flange sections are useful to find sections to satisfy the design criteria of  $M_a \leq M_n / \Omega$  or  $M_u \leq \phi_b M_n$ . The maximum moment that can be applied on a beam (taking self weight into account),  $M_a$  or  $M_u$ , can be plotted against the unbraced length,  $L_b$ . The limiting length,  $L_p$  (fully plastic), is indicated by a solid dot (•), while the limiting length,  $L_r$  (for lateral torsional buckling), is indicated by an open dot ( $\bigcirc$ ). Solid lines indicate the most economical, while dashed lines indicate there is a lighter section that could be used.  $C_b$ , which is a modification factor for non-zero moments at the ends, is 1 for simply supported beams (0 moments at the ends). (see *figure*)

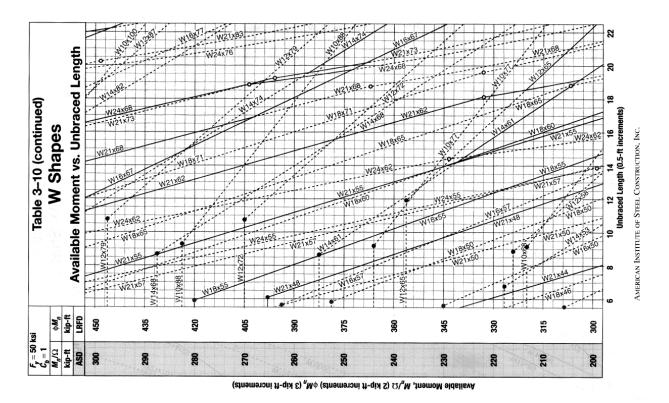

#### Design Procedure

The intent is to find the most light weight member (which is economical) satisfying the section modulus size.

- 1. Determine the unbraced length to choose the limit state (yielding, lateral torsional buckling or more extreme) and the factor of safety and limiting moments. Determine the material.
- 2. Draw V & M, finding V<sub>max</sub> and M<sub>max</sub>.for unfactored loads (ASD,  $V_a \& M_a$ ) or from factored loads (LRFD,  $V_u \& M_u$ )
- 3. Calculate  $Z_{req'd}$  when yielding is the limit state. This step is equivalent to determining if

$$f_b = \frac{M_{max}}{S} \le F_b$$
,  $Z_{req'd} \ge \frac{M_{max}}{F_b} = \frac{M_{max}}{F_y}$  and  $Z_{req'd} \ge \frac{M_u}{\phi_b F_y}$  to meet the design criteria that

$$M_a \leq M_n / \Omega$$
 or  $M_u \leq \phi_b M_n$ 

If the limit state *is something other than yielding*, determine the nominal moment,  $M_n$ , or use plots of available moment to unbraced length,  $L_b$ .

- 4. For steel: use the section charts to find a trial Z and remember that the beam self weight (the second number in the section designation) will increase  $Z_{req'd.}$  The design charts show the lightest section within a grouping of similar Z's.
- \*\*\*\* Determine the "updated"  $V_{max}$  and  $M_{max}$  including the beam self weight, and verify that the updated  $Z_{req'd}$  has been met.\*\*\*\*\*

TABLE 9.1	Load Factor Resi	stance Design	Selection
-----------	------------------	---------------	-----------

			$F_{y} = 3$	6 ksi	
Designation	$Z_{x}$ in. <sup>3</sup>	L <sub>p</sub> ft	L <sub>r</sub> ft	М <sub>р</sub> kip-ft	M, kip-fi
W 33 × 141	514	10.1	30.1	1,542	971
W $30 \times 148$	500	9.50	30.6	1,500	945
W 24 $\times$ 162	468	12.7	45.2	1,404	897
W 24 $\times$ 146	418	12.5	42.0	1,254	804
W 33 × 118	415	9.67	27.8	1,245	778
W $30 \times 124$	408	9.29	28.2	1,224	769
W $21 \times 147$	373	12.3	46.4	1,119	713
W 24 $\times$ 131	370	12.4	39.3	1,110	713
W 18 $\times$ 158	356	11.4	56.5	1,068	672

- 5. Consider lateral stability.
- 6. Evaluate horizontal shear using  $V_{\text{max}}$ . This step is equivalent to determining if  $f_v \leq F_v$  is satisfied to meet the design criteria that  $V_a \leq V_n / \Omega$  or  $V_u \leq \phi_v V_n$

For I beams: 
$$f_{v-\max} = \frac{3V}{2A} \approx \frac{V}{A_{web}} = \frac{V}{t_w d}$$
  $V_n = 0.6F_{yw}A_w$  or  $V_n = 0.6F_{yw}A_wC_v$   
Others:  $f_{v-\max} = \frac{VQ}{Ib}$ 

- 7. Provide adequate bearing area at supports. This step is equivalent to determining if  $f_p = \frac{P}{A} \le F_p$  is satisfied to meet the design criteria that  $P_a \le P_n / \Omega$  or  $P_u \le \phi P_n$
- 8. Evaluate shear due to torsion  $f_{\nu} = \frac{T\rho}{J} \text{ or } \frac{T}{c_1 a b^2} \le F_{\nu}$  (circular section or rectangular)
- 9. Evaluate the deflection to determine if  $\Delta_{maxLL} \leq \Delta_{LL-allowed}$  and/or  $\Delta_{maxTotal} \leq \Delta_{Total allowed}$
- \*\*\*\* note: when  $\Delta_{calculated} > \Delta_{limit}$ ,  $I_{req'd}$  can be found with: and  $Z_{req'd}$  will be satisfied for similar self weight \*\*\*\*\*

# $I_{req'd} \geq \frac{\Delta_{loobig}}{\Delta_{limit}} I_{trial}$

## FOR ANY EVALUATION:

Redesign (with a new section) at any point that a stress or serviceability criteria is NOT satisfied and re-evaluate each condition until it is satisfactory.

#### Load Tables for Uniformly Loaded Joists & Beams

Tables exist for the common loading situation of uniformly distributed load. The tables either provide the safe distributed load based on bending and deflection limits, they give the allowable span for specific live and dead loads including live load deflection limits. If the load is *not uniform*, an *equivalent uniform load* can be calculated  $M_{max} = \frac{W_{equivalent}L^2}{8}$ 

If the deflection limit is less, the design live load to check against allowable must be increased, ex.

## **Criteria for Design of Columns**

If we know the loads, we can select a section that is adequate for strength & buckling.

If we know the length, we can find the limiting load satisfying strength & buckling.

$$w_{adjusted} = w_{ll-have} \left( \frac{L/360}{L/400} \right) table limitwanted$$

$$wanted$$

$$w_{ll-have} \left( \frac{L/360}{L/400} \right) table limitwanted$$

$$w_{ll-have} \left( \frac{L/360}{L/400} \right) table limitwanted$$

$$w_{ll-have} \left( \frac{L/360}{L/400} \right) table limitwanted$$

#### Note Set 18

#### F2013abn

#### Allowable Stress Design


# American Institute of Steel Construction (AISC) Manual of ASD, 9<sup>th</sup> ed:

<u>Long and slender:</u> [  $L_e/r \ge C_c$ , preferably < 200]

$$F_{allowable} = \frac{F_{cr}}{F.S.} = \frac{12\pi^2 E}{23(\frac{Kl}{r})^2}$$

The yield limit is idealized into a parabolic curve that blends into the Euler's Formula at C<sub>c</sub>.

With 
$$F_y = 36$$
 ksi,  $C_c = 126.1$   
With  $F_y = 50$  ksi,  $C_c = 107.0$   
 $C_c = \sqrt{\frac{2\pi^2 E}{F_y}}$ 

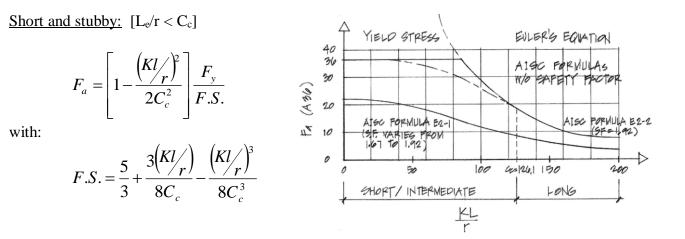

#### Design for Compression

# American Institute of Steel Construction (AISC) Manual 14<sup>th</sup> ed:

$$P_a \leq P_n / \Omega$$
 or  $P_u \leq \phi_c P_n$  where  $P_u = \Sigma \gamma_i P_i$   
 $\gamma$  is a load factor  
P is a load type  
 $\phi$  is a resistance factor  
 $P_n$  is the nominal load capacity (strength)

$$\phi = 0.90 \text{ (LRFD)} \qquad \Omega = 1.67 \text{ (ASD)}$$

For compression  $P_n = F_{cr}A_g$ 

where :  $A_g$  is the cross section area and  $F_{cr}$  is the flexural buckling stress

The flexural buckling stress,  $F_{cr}$ , is determined as follows:

when 
$$\frac{KL}{r} \le 4.71 \sqrt{\frac{E}{F_y}}$$
 or  $(F_e \ge 0.44F_y)$ :  
 $F_{cr} = \left[ 0.658^{\frac{F_y}{F_e}} \right] F_y$   
when  $\frac{KL}{r} > 4.71 \sqrt{\frac{E}{F_y}}$  or  $(F_e < 0.44F_y)$ :  
 $F_{cr} = 0.877F_e$ 

where  $F_e$  is the elastic critical buckling stress:

$$F_e = \frac{\pi^2 E}{\left(\frac{KL}{r}\right)^2}$$

## Design Aids

Tables exist for the value of the flexural buckling stress based on slenderness ratio. In addition, tables are provided in the AISC Manual for Available Strength in Axial Compression based on the effective length with respect to least radius of gyration,  $r_y$ . If the critical effective length is about the largest radius of gyration,  $r_x$ , it can be turned into an effective length about the y axis by dividing by the fraction  $r_x/r_y$ .

) L	- 60 koi		- Ag	Table 4-1 ailable	14 9 9 9	Table 4-1 (continued) Available Strength	nued	2.		┢	
- -	2	4	Axial	0 0	mpress W Shapes	Compression, W Shapes	, no	kips	<i>(</i> )	¥12	
5	Shape					ž	W12×				2
3	WUT	6	96		87	-	62	-	72		65
đ	Decion	$P_n/\Omega_c$	\$cPn	$P_n/\Omega_c$	\$P_n	$P_n/\Omega_c$	\$Pn	$P_n / \Omega_c$	\$cPn	$P_n/\Omega_c$	$\phi_c P_n$
5	- Iĥo	ASD	LRFD	ASD	LRFD	ASD	LRFD	ASD	LRFD	ASD	LRFD
	•	844	1270	766	1150	694	1040	633	951	1/2	859
5	9	811	1220	735	1110	667	1000	607	913	548	824
5 u	~ •	800	1200	725	1090	657	987	598	899	540	811
otter	5 07	772	1160	669	1050	634	952	577	867	520	782
<b>Á</b> 6 ,	9	756	1140	685	1030	620	932	565	849	509	765
to s	F	739	1110	699	1010	909	910	551	828	497	747
nip	5	720	1080	652	980	290	887	537	807	484	727
en i	<u>e</u> :	101	1050	634	953	213	862	522	784	470	206
see	4 ¥	650	0201	615	924	200	800	900	19/	456	C89
1 at	2 4	537	067	275	000		701	24	710	and a	200
108	2 6	100	106	554	833	105	752	415	684	404	615
ds	: @	591	888	233	801	481	723	437	657	393	591
n it	19	567	852	511	769	461	694	419	630	377	566
iw.	8	543	816	490	736	442	664	401	603	360	541
(u)	នដ	495	744	446	670	402	603	365	548	327	491
DN I	\$ 8	44/	2/0	360	541	202	- 944	328	440	582	302
цtв	3 8	356	534	319	479	286	430	259	389	231	347
iəl e	8	312	469	279	420	250	376	226	340	202	303
ovita:	8	274	.412	246	369	220	331	199	299	177	267
hei	म्र	243	365	218	327	195	293	176	265	157	236
9	8	217	326	194	292	174	261	157	236	140	211
	<b>8</b> 9	195	292	157	262	156	234	141	212	126	189
1					Properties	rties					
Thine		197	206	101	181	TOA	167	000	126	78.7	117
ikins.	(u)	18.3	27.5	17.2	25.8	157	235	14.3	215	13.0	195
P <sub>wb</sub> (kips)		296	445	243	366	185	278	142	213	106	159
(kips)			228		185		152		126	68.5	103
€€		- 7	10.9 46.6	- 4	10.8	- 6	10.8 30.0	- 6	10.7	~ ~	11.9
10. 2			0.0	r c	0.0		0.0		1.1		
4g (III. 4)		83 4	20.2 833	740	40.02	99	662	26	597 597	- 23	533
(in. <sup>4</sup> )		27	000	24		21	6	19	5	17	4
Ratio r./			1.76		3.07		3.03		3.04		1.75
(KL2)	Per (KL2)/104 (k-in.2)	23800	00	21200	00	1890	18900 6180	17100	89	15300	00
A	ASD		0	200				200			
-	= 167	-	000 -								

#### Procedure for Analysis

- 1. Calculate KL/r for each axis (if necessary). The largest will govern the buckling load.
- 2. Find F<sub>a</sub> or F<sub>cr</sub> as a function of KL/r from the appropriate equation (above) or table.
- 3. Compute  $P_{allowable} = F_a \cdot A$  or  $P_n = F_{cr} \cdot A_g$ or alternatively compute  $f_c = P/A$  or  $P_u/A$
- 4. Is the design satisfactory?

Is 
$$P \le P_{allowable}$$
 (or  $P_a \le P_n/\Omega$ ) or  $P_u \le \phi_c P_n$ ?  $\Rightarrow$  yes, it is; no, it is no good

or Is 
$$f_c \leq F_a$$
 (or  $\leq F_{cr}/\Omega$ ) or  $\phi_c F_{cr}$ ?  $\Rightarrow$  yes, it is; no, it is no good

#### Procedure for Design

- 1. Guess a size by picking a section.
- 2. Calculate KL/r for each axis (if necessary). The largest will govern the buckling load.
- 3. Find  $F_a$  or  $F_{cr}$  as a function of KL/r from appropriate equation (above) or table.
- 4. Compute  $P_{allowable} = F_a \cdot A$  or  $P_n = F_{cr} \cdot A_g$ or alternatively compute  $f_c = P/A$  or  $P_u/A$
- 5. Is the design satisfactory?
  - Is  $P \le P_{allowable}$  ( $P_a \le P_n/\Omega$ ) or  $P_u \le \phi_c P_n$ ? yes, it is; no, pick a bigger section and go back to step 2.
  - Is  $f_c \leq F_a$  ( $\leq F_{cr}/\Omega$ ) or  $\phi_c F_{cr}$ ?  $\Rightarrow$  yes, it is; *no*, *pick a bigger section and go back to step 2*.
- 6. Check design efficiency by calculating percentage of stress used:=

$$\frac{P}{P_{allowable}} \cdot 100\% \left( \frac{P_a}{P_n/\Omega} \cdot 100\% \right) or \frac{P_u}{\phi_c P_n} \cdot 100\%$$

If value is between 90-100%, it is efficient.

If values is less than 90%, pick a smaller section and go back to step 2.

#### Columns with Bending (Beam-Columns)

In order to *design* an adequate section for allowable stress, we have to start somewhere:

- 1. Make assumptions about the limiting stress from:
  - buckling
  - axial stress
  - combined stress
- 2. See if we can find values for  $\underline{r}$  or  $\underline{A}$  or  $\underline{Z}$
- 3. Pick a trial section based on if we think r or A is going to govern the section size.

- 4. Analyze the stresses and compare to allowable using the allowable stress method or interaction formula for eccentric columns.
- 5. Did the section pass the stress test?
  - If not, do you *increase* r or A or Z?
  - If so, is the difference really big so that you could *decrease* r or A or Z to make it more efficient (economical)?
- 6. Change the section choice and go back to step 4. Repeat until the section meets the stress criteria.

## Design for Combined Compression and Flexure:

The interaction of compression and bending are included in the form for two conditions based on the size of the required axial force to the available axial strength. This is notated as  $P_r$  (either P from ASD or P<sub>u</sub> from LRFD) for the axial force being supported, and  $P_c$  (either  $P_n/\Omega$  for ASD or  $\phi_c P_n$  for LRFD). The increased bending moment due to the P- $\Delta$  effect must be determined and used as the moment to resist.

For 
$$\frac{P_r}{P_c} \ge 0.2$$
:  $\frac{P}{P_n/\Omega} + \frac{8}{9} \left( \frac{M_x}{M_{nx}/\Omega} + \frac{M_y}{M_{ny}/\Omega} \right) \le 1.0 \quad \frac{P_u}{\phi_c P_n} + \frac{8}{9} \left( \frac{M_{ux}}{\phi_b M_{nx}} + \frac{M_{uy}}{\phi_b M_{ny}} \right) \le 1.0$ 

(LRFD)

For 
$$\frac{P_r}{P_c} < 0.2$$
:  $\frac{P}{2P_n/\Omega} + \left(\frac{M_x}{M_{nx}/\Omega} + \frac{M_y}{M_{ny}/\Omega}\right) \le 1.0$   $\frac{P_u}{2\phi_c P_n} + \left(\frac{M_{ux}}{\phi_b M_{nx}} + \frac{M_{uy}}{\phi_b M_{ny}}\right) \le 1.0$   
(ASD) (LRFD)

where:

•••		
for compression	$\phi_{\rm c} = 0.90 \; (LRFD)$	$\Omega = 1.67 \text{ (ASD)}$
for bending	$\phi_{\rm b} = 0.90 \; (LRFD)$	$\Omega = 1.67 (ASD)$

For a <u>braced</u> condition, the moment magnification factor  $B_I$  is determined by

$$B_1 = \frac{C_m}{1 - (P_u/P_{e_1})} \ge 1.0$$

where  $C_m$  is a modification factor accounting for end conditions

- When not subject to transverse loading between supports in plane of bending:
  - = 0.6 0.4 (M<sub>1</sub>/M<sub>2</sub>) where M<sub>1</sub> and M<sub>2</sub> are the end moments and M<sub>1</sub><M<sub>2</sub>. M<sub>1</sub>/M<sub>2</sub> is positive when the member is bent in reverse curvature (same direction), negative when bent in single curvature.

When there is transverse loading between the two ends of a member:

- = 0.85, members with restrained (fixed) ends
- = 1.00, members with unrestrained ends


Pe1 =Euler buckling strength

$$P_{e1} = \frac{\pi^2 EA}{\left(\frac{Kl}{r}\right)^2}$$

#### **Criteria for Design of Connections**

Connections must be able to transfer any axial force, shear, or moment from member to member or from beam to column.

Connections for steel are typically high strength bolts and electric arc welds. Recommended practice for ease of construction is to specified *shop welding* and *field bolting*.

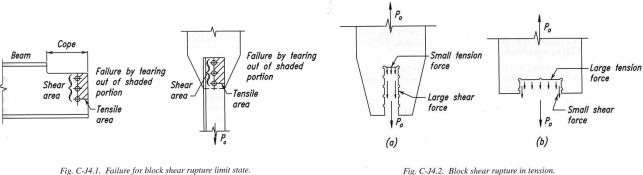

#### Bolted and Welded Connections

The limit state for connections depends on the loads:

- 1. tension yielding
- 2. shear yielding
- 3. bearing yielding
- 4. bending yielding due to eccentric loads
- 5. rupture

Welds must resist shear stress. The design strengths depend on the weld materials.

#### Bolted Connection Design

Bolt designations signify material and type of connection where

SC: slip critical


N: bearing-type connection with bolt threads *included* in shear plane

X: bearing-type connection with bolt threads excluded from shear plane


A307: similar in strength to A36 steel (also known as ordinary, common or unfinished bolts)

A325: high strength bolts (Group A)

A490: high strength bolts (higher than A325) (Group B)





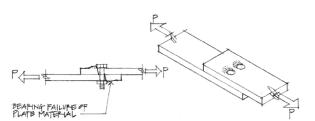

- Bearing-type connection: no frictional resistance in the contact surfaces is assumed and slip between members occurs as the load is applied. (Load transfer through bolt only).
- Slip-critical connections: bolts are torqued to a high tensile stress in the shank, resulting in a clamping force on the connected parts. (Shear resisted by clamping force). Requires inspections and is useful for structures seeing dynamic or fatigue loading. Class A indicates the *faying* (contact) surfaces are clean mill scale or adequate paint system, while Class B indicates blast cleaning or paint for  $\mu = 0.50$ .

Bolts rarely fail in **bearing**. The material with the hole will more likely yield first.

For the determination of the net area of a bolt hole the width is taken as 1/16 "greater than the nominal dimension of the hole. Standard diameters for bolt holes are 1/16" larger than the bolt diameter. (This means the net width will be 1/8" larger than the bolt.)

#### Design for Bolts in Bearing, Shear and Tension

Available shear values are given by bolt type, diameter, and loading (Single or Double shear) in AISC manual tables. Available shear value for slip-critical connections are given for limit states of serviceability or strength by bolt type, hole type (standard, short-slotted, long-slotted or oversized), diameter, and loading. Available tension values are given by bolt type and diameter in AISC manual tables.

Available bearing force values are given by bolt diameter, ultimate tensile strength,  $F_u$ , of the connected part, and thickness of the connected part in AISC manual tables.

For shear OR tension (same equation) in bolts:

 $R_a \le R_n / \Omega$  or  $R_u \le \phi R_n$ where  $R_u = \Sigma \gamma_i R_i$ 

- single shear (or tension)  $R_n = F_n A_b$
- double shear  $R_n = F_n 2A_b$

where  $\phi =$  the resistance factor

 $F_n$  = the nominal tension or shear strength of the bolt  $A_b$  = the cross section area of the bolt

 $\phi = 0.75 \text{ (LRFD)} \qquad \Omega = 2.00 \text{ (ASD)}$ 

For bearing of plate material at bolt holes:

$$R_a \leq R_n / \Omega \text{ or } R_u \leq \phi R_i$$
  
where  $R_u = \Sigma \gamma_i R_i$ 

• deformation at bolt hole is a concern

$$R_n = 1.2L_c tF_u \le 2.4 dtF_u$$

• deformation at bolt hole is not a concern

$$R_n = 1.5L_c tF_u \leq 3.0 dtF_u$$

• long slotted holes with the slot perpendicular to the load

$$R_n = 1.0L_c t F_u \le 2.0 dt F_u$$





Figure 10.11 End tear-out.

where	$R_n$ = the nominal bearing strength
	$F_u$ = specified minimum tensile strength
	$L_c =$ clear distance between the edges of the hole and the next hole or edge in
	the direction of the load
	d = nominal bolt diameter
	t = thickness of connected material
φ	$= 0.75 (LRFD)$ $\Omega = 2.00 (ASD)$

The *minimum* edge desistance from the center of the outer most bolt to the edge of a member is generally 1<sup>3</sup>/<sub>4</sub> times the bolt diameter for the sheared edge and 1<sup>1</sup>/<sub>4</sub> times the bolt diameter for the rolled or gas cut edges.

The maximum edge distance should not exceed 12 times the thickness of thinner member or 6 in.

Standard bolt hole spacing is 3 in. with the minimum spacing of  $2\frac{2}{3}$  times the diameter of the bolt,  $d_b$ . Common edge distance from the center of last hole to the edge is  $1\frac{1}{4}$  in..

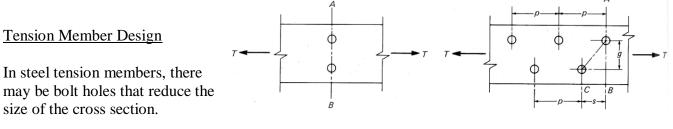

g refers to the row spacing or gage

p refers to the bolt spacing or pitch


s refers to the longitudinal spacing of two consecutive holes

## Effective Net Area:

The smallest effective are must be determined by subtracting the bolt hole areas. With staggered holes, the shortest length must be evaluated.

A series of bolts can also transfer a portion of the tensile force, and some of the effective net areas see reduced stress.

The effective net area,  $A_e$ , is determined from the net area,  $A_n$ , multiplied by a shear lag factor, U, which depends on the element type and connection configuration. If a portion of a connected member is not fully connected (like the leg of an angle), the unconnected part is not subject to the full stress and the shear lag factor can range from 0.6 to 1.0:  $A_e = A_n U$ 

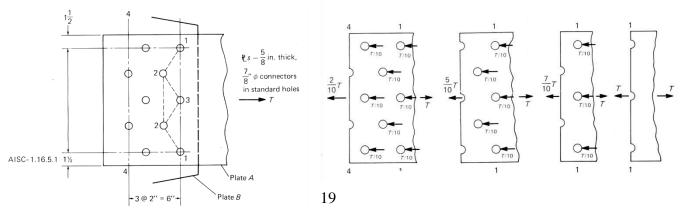

Т

The staggered hole path area is determined by: T

$$A_n = A_g - A_{of all holes} + t\Sigma \frac{s^2}{4g}$$

where t is the plate thickness, s is each stagger spacing, and g is the gage spacing.

#### For tension elements:

$$R_a \le R_n / \Omega$$
 or  $R_u \le \phi R$   
where  $R_u = \Sigma \gamma_i R_i$ 

1. yielding  $R_n = F_y A_g$ 

$$\phi = 0.90 (LRFD)$$
  $\Omega = 1.67 (ASD)$ 

- 2. rupture  $R_n = F_u A_e$  $\phi = 0.75 \text{ (LRFD)} \quad \Omega = 2.00 \text{ (ASD)}$ 
  - where  $A_g =$  the gross area of the member (excluding holes)  $A_e =$  the effective net area (with holes, etc.)  $F_y =$  the yield strength of the steel  $F_u =$  the tensile strength of the steel (ultimate)

#### Welded Connections


Weld designations include the strength in the name, i.e. E70XX has Fy = 70 ksi. Welds are weakest in shear and are assumed to always fail in the shear mode.


The throat size, T, of a fillet weld is determined trigonometry by:  $T = 0.707 \times weld size^*$ \* When the submerged arc weld process is used, welds over 3/8" will have a throat thickness of 0.11 in. larger than the formula.

Weld sizes are limited by the size of the parts being put together and are given in AISC manual table J2.4 along with the allowable strength per length of fillet weld, referred to as *S*.

The *maximum* size of a fillet weld:

- a) can't be greater than the material thickness if it is <sup>1</sup>/<sub>4</sub>" or less
- b) is permitted to be 1/16" less than the thickness of the material if it is over 1/4"

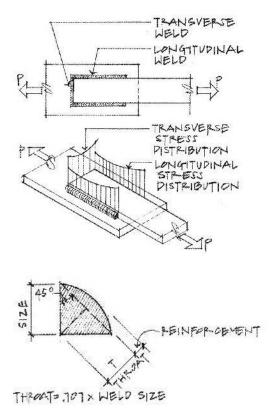



The *minimum length* of a fillet weld is 4 times the nominal size. If it is not, then the weld size used for design is <sup>1</sup>/<sub>4</sub> the length. TABLE J2.4

Intermittent fillet welds cannot be less than four times the weld size, not to be less than  $1 \frac{1}{2}$ ".

Material Thickness of Thicker Part Joined (in.)	Minimum Size of Fillet Weld <sup>a</sup> (in.)
To 1/4 inclusive	1/8
Over 1/4 to 1/2	3/16
Over 1/2 to 3/4	1/4
Over <sup>3</sup> / <sub>4</sub>	5/16

American Institute of Steel Construction

<u>For fillet welds:</u>	$R_a \leq R_n / \Omega$ or $R_u \leq \phi R_n$
	where $R_u = \Sigma \gamma_i R_i$

for the weld metal:  $R_n = 0.6F_{EXX}Tl = Sl$  $\phi = 0.75$  (LRFD)  $\Omega = 2.00$  (ASD)

where:

T is throat thickness l is length of the weld

*For a connected part*, the other limit states for the base metal, such as tension yield, tension rupture, shear yield, or shear rupture **must** be considered.

Available	Strength of Fil	let Welds
per	inch of weld (	$\phi S$ )
Weld Size	E60XX	E70XX
(in.)	(k/in.)	(k/in.)
3/16	3.58	4.18
1⁄4	4.77	5.57
5/16	5.97	6.96
$\frac{3}{8}$	7.16	8.35
7/16	8.35	9.74
1/2	9.55	11.14
5/8	11.93	13.92
3⁄4	14.32	16.70

(not considering increase in throat with submerged arc weld process)

GIPDER BEAM


#### Framed Beam Connections

*Coping* is the term for cutting away part of the flange to connect a beam to another beam using welded or bolted angles.

AISC provides tables that give bolt and angle available strength knowing number of bolts, bolt type, bolt diameter, angle leg thickness, hole type and coping, *and* the wide flange beam being connected. For the connections the limit-state of bolt shear, bolts bearing on the angles, shear yielding of the angles, shear rupture of the angles, and block shear rupture of the angles, and bolt bearing on the beam web are considered.

Group A bolts include A325, while Group B includes A490.

There are also tables for bolted/welded double-angle connections and all-welded double-angle connections.

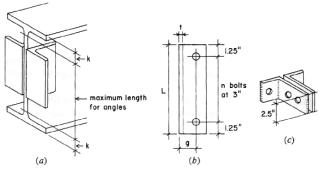

-29 	= 65 ksi	Ð	Ā	ň	olte	All-Bolted Double-Angle	õ	Iqn	e-1	Ang	le	6 KSI	°∕4-in.	Ë.
u≿ əj6u	1				ŏ	Connections	ec	tio	ns	)			Bolts	ts
1A 13	= 58 ksi	5	ngth, k	016.01	B	Bolt and Angle Available Strength, kips	Angle	Availab	le Stre	ngth, k	sdi	0 X82		
4	4 Rows		Ê	And And	3	4	ste		An	Angle Thickness, in.	ckness	'n.	S NOVE	
		Group		Cond.	22	and L	08	1/4	19	5/16	- 122	3/8	A LUA	1/2
WZ4	W24, 21, 18, 16	024	ŝ.	112.4	1981	02.4	ASD	ASD LRFD	ASD		1.170		ASD	ASD LRFD
				z>	s s	ers e	67.1	101	83.9	126	95.5	143	95.5	143
							1.10	101		071		-	120	-1
		2		sc	s c	SID	50.6	6.0'	10.00	6.61	1.1.2	6.0'	50.6	
	-	Group		Class A	> v	SNIT	50.6 50.6	75.9	43.1 50.6	75.9	43.1 50.6		43.1 F0.6	75.0
ŀ	1	4		83 3	5 0	STD	67.1	101	1.11	126			84.4	-
	•		S	SC	0.0	SNO	653	97.9	2112	108	19		119	
j		33	Cla	Class B	o So	SSLT	65.8	98.7	1.1.1.1	123	84.4		84.4	
1	8			z	S	STD	67.1	101	83.9	126	101	151	120	
4.				×	ŝ	STD	67.1	101	101.0	126	-	-	-	201
	~		Ű	J	ŝ	STD	63.3	94.9	12011	94.9			1	94.9
-		Group		Class A	0	SNO	53.9	80.7		80.7	1943		53.9	
		m			Si Si	SSLT	63.3	94.9		94.9	-	_	63.3	94.9
			S	sc	ν c		1./9	101	19252	971	101		105	
			Clay	Class B	⊃ v	SUL	00.3	21.90	0.10	122	68.80	40 1 AB	89.9	158
		Be	am We	b Avail	able S	Beam Web Available Strendth Der Inch Thickness. kins/in-	Der In	ch Thic	kness.	kins/in		-	8	3
	1122			S	STD	•		6	SNO			SSLT	1	
	Hole Type			196				Leh	Leh*, in.					
	12		2	11/2	1	13/4	Ľ	11/2		13/4	Ē	11/2	1	13/4
	70% III.		ASD	LRFD	ASD	LRFD	ASD	LRFD	ASI	LRFD	ASD	LRFD	ASD	LRFD
	187 130	11/4	167	250	175	262	156	234	1000	246	164	245	172	257
		13/8	169	254	111	266	158	238	167	250	166	249	174	261
Cope	Coped at Top	11/2	171	257	180	269	161	241	169	254	168	253	177	265
Flan	Flange Only	15/8	174	261	182	273	163	245	171	257	171	256	179	268
		2	181	272	189	284	17	256	179	268	178	267	186	279
	S34   100	•	201	301	209	313	190	285	198	297	198	296	206	309
		11/4	156	234	156	234	146	219	146	219	156	234	156	234
		1 <sup>3/8</sup>	191	241	191	241	151	122	151	177	191	241	161	241
a oo	Coped at Both	11/2	166	249	166	249	156	234	156	234	166	249	166	249
Ï	Hanges	15/8	4	256	4	256	161	241	161	241	4	256	171	256
		2	181	272	185	278	4	256	176	263	178	267	185	278
	100	e	201	301	209	313	190	285	198	297	198	296	206	309
	Uncoped	SVE.	234	351	234	351	234	351	234	351	234	351	234	351
ding '	Support Available	e	Notes:	lotes: CTD - Standard holes	d holae				M - Th	onde inc	- 			
<u> </u>	surengur per Inch Thickness, kips/in.		OVS = 1	Oversiz Short-sl	Oversized holes Short-slotted holes to direction of load	Oversized holes Short-slotted holes to direction of load	sverse		X = Th SC = SII	X = Threads excluded SC = Slip critical	cluded			
Hole	<u></u>	LRFD	* Tabul	ated valu	les inclu	Ide 1/4-in	. reducti	on in en	d distanc	ce, Leh, to	0 accou	Tabulated values include <sup>1</sup> /4-in. reduction in end distance, Lev. to account for possible	ssible	Stoff Stoff
STD/	884	702	Note: S been a	underrun in beam length. ote: Slip-critical bolt value een added to distribute lo	eam len al bolt v Jistribut	gth. alues as: e loads ir	sume no n the fills	more th ers.	an one 1	iller has	been pr	underrun in beam length. Nue: Silo-critical but values assume no more than one filler has been provided or bolts have been added to distribute hads in the fillers.	r bolts h	ave
S														


#### Sample AISC Table for Bolt and Angle Available Strength in All-Bolted Double-Angle Connections

#### Limiting Strength or Stability States

In addition to resisting shear and tension in bolts and shear in welds, the connected materials may be subjected to shear, bearing, tension, flexure and even prying action. Coping can significantly reduce design strengths and may require web reinforcement. All the following must be considered:

- shear yielding
- shear rupture
- block shear rupture failure of a block at a beam as a result of shear and tension
- tension yielding
- tension rupture
- local web buckling
- lateral torsional buckling

Block Shear Strength (or Rupture):

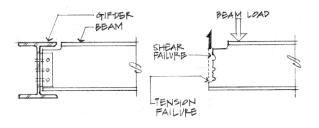

 $R_a \le R_n / \Omega$  or  $R_u \le \phi R_n$ where  $R_u = \Sigma \gamma_i R_i$ 

$$R_{n} = 0.6F_{u}A_{nv} + U_{bs}F_{u}A_{nt} \le 0.6F_{y}A_{gv} + U_{bs}F_{u}A_{nt}$$
  
$$\phi = 0.75 \text{ (LRFD)} \qquad \Omega = 2.00 \text{ (ASD)}$$

where:

 $A_{nv}$  is the net area subjected to shear  $A_{nt}$  is the net area subjected to tension  $A_{gv}$  is the gross area subjected to shear  $U_{bs} = 1.0$  when the tensile stress is uniform (most cases) = 0.5 when the tensile stress is non-uniform

#### Gusset Plates

Gusset plates are used for truss member connections where the geometry prevents the members from coming together at the joint "point". Members being joined are typically double angles.

#### Decking

Shaped, thin sheet-steel panels that span several joists or evenly spaced support behave as continuous beams. Design tables consider a "1 unit" wide strip across the supports and determine maximum bending moment and deflections in order to provide allowable loads depending on the depth of the material.

The other structural use of decking is to construct what is called a *diaphragm*, which is a horizontal unit tying the decking to the joists that resists forces parallel to the surface of the diaphragm.

When decking supports a concrete topping or floor, the steel-concrete construction is called *composite*.


#### Frame Columns


Because joints can rotate in frames, the effective length of the column in a frame is harder to determine. The stiffness (EI/L) of each member in a joint determines how rigid or flexible it is. To find k, the relative stiffness, G or  $\Psi$ , must be found for both ends, plotted on the alignment charts, and connected by a line for braced and unbraced fames.

$$G = \Psi = \frac{\Sigma \frac{EI}{l_c}}{\Sigma \frac{EI}{l_b}}$$

where

- E = modulus of elasticity for a member
- I = moment of inertia of for a member
- $l_{\rm c}$  = length of the column from center to center
- $l_{\rm b}$  = length of the beam from center to center
- For pinned connections we typically use a value of 10 for  $\Psi$ .
- For fixed connections we typically use a value of 1 for  $\Psi$ .



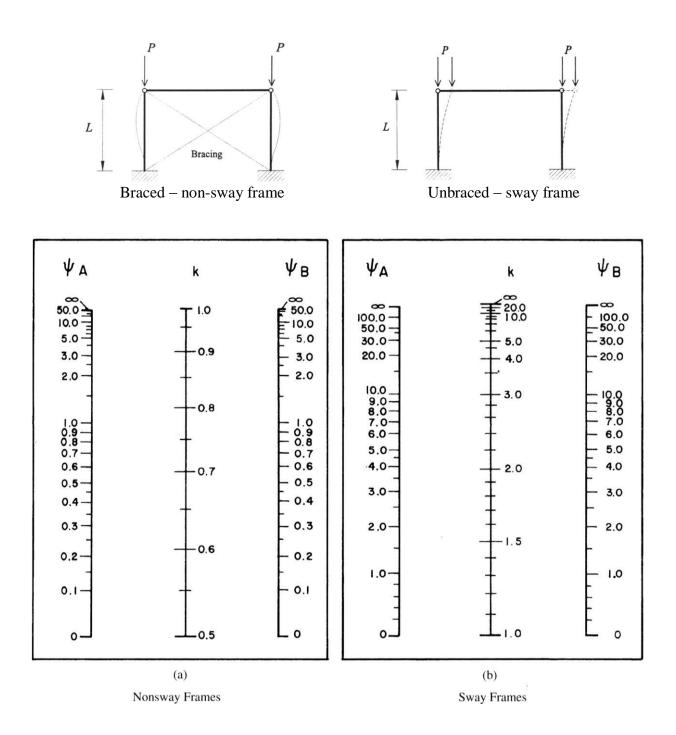



Example 1 (pg 330) \*Hypothetically determine the size of section required when the deflection criteria is NOT met


#### Example Problem 9.16 (Figures 9.76 to 9.78)

A steel beam (A572/50) is loaded as shown. Assuming a deflection requirement of  $\Delta_{\text{total}} = L/240$  and a depth restriction of 18" nominal, select the most economical section. (unified ASD)

 $F_b = 30$  ksi;  $F_v = 20$  ksi;  $E = 30 \times 10^3$  ksi  $F_y = 50$  ksi








#### Example 2 Given:

Select an ASTM A992 W-shape beam with a simple span of 35 feet. Limit the member to a maximum nominal depth of 18 in. Limit the live load deflection to L/360. The nominal loads are a uniform dead load of 0.45 kip/ft and a uniform live load of 0.75 kip/ft. Assume the beam is continuously braced. Use ASD of the Unified Design method.



Beam Loading & Bracing Diagram (full lateral support)

#### Solution:

#### **Material Properties:**

ASTM A992  $F_y = 50 \text{ ksi}$   $F_u = 65 \text{ ksi}$ 

1. The unbraced length is 0 because it says it is fully braced.

2. Find the maximum shear and moment from unfactored loads:

V<sub>a</sub> = 1.20 k/ft(35 ft)/2 = 21 k

M<sub>a</sub> = 1.20 k/ft(35 ft)<sup>2</sup>/8 = 184 k-ft

If  $M_a \le M_n/\Omega$ , the maxmimum moment for design is  $M_a\Omega$ :  $M_{max} = 184$  k-ft

3. Find Zreq'd:

$$Z_{req'd} \ge M_{max}/F_b = M_{max}(\Omega)/F_y = 184 \text{ k-ft}(1.67)(12 \text{ in/ft})/50 \text{ ksi} = 73.75 \text{ in}^3 (F_y \text{ is the limit stress when fully braced})$$

4. Choose a trial section, and also limit the depth to 18 in as instructed:

W18 x 40 has a plastic section modulus of 78.4 in<sup>3</sup> and is the most light weight (as indicated by the bold text) in Table 9.1

w<sub>a</sub> = 0.450 k/ft + 0.750 k/ft = 1.20 k/ft

```
Include the self weight in the maximum values:

w^*_{a-adjusted} = 1.20 \text{ k/ft} + 0.04 \text{ k/ft}
V^*_{a-adjusted} = 1.24 \text{ k/ft}(35 \text{ ft})/2 = 21.7 \text{ k}
M^*_{a-adjusted} = 1.24 \text{ k/ft}(35 \text{ ft})^3/8 = 189.9 \text{ k}
```

 $Z_{reg'd} \ge 189.9 \text{ k-ft}(1.67)(12 \text{ in/ft})/50 \text{ ksi} = 76.11 \text{ in}^3$  And the Z we have (78.4) is larger than the Z we need (76.11), so OK.

6. Evaluate shear (is  $V_a \le V_n/\Omega$ ): A<sub>w</sub> = dt<sub>w</sub> so look up section properties for W18 x 40: d = 17.90 in and t<sub>w</sub> = 0.315 in

 $V_n/\Omega = 0.6F_{yw}A_w/\Omega = 0.6(50 \text{ ksi})(17.90 \text{ in})(0.315 \text{ in})/1.5 = 112.8 \text{ k which is much larger than } 21.7 \text{ k, so OK}.$ 

9. Evaluate the deflection with respect to the limit stated of L/360 for the live load. (If we knew the **total** load limit we would check that as well). The moment of inertia for the W18 x 40 is needed. I<sub>x</sub> = 612 in<sup>4</sup>

 $\Delta$  live load limit = 35 ft(12 in/ft)/360 = 1.17 in

 $\Delta = 5wL^4/384EI = 5(0.75 \text{ k/ft})(35 \text{ ft})^4(12 \text{ in/ft})^3/384(29 \text{ x } 10^3 \text{ ksi})(612 \text{ in}^4) = 1.42 \text{ in!}$  This is TOO BIG (not less than the limit.


Find the moment of inertia needed:


 $I_{req'd} \ge \Delta_{too big} (I_{trial}) / \Delta_{limit} = 1.42 in(612 in^4) / (1.17 in) = 742.8 in^4$ 

From Table 9.1, a W16 x 45 is larger (by Z), but not the most light weight (efficient), as is W10 x 68, W14 x 53, W18 x 46, (W21 x 44 is too deep) and W18 x 50 is bolded (efficient). (Now look up I's). (In order:  $I_x = 586$ , 394, 541, 712 and 800 in<sup>4</sup>)

Choose a W18 x 50

For the same beam and loading of Example 1, select the most economical beam using Load and Resistance Factor Design (LRFD) with the 18" depth restriction. Assume the distributed load is dead load, and the point load is live load.  $F_y = 50$  ksi and  $E = 30 \times 10^3$  ksi





1. To find V<sub>u-max</sub> and M<sub>u-max</sub>, factor the loads, construct a *new* load diagram, shear diagram and bending moment diagram.

2. To satisfy 
$$M_u \le \phi_b M_{n_s}$$
 we find  $M_n = \frac{M_u}{\phi_b} = \frac{341.6^{k-ft}}{0.9} = 379.6^{k-ft}$  and

solve for Z needed: 
$$Z = \frac{M_n}{F_y} = \frac{379.6^{k-ft} (12 \frac{in}{ft})}{50 ksi} = 91.1 in^3$$

Choose a *trial* section from the <u>Listing of W Shapes in Descending Order</u> of Z by selecting the **bold** section at the top of the grouping satisfying our Z and depth requirement – W18 x 50 is the *lightest* with Z = 101 in<sup>3</sup>. (W22 x 44 is the lightest without the depth requirement.) Include the additional self weight (dead load) and find the maximum shear and bending moment:

$$V_{u-adjusted}^{*} = 32.8k + \frac{1.2(50^{lb}/f_{ft})28ft}{2(1000^{lb}/k)} = 33.64k$$

$$M_{u-adjusted}^{*} = 341.6^{k-ft} + \frac{1.2(50^{lb}/f_{ft})(28ft)^{2}}{8(1000^{lb}/k)} = 347.5^{k-ft}$$

$$Z_{req'd}^{*} \ge \frac{M_{u}}{\phi_{b}F_{y}} = \frac{347.5^{k-ft}(12^{in}/f_{ft})}{0.9(50ksi)} = 92.7in^{3}, \text{ so Z (have) of 101 in^{3} is greater than the Z (needed).}$$

3. Check the shear capacity to satisfy  $V_u \le \phi_v V_n$ :  $A_{web} = dt_w$  and d=17.99 in.,  $t_w = 0.355$  in. for the W18x50

$$\phi_v V_n = \phi_v 0.6 F_{yw} A_w = 1.0(0.6) 50 ksi(17.99 in) 0.355 in = 191.6k$$
 So 33.64k  $\leq$  191.6 k OK


4. Calculate the deflection from the *unfactored* loads, including the self-weight now because it is known, and satisfy the deflection criteria of Δ<sub>LL</sub>≤Δ<sub>LL-limit</sub> and Δ<sub>total</sub>≤Δ<sub>total-limit</sub>. (This is <u>identical</u> to what is done in Example 1.) I<sub>x</sub> =800 in<sup>3</sup> for the W18x50

$$\Delta_{\text{total-limit}}$$
 = L/240 = 1.4 in., say  $\Delta_{\text{LL}}$  = L/360 = 0.93 in

$$\Delta_{total} = \frac{PL^3}{48EI} + \frac{5wL^4}{384EI} = \frac{20k(28ft)^3(12\frac{in}{ft})^3}{48(30x10^3ksi)800in^3} + \frac{5(1.050\frac{k}{ft})(28ft)^4(12\frac{in}{ft})^3}{384(30x10^3ksi)800in^3} = 0.658 + 0.605 = 1.26in$$

So 1.26 in.  $\leq$  1.4 in., and 0.658 in.  $\leq$  0.93 in. <u>OK</u>  $\therefore$  FINAL SELECTION IS W18x50

A steel beam with a 20 ft span is designed to be simply supported at the ends on columns and to carry a floor system made with open-web steel joists at 4 ft on center. The joists span 28 feet and frame into the beam from *one side only* and have a self weight of 8.5 lb/ft. Use A992 (grade 50) steel and select the most economical wide-flange section for the beam with LRFD design. Floor loads are 50 psf LL and 14.5 psf DL.

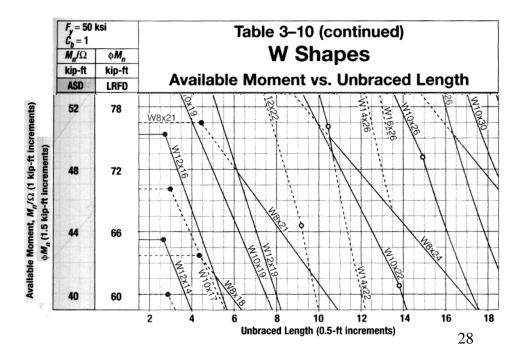

Note Set 18

#### SOLUTION:

To use the Available Moment tables, the maximum moment required is plotted against the unbraced length. The first solid line with capacity or unbraced length *above* what is needed is the most economical.

DESIGN LOADS (load factors applied on figure):

$$M_{u} = \frac{wl^{2}}{2} + Pb = \frac{3.07 \, \text{k/f}(20 \, ft)^{2}}{2} + 4.8k(10 \, ft) = 662^{k-ft} \quad V_{u} = wl + P = 3.07 \, \text{k/f}(20 \, ft) + 4.8k = 66.2k$$

Plotting 662 k-ft vs. 10 ft lands just on the capacity of the W21x83, but it is dashed (and not the most economical) AND we need to consider the contribution of self weight to the total moment. Choose a *trial* section of W24 x 76. Include the new dead load:

$$M_{u-adjusted}^{*} = 662^{k-ft} + \frac{1.2(76^{lb}_{ft})(20\,ft)^{2}}{2(1000^{lb}_{k})} 680.2^{k-ft} \qquad V_{u-adjusted}^{*} = 66.2k + 1.2(0.076^{k}_{ft})(20\,ft) = 68.0k$$


<u>Replot</u> 680.2 k-ft vs. 10ft, which lands *above* the capacity of the W21x83. We can't look up because the chart ends, but we can look for that capacity with a longer unbraced length. This leads us to a **W24 x 84** as the most economical. (With the additional self weight of 84 - 76 lb/ft = 8 lb/ft, the increase in the *factored* moment is only 1.92 k-ft; therefore, it is still OK.)


Evaluate the shear capacity:

$$\phi_v V_n = \phi_v 0.6F_{vw} A_w = 1.0(0.6)50 ksi(24.10in)0.47 in = 338.4k$$
 so yes, 68 k  $\leq$  338.4k OK

Evaluate the deflection with respect to the limits of L/240 for live (*unfactored*) load and L/180 for total (*unfactored*) load: L/240 = 1 in. and L/180 = 1.33 in.

$$\Delta_{total} = \frac{Pb^2(3l-b)}{6EI} + \frac{wL^4}{24EI} = \frac{3k(10ft)^2(3\cdot20-10ft)(12\frac{in}{ft})^3}{6(30x10^3\,ksi)2370in^3} + \frac{(2.209^{\frac{k}{ft}})(20ft)^4(12\frac{in}{ft})^3}{24(30x10^3\,ksi)2370in^3} = 0.06 + 0.36 = 0.42in$$

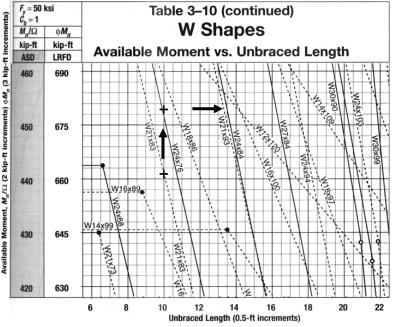



So,  $\Delta_{LL} \leq \Delta_{LL-limit}$  and  $\Delta_{total} \leq \Delta_{total-limit}$ :

(This section is so big to accommodate the large bending moment at the cantilever support that it deflects very little.)

#### ∴ FINAL SELECTION IS W24x84

P = 1.6(3k) = 4.8k10' + w = 1.2(825 lb/ft) + 1.6(1300 lb/ft) = 3.07k/ft

 $<sup>0.06 \</sup>text{ in.} \le 1 \text{ in.}$  and  $0.42 \text{ in.} \le 1.33 \text{ in.}$ 

Select the most economical joist for the 40 ft grid structure with floors and a flat roof. The roof loads are 10 lb/ft<sup>2</sup> dead load and 20 lb/ft<sup>2</sup> live load. The floor loads are 30 lb/ft<sup>2</sup> dead load 100 lb/ft<sup>2</sup> live load. (Live load deflection limit for the roof is L/240, while the floor is L/360). Use the (LRFD) K and LH series charts provided.

	40'	•	40'
	1	0	00
	ļ	Ĭ	
	5′		
	T		
40,			
4			
<u> </u>		۱ <u>ـــــــ</u>	J

Figure 7.218 Framing plan for joists, girders, and columns on 40 ft × 40 ft grid.

			Ba	sed or										TS, K-S nds per			(plf)				
Joist Designation	18K3	18K4	18K5	18K6	18K7	18K9	18K10	20K3	20K4	20K5	20K6	20K7	20K9	20K10	22K4	22K5	22K6	22K7	22K9	22K10	22K1
Depth (In.)	18	18	18	18	18	18	18	20	20	20	20	20	20	20	22	22	22	22	22	22	22
Approx. Wt. (lbs./ft.)	6.6	7.2	7.7	8.5	9	10.2	11.7	6.7	7.6	8.2	8.9	9.3	10.8	12.2	8	8.8	9.2	9.7	11.3	12.6	13.8
Span (ft.)																					
38								211 74	255 87	286 98	312 106	348 118	418 139	496 164	280 107	316 119	345 130	384 144	462 170	549 200	628 228
39								199 69	241 81	271 90	297 98	330 109	397 129	471 151	267 98	300 110	327 120	364 133	438 157	520 185	595 211
40								190 64	229 75	258 84	282 91	313 101	376 119	447 140	253 91	285 102	310 111	346 123	417 146	495 171	565 195
41															241 85	271 95	295 103	330 114	396 135	471 159	538 181
Joist	24	4K4	24K5	24	(6	24K7	24K8	24	(0	24K10	24K1	2 3	26K5	26K6	26K		26K8	26K9			26K12
Designation Depth (In.)		24	24	24		24	24	24		24	24		26	26	26		26	26		26	26
Approx. Wt. (lbs./ft.)		3.4	9.3	9.		10.1	11.5	12		13.1	16.0		9.8	10.6	10.9		12.1	12.2		3.8	16.6
Span (ft.)																					
38		307 28	346 143	37		421 172	465 189	50 20		601 240	691 275		376 169	411 184	457		505 223	550 241		54 84	691 299
39		292 18	328 132	35 14		399 159	441 174	48 18		570 222	673 261		357 156	390 170	433		480 206	522 223		19 62	673 283
40		277 09	312 122	34 13		379 148	420 161	45 17	-	541 206	657 247		340 145	370 157	412 174		456 191	496 207	-	89 43	657 269
41		264 01	297 114	32 12		361 137	399 150	43 16		516 191	640 235		322 134	352 146	393 162		433 177	472 192		61 25	640 256
Joist Designation		28K6	28	3K7	28	<8	28K9	28	3K10	- 28K	12	30K	7	30K8	30	K9		10	30K11	3	0K12
Designation Depth (In.)		28	5	28	28	3	28		28	28	3	30		30		0	30		30		30
Approx. Wt. (lbs./ft.)		11.4		1.8	12	-	13.0		4.3	17		12.3		13.2		3.4	15.		16.4		17.6
Span (ft.) ↓																					
38		444 214		93 37	54 26		594 282		691 325	69 32		531 274		586 300		39 25	691 353		691 353		691 353
39		420 198	4	69 19	51 24	9	564 260	6	670 806	67 30	3	504 253		556 277	6	06 00	673 333	3	673 333		673 333
40		399 183	2	45 03	49 22	2	535 241	2	636 284	65 29	1	478 234		529 256	2	76 78	657 315	5	657 315		657 315
41		379 170		24 89	46 20		510 224		606 263	64 27		454 217		502 238		17 58	640 300		640 300		640 300

(Top values are maximum total factored load in lb/ft, while the lower (lighter) values are maximum (unfactored) live load for a deflection of L/360)

Shaded areas indicate the bridging requirements.

## Example 6 (continued)

# (Top values are maximum total factored load in lb/ft, while the lower (lighter) values are maximum (unfactored) live load for a deflection of L/360)

Joist	Approx. Wt in Lbs. Per	Depth in	SAFE LOAD* in Lbs.							CLE	AR SP/	AN IN F	EET						
Designation	Linear Ft (Joists only)	inches	Between 22-24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40
20LH02	10	20	16950	663	655	646	615	582	547	516	487	460	436	412	393	373	355	337	32
201102	10	20	10350	306	303	298	274	250	228	208	190	174	160	147	136	126	117	108	10
20LH03	11	20	18000	703	694	687	678	651	621	592	558	528	499	474	448	424	403	382	36
				337	333	317	302	280	258	238	218	200	184	169	156	143	133	123	11
20LH04	12	20	22050	861	849	837	792	744	700	660	624	589	558	529	502	477	454	433	41
				428	406	386	352	320	291	265	243	223	205	189	174	161	149	139	12
20LH05	14	20	23700	924	913	903	892	856	816	769	726	687	651	616	585	556	529	504	48
0011100	45	20	01050	459	437 1186	416	395 1084	366 1018	337 952	308 894	281 840	258	238	219 703	202	187 631	173	161 568	15
20LH06	15	20	31650	1233 606	561	1144 521	477	427	952 386	894 351	320	790 292	745 267	246	666 226	209	598 192	178	54 16
20LH07	17	20	33750	1317	1267	1221	1179	1140	1066	1000	940	885	834	789	745	706	670	637	60
2021107	17	20	00/00	647	599	556	518	484	438	398	362	331	303	278	256	236	218	202	18
20LH08	19	20	34800	1362	1309	1263	1219	1177	1140	1083	1030	981	931	882	837	795	754	718	68
				669	619	575	536	500	468	428	395	365	336	309	285	262	242	225	20
20LH09	21	20	38100	1485	1429	1377	1329	1284	1242	1203	1167	1132	1068	1009	954	904	858	816	77
				729	675	626	581	542	507	475	437	399	366	336	309	285	264	244	22
20LH10	23	20	41100	1602	1542	1486	1434 626	1386	1341	1297	1258	1221	1186	1122	1060	1005	954 296	906	86
1			'	786 33	724 34	673 35	36	585 37	545 38	510 39	479 40	448 <b>41</b>	411 42	377 43	346 44	320 45	296 46	274 47	4
24LH03	11	24	17250	513	508	504	484	460	439	418	400	382	366	351	336	322	310	298	28
				235	226	218	204	188	175	162	152	141	132	124	116	109	102	96	90
24LH04	12	24	21150	628	597	568	540	514	490	468	447	427	409	393	376	361	346	333	32
24LH05	13	24	22650	288 673	265 669	246 660	227 628	210 598	195 570	182 544	169 520	158 496	148 475	138 456	130 436	122 420	114 403	107 387	10
24LHU0	13	24	22050	308	297	285	264	244	226	210	196	182	475	160	150	420	132	124	11
24LH06	16	24	30450	906	868	832	795	756	720	685	655	625	598	571	546	522	501	480	46
				411	382	356	331	306	284	263	245	228	211	197	184	172	161	152	14
24LH07	17	24	33450	997	957	919	882	847	811	774	736	702	669	639	610	583	559	535	51
24LH08	18	24	35700	452 1060	421 1015	393 973	367 933	343 895	320 858	297 817	276 780	257 745	239 712	223 682	208 652	195 625	182 600	171 576	16 55
24L1100	10	24	33700	480	447	416	388	362	338	314	292	272	254	238	222	208	196	184	17
24LH09	21	24	42000	1248	1212	1177	1146	1096	1044	994	948	903	861	822	786	751	720	690	66
				562	530	501	460	424	393	363	337	313	292	272	254	238	223	209	19
24LH10	23	24	44400	1323	1284	1248	1213	1182	1152	1105	1053	1002	955	912	873	834	799	766	73
24LH11	25	24	46800	596 1390	559 1350	528 1312	500 1276	474 1243	439 1210	406 1180	378 1152	351 1101	326 1051	304 1006	285 963	266 924	249 885	234 850	22
2461111	20		40000	624	588	555	525	498	472	449	418	388	361	337	315	294	276	259	24
			33-40	41	42	43	44	45	46	47	48	49	50	51	52	53	54	55	56
28LH05	13	28	21000	505	484	465	445	429	412	397	382	367	355	342	330	319	309	298	28
28LH06	16	28	27900	219 672	205 643	192 618	180 592	169 568	159 546	150 525	142 505	133 486	126 469	119 451	113 436	107 421	102 406	97 393	92
201100	10	20	21300	289	270	253	238	223	209	197	186	175	166	156	148	140	133	126	12
28LH07	17	28	31500	757	726	696	667	640	615	591	568	547	528	508	490	474	457	442	42
				326	305	285	267	251	236	222	209	197	186	176	166	158	150	142	13
28LH08	18	28	33750	810 348	775	744	712	684	657	630	604	580	556 196	535	516	496	478	462	44
28LH09	21	28	41550	1000	325 958	305 918	285 879	268 844	252 810	236 778	222 748	209 721	694	185 669	175 645	165 622	156 601	148 580	56
LOLINGO	21		41000	428	400	375	351	329	309	291	274	258	243	228	216	204	193	183	17
28LH10	23	28	45450	1093	1056	1018	976	937	900	864	831	799	769	742	715	690	666	643	62
	0.5		105-1	466	439	414	388	364	342	322	303	285	269	255	241	228	215	204	19
28LH11	25	28	48750	1170	1143	1104	1066	1023	982	943	907	873	841 294	810	781	753	727	702	67
28LH12	27	28	53550	498 1285	475 1255	448 1227	423 1200	397 1173	373 1149	351 1105	331 1063	312 1023	984	278 948	263 913	249 880	236 849	223 819	21
LOLITIE	21		00000	545	520	496	476	454	435	408	383	361	340	321	303	285	270	256	24
28LH13	30	28	55800	1342	1311	1281	1252	1224	1198	1173	1149	1126	1083	1041	1002	964	930	897	86
		I		569	543	518	495	472	452	433	415	396	373	352	332	314	297	281	26

Shaded areas indicate the bridging requirements.

#### Example 7 (LRFD)

## EXAMPLE 5.1 Open-Web Steel Joist Design

A fully exposed roof system for a commercial building, spanning 35 ft, located in Muncie, Indiana, in an urban environment.

IBC specifies a **20 psf snow live load** for Muncie, Indiana, home of Ball State University. Table 1.3 indicates the snow exposure factor:  $C_e = 0.9$ . Table 1.4 indicates the snow thermal factor:  $C_t = 1.0$ . Table 1.7 indicates an occupancy importance factor (for Category II):  $I_S = 1.0$ . Fig. 1.2 indicates the ground snow load:  $p_q = 20$  psf

 $P_{s} = 0.7(0.9)1.0(1.0)20 \text{ psf} = 13.9 \text{ psf}$ 

#### A typical roof construction might consist of:

Membrane roofing	1.0 psf
4 in. average tapered rigid insulation	6.0 psf
Steel deck (2–4 ft span)	1.0 psf
Estimated joist weight:	
35 ft span would be a minimum 18 in. joist	
An average 18 in. joist weight = 9.0 plf	
Spaced @ 4 ft-0 in. o.c. 9.0 plf/4 ft	2.3 psf
Ceiling suspension system	1.0 psf
<sup>1</sup> / <sub>2</sub> in. gypsum ceiling	2.0 psf

Mechanical system estimates should also be included; the heavy sprinkler/drain piping running parallel to a joist or pair of joists is especially critical.


Miscellaneous ductwork/electrical	1.0 psf
Total dead load	14.3 psf $ imes$ 4 ft o.c. = 57.2 plf
Total live load	13.9 psf X 4 ft o.c. = 55.6 plf
Total factored live snow load + de	ad load = $1.2(55.6) + 1.6(57.2) = 158.2$ plf

Use joist load tables to select the best section:

At 35 ft, 18K3 joists carry 237 plf TFL and 84 plf LL

LL: deflection controls and the weight is 6.4 plf.


At least on the surface, this is the best choice, but depending upon the need to integrate mechanical systems into the joist space, a 20K3 at 6.5 plf or even a 22K4 at 7.3 plf which is both deeper and heavier than the previous selection may be best:






	Based On A 50 ksi Maximum Yield Strength - Loads Shown In Pounds Per Linear Foot (plf)																				
Joist Designation	18K3	18K4	18K5	18K6	18K7	18K9	18K10	20K3	20K4	20K5	20K6	20K7	20K9	20K10	22K4	22K5	22K6	22K7	22K9	22K10	22K11
Depth (In.)	18	18	18	18	18	18	18	20	20	20	20	20	20	20	22	22	22	22	22	22	22
Approx. Wt. (Ibs./ft.)	6.4	7.2	7.7	8.4	8.9	10.1	11.6	6.5	7.2	7.7	8.4	8.9	10.1	11.6	7.3	7.7	8.5	9.0	10.2	11.7	11.9
Span (ft.) ↓																					
34	237	285	321	349	390	468	555	264	318	358	391	435	523	621	352	397	432	481	579	687	774
	84	98	110	120	132	156	184	105	122	137	149	165	195	229	149	167	182	202	239	280	314
35	223	268	303	330	367	441	523	249	300	339	369	411	493	585	331	373	408	454	546	648	741
	77	90	101	110	121	143	168	96	112	126	137	151	179	210	137	153	167	185	219	257	292

A floor with multiple bays is to be supported by open-web steel joists spaced at 3 ft. on center and spanning 30 ft. having a dead load of 70 lb/ft<sup>2</sup> and a live load of 100 lb/ft<sup>2</sup>. The joists are supported on joist girders spanning 30 ft. with 3 ft.-long panel points (shown). Determine the member forces at the location shown in a horizontal chord and the maximum force in a web member for an interior girder. Use factored loads. Assume a self weight for the open-web joists of 12 lb/ft, and the self weight for the joist girder of 35 lb/ft.

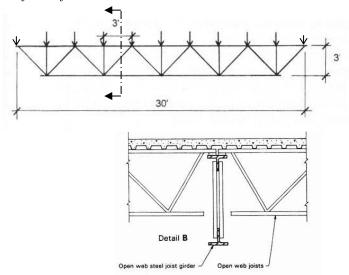


A floor is to be supported by trusses spaced at 5 ft. on center and spanning 60 ft. having a dead load of 53 lb/ft<sup>2</sup> and a live load of 100 lb/ft<sup>2</sup>. With 3 ft.-long panel points, the depth is assumed to be 3 ft with a span-to-depth ratio of 20. With 6 ft.-long panel points, the depth is assumed to be 6 ft with a span-to-depth ratio of 10. Determine the maximum force in a horizontal chord and the maximum force in a web member. Use factored loads. *Assume a self weight of 40 lb/ft*.

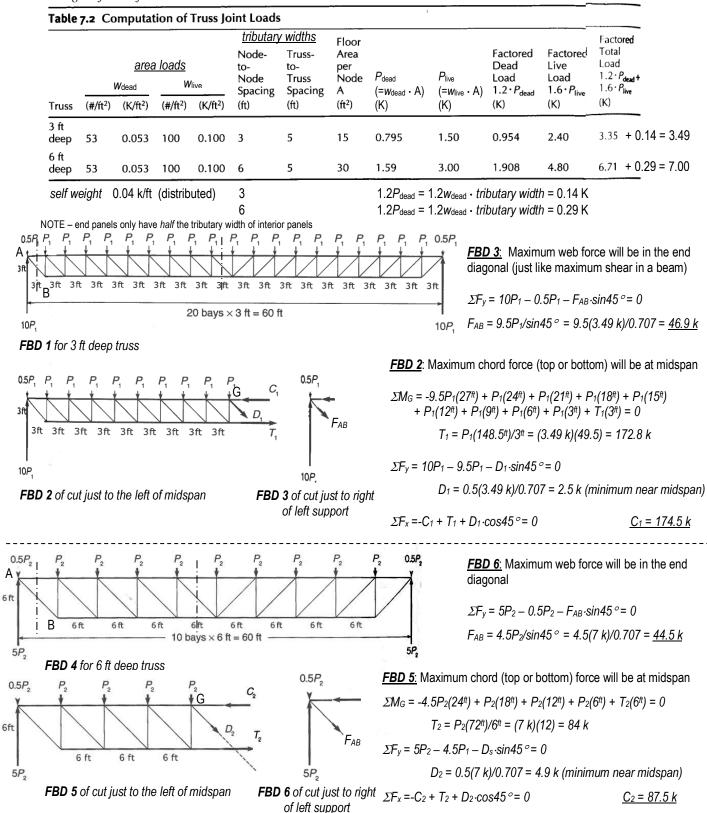

## Example 10 (pg 367) + LRFD Example Problem 10.10 (Figure 10.41)

A 24-ft.-tall, A572 grade 50, steel column (W14×82) with an  $F_y = 50$  ksi has pins at both ends. Its weak axis is braced at midheight, but the column is free to buckle the full 24 ft. in the strong direction. Determine the safe load capacity for this column. using ASD and LRFD.




*Figure 10.41 (a) Strong axis buckling.* (b) Weak axis buckling.

## Example 11 (pg 371) + chart method

Example Problem 10.14: Design of Steel Columns (Figure 10.48)

Select the most economical W12  $\times$  column 18' in height to support an axial load of 600 kips using A572 grade 50 steel. Assume that the column is hinged at the top but fixed at the base. Use LRFD assuming that the load is a dead load (factor of 1.4)

ALSO: Select the W12 column using the Available Strength charts.



#### Given:

Redesign the column from Example E.1a assuming the column is laterally braced about the y-y axis and torsionally braced at the midpoint. Use both ASD and LRFD.  $F_y = 50$  ksi. (Not using Available Strength charts)

#### Solution:

#### ASD:

1. P<sub>a</sub> = 140 k + 420 k = 560 k

2. The effective length in the weak (y-y) axis is 15 ft, while the effective length in the strong (x-x) axis is 30 ft. (K = 1, KL = 1×30 ft). To find kL/r<sub>x</sub> and kL/r<sub>y</sub> we can assume or choose values from the wide flange charts.  $r_y$ 's range from 1 to 3 in., while  $r_x$ 's range from 3 to 14 inches. Let's try  $r_y$  = 2 in and  $r_x$  = 9 in. (something in the W21 range, say.)

 $kL/r_y \simeq 15 \text{ ft}(12 \text{ in/ft})/2 \text{ in.} = 90 \iff \text{GOVERNS}$  (is larger)

 $kL/r_x \cong 30 \text{ ft}(12 \text{ in/ft})/9 \text{ in.} = 40$ 

3. Find a section with sufficient area (which then will give us "real" values for  $r_x$  and  $r_y$ ):

If  $P_a \le P_n/\Omega$ , and  $P_n = F_{cr} A$ , we can find  $A \ge P_a\Omega/F_{cr}$  with  $\Omega = 1.67$ 

The tables provided have  $\phi F_{cr}$ , so we can get  $F_{cr}$  by dividing by  $\phi = 0.9$ 

 $\phi$ F<sub>cr</sub> for 90 is 24.9 ksi, F<sub>cr</sub> = 24.9 ksi/0.9 = 27.67 ksi so A ≥ 560 k(1.67)/27.67 ksi = 33.8 in<sup>2</sup>

4. Choose a trial section, and find the effective lengths and associated available strength, F cr :

Looking from the smallest sections, the W14's are the first with a big enough area:

Try a W14 x 120 (A = 35.3 in<sup>2</sup>) with  $r_y$  = 3.74 in and  $r_x$  = 6.24 in.: kL/r<sub>y</sub> = 48.1 and kL/r<sub>x</sub> = 57.7 (GOVERNS)

 $\phi F_{cr}$  for 58 is 35.2 ksi,  $F_{cr}$  = 39.1 ksi so A ≥ 560 k(1.67)/39.1 ksi = 23.9 in<sup>2</sup>

Choose a W14 x 90 (Choosing a W14 x 82 would make kL/r<sub>x</sub> = 59.5, and A<sub>reqd</sub> = 24.3 in<sup>2</sup>, which is more than 24.1 in<sup>2</sup>!)

#### LRFD:

1. P<sub>u</sub> = 1.2(140 k) + 1.6(420 k) = 840 k

2. The effective length in the weak (y-y) axis is 15 ft, while the effective length in the strong (x-x) axis is 30 ft. (K = 1, KL = 1×30 ft). To find kL/r<sub>x</sub> and kL/r<sub>y</sub> we can assume or choose values from the wide flange charts.  $r_y$ 's range from 1 to 3 in., while  $r_x$ 's range from 3 to 14 inches. Let's try  $r_y$  = 2 in and  $r_x$  = 9 in. (something in the W21 range, say.)

 $kL/r_y \cong 15 \text{ ft}(12 \text{ in/ft})/2 \text{ in.} = 90 \iff \text{GOVERNS}$  (is larger)

 $kL/r_x \cong 30$  ft(12 in/ft)/9 in. = 40

3. Find a section with sufficient area (which then will give us "real" values for rx and ry):

If  $P_u \le \phi P_n$ , and  $\phi P_n = \phi F_{cr} A$ , we can find  $A \ge P_u / \phi F_{cr}$  with  $\phi = 0.9$ 

 $\phi F_{cr}$  for 90 is 24.9 ksi, so A ≥ 840 k/24.9 ksi = 33.7 in<sup>2</sup>

4. Choose a trial section, and find the effective lengths and associated available strength,  $\phi F_{cr}$ :


Looking from the smallest sections, the W14's are the first with a big enough area:

Try a W14 x 120 (A = 35.3 in<sup>2</sup>) with  $r_y$  = 3.74 in and  $r_x$  = 6.24 in.: kL/r<sub>y</sub> = 48.1 and kL/r<sub>x</sub> = 57.7 (GOVERNS)

 $\phi F_{cr}$  for 58 is 35.2 ksi, so A ≥ 840 k/35.2 ksi = 23.9 in<sup>2</sup>

Choose a W14 x 90 (Choosing a W14 x 82 would make kL/r<sub>x</sub> = 59.5, and A<sub>regid</sub> = 24.3 in<sup>2</sup>, which is more than 24.1 in<sup>2</sup>!)





Example 6-1:

1: For the building frame shown in Fig. 6-20, determine the effective column length factor, K, the slenderness ratio, KL/r for each column. Assume the columns buckle and the beams bend about their strong axis.

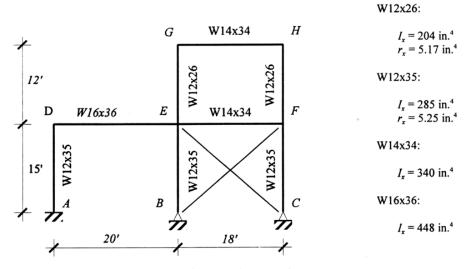


Figure 6-20: Building frame for Example 6-1.

Solution:

Note: The diagonal bracing prevents sidesway of the first story columns only.

$$G_{A} = 1.0 \text{ (fixed support)} \qquad G_{B} = G_{C} = 10.0 \text{ (pinned support)}$$

$$G_{D} = \frac{\frac{285}{15}}{\frac{448}{20}} = 0.85 \qquad G_{E} = \frac{\frac{285}{15} + \frac{204}{12}}{\frac{448}{20} + \frac{340}{18}} = 0.87$$

$$G_{F} = \frac{\frac{285}{15} + \frac{204}{12}}{\frac{340}{18}} = 1.91 \qquad G_{G} = G_{H} = \frac{\frac{204}{12}}{\frac{340}{18}} = 0.90$$

Column	$G_{ extsf{Top}}$	$G_{Bot}$	K		KL/r
AD	0.85	1.0	0.76	Braced	0.76(15)(12)/5.25 = 26.1
BE	0.87	10.0	0.85	Braced	0.85(15)(12)/5.25 = 29.1
CF	1.91	10.0	0.90	Braced	0.90(15)(12)/5.25 = 30.9
EG	0.90	0.87	1.29	Unbraced	1.29(12)(12)/5.17 = 35.9
FH	0.90	1.91	1.43	Unbraced	1.43(12)(12)/5.17 = 39.8

Table 6-1: Column effective length factors and slenderness ratios for Example 6-1.

Investigate the accepatbility of a W16 x 67 used as a beam-column under the unfactored loading shown in the figure. It is A992 steel ( $F_y = 50$  ksi). Assume 25% of the load is dead load with 75% live load.

#### SOLUTION:

DESIGN LOADS (shown on figure):

15000000

Axial load = 1.2(0.25)(350k)+1.6(0.75)(350k)=525k

Moment at joint = 1.2(0.25)(60 k-ft) + 1.6(0.75)(60 k-ft) = 90 k-ft

Determine column capacity and fraction to choose the appropriate interaction equation:

$$\frac{kL}{r_x} = \frac{15ft(12^{\frac{m}{ft}})}{6.96in} = 25.9 \text{ and } \frac{kL}{r_y} = \frac{15ft(12^{\frac{m}{ft}})}{2.46in} = 73 \text{ (governs)}$$

$$P_c = \phi_c P_n = \phi_c F_{cr} A_g = (30.5ksi) 19.7in^2 = 600.85k$$

$$\frac{P_r}{P_c} = \frac{525k}{600.85k} = 0.87 > 0.2 \text{ so use } \frac{P_u}{\phi_c P_n} + \frac{8}{9} \left(\frac{M_{ux}}{\phi_b M_{nx}} + \frac{M_{uy}}{\phi_b M_{ny}}\right) \le 1.0$$

There is no bending about the y axis, so that term will not have any values.

Determine the bending moment capacity in the x direction:

The unbraced length to use the full plastic moment ( $L_p$ ) is listed as 8.69 ft, and we are over that so of we don't want to determine it from formula, we can find the beam in the Available Moment vs. Unbraced Length tables. The value of  $\phi M_n$  at  $L_b$  =15 ft is 422 k-ft.

Determine the magnification factor when  $M_1 = 0$ ,  $M_2 = 90$  k-ft:

$$C_{m} = 0.6 - 0.4 \frac{M_{1}}{M_{2}} = 0.6 - \frac{0^{k-r}}{90^{k-r}} = 0.6 \le 1.0 \qquad P_{e1} = \frac{\pi^{2} EA}{\left(\frac{Kl}{r}\right)^{2}} = \frac{\pi^{2} (30x10^{3} ksi) 19.7 in^{2}}{(25.9)^{2}} = 8,695.4k$$


$$B_{1} = \frac{C_{m}}{1 - (F_{u}/F_{e1})} = \frac{0.6}{1 - (525k/8695.4k)} = 0.64 \ge 1.0 \qquad \text{USE 1.0} \qquad \text{Mu} = (1)90 \text{ k-ft}$$

Finally, determine the interaction value:

$$\frac{P_u}{\phi_c P_n} + \frac{8}{9} \left( \frac{M_{ux}}{\phi_b M_{nx}} + \frac{M_{uy}}{\phi_b M_{ny}} \right) = 0.87 + \frac{8}{9} \left( \frac{90^{k-ft}}{422^{k-ft}} \right) = 1.06 \le 1.0$$


Example 15


**10.9** Determine the maximum load carrying capacity of this lap joint., assuming A36 steel with E60XX electrodes.



This is NOT OK. (and outside error tolerance).

The section should be larger.





**10.7** Determine the capacity of the connection in Figure 10.44 assuming A36 steel with E70XX electrodes.

#### Solution:

Capacity of weld:

For a  $\frac{5}{6}$  fillet weld,  $\phi S = 6.96$  k/in

Weld length = 8 in + 6 in + 8 in = 22 in.


Weld capacity =  $22'' \times 6.96$  k/in = 153.1 k

Capacity of plate:

 $\phi P_n = \phi F_y A_g \quad \phi = 0.9$ 

Plate capacity = 0.9 x 36 k/in<sup>2</sup> x 3/8" x 6" = 72.9 k

 $\therefore$  Plate capacity governs,  $P_{\text{allow}} = 72.9 \text{ k}$ 



The weld size used is obviously too strong. What size, then, can the weld be reduced to so that the weld strength is more compatible to the plate capacity? To make the weld capacity  $\approx$  plate capacity:

 $22'' \times ($ weld capacity per in.) = 72.9k

Weld capacity per inch =  $\frac{72.9 \text{ k}}{22 \text{ in.}}$  - 3.31 k/in.

From Available Strength table, use 3/16'' weld  $(\phi S = 4.18 \text{ k/in.})$ Minimum size fillet = 3/6'' based on a 3%'' thick plate.

### Example 17

**10.5** Using the AISC framed beam connection bolt shear in Table 7-1, determine the shear adequacy of the connection shown in Figure 10.28. What thickness and angle length are required? Also determine the bearing capacity of the wide flange sections.

Factored end beam reaction = 90 k.

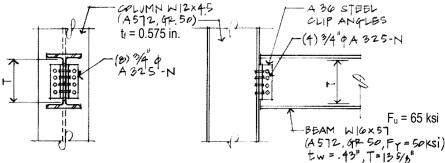


Figure 10.28 Typical beam-column connection.

**10.2** The butt splice shown in Figure 10.22 uses two  $8 \times \frac{3}{6}$  "plates to "sandwich" in the  $8 \times \frac{1}{2}$ " plates being joined. Four  $\frac{7}{6}$ "  $\phi$  A325-SC bolts are used on both sides of the splice. Assuming A36 steel and standard round holes, determine the allowable capacity of the connection.

#### SOLUTION:

Shear, bearing and net tension will be checked to determine the critical conditions that governs the capacity of the connection.

Shear: Using the AISC available shear in Table 7-3 (Group A):

 $\phi R_n$  = 26.4 k/bolt x 4 bolts = 105.6 k

Bearing: Using the AISC available bearing in Table 7-4:

There are 4 bolts bearing on the center (1/2") plate, while there are 4 bolts bearing on a total width of two sandwich plates (3/4") total). The thinner bearing width will govern. Assume 3 in. spacing (center to center) of bolts. For A36 steel, F<sub>u</sub> = 58 ksi.

 $\phi R_n = 91.4 \text{ k/bolt/in. x } 0.5 \text{ in. x } 4 \text{ bolts} = 182.8 \text{ k}$  (Table 7-4)

With the edge distance of 2 in., the bearing capacity might be smaller from Table 7-5 which says the distance should be  $2\frac{1}{4}$  in for full bearing (and we have 2 in.).

 $\phi R_n$  = 79.9 k/bolt/in. x 0.5 in. x 4 bolts = 159.8 k

*Tension:* The center plate is critical, again, because its thickness is less than the combined thicknesses of the two outer plates. We must consider tension yielding and tension rupture:

 $\phi R_n = \phi F_y A_g$  and  $\phi R_n = \phi F_u A_e$  where  $A_e = A_{net} U$ 

 $A_g = 8$  in. x  $\frac{1}{2}$  in. = 4 in<sup>2</sup>

The holes are considered 1/8 in. larger than the bolt hole diameter = (7/8 + 1/8) = 1.0 in.

 $A_n = (8 \text{ in.} - 2 \text{ holes x } 1.0 \text{ in.}) \text{ x } \frac{1}{2} \text{ in.} = 3.0 \text{ in}^2$ 

The whole cross section sees tension, so the shear lag factor U = 1

 $\phi F_y A_g = 0.9 \text{ x} 36 \text{ ksi x} 4 \text{ in}^2 = 129.6 \text{ k}$ 

 $\phi F_u A_e = 0.75 \text{ x } 58 \text{ ksi x } (1) \text{ x } 3.0 \text{ in}^2 = 130.5 \text{ k}$ 

The maximum connection capacity (*smallest value*) **so far** is governed by bolt shear:  $\phi R_n = 105.6 \text{ k}$ 


*Block Shear Rupture:* It is possible for the center plate to rip away from the sandwich plates leaving the block (shown hatched) behind:


 $\phi R_n = \phi (0.6F_u A_{nv} + U_{bs} F_u A_{nt}) \leq \phi (0.6F_v A_{gv} + U_{bs} F_u A_{nt})$ 


where  $A_{nv}$  is the area resisting shear,  $A_{nt}$  is the area resisting tension,  $A_{gv}$  is the gross area resisting shear, and  $U_{bs} = 1$  when the tensile stress is uniform.


 $\begin{aligned} A_{gv} &= 2 \times (4 + 2 \text{ in.}) \times \frac{1}{2} \text{ in.} = 6 \text{ in}^2 \\ A_{nv} &= A_{gv} - 1 \frac{1}{2} \text{ holes areas} = 6 \text{ in}^2 - 1.5 \times 1 \text{ in.} \times \frac{1}{2} \text{ in.} = 5.25 \text{ in}^2 \\ A_{nt} &= 3.5 \text{ in.} \times t - 2(\frac{1}{2} \text{ hole areas}) = 3.5 \text{ in.} \times \frac{1}{2} \text{ in} - 1 \times 1 \text{ in.} \times \frac{1}{2} \text{ in.} = 1.25 \text{ in}^2 \\ \phi(0.6F_uA_{nv} + U_{bs}F_uA_{nt}) = 0.75 \times (0.6 \times 58 \text{ ksi} \times 5.25 \text{ in}^2 + 1 \times 58 \text{ ksi} \times 1.25 \text{ in}^2) = 191.4 \text{ k} \\ \phi(0.6F_yA_{gv} + U_{bs}F_uA_{nt}) = 0.75 \times (0.6 \times 36 \text{ ksi} \times 6 \text{ in}^2 + 1 \times 58 \text{ ksi} \times 1.25 \text{ in}^2) = 151.6 \text{ k} \end{aligned}$ 

The maximum connection capacity (*smallest value*) is governed by block shear rupture:  $\oint R_0 = 151.6 \text{ k}$ 









<sup>7</sup>/8<sup>-in.</sup>

Bolts

1/2

ASD LRFD

296

296

197

150 225

### Example 19

The steel used in the connection and beams is A992 with  $F_v = 50$  ksi, and  $F_u = 65$  ksi. Using A490-N bolt material, determine the maximum capacity of the connection based on shear in the bolts, bearing in all materials and pick the number of bolts and angle length (not staggered). Use A36 steel for the angles.

W21x93: d = 21.62 in,  $t_w = 0.58$  in,  $t_f = 0.93$  in W10x54:  $t_f = 0.615$  in

#### SOLUTION:

The maximum length the angles can be depends on how it fits between the top and bottom flange with some clearance allowed for the fillet to the flange, and getting an air wrench in to tighten the bolts. This example uses 1" of clearance:

Available length = beam depth – both flange thicknesses – 1" clearance at top & 1" at bottom

= 21.62 in - 2(0.93 in) - 2(1 in) = 17.76 in.

Beam

Angle

With the spaced at 3 in. and 1 ¼ in. end lengths (each end), the maximum number of bolts can be determined:

Available length  $\geq$  1.25 in. + 1.25 in. + 3 in. x (number of bolts – 1)

number of bolts  $\leq$  (17.76 in - 2.5 in. - (-3 in.))/3 in. = 6.1, so 6 bolts.

Bolt

Group

Group

Group

Thread

Cond.

SC

Class A

SC

Class B

Ν

SC

Class A

SC

Class B

 $F_V = 50$  ksi

 $F_u = 65$  ksi

 $F_v = 36$  ksi

 $F_u = 58$  ksi

6 Rows

W40, 36, 33, 30, 27,

24, 21

It is helpful to have the All-bolted Double-Angle Connection Tables 10-1. They are available for 3/4", 7/8", and 1" bolt diameters and list angle thicknesses of 1/4",  $5/16^{\circ}$ ,  $3/8^{\circ}$ , and  $\frac{1}{2}^{\circ}$ . Increasing the angle thickness is likely to increase the angle strength, although the limit states include shear yielding of the angles, shear rupture of the angles, and block shear rupture of the angles.

For these diameters, the available shear (double) from Table 7-1 for 6 bolts is (6)45.1 k/bolt = 270.6 kips, (6)61.3 k/bolt = 367.8 kips, and (6)80.1 k/bolt = 480.6 kips.

Tables 10-1 (not all provided here) list a bolt and angle available strength of 271 kips for the 3/4" bolts, 296 kips for the 7/8" bolts, and 281 kips for the 1" bolts. It appears that increasing the bolt diameter to 1" will not gain additional load. Use 7/8" bolts.

 $\phi R_n = 367.8$  kips for double shear of 7/8" bolts

97.3  $\phi R_n = 296$  kips for limit state in angles

Table 10-1 (continued)

All-Bolted Double-Angle

Connections

Hole

Туре

STD

STD

STD

OVS

SSLT

STD

0VS

SSLT

STD

STD

OVS

SSLT

STD

0VS

SSU

Bolt and Angle Available Strength, kips

140

146 122 182 146 219 176 264

117

123 185

123

148 123

146 122 182 146 219 195 292

1/4

98.6 148

98.6 148 123 185

98.6 148 106 159 106 159 106 159

90.1 135 90.1 135 90. 135 90. 135

97.3 146 106 159 106 159 106 159 264

98.6 148 123 185 148 222 176

93.5

97.3

98.6 148

98.6 148

98.6 148 123 185 133 199 133 199

93.5 140 113

97.3 146 122 182 133 199 133 199

98.6

93.5 140 117 175 140 210 187 281

Angle Thickness, in.

148

148

148

169 113

185 148

3/8

222

210

222 197

222 197 296

169 113 169

222 197 296

5/16

ASD LRFD ASD LRFD ASD LRFD

185 148 222 195 292

175 140

185

We also need to evaluate bearing of bolts on the beam web, and column flange where there are bolt holes. Table 7-4 provides available bearing strength for the material type, bolt diameter, hole type, and spacing per inch of material thicknesses.


There are 6 bolt holes through the beam web. This is typically the critical bearing limit value a) Bearing for beam web: because there are two angle legs that resist bolt bearing and twice as many bolt holes to the column. The material is A992 ( $F_u = 65$  ksi), 0.58" thick, with 7/8" bolt diameters at 3 in. spacing.

 $\phi R_n = 6 \text{ bolts} \cdot (102 \text{ k/bolt/inch}) \cdot (0.58 \text{ in}) = 355.0 \text{ kips}$ 


b) Bearing for column flange: There are 12 bolt holes through the column. The material is A992 (F<sub>u</sub> = 65 ksi), 0.615" thick, with 1" bolt diameters.

$$\phi R_n = 12 \text{ bolts} \cdot (102 \text{ k/bolt/inch}) \cdot (0.615 \text{ in}) = 752.8 \text{ kips}$$

Although, the bearing in the beam web is the smallest at 355 kips, with the shear on the bolts even smaller at 324.6 kips, the maximum capacity for the simple-shear connector is 296 kips limited by the critical capacity of the angles.



## **Beam Design Flow Chart**

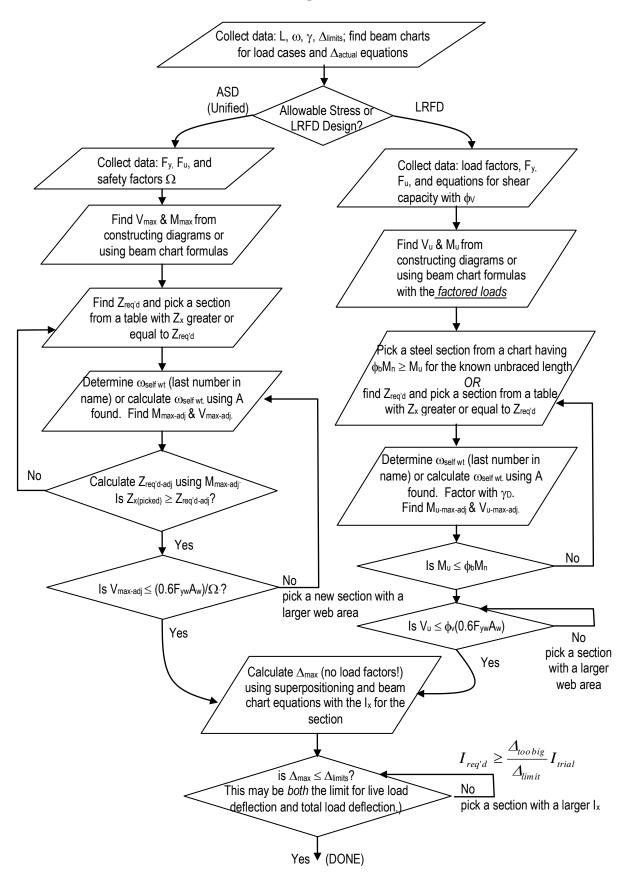

Listing of W Shapes in Descending order of  $Z_x$  for Beam Design

$\begin{array}{c} Z_{\rm x} - US \\ ({\rm in.}^3) \end{array}$	$I_x - US$ (in. <sup>4</sup> )	Section	$I_x - SI$ (10 <sup>6</sup> mm. <sup>4</sup> )	$\begin{array}{c} Z_{x} - SI \\ (10^{3} \text{mm.3}) \end{array}$	$\begin{array}{c} Z_{x} - US \\ (in.^{3}) \end{array}$	$I_x - US$ (in. <sup>4</sup> )	Section	$I_x - SI$ (10 <sup>6</sup> mm. <sup>4</sup> )	$\begin{array}{c} Z_{x} - SI \\ (10^{3} \text{mm.3}) \end{array}$
514	7450	W33X141	3100	8420	289	3100	W24X104	1290	4740
511	5680	W24X176	2360	8370	287	1900	W14X159	791	4700
509	7800	W36X135	3250	8340	283	3610	W30X90	1500	4640
500	6680	W30X148	2780	8190	280	3000	W24X103	1250	4590
490	4330	W18X211	1800	8030	279	2670	W21X111	1110	4570
487	3400	W14X257	1420	7980	278	3270	W27X94	1360	4560
481	3110	W12X279	1290	7880	275	1650	W12X170	687	4510
476	4730	W21X182	1970	7800	262	2190	W18X119	912	4290
468	5170	W24X162	2150	7670	260	1710	W14X145	712	4260
467	6710	W33X130	2790	7650	254	2700	W24X94	1120	4160
464	5660	W27X146	2360	7600	253	2420	W21X101	1010	4150
442	3870	W18X192	1610	7240	244	2850	W27X84	1190	4000
437	5770	W30X132	2400	7160	243	1430	W12X152	595	3980
436	3010	W14X233	1250	7140	234	1530	W14X132	637	3830
432	4280	W21X166	1780	7080	230	1910	W18X106	795	3770
428	2720	W12X252	1130	7010	224	2370	W24X84	986	3670
418	4580	W24X146	1910	6850	221	2070	W21X93	862	3620
415	5900	W33X118	2460	6800	214	1240	W12X136	516	3510
408	5360	W30X124	2230	6690	212	1380	W14X120	574	3470
398	3450	W18X175	1440	6520	211	1750	W18X97	728	3460
395	4760	W27X129	1980	6470	200	2100	W24X76	874	3280
390	2660	W14X211	1110	6390	198	1490	W16X100	620	3240
386	2420	W12X230	1010	6330	196	1830	W21X83	762	3210
378	4930	W30X116	2050	6190	192	1240	W14X109	516	3150
373	3630	W21X147	1510	6110	186	1530	W18X86	637	3050
370	4020	W24X131	1670	6060	186	1070	W12X120	445	3050
356	3060	W18X158	1270	5830	177	1830	W24X68	762	2900
355	2400	W14X193	999	5820	175	1300	W16X89	541	2870
348	2140	W12X210	891	5700	173	1110	W14X99	462	2830
346	4470	W30X108	1860	5670	172	1600	W21X73	666	2820
343	4080	W27X114	1700	5620	164	933	W12X106	388	2690
333	3220	W21X132	1340	5460	163	1330	W18X76	554	2670
327	3540	W24X117	1470	5360	160	1480	W21X68	616	2620
322	2750	W18X143	1140	5280	157	999	W14X90	416	2570
320	2140	W14X176	891	5240	153	1550	W24X62	645	2510
312	3990	W30X99	1660	5110	150	1110	W16X77	462	2460
311	1890	W12X190	787	5100	147	833	W12X96	347	2410
307	2960	W21X122	1230	5030	147	716	W10X112	298	2410
305	3620	W27X102	1510	5000	146	1170	W18X71	487	2390
290	2460	W18X130	1020	4750				(	continued)

Listing of W Shapes in Descending order of  $Z_x$  for Beam Design (Continued)

$Z_x - US$	$I_x - US$		$I_x - SI$	$Z_x - SI$	$Z_x - US$	$I_x - US$		$I_x - SI$	$Z_x - SI$
(in. <sup>3</sup> )	(in. <sup>4</sup> )	Section	$(10^6 \text{mm.}^4)$	$(10^3 \text{mm.3})$	(in. <sup>3</sup> )	(in. <sup>4</sup> )	Section	$(10^6 \text{mm.}^4)$	$(10^3 \text{mm.3})$
144	1330	W21X62	554	2360	66.5	510	W18X35	212	1090
139	881	W14X82	367	2280	64.2	348	W12X45	145	1050
134	1350	W24X55	562	2200	64.0	448	W16X36	186	1050
133	1070	W18X65	445	2180	61.5	385	W14X38	160	1010
132	740	W12X87	308	2160	60.4	272	W10X49	113	990
130	954	W16X67	397	2130	59.8	228	W8X58	94.9	980
130	623	W10X100	259	2130	57.0	307	W12X40	128	934
129	1170	W21X57	487	2110	54.9	248	W10X45	103	900
126	1140	W21X55	475	2060	54.6	340	W14X34	142	895
126	795	W14X74	331	2060	54.0	375	W16X31	156	885
123	984	W18X60	410	2020	51.2	285	W12X35	119	839
119	662	W12X79	276	1950	49.0	184	W8X48	76.6	803
115	722	W14X68	301	1880	47.3	291	W14X30	121	775
113	534	W10X88	222	1850	46.8	209	W10X39	87.0	767
112	890	W18X55	370	1840	44.2	301	W16X26	125	724
110	984	W21X50	410	1800	43.1	238	W12X30	99.1	706
108	597	W12X72	248	1770	40.2	245	W14X26	102	659
107	959	W21X48	399	1750	39.8	146	W8X40	60.8	652
105	758	W16X57	316	1720	38.8	171	W10X33	71.2	636
102	640	W14X61	266	1670	37.2	204	W12X26	84.9	610
101	800	W18X50	333	1660	36.6	170	W10X30	70.8	600
97.6	455	W10X77	189	1600	34.7	127	W8X35	52.9	569
96.8	533	W12X65	222	1590	33.2	199	W14X22	82.8	544
95.4	843	W21X44	351	1560	31.3	144	W10X26	59.9	513
92.0	659	W16X50	274	1510	30.4	110	W8X31	45.8	498
90.7	712	W18X46	296	1490	29.3	156	W12X22	64.9	480
87.1	541	W14X53	225	1430	27.2	98.0	W8X28	40.8	446
86.4	475	W12X58	198	1420	26.0	118	W10X22	49.1	426
85.3	394	W10X68	164	1400	24.7	130	W12X19	54.1	405
82.3	586	W16X45	244	1350	23.1	82.7	W8X24	34.4	379
78.4	612	W18X40	255	1280	21.6	96.3	W10X19	40.1	354
78.4	484	W14X48	201	1280	20.4	75.3	W8X21	31.3	334
77.9	425	W12X53	177	1280	20.1	103	W12x16	42.9	329
74.6	341	W10X60	142	1220	18.7	81.9	W10X17	34.1	306
73.0	518	W16X40	216	1200	17.4	88.6	W12X14	36.9	285
71.9	391	W12X50	163	1180	17.0	61.9	W8X18	25.8	279
70.1	272	W8X67	113	1150	16.0	68.9	W10X15	28.7	262
69.6	428	W14X43	178	1140	13.6	48.0	W8X15	20.0	223
66.6	303	W10X54	126	1090	12.6	53.8	W10X12	22.4	206
					11.4	39.6	W8X13	16.5	187
					8.87	30.8	W8X10	12.8	145

			-					-	
KL/r	$\phi_c F_{cr}$								
1	32.4	41	29.7	81	22.9	121	15.0	161	8.72
2	32.4	42	29.5	82	22.7	122	14.8	162	8.61
3	32.4	43	29.4	83	22.5	123	14.6	163	8.50
4	32.4	44	29.3	84	22.3	124	14.4	164	8.40
5	32.4	45	29.1	85	22.1	125	14.2	165	8.30
6	32.3	46	29.0	86	22.0	126	14.0	166	8.20
7	32.3	47	28.8	87	21.8	127	13.9	167	8.10
8	32.3	48	28.7	88	21.6	128	13.7	168	8.00
9	32.3	49	28.6	89	21.4	129	13.5	169	7.91
10	32.2	50	28.4	90	21.2	130	13.3	170	7.82
11	32.2	51	28.3	91	21.0	131	13.1	171	7.73
12	32.2	52	28.1	92	20.8	132	12.9	172	7.64
13	32.1	53	27.9	93	20.5	133	12.8	173	7.55
14	32.1	54	27.8	94	20.3	134	12.6	174	7.46
15	32.0	55	27.6	95	20.1	135	12.4	175	7.38
16	32.0	56	27.5	96	19.9	136	12.2	176	7.29
17	31.9	57	27.3	97	19.7	137	12.0	177	7.21
18	31.9	58	27.1	98	19.5	138	11.9	178	7.13
19	31.8	59	27.0	99	19.3	139	11.7	179	7.05
20	31.7	60	26.8	100	19.1	140	11.5	180	6.97
21	31.7	61	26.6	101	18.9	141	11.4	181	6.90
22	31.6	62	26.5	102	18.7	142	11.2	182	6.82
23	31.5	63	26.3	103	18.5	143	11.0	183	6.75
24	31.4	64	26.1	104	18.3	144	10.9	184	6.67
25	31.4	65	25.9	105	18.1	145	10.7	185	6.60
26	31.3	66	25.8	106	17.9	146	10.6	186	6.53
27	31.2	67	25.6	107	17.7	147	10.5	187	6.46
28	31.1	68	25.4	108	17.5	148	10.3	188	6.39
29	31.0	69	25.2	109	17.3	149	10.2	189	6.32
30	30.9	70	25.0	110	17.1	150	10.0	190	6.26
31	30.8	71	24.8	111	16.9	151	9.91	191	6.19
32	30.7	72	24.7	112	16.7	152	9.78	192	6.13
33	30.6	73	24.5	113	16.5	153	9.65	193	6.06
34	30.5	74	24.3	114	16.3	154	9.53	194	6.00
35	30.4	75	24.1	115	16.2	155	9.40	195	5.94
36	30.3	76	23.9	116	16.0	156	9.28	196	5.88
37	30.1	77	23.7	117	15.8	157	9.17	197	5.82
38	30.0	78	23.5	118	15.6	158	9.05	198	5.76
39	29.9	79	23.3	119	15.4	159	8.94	199	5.70
40	29.8	80	23.1	120	15.2	160	8.82	200	5.65

Available Critical Stress,  $\phi_c F_{cr}$ , for Compression Members, ksi ( $F_y = 36$  ksi and  $\phi_c = 0.90$ )

KL/r	$\phi_c F_{cr}$								
1	45.0	41	39.8	81	27.9	121	15.4	161	8.72
2	45.0	42	39.6	82	27.5	122	15.2	162	8.61
3	45.0	43	39.3	83	27.2	123	14.9	163	8.50
4	44.9	44	39.1	84	26.9	124	14.7	164	8.40
5	44.9	45	38.8	85	26.5	125	14.5	165	8.30
6	44.9	46	38.5	86	26.2	126	14.2	166	8.20
7	44.8	47	38.3	87	25.9	127	14.0	167	8.10
8	44.8	48	38.0	88	25.5	128	13.8	168	8.00
9	44.7	49	37.8	89	25.2	129	13.6	169	7.91
10	44.7	50	37.5	90	24.9	130	13.4	170	7.82
11	44.6	51	37.2	91	24.6	131	13.2	171	7.73
12	44.5	52	36.9	92	24.2	132	13.0	172	7.64
13	44.4	53	36.6	93	23.9	133	12.8	173	7.55
14	44.4	54	36.4	94	23.6	134	12.6	174	7.46
15	44.3	55	36.1	95	23.3	135	12.4	175	7.38
16	44.2	56	35.8	96	22.9	136	12.2	176	7.29
17	44.1	57	35.5	97	22.6	137	12.0	177	7.21
18	43.9	58	35.2	98	22.3	138	11.9	178	7.13
19	43.8	59	34.9	99	22.0	139	11.7	179	7.05
20	43.7	60	34.6	100	21.7	140	11.5	180	6.97
21	43.6	61	34.3	101	21.3	141	11.4	181	6.90
22	43.4	62	34.0	102	21.0	142	11.2	182	6.82
23	43.3	63	33.7	103	20.7	143	11.0	183	6.75
24	43.1	64	33.4	104	20.4	144	10.9	184	6.67
25	43.0	65	33.0	105	20.1	145	10.7	185	6.60
26	42.8	66	32.7	106	19.8	146	10.6	186	6.53
27	42.7	67	32.4	107	19.5	147	10.5	187	6.46
28	42.5	68	32.1	108	19.2	148	10.3	188	6.39
29	42.3	69	31.8	109	18.9	149	10.2	189	6.32
30	42.1	70	31.4	110	18.6	150	10.0	190	6.26
31	41.9	71	31.1	111	18.3	151	9.91	191	6.19
32	41.8	72	30.8	112	18.0	152	9.78	192	6.13
33	41.6	73	30.5	113	17.7	153	9.65	193	6.06
34	41.4	74	30.2	114	17.4	154	9.53	194	6.00
35	41.1	75	29.8	115	17.1	155	9.40	195	5.94
36	40.9	76	29.5	116	16.8	156	9.28	196	5.88
37	40.7	77	29.2	117	16.5	157	9.17	197	5.82
38	40.5	78	28.8	118	16.2	158	9.05	198	5.76
39	40.3	79	28.5	119	16.0	159	8.94	199	5.70
40	40.0	80	28.2	120	15.7	160	8.82	200	5.65

## **Bolt Strength Tables**

ASTM Desig. Group A Group B A307 Nor	minal Bolt Nominal B Thread Cond. N X N X X minal Bolt Nominal B	Fnv/Ω         (ksi)           ASD         27.0           34.0         34.0           42.0         13.5		Load- ing S D S D	0.3 r <sub>n</sub> /Ω ASD 8.29 16.6	/8 807 φ <i>r<sub>n</sub></i> LRFD	<b>r</b> n/Ω	/4 142 φrn	201	/8 501	1. 1912	1 785
ASTM Desig. Group A Group B A307 Nor ASTM	Thread Cond. N X N X X minal Bott	F <sub>nv</sub> /Ω           (ksi)           ASD           27.0           34.0           34.0           42.0           13.5	φ <i>Fnv</i> (ksi) LRFD 40.5 51.0 51.0	S D S D	r <sub>n</sub> /Ω ASD 8.29 16.6	φ <i>r</i> n LRFD	<b>r</b> n/Ω		in the second		1. 1912	785
Desig. Group A Group B A307 Nor ASTM	N N X N X minal Bott	(ksi) ASD 27.0 34.0 34.0 42.0 13.5	(ksi) LRFD 40.5 51.0 51.0	S D S D	ASD 8.29 16.6	LRFD	narah	φ <b>r</b> n	<b>r_n</b> /Ω	1.	5 10050	1
Group A Group B A307 Nor ASTM	A Contraction of the second se	27.0 34.0 34.0 42.0 13.5	40.5 51.0 51.0	S D S D	8.29 16.6	15004	No. and the second			φ <b>r</b> n	r <sub>n</sub> /Ω	φ <b>r</b> n
A Group B A307 Nor ASTM	X qq N N SOL, 2005 X A  minal Bolt	34.0 34.0 42.0 13.5	51.0 51.0	D S D	16.6	10.4	ASD	LRFD	ASD	LRFD	ASD	LRFD
A Group B A307 Nor ASTM	N N Sold , 2005 X A Minal Bolt	34.0 42.0 13.5	51.0	S D	1 1 1 1 1 1 H	12.4 24.9	11.9	17.9 35.8	16.2	24.3 48.7	21.2	31.8
Group B A307 Nor ASTM	N N Sold , 2005 X A Minal Bolt	34.0 42.0 13.5	51.0	D	10.4	15.7	23.9 15.0	22.5	32.5	30.7	42.4	63.6
B A307 Nor ASTM	x X minal Bolt	42.0 13.5	harman		20.9	31.3	30.1	45.1	40.9	61.3	53.4	80.1
B A307 Nor ASTM	x X minal Bolt	42.0 13.5	harman	S	10.4	15.7	15.0	22.5	20.4	30.7	26.7	40.0
A307 Nor	ninal Bolt	13.5	63.0	DS	20.9	31.3 19.3	30.1	45.1 27.8	40.9	61.3 37.9	53.4 33.0	80.1 49.5
Nor	- minal Bolt		10.00	D	25.8	38.7	18.6 37.1	55.7	50.5	75.7	65.9	98.9
Nor			20.3	S	4.14	6.23	5.97	8.97	8.11	12.2	10.6	15.9
ASTM		Diamoto	872	D	8.29	12.5	11.9	17.9	16.2	24.4	21.2	31.9
ASTM	Nominal B			ar suo	139401	/8 900	100111111	/49/01		3/8		1/2
0.07.0200		olt Area	, in. <sup>2</sup>	139851	0.9	94	1.	23	1.	48	C. 131	.77
	Thread Cond.	F <sub>nv</sub> /Ω (ksi)	¢ <i>F<sub>nv</sub></i> (ksi)	Load-	r <sub>n</sub> /Ω	¢r <sub>n</sub>	<b>r</b> <sub>n</sub> /Ω	¢r <sub>n</sub>	<b>r</b> <sub>n</sub> /Ω	φ <b>r</b> n	r <sub>n</sub> /Ω	¢r <sub>n</sub>
		ASD	LRFD		ASD	LRFD	ASD	LRFD	ASD	LRFD	ASD	LRFD
Group	N	27.0	40.5	S D	26.8 53.7	40.3 80.5	33.2 66.4	49.8 99.6	40.0 79.9	59.9 120	47.8 95.6	71.7
Group				S	33.8	50.7	41.8	62.7	50.3	75.5	60.2	90.3
126	X	34.0	51.0	D	67.6	101	83.6	125	101	151	120	181
0	N	34.0	51.0	S	33.8	50.7	41.8	62.7	50.3	75.5	60.2	90.3
Group B	-	5.00	1.000	DS	67.6 41.7	101 62.6	83.6 51.7	125 77.5	101 62.2	151 93.2	120 74.3	181
	. X	42.0	63.0	D	83.5	125	103	155	124	186	149	223
A307	_	13.5	20.3	S	13.4	20.2	16.6	25.0	20.0	30.0	23.9	35.9
ASD	LRFD			D	26.8 s greater t	40.4	33.2	49.9 Specific	40.0	60.1	47.8	71.9
$\Omega = 2.00$	¢ = 0.75	TO CILU	ioaucu c	Unitocuork	s greater u	101 30 11.	, 500 AIU	opecine		00.210	ounder D.	
		S		vail	Table able n of	e Te	ensi		S			
Nominal I	Bolt Diame	ter, <i>d</i> , i	n.	5/	8		<sup>3</sup> /4		7/8		1	
Nomin	al Bolt Are	a, in.²		0.3	07	0	.442		0.601		0.7	85
ASTM Des	1 110		þ <i>F<sub>nt</sub></i> ksi)	<b>r</b> _/Ω	ф <b>г</b> л	r <sub>n</sub> /Ω	¢r <sub>n</sub>	r <sub>n</sub> i	Ω	ф <b>г</b> п	r <sub>n</sub> /Ω	<b>¢r</b> n
	10000	SD L	RFD	ASD	LRFD	ASD	LRF	D AS	DL	RFD	ASD	LRFD
Group A		20/00/2012	7.5	13.8	20.7	19.9	29.8	1 (10.1396.2)	CONTRACTOR NO.	0.6	35.3	53.0
Group B A307	56 22	2.27 C	4.8 3.8	17.3 6.90	26.0 10.4	25.0 9.94	37.4 14.9		COL. 1111	1.0 0.3	44.4 17.7	66.6 26.5
Nominal I	Bolt Diame	eter, <i>d</i> , i	n." 868 /	11	/8	B)   3	11/4	02.41	13/8	12	1 The	12
Nomin	al Bolt Ar	ea, in.²	12/10	0.9	94	S.T.	1.23	hand	1.48	2	1.	n
nonim			¢ <i>F<sub>nt</sub></i> ksi)	r <sub>n</sub> /Ω	φ <b>r</b> n	r <sub>n</sub> /Ω	φ <b>r</b> n	r <sub>n</sub> ,	Ω	φ <b>r</b> n	r <sub>n</sub> /Ω	¢r <sub>n</sub>
ASTM Des	ig. (K	SD L	RFD	ASD	LRFD	ASD	LRF	DA	SD L	RFD	ASD	LRFD
	ing.		7.5	44.7	67.1	55.2	82.8	00	25-	~ T	T1742772	4.4.0
	A:	Constanting and the	4.8	56.2	84.2	69.3	104	A CONTRACTOR OF THE OWNER	.8 10 .9 12	100 C	79.5 99.8	119 150

 $\phi = 0.75$ 

 $\Omega = 2.00$ 

Group A Bolts	S	Table 7-3 Slip-Critical Conn	ritic	Table 7-3	-3 Dnne	ections	su				S	Table 7-3 (continued) Slip-Critical Connections	Table 7-3 (continued) Critical Connec	3 (cor al Co	ntinue	d) ctiol	SL	Group B Bolts	p B ts
A325, A325M F1858 A354 Grade BC		Available Shear Strength, kips (Class A Faying Surface, $\mu$ = 0.30)	ole Sh Fayir	lear S Ig Sur	treng face,	th, ki ⊨ = 0	,30)				Ő	Available Shear Strength, kips (Class A Faying Surface, $\mu$ = 0.30)	ole Sh Fayin	ear St ig Sur	face,	h, kip µ = 0.		A490, A490M F2280 A354 Grade BD	de BD
A449	U	1000	G	Group A Bolts	Its						n Z		Gr	Group B Bolts	ts		#	12	
11 J.H.	BOX STATE VIEW	0.00	204/0	Non	ninal Bolt	Nominal Bolt Diameter, d, in.	<i>d</i> , in.			ALC: NO		Antes		Nom	inal Bolt C	Nominal Bolt Diameter, d, in.	(, in.	1.00	100
1		-	5/8		3/4		8/2		-	11 03	Curl L	1150	5/8	3/	3/4	12		-	P
Unio Tumo	Indian			Minimum Group A		Bolt Prete	Bolt Pretension, kips	5				New York	100	Minimum	Group B B	Minimum Group B Bolt Pretension, kips	sion, kips	1	
unia i àha	roauliy		19	C4	28		39		51	Hole lype	Loading		24	3	35	49		64	4
		$r_n/\Omega$	φľn	$r_n/\Omega$	φın	$r_n/\Omega$	φrn	$r_n/\Omega$	φľn			$r_n/\Omega$	φι	$r_n/\Omega$	φľn	$r_n/\Omega$	φſn	$r_n/\Omega$	φľn
	No 1	ASD	LRFD	ASD	LRFD	ASD	LRFD	ASD	LRFD			ASD	LRFD	ASD	LRFD	ASD	LRFD	ASD	LRFD
STD/SSLT	sa	4.29 8.59	6.44 12.9	6.33 12.7	9.49 19.0	8.81 17.6	13.2 26.4	11.5 23.1	17.3 34.6	STD/SSLT	νD	5.42 10.8	8.14 16.3	7.91 15.8	11.9 23.7	11.1 22.1	16.6 33.2	14.5 28.9	21.7 43.4
OVS/SSLP	s o	3.66 7.32	5.47 10.9	5.39 10.8	8.07 16.1	7.51 15.0	11.2 22.5	9.82 19.6	14.7 29.4	JUS/SVD	s a	4.62 9.25	6.92 13.8	6.74 13.5	10.1 20.2	9.44 18.9	14.1 28.2	12.3 24.7	18.4 36.9
ISL	sa	3.01 6.02	4.51 9.02	4.44 8.87	6.64 13.3	6.18 12.4	9.25 18.5	8.08 16.2	12.1 24.2	ISL	νD	3.80 7.60	5.70 11.4	5.54	8.31 16.6	7.76 15.5	11.6 23.3	10.1 20.3	15.2 30.4
1111		- Aller		Nom	Nominal Bolt	Diameter, d, in.	d, in.				1.2.1	1 Danie		Nom	inal Bolt C	Nominal Bolt Diameter, d, in.	(, in.		1.00
		-	11/8	+	11/4	-	13/8	-	11/2				11/8	1	11/4	13/8	/8	11/2	12
		1.11		Minimum Group A		Bolt Prete	Bolt Pretension, kips	5	11	1		100		Minimum	Group B B	Minimum Group B Bolt Pretension, kips	sion, kips		
noie iype	Loading	u)	56	7	71	1	85	-	103	Hole lype	Loading		80	Ę	102	121	-	148	8
		$r_n/\Omega$	φľn	$r_n/\Omega$	φľn	$r_n/\Omega$	¢ľn	$r_n/\Omega$	φſn			$r_n/\Omega$	φln	$r_n/\Omega$	φľn	$r_n/\Omega$	0In	$r_n/\Omega$	φln
		ASD	LRFD	ASD	LRFD	ASD	LRFD	ASD	LRFD	11		ASD	LRFD	ASD	LRFD	ASD	LRFD	ASD	LRFD
STD/SSLT	s c	12.7	19.0 38.0	16.0	24.1 48.1	19.2	28.8 57.6	23.3	34.9 60.8	STD/SSLT	s	18.1	27.1	23.1	34.6	27.3	41.0	33.4	50.2
UVC/CCI D	s	10.8	16.1	13.7	20.5	16.4	24.5	19.8	29.7	a loor one	0	15.4	23.1	19.6	29.4	23.3	34.9	28.5	42.6
	0	21.6	32.3	27.4	40.9	32.7	49.0	39.7	59.4	JICC/CAN	D	30.8	46.1	39.3	58.8	46.6	69.7	57.0	85.3
rsı	sa	8.87 17.7	13.3 26.6	11.2 22.5	16.8 33.7	13.5 26.9	20.2 40.3	16.3 32.6	24.4 48.9	ISI	sa	12.7 25.3	19.0 38.0	16.2 32.3	24.2 48.4	19.2 38.3	28.7 57.4	23.4 46.9	35.1 70.2
STD = standard hole OVS = oversized hole SSLT = short-slotted hole transverse to the line of force SSLP = short-slotted hole parallel to the line of force LSL = long-slotted hole transverse or parallel to the lin	<ul> <li>= standard hole</li> <li>= oversized hole</li> <li>= short-slotted hole transverse to the line of force</li> <li>= short-slotted hole parallel to the line of force</li> <li>= long-slotted hole transverse or parallel to the line of force</li> </ul>	sverse to th allel to the li verse or pa	le line of fo ine of force rallel to the	rrce a line of for	es	S = single shear D = double shear	e shear le shear			STD = standard hole OVS = oversized hole SSLT = short-stotted hole transverse to the line of force SSLP = short-stotted hole parallel to the line of force LSL = long-slotted hole transverse or parallel to the lin	= standard hole = oversized hole = short-slotted hole transverse to the line of force = short-slotted hole parallel to the line of force = long-slotted hole transverse or parallel to the line of force	ansverse to I irallel to the nsverse or p	he line of fo line of force arallel to th	orce e e line of for		S = single shear D = double shear	shear		
Hole Type	ASD	LRFD	Note: Stip	Note: Slip-critical bolt values assume no more than one filler has been provided or holts have been added to distribute loads in the fillers	values assu	ume no mor	e than one fi	iller has beel	n provided	Hole Type	ASD	LRFD	Note: Slip	Note: Slip-critical bolt values assume no more than one filler has been provided or holts have hear added to distribute leads in the fillers.	values assu	me no more	than one fills	ar has been	provided
STD and SSLT	$\Omega = 1.50$	$\varphi=1.00$	See AISC	See AISC Specification Sections	7 Sections J	13.8 and J5	J3.8 and J5 for provisions when fillers	s when filler	S	STD and SSLT	$\Omega = 1.50$	$\phi = 1.00$		See AISC Specification Sections J3.8 and J5 for provisions when fillers	n Sections J	3.8 and J5 ft	or provisions	when fillers	
OVS and SSLP	$\Omega = 1.76$	$\varphi=0.85$	For Class B	are present. For Class B faving surfaces, multiply the tabulated available strendth by 1.67	faces. multi	iniv the tabu	lated availat	le strenoth h	1 67	<b>OVS and SSLP</b>	$\Omega = 1.76$	$\phi = 0.85$		are present. For Class B faving surfaces multiply the fabulated available strength by 1.67.	faces multi	olv the tabul	ated available	a strength b	w 1.67.
LSL	$\Omega = 2.14$	$\phi = 0.70$	-	Rufera	-	tons our fide		Infain to our		LSL	$\Omega = 2.14$	$\phi = 0.70$	-	Rufaia	(main)				

A	Available Bearing Strength Based on Bolt Spa	le Ba	sed	ig S on E	g Stren n Bolt		Bearing Strength at Bolt Holes Based on Bolt Spacing	olt F	Hole	S	Av	Available Bearing Strength at Bolt Holes Based on Bolt Spacing	Bé Bé	eari	aring Strength a	Based on Bolt Spacing	gth	at B cing	_ et	lole	
			kip	kips/in. thickness	thick	ress								ki	ps/in.	kips/in. thickness	ness				
					Nomi	Nominal Bolt D	Diameter, d, in.	ť, in.					14. A. W.		14, 101, 11	Nom	Nominal Bolt Diameter, d, in.	Diameter,	d, in.	_	
tick Tan	Bolt	i koi		5/8	E quints	3/4		8/2				-			11/8		11/4		13/8		11/2
adki alou	spacing, s, in.		$r_n/\Omega$	φľn	$r_n/\Omega$	φľa	r <sub>n</sub> /Ω	φľn	$r_n/\Omega$	φr <sub>n</sub>	Hole Type	Spacing, s in.	, Fun KSI	$r_n/\Omega$	0In	$r_n/\Omega$	φľn	$r_n/\Omega$	φľn	$r_n/\Omega$	φľn
			ASD	LRFD	ASD	LRFD	ASD	LRFD	ASD	LRFD	DIGIT -	1 V V V V V V V V V V V V V V V V V V V		ASD	LRFD	ASD	LRFD	ASD	LRFD	ASD	LRFD
STD	2 <sup>2</sup> /3 db	<b>58</b> 65	34.1 .	51.1 57.3	41.3 46.3	62.0 69.5	48.6 54.4	72.9 81.7	55.8 62.6	83.7 93.8	EID	2 <sup>2/3</sup> d <sub>b</sub>	85 58	63.1 70.7	94.6 106	70.3	105 118	77.6 86.9	116 130	84.8 95.1	127 143
SSLT	3 in.	58 62	43.5 48.8	65.3 73.1	52.2 58.5	78.3 87.8	60.9 68.3	91.4 102	67.4 75.6	101	SSLT	3 in.	89	63.1 70.7	94.6 106	11	T-T	11	11	11	1.1
100	2 <sup>2/3</sup> db	58 65	27.6 30.9	41.3 46.3	34.8 39.0	52.2 58.5	42.1 47.1	63.1 70.7	47.1 52.8	70.7 79.2		2 <sup>2/3</sup> db		52.2 58.5	78.3 87.8	59.5 66.6	89.2 99.9	66.7 74.8	100 112	74.0 82.9	111 124
201	3 in.	58 65	43.5	65.3 73.1	52.2 58.5	78.3 87.8	60.9 68.3	91.4 102	58.7 65.8	88.1 98.7	SSLP	3 in.	88	52.2 58.5	78.3 87.8	11	1.1	11	11	11	11
ano	2 <sup>2</sup> / <sub>3</sub> d <sub>b</sub>	58 65	29.7 33.3	44.6 50.0	37.0 41.4	55.5 62.2	44.2 49.6	66.3 74.3	49.3 55.3	74.0 82.9		2 <sup>2/3</sup> db		54.4 60.9	81.6 91.4	61.6 69.1	92.4 104	68.9 77.2	103 116	76.1 85.3	114
5	3 in.	58 65	43.5 48.8	65.3 73.1	52.2 58.5	78.3 87.8	60.9 68.3	91.4 102	60.9 68.3	91.4 102	SVO	3 in.	83	54.4 60.9	81.6 91.4	11	Ē.	11		11	
	2 <sup>2</sup> / <sub>3</sub> d <sub>b</sub>	58 65	3.62 4.06	5.44 6.09	4.35	6.53 7.31	5.08 5.69	7.61 8.53	5.80 6.50	8.70 9.75		2 <sup>2/3</sup> db	-	6.53	9.79	7.25 8.13	10.9 12.2	7.98 8.94	12.0 13.4	8.70 9.75	13.1
LSL	3 in.	58 65	43.5 48.8	65.3 73.1	39.2 43.9	58.7 65.8	28.3 31.7	42.4 47.5	17.4 19.5	26.1 29.3	LSLP	3 in.	83 59	6.53	9.79		1-1	11	H	11	1. t.
1.01	2 <sup>2/3</sup> db	58 65	28.4 31.8	42.6 47.7	34.4 38.6	51.7 57.9	40.5 45.4	60.7 68.0	46.5 52.1	69.8 78.2		2 <sup>2/3</sup> db	-	52.6 58.9	78.8 88.4	58.6 65.7	87.9 98.5	64.6 72.4	97.0 109	70.7 79.2	106
רפרו	3 in.	58 65	36.3 40.6	54.4 60.9	43.5 48.8	65.3 73.1	50.8 56.9	76.1 85.3	56.2 63.0	84.3 94.5	L'SLI	3 in.	88 88	52.6 58.9	78.8 88.4	11	11	11	11	11	불소
STD, SSLT, SSLP, OVS, LSLP	S ≥ Sfull	82 82	43.5	65.3 73.1	52.2 58.5	78.3 87.8	60.9 68.3	91.4 102	69.6 78.0	104 117	STD, SSLT, SSLP, OVS, LSLP	; S≥Stull	# 58 #	78.3 87.8	117 132	87.0 97.5	131 146	95.7 107	144 161	104 117	157 176
LSLT	S ≥ Sfull	<b>58</b> 65	36.3 40.6	54.4 60.9	43.5 48.8	65.3 73.1	<b>50.8</b> 56.9	76.1 85.3	58.0 65.0	87.0 97.5	LISL1	S ≥ Sfull	// 58 65	65.3 73.1	97.9 110	72.5 81.3	109 122	79.8 89.4	120 134	87.0 97.5	131 146
Spacinç	Spacing for full	STD, SSLT, LSLT	1 <sup>15/16</sup>	<b>'</b> 16	25/	25/16	211	211/16	31	31/16	Spacin	Spacing for full	STD, SSLT, SSLT,		37/16	e	3 <sup>13/16</sup>	43	43/16	49/	49/16
bearing	bearing strength	SVO	21/16	91	27/16	16	213/16	16	31/4	/4	bearing	bearing strength	OVS		311/16	4	41/16	47	47/16	415	413/16
Stull	Stull <sup>a</sup> , IN.	SSLP	21/8		21/2	12	27/8	8	35	35/16	Stut	Stuil <sup>a</sup> , in.	SSLP		33/4	4	41/8	41	41/2	47/8	8
		LSLP	213/16	16	33/8	/8	315/16	<sup>16</sup>	4	41/2			LSLP		51/16	S	55/8	9	63/16	63/4	4
Minimum S	Minimum Spacing <sup>a</sup> = $2^2/_3d$ , in.	'/3d, in.	111/16	16	2		25/16	16	211/16	/16	Minimum	Minimum Spacing <sup>a</sup> = 2 <sup>2</sup> / <sub>3</sub> d, in.	2 <sup>2/3</sup> d, in.		3	3	35/16	3	311/16	4	
STD = standard hole SSLT = short-slotted h SSLP = short-slotted h	STD = standard hole SSLT = short-slotted hole oriented transverse to the line of force SSLP = short-slotted hole oriented parallel to the line of force	a oriented	ransverse harallel to	to the line the line of	tof force force					আৰু	STD = sta SSLT = sho SSLP = sho	STD = standard hole SSLT = short-slotted hole oriented transverse to the line of force $SSL = short-slotted hole oriented parallel to the line of force SSL = short-slotted$	tole orient	ed transver ed parallel	se to the I to the line	ine of force of force					
LSLP = long-slotted ho LSLT = long-slotted ho	UVS = oversized note LSLP = long-slotted hole oriented parallel to the line of force LSLT = long-slotted hole oriented transverse to the line of force	oriented p oriented tr	arailel to t ansverse t	ne line of 1 o the line	force of force					010	LSLP = lon LSLT = lon	Use = oversized note LSLP = long-slotted hole oriented parallel to the line of force LSLT = long-slotted hole oriented transverse to the line of force	e ole oriente ole oriente	d parailel t d transvers	o the line i se to the li	of force ne of force					
ASD	LRFD	Note: Spac	ing indicate	d is from th	e center of	the hole or	slot to the c	enter of the	adjacent h	ole or	ASD	LRFD	- ind	cates spacin	ig less than	- indicates spacing less than minimum spacing required per AISC Specification Section J3.3.	acing requi	red per AIS(	Specificati	In Section J	J3.3.
$\Omega = 2.00$	φ = 0.75	slot in the see AISC 5 a Decimal	pecification alue has bu	. Hole defor Section J3. en rounded	mation is c .10. I to the neal	onsidered. 1 rest sixteen	sion in the line of note, hole exponentiation is considered. When hole deformation is not considered, see AISC Specifications Section 13.10. * Decimal value has been rounded to the nearest succenth of an inch.	eformation	IS not cons	Odien	Ω = 2.00	-0	T	pacing indic the line of to C Specificau	ated is from rce. Hole de tion Section	Note: Spacing indicated is from the center of the hole or slot to the center of the adjacent hole or slot in the line of force. Hole deformation is considered. When hole deformation is not considered, see AISC Specification Section J3.10.	of the hole c considered	r slot to the When hole	center of th deformation	e adjacent l is not cons	hole c siderel

		le B Bas	Available Bearing Strength at Bolt Holes Based on Edge Distance kips/in. thickness	ng Streng on Edge s/in. thickr	ring Strength I on Edge Dis kips/in. thickness	gth Dist ness	h at Bo istance	solt	Hole	9	Av	Available Bearing Based on <sup>kips/ii</sup>	le Be Bas	ed o kip	n Ec	e Bearing Strength at Bolt Holes Based on Edge Distance kips/in. thickness	gth a Dist	at B anc	e olt h	lole	S
		a la anto	mail: 144	Rommal	Nomi	inal Bolt L	Nominal Bolt Diameter, d, in.	ď, in.				They are			Di Alla	Nomin	al Bolt Di	Nominal Bolt Diameter, d, in.	, in.		
Hole Tyne	Edge	F. kei		8/g		3/4	100	7/8	1	-	2	Edge		-	11/8	-	11/4		13/8	-	11/2
addit allow	Le, in.	icu (1)	$r_n/\Omega$	φľn	$r_n/\Omega$	¢ſn	$r_n/\Omega$	φ <i>l</i> n	r <sub>n</sub> /Ω	0fn	Hole Type	Distance / _ in.	F <sub>th</sub> ksi	r <sub>n</sub> /Ω	¢r <sub>n</sub>	r <sub>n</sub> /Ω	φľn	$r_n/\Omega$	φľn	$r_n/\Omega$	φĽ
Paso	124 2.43	11 DE	ASD	LRFD	ASD	LRFD	ASD	LRFD	ASD	LRFD		5		ASD	LRFD	ASD	LRFD	ASD	LRFD	ASD	LRFD
STD	11/4	88 59	31.5 35.3	47.3 53.0	29.4 32.9	44.0 49.4	27.2 30.5	40.8	25.0	37.5 42.0	UT0	11/4	88 59	22.8	34.3 38.4	20.7	31.0	18.5	27.7 31.1	16.3	24.5
SSLT	2	58 62	43.5 48.8	65.3 73.1	52.2 58.5	78.3 87.8	53.3 59.7	79.9 89.6	51.1 57.3	76.7 85.9	SSLT	2	8 88 18	48.9	73,4 82.3	46.8	70.1	44.6	66.9 75.0	42.4	63.6 71.3
100	11/4	83 83	28.3 31.7	42.4 47.5	26.1 29.3	39.2 43.9	23.9 26.8	35.9 40.2	20.7 23.2	31.0 34.7		11/4	8 88 19	17.4	26.1	15.2	22.8	13.1	19.6	10.9	16.3
200	2	85 58	43.5 48.8	65.3 73.1	52.2 58.5	78.3 87.8	50.0 56.1	75.0 84.1	46.8 52.4	70.1 78.6	SSLP	2	8 8 9	43.5	65.3 73.1	41.3	62.0	39.2	58.7 65.8	37.0	55.5 62.2
and	11/4	85 58	29.4 32.9	44.0 49.4	27.2 30.5	40.8 45.7	25.0 28.0	37.5 42.0	21.8 24.4	32.6 36.6		11/4	8 8 8	18.5	27.7 31.1	16.3	24.5 27.4	14.1	21.2	12.0	17.9
S	2	28 62	43.5 48.8	65.3 73.1	52.2 58.5	78.3 87.8	51.1 57.3	76.7 85.9	47.9 53.6	71.8 80.4	SVO	2	8 8 8	44.6	66.9 75.0	42.4	63.6	40.2	60.4 67.6	38.1 42.7	57.1
1	11/4	85 85	16.3 18.3	24.5 27.4	10.9 12.2	16.3 18.3	5.44 6.09	8.16 9.14	11	1-1	14	11/4	8 8 9		11	1	11		11	i	11
Lacr.	2	83 89	42.4 47.5	63.6 71.3	37.0	55.5 62.2	31.5 35.3	47.3 53.0	26.1 29.3	39.2 43.9	LISLP	2	8 8 8	20.7	31.0	15.2	22.8 25.6	9.79	14.7	4.35	6.53
L01	11/4	88 89	26.3 29.5	39.4 44.2	24.5 27.4	36.7 41.1	22.7 25.4	34.0 38.1	20.8 23.4	31.3 35.0		11/4	8 8 9	19.0	28.5 32.0	17.2	25.8	15.4	23.1	13.6	20.4
P	2	83 83	36.3 40.6	54.4 60.9	43.5 48.8	65.3 73.1	44.4 49.8	66.6 74.6	42.6 47.7	63.9 71.6	LSLT	2	8 8 8	40.8	61.2 68.6	39.0	58.5	37.2 41.6	55.7 62.5	35.3	53.0 59.4
STD, SSLT, SSLP, OVS, LSLP	Le ≥ Le tull	8 8	43.5 48.8	65.3 73.1	52.2 58.5	78.3 87.8	60.9 68.3	91.4 102	69.6 78.0	104 117	STD, SSLT, SSLP, OVS, I SI P	L <sub>e</sub> ≥ L <sub>e tull</sub>	8 8	78.3 87.8	117 132		131 146	95.7 107	144 161	104	157 176
LSLT	$L_{e} \ge L_{e} t_{ull}$	<b>58</b> 62	36.3 40.6	54.4 60.9	43.5 48.8	65.3 73.1	50.8 56.9	76.1 85.3	58.0 65.0	87.0 97.5	LSLT	Le≥ Le tull	58 65	65.3 73.1	97.9 110	72.5 81.3	109	79.8	120 134	87.0 97.5	131
Edge distance for full bearing	Edge distance for full bearing	STD, SSLT, LSLT	15/8	~	1	1 <sup>15/16</sup>	21/4	14	26	29/16	Edge di	Edge distance	SSLT, SSLT, LISLT	27/8		33	9	31/2		3 <sup>13/16</sup>	16
strength	igth	SVO	111/16	/16	2		25	25/16	25	25/8	strei	strength	SNO	e		35/16	9	35/8		3 <sup>15/16</sup>	/16
Le ≥ Le tult <sup>a</sup> , in.	tur <sup>a</sup> , in.	SSLP	111/16	/16	2		25	25/16	21	211/16	$L_{e} \geq L_{e}$	$L_e \ge L_e full^a$ , in.	SSLP	6	-	35/16	9	35/8		315/16	/16
No. 11		LSLP	21/16	9	2	27/16	27/8	18	31/4	14			LSLP	311/16	16	41/16	9	41/2		47/8	
STD = standard hole SSLT = short-slotted hi SSLP = short-slotted hi OVS = oversized hole LSLP = long-slotted ho LSLT = long-slotted ho	STD = standard hole SSLT = short-slotted hole oriented transverse to the line of force SSLT = short-slotted hole oriented parallel to the line of force OVS = oversized hole USLP = long-slotted hole oriented parallel to the line of force LSLT = long-slotted hole oriented transverse to the line of force	e oriented e oriented oriented 1	transverse parallel to parallel to t transverse t	to the lin the line of he line of to the line	e of force f force force of force						STD = stan SSLT = shor SSLP = shor OVS = over LSLP = long	STD = standard hole SSLT = short-slotted hole oriented transverse to the line of force SSLP = short-slotted hole oriented parallel to the line of force OVS = oversized hole LSLP = long-slotted hole oriented parallel to the line of force LSLP = long-slotted hole oriented transverse to the line of force	<ul> <li>oriented t</li> <li>oriented p</li> <li>oriented p</li> </ul>	ransverse arallel to 1 arallel to tt ansverse t	to the line the line of he line of f o the line	of force force orce of force		2 8 2458 to		ar raek Sasara	
ASD	LRFD	- indica		ess than m	inimum spa	cing require	ed per AISC	Specificatio	on Section .	13.3.	ASD	LRFD	- indicate	s spacing le	ess than mir	<ul> <li>indicates spacing less than minimum spacing required per AISC Specification Section J3.3.</li> </ul>	ng required	i per AISC	Specificatio	7 Section J3	.3.
Ω = 2.00	φ = 0.75	<ul> <li>Note: Spa slot in the see AISC</li> <li><sup>a</sup> Decimal</li> </ul>	Note: Spacing indicated is from the center of the hole or slot to the center of the adjacent hole of slot in the line of force. Hole eleformation is considered. When hole deformation is not considered, set AISC Specification Section 13.10. • Becrimat value has been rounded to the nearest sixteenth of an inch.	d is from the Add is from the Add is from the Section J3 Section J3	he center of irmation is c 1.10. d to the nea	the hole or onsidered.	when hole i with of an inc	center of tt. deformation th.	ne adjacent n is not cont	hole of sidered,	Ω = 2.00	φ = 0.75	Note: Spac slot in the l see AISC S	ing indicated ine of force. pecification	d is from th . Hole defor Section J3.	Note: Spacing indicated is from the center of the hole or slot to the center of the adjacent hole or slot in the line of force. Hole deformation is considered. When hole deformation is not considered, see AISC Specification Section 3.1.0. In Procrima visual has been municed to the nearest stremeth of an inch.	te hole or s nsidered. W	hen hole d	enter of the eformation	adjacent h is not consi	ole or dered,

## **Reinforced Concrete Design**

## Notation:

πυια	011.	
а	= depth of the effective compression	
	block in a concrete beam	
Α	= name for area	
$A_{g}$	gross area, equal to the total area	
0	ignoring any reinforcement	
$A_s$	= area of steel reinforcement in	
	concrete beam design	
$A'_s$	= area of steel compression	
	reinforcement in concrete beam	
	design	
$A_{st}$	= area of steel reinforcement in	
31	concrete column design	
$A_{v}$	= area of concrete shear stirrup	
v	reinforcement	
ACI	= American Concrete Institute	
b	= width, often cross-sectional	
$b_E$	= effective width of the flange of a	
0 L	concrete T beam cross section	
$b_f$	= width of the flange	
$b_w$	= width of the stem (web) of a	
υw	concrete T beam cross section	
сс	= shorthand for clear cover	
C	= name for centroid	
C	= name for a compression force	
$C_{c}$	= compressive force in the	
-1	compression steel in a doubly	
	reinforced concrete beam	
$C_s$	= compressive force in the concrete	
03	of a doubly reinforced concrete	
	beam	
d	= effective depth from the top of a	
	reinforced concrete beam to the	
	centroid of the tensile steel	
ď	= effective depth from the top of a	
	reinforced concrete beam to the	
	centroid of the compression steel	
$d_b$	= bar diameter of a reinforcing bar	
D	= shorthand for dead load	
DL	= shorthand for dead load	
Ε	= modulus of elasticity or Young's	
	modulus	
	= shorthand for earthquake load	
$E_c$	= modulus of elasticity of concrete	
$\tilde{E_s}$	= modulus of elasticity of steel	
f	= symbol for stress	
5	-	
		1

$f_c$	= compressive stress
f'c	= concrete design compressive stress
$f_{pu}$	= tensile strength of the prestressing reinforcement
£	= stress in the steel reinforcement for
$f_s$	
£I	concrete design
$f'_{s}$	= compressive stress in the
	compression reinforcement for
0	concrete beam design
$egin{array}{c} f_y \ F \end{array}$	= yield stress or strength
	= shorthand for fluid load
$F_y$	= yield strength
G	= relative stiffness of columns to
	beams in a rigid connection, as is $\Psi$
h	= cross-section depth
H	= shorthand for lateral pressure load
$h_{\!f}$	= depth of a flange in a T section
I <sub>trans</sub>	<i>formed</i> = moment of inertia of a multi-
	material section transformed to one
	material
k	= effective length factor for columns
$\ell_{b}$	= length of beam in rigid joint
$\ell_c$	= length of column in rigid joint
$l_d$	= development length for reinforcing
	steel
$l_{dh}$	= development length for hooks
$l_n$	= clear span from face of support to
	face of support in concrete design
L	= name for length or span length, as is
	l $l$ $l$
	= shorthand for live load
$L_r$	= shorthand for live roof load
LL	= shorthand for live load
$M_n$	= nominal flexure strength with the
	steel reinforcement at the yield
	stress and concrete at the concrete
	design strength for reinforced
	concrete beam design
$M_{\mu}$	= maximum moment from factored
·u	loads for LRFD beam design
n	= modulus of elasticity
-	transformation coefficient for steel
	to concrete
	a h arth and far neutral awis (N A)

n.a. = shorthand for neutral axis (N.A.)

pH	= chemical alkalinity	$W_{LL}$	= load per unit length on a beam from
Р	= name for load or axial force vector		live load
$P_o$	= maximum axial force with no	Wself	wt = name for distributed load from self
	concurrent bending moment in a		weight of member
	reinforced concrete column	Wu	= load per unit length on a beam from
$P_n$	= nominal column load capacity in		load factors
	concrete design	W	= shorthand for wind load
$P_u$	= factored column load calculated	х	= horizontal distance
	from load factors in concrete design		= distance from the top to the neutral
R	= shorthand for rain or ice load		axis of a concrete beam
$R_n$	= concrete beam design ratio =	у	= vertical distance
	$M_u/bd^2$	$\beta_1$	= coefficient for determining stress
S	= spacing of stirrups in reinforced	, 1	block height, a, based on concrete
	concrete beams		strength, $f'_c$
S	= shorthand for snow load	Δ	= elastic beam deflection
t	= name for thickness	21 8	= strain
Т	= name for a tension force	$\phi$	= resistance factor
	= shorthand for thermal load	•	
U	= factored design value	$\phi_{c}$	= resistance factor for compression
$V_c$	= shear force capacity in concrete	γ	= density or unit weight
$V_s$	= shear force capacity in steel shear	ρ	= radius of curvature in beam
	stirrups	<i>I</i> =	deflection relationships
$V_{u}$	= shear at a distance of $d$ away from		= reinforcement ratio in concrete
	the face of support for reinforced		
	concrete beam design	-	beam design = $A_s/bd$
$W_c$	= unit weight of concrete	$ ho_{\scriptscriptstyle bala}$	unced = balanced reinforcement ratio in
$W_{DL}$	= load per unit length on a beam from		concrete beam design
	dead load	$\upsilon_c$	= shear strength in concrete design

## **Reinforced Concrete Design**

Structural design standards for reinforced concrete are established by the *Building Code and Commentary (ACI 318-11)* published by the American Concrete Institute International, and uses **ultimate** strength design (also known as *limit state* design).

 $f_{\rm c}$  = concrete compressive design strength at 28 days (units of psi when used in equations)


## Materials

Concrete is a mixture of cement, coarse aggregate, fine aggregate, and water. The cement hydrates with the water to form a binder. The result is a hardened mass with "filler" and pores. There are various types of cement for low heat, rapid set, and other properties. Other minerals or cementitious materials (like fly ash) may be added.

### ASTM designations are

Type I:	Ordinary portland cement (OPC)
Type II:	Low temperature
Type III:	High early strength
Type IV:	Low-heat of hydration
Type V:	Sulfate resistant

The proper proportions, by volume, of the mix constituents determine strength, which is related to the water to cement ratio (w/c). It also determines other properties, such as workability of fresh concrete. Admixtures, such as retardants, accelerators, or superplasticizers, which aid flow without adding more water, may



be added. Vibration may also be used to get the mix to flow into forms and fill completely.

*Slump* is the measurement of the height loss from a compacted cone of fresh concrete. It can be an indicator of the workability.

Proper mix design is necessary for durability. The pH of fresh cement is enough to prevent reinforcing steel from oxidizing (rusting). If, however, cracks allow corrosive elements in water to penetrate to the steel, a corrosion cell will be created, the steel will rust, expand and cause further cracking. Adequate cover of the steel by the concrete is important.

Deformed reinforcing bars come in grades 40, 60 & 75 (for 40 ksi, 60 ksi and 75 ksi yield strengths). Sizes are given as # of 1/8" up to #8 bars. For #9 and larger, the number is a nominal size (while the actual size is larger).

Reinforced concrete is a composite material, and the average density is considered to be  $150 \text{ lb/ft}^3$ . It has the properties that it will creep (deformation with long term load) and shrink (a result of hydration) that must be considered.

## **Construction**


Because fresh concrete is a viscous suspension, it is cast or placed and *not poured*. Formwork must be able to withstand the hydraulic pressure. *Vibration* may be used to get the mix to flow around reinforcing bars or into tight locations, but excess vibration will cause segregation, honeycombing, and excessive *bleed* water which will reduce the water available for hydration and the strength, subsequently.


After casting, the surface must be worked. *Screeding* removes the excess from the top of the forms and gets a rough level. *Floating* is the process of working the aggregate under the surface and to "float" some paste to the surface. *Troweling* takes place when the mix has hydrated to the point of supporting weight and the surface is smoothed further and consolidated. *Curing* is allowing the hydration process to proceed with adequate moisture. Black tarps and curing compounds are commonly used. *Finishing* is the process of adding a texture, commonly by using a broom, after the concrete has begun to set.

Note Set 22.1

#### **Behavior**

Plane sections of composite materials can still be assumed to be plane (strain is linear), *but* the stress distribution *is not* the same in both materials because the *modulus of elasticity* is different. ( $f=E\cdot\epsilon$ )

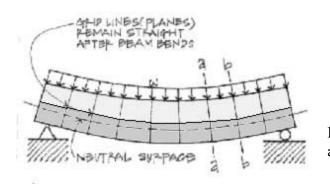

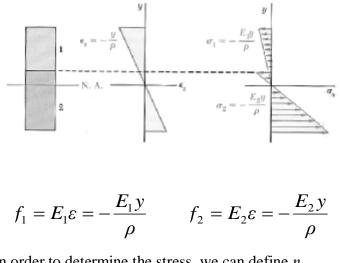


In order to determine the stress, we can define *n* as the ratio of the elastic moduli:  $n = \frac{E_2}{E_1}$ 

n is used to <u>transform</u> the <u>width</u> of the second material such that it sees the equivalent element stress.

#### Transformed Section y and I

In order to determine stresses in all types of material in the beam, we transform the materials into a single material, and calculate the location of the neutral axis and modulus of inertia for that material.

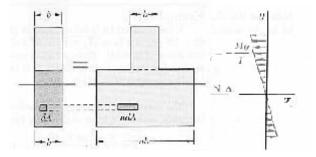

ex: When material 1 above is concrete and material 2 is steel

to transform steel into concrete 
$$n = \frac{E_2}{E_1} = \frac{E_{steel}}{E_{concrete}}$$

to find the neutral axis of the equivalent concrete member we transform the width of the steel by multiplying by n


to find the moment of inertia of the equivalent concrete member,  $I_{transformed}$ , use the new geometry resulting from transforming the width of the steel

concrete stress:  $f_{concrete} = -\frac{My}{I_{transformel}}$ 


steel stress:


$$f_{steel} = -\frac{Myn}{I_{transformel}}$$

#### Reinforced Concrete Beam Members




Stresses in the concrete above the neutral axis are compressive and nonlinearly distributed. In the tension zone below the neutral axis, the concrete is assumed to be cracked and the tensile force present to be taken up by reinforcing steel.






Working stress analysis. (Concrete stress distribution is assumed to be linear. Service loads are used in calculations.)

Actual stress distribution near ultimate strength (nonlinear).



Typical stress-strain curve for concrete,




Ultimate strength analysis. (A rectangular stress block is used to idealize the actual stress distribution. Calculations are based on ultimate loads and failure stresses.)


#### Ultimate Strength Design for Beams

The ultimate strength design method is similar to LRFD. There is a *nominal* strength that is reduced by a factor  $\phi$  which must exceed the factored design stress. For beams, the concrete only works in compression over a rectangular "stress" block above the n.a. from elastic calculation, and the steel is exposed and reaches the yield stress,  $F_y$ 

For stress analysis in reinforced concrete beams

- the steel is transformed to concrete
- any concrete in tension is assumed to be cracked and to have <u>no strength</u>
- the steel can be in tension, and is placed in the bottom of a beam that has positive bending moment

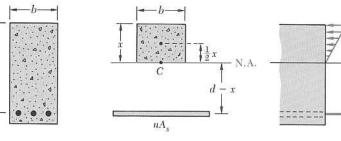






Figure 8.5: Bending in a concrete beam without and with steel reinforcing

F.

F2013abn

The neutral axis is where there is no stress and no strain. The concrete above the n.a. is in compression. The concrete below the n.a. is considered ineffective. The steel below the n.a. is in tension.

Because the n.a. is defined by the moment areas, we can solve for x knowing that d is the distance from the top of the concrete section to the centroid of the steel:  $bx \cdot \frac{x}{2} - nA_s(d-x) = 0$ 


x can be solved for when the equation is rearranged into the generic format with a, b & c in the

binomial equation:  $ax^2 + bx + c = 0$  by  $x = \frac{-b \pm \sqrt{b^2 - 4ac}}{2a}$ 

**T**-sections

If the n.a. is *above* the bottom of a flange in a T section, x is found as for a rectangular section.

If the n.a. is *below* the bottom of a flange in a T section, x is found by including the flange and the stem of the web  $(b_w)$  in the moment area calculation:




$$b_f h_f \left( x - \frac{h_f}{2} \right) + \left( x - h_f \right) b_w \frac{\left( x - h_f \right)}{2} - n A_s (d - x) = 0$$

Load Combinations (Alternative values are allowed)

1.4D 1.2D + 1.6L +0.5( $L_r$  or S or R) 1.2D + 1.6( $L_r$  or S or R) + (1.0L or 0.5W) 1.2D + 1.0W +1.0L + 0.5( $L_r$  or S or R) 1.2D + 1.0E + 1.0L + 0.2S 0.9D + 1.0W 0.9D + 1.0E

Bar size, no.	Nominal diameter, in.	Nominal area, in. <sup>2</sup>	Nominal weight lb/ft
3	0.375	. 0.11	0.376
4	0.500	0.20	0.668
5	0.625	0.31	1.043
6	0.750	0.44	1.502
7	0.875	0.60	2.044
8	1.000	0.79	2.670
9	1.128	1.00	3.400
10	1.270	1.27	4.303
11	1.410	1.56	5.313
14	1.693	2.25	7.650
18	2.257	4.00	13.600

#### Internal Equilibrium

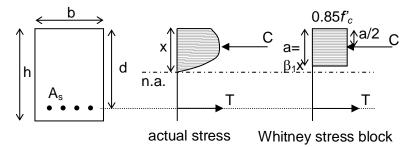

 $C = compression in concrete = stress x area = 0.85 f'_c ba$ 

T = tension in steel = stress x area = 
$$A_s f_y$$

$$C = T$$
 and  $M_n = T(d - a/2)$ 

where  $f'_c = \text{concrete compression strength}$  a = height of stress block  $\beta_1 = \text{factor based on } f'_c$  x = location to the neutral axis b = width of stress block  $f_y = \text{steel yield strength}$   $A_s = \text{area of steel reinforcement}$  d = effective depth of section = depth to n.a. of reinforcementWith C=T,  $A_s f_y = 0.85 f'_c ba$  so a can be determined with  $a = \frac{A_s f_y}{0.85 f'_c b}$ 

#### **Criteria for Beam Design**

For flexure design:

 $M_u \le \phi M_n$   $\phi = 0.9$  for flexure (when the section is <u>tension</u> controlled) so for design,  $M_u$  can be set to  $\phi M_n = \phi T(d-a/2) = \phi A_s f_v (d-a/2)$ 

#### Reinforcement Ratio

The amount of steel reinforcement is *limited*. Too much reinforcement, or **over-reinforcing** will not allow the steel to yield before the concrete crushes and there is a sudden failure. A beam with the proper amount of steel to allow it to yield at failure is said to be **under reinforced**.

The reinforcement ratio is just a fraction:  $\rho = \frac{A_s}{bd}$  (or p) and must be less than a value

determined with a concrete strain of 0.003 and tensile strain of 0.004 (minimum). When the strain in the reinforcement is 0.005 or greater, the section is **tension controlled**. (For smaller strains the resistance factor reduces to 0.65 – see tied columns - because the stress is less than the yield stress in the steel.) Previous codes limited the amount to  $0.75\rho_{balanced}$  where  $\rho_{balanced}$  was determined from the amount of steel that would make the concrete start to crush at the exact same time that the steel would yield based on strain.

## Flexure Design of Reinforcement

One method is to "wisely" estimate a height of the stress block, a, and solve for  $A_s$ , and calculate a new value for a using  $M_u$ .

1. guess *a* (less than n.a.)

$$2. \quad A_s = \frac{0.85 f_c' ba}{f_c}$$

3. solve for *a* from

setting 
$$M_{\mathcal{U}} = \phi A_{s} f_{y} (d - a/2)$$
:

$$a = 2 \left( d - \frac{M_u}{\phi A_s f_y} \right)$$

Maximum Rei	nforcemen	nt Ra	tio $\rho$ for S	Singly	y Reinforc	ed F	Rectangula	r Be	ams
(tensile strain	= 0.005) f	or wh	ich \u00f6 is pe	rmitt	ed to be 0.	9	-		
<i>C1</i>	2000	~	2500 .	<i>C1</i>	4000 .	<i>C1</i>	5000 ·	~1	6000

-	$f_c' = 3000 \text{ psi}$	$f_c' = 3500 \text{ psi}$	$f_c' = 4000 \text{ psi}$	$f'_{c} = 5000 \text{ psi}$	$f_c' = 6000 \text{ psi}$
$f_y$	$\beta_1 = 0.85$	$\beta_1 = 0.85$	$\beta_1 = 0.85$	$\beta_1 = 0.80$	$\beta_1 = 0.75$
40,000 psi	0.0203	0.0237	0.0271	0.0319	0.0359
50,000 psi	0.0163	0.0190	0.0217	0.0255	0.0287
60,000 psi	0.0135	0.0158	0.0181	0.0213	0.0239
	$f_c' = 20 \text{ MPa}$	$f_c' = 25 \text{ MPa}$	$f_c' = 30 \text{ MPa}$	$f_c' = 35 \text{ MPa}$	$f_c' = 40 \text{ MPa}$
$f_y$	$\beta_1 = 0.85$	$\beta_1 = 0.85$	$\beta_1 = 0.85$	$\beta_1 = 0.81$	$\beta_1 = 0.77$
300 MPa	0.0181	0.0226	0.0271	0.0301	0.0327
350 MPa	0.0155	0.0194	0.0232	0.0258	0.0281
400 MPa	0.0135	0.0169	0.0203	0.0226	0.0245
500 MPa	0.0108	0.0135	0.0163	0.0181	0.0196

from Reinforced Concrete, 7th,

4. repeat from 2. until *a* found from step 3 matches *a* used in step 2.

## Design Chart Method:

- 1. calculate  $R_n = \frac{M_n}{bd^2}$
- 2. find curve for  $f'_c$  and  $f_v$  to get  $\rho$
- 3. calculate  $A_s$  and a, where:

$$A_s = \rho bd$$
 and  $a = \frac{A_s f_y}{0.85 f_c' b}$ 

Any method can simplify the size of d using h = 1.1d

## Maximum Reinforcement

Based on the limiting strain of 0.005 in the steel, x(or c) = 0.375d so


 $a = \beta_1(0.375d)$  to find A<sub>s-max</sub> ( $\beta_1$  is shown in the table above)


## Minimum Reinforcement

Minimum reinforcement is provided even if the concrete can resist the tension. This is a means to control cracking.

Minimum required: 
$$A_s = \frac{3\sqrt{f_c'}}{f_y}(b_w d)$$
  
but not less than:  $A_s = \frac{200}{f_y}(b_w d)$   
where  $f_c'$  is in psi.  
 $A_s = \frac{200}{f_y}(b_w d)$   
This can be translated to  $\rho_{\min} = \frac{3\sqrt{f_c'}}{f}$  but not less than  $\frac{200}{f}$ 

where  $f_c'$  is in psi.

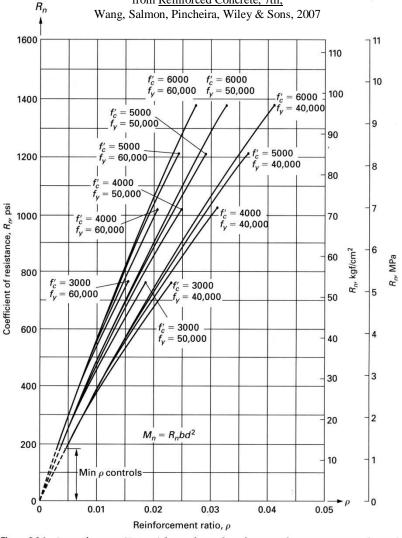




8

## Cover for Reinforcement

Cover of concrete over/under the reinforcement must be provided to protect the steel from corrosion. For indoor exposure, 1.5 inch is typical for beams and columns, 0.75 inch is typical for slabs, and for concrete cast against soil, 3 inch minimum is required.

## Bar Spacing

Minimum bar spacings are specified to allow proper consolidation of concrete around the reinforcement. The minimum spacing is the maximum of 1 in, a bar diameter, or 1.33 times the maximum aggregate size.



## T-beams and T-sections (pan joists)

Beams cast with slabs have an effective width,  $b_E$ , that sees compression stress in a wide flange beam or joist in a slab system with positive bending.

For *interior* T-sections,  $b_E$  is the smallest of L/4,  $b_w + 16t$ , or center to center of beams

For *exterior* T-sections,  $b_E$  is the smallest of  $b_w + L/12$ ,  $b_w + 6t$ , or  $b_w + \frac{1}{2}$  (clear distance to next beam)


When the **web** is in tension the minimum reinforcement required is the same as for rectangular sections with the web width  $(b_w)$  in place of b.

Compression zone

When the **flange** is in tension (negative bending), the minimum reinforcement required is the greater value of  $A_s = \frac{6\sqrt{f_c'}}{f_w}(b_w d)$  or  $A_s = \frac{3\sqrt{f_c'}}{f}(b_f d)$ 

where  $f'_c$  is in psi,  $b_w$  is the beam width, and  $b_f$  is the effective flange width

## Compression Reinforcement



$$C_s = A_s \, (f'_s - 0.85 f'_c)$$

The total compression that balances the tension is now:  $T = C_c + C_s$ . And the moment taken about the centroid of the compression stress is  $M_n = T(d-a/2) + C_s(a-d')$ 

where  $A_s$  is the area of compression reinforcement, and d is the effective depth to the centroid of the compression reinforcement

Because the compression steel may not be yielding, the neutral axis x must be found from the force equilibrium relationships, and the stress can be found based on strain to see if it has yielded.


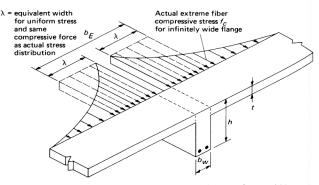


Figure 9.3.1 Actual and equivalent stress distribution over flange width.

Tension reinforcement



## Slabs

One way slabs can be designed as "one unit"wide beams. Because they are thin, control of deflections is important, and minimum depths are specified, as is minimum reinforcement for shrinkage and crack control when not in flexure. Reinforcement is commonly small diameter bars and welded wire fabric. Maximum spacing between bars is also specified for shrinkage and crack control as five times the slab thickness not exceeding 18". For required flexure reinforcement the spacing limit is three times the slab thickness not exceeding 18".

#### TABLE 9.5(a)—MINIMUM THICKNESS OF NONPRESTRESSED BEAMS OR ONE-WAY SLABS UNLESS DEFLECTIONS ARE COMPUTED

	Minimum t						
Simply sup- ported	One end continuous	Both ends continuous	Cantilever				
Members not supporting or attached to partitions or other construction likely to be damaged by large deflections.							
l/20	l/24	l/28	l /10				
Beams or ribbed one- way slabs $\ell/16$		l /21	l /8				
	Ported Members no other constr deflections. $\ell/20$	Simply supportedOne end continuousMembers not supporting of other construction likely to deflections. $\ell/20$ $\ell/24$	portedcontinuouscontinuousMembers not supporting or attached to other construction likely to be damaged deflections.edamaged $\ell/20$ $\ell/24$ $\ell/28$				

Values given shall be used directly for members with normalweight concrete and Grade 60 reinforcement. For other conditions, the values shall be modified as follows:

as for lightweight concrete having equilibrium density,  $w_c$ , in the range of 90 to 115 lb/ft<sup>3</sup>, the values shall be multiplied by  $(1.65 - 0.005w_c)$  but not less than 1.09.

b) For  $f_y$  other than 60,000 psi, the values shall be multiplied by  $(0.4 + f_y/100,000)$ .


Shrinkage and temperature reinforcement (and minimum for flexure reinforcement):

Minimum for slabs with grade 40 or 50 bars:

Minimum for slabs with grade 60 bars:

$$\rho = \frac{A_s}{bt} = 0.002 \quad or \quad A_{s-min} = 0.002bt$$
$$\rho = \frac{A_s}{bt} = 0.0018 \quad or \quad A_{s-min} = 0.0018bt$$

Horizontal shear stresses occur along with bending stresses to cause tensile stresses where the concrete cracks. Vertical reinforcement is required to bridge the cracks which are called shear stirrups (or stirrups).

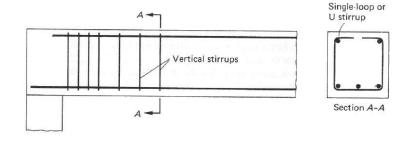

The maximum shear for design,  $V_u$  is the value at a distance of d from the face of the support.

# Nominal Shear Strength

The shear force that can be resisted is the shear stress  $\times$  cross section area:  $V_c = v_c \times b_w d$ 

The shear stress for beams (one way)  $v_c = 2\sqrt{f'_c}$  so  $\phi V_c = \phi 2\sqrt{f'_c} b_w d$  $b_w$  = the beam width or the minimum width of the stem. where  $\phi = 0.75$  for shear

One-way joists are allowed an increase of 10% V<sub>c</sub> if the joists are closely spaced.

Stirrups are necessary for strength (as well as crack control):  $V_s = \frac{A_v f_y d}{s} \le 8\sqrt{f'_c} b_w d(max)$ 

where  $A_v$  = area of all vertical legs of stirrup s = spacing of stirrups

d = effective depth

For shear design:

$$V_U \leq \phi V_C + \phi V_S$$
  $\phi = 0.75$  for shear

Spacing Requirements

Stirrups are required when V<sub>u</sub> is greater than  $\frac{\phi V_c}{2}$ 

		$V_{u} \leq \frac{\phi V_{c}}{2}$	$\phi V_c \ge V_u > \frac{\phi V_c}{2}$	$V_u > \phi V_c$
Required area of stirrups, Av**		none	50b <sub>w</sub> s f <sub>y</sub>	$\frac{(V_u - \phi V_c)s}{\phi f_y d}$
	Required	_	A <sub>v</sub> fy 50b <sub>w</sub>	$\frac{\phi A_v f_y d}{V_u - \phi V_c}$
	Recommended Minimum <sup>†</sup>	_	-	4 in.
Stirrup spacing, s	Maximum <sup>††</sup>	_	d or 24 in.	$\frac{d}{2}$ or 24 in. for $\left(V_{u} - \phi V_{c}\right) \le \phi 4 \sqrt{t_{c}} b_{w} d$
	(ACI 11.5.4)		<i>.</i>	$\frac{d}{4}$ or 12 in. for $\left(V_{u} - \phi V_{c}\right) > \phi 4 \sqrt{f_{c}'} b_{w} d$

Table 3-8 ACI Provisions for Shear Design\*

\*Members subjected to shear and flexure only;  $\phi V_c = \phi 2 \sqrt{f'_c} b_w d$ ,  $\phi = 0.75$  (ACI 11.3.1.1)

\*\*A<sub>v</sub> = 2 × A<sub>b</sub> for U stirrups;  $f_y \le 60$  ksi (ACI 11.5.2)


†A practical limit for minimum spacing is d/4

 $\uparrow\uparrow$ Maximum spacing based on minimum shear reinforcement (= A<sub>v</sub>f<sub>v</sub>/50b<sub>w</sub>) must also be considered (ACI 11.5.5.3).

Economical spacing of stirrups is considered to be greater than d/4. Common spacings of d/4, d/3 and d/2 are used to determine the values of  $\phi V_s$  at which the spacings can be increased.

 $\phi V_s = \frac{\phi A_v f_y d}{s}$ 

This figure shows the size of  $V_n$  provided by  $V_c + V_s$  (long dashes) exceeds  $V_u/\phi$  in a step-wise function, while the spacing provided (short dashes) is at or less than the required s (limited by the maximum allowed). (Note that the maximum shear permitted from the stirrups is  $8\sqrt{f'_c} b_w d$ )

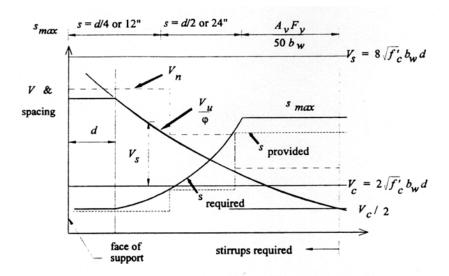

The minimum recommended spacing for the first stirrup is 2 inches from the face of the support.

# Torsional Shear Reinforcement

On occasion beam members will see twist along the axis caused by an eccentric shape supporting a load, like on an L-shaped spandrel (edge) beam. The torsion results in shearing stresses, and closed stirrups may be needed to resist the stress that the concrete cannot resist.




Fig. R11.6.3.6(b)-Definition of Aoh

# Development Length for Reinforcement

Because the design is based on the reinforcement attaining the yield stress, the reinforcement needs to be properly bonded to the concrete for a finite length (*both sides*) so it won't slip. This is referred to as the development length,  $l_d$ . Providing sufficient length to anchor bars that need to reach the yield stress near the end of connections are also specified by hook lengths. *Detailing reinforcement is a tedious job*. Splices are also necessary to extend the length of reinforcement that come in standard lengths. The equations are not provided here.

# Development Length in Tension

With the proper bar to bar spacing and cover, the common development length equations are:

#6 bars and smaller: 
$$l_d = \frac{d_b F_y}{25\sqrt{f'_c}}$$
 or 12 in. minimum  
#7 bars and larger:  $l_d = \frac{d_b F_y}{20\sqrt{f'_c}}$  or 12 in. minimum

Development Length in Compression

$$l_{d} = \frac{0.02d_{b}F_{y}}{\sqrt{f_{c}'}} \leq 0.0003d_{b}F_{y}$$

Hook Bends and Extensions

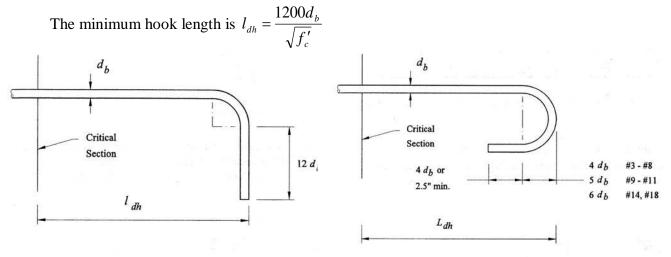


Figure 9-17: Minimum requirements for 90° bar hooks.

Figure 9-18: Minimum requirements for 180° bar hooks.

# Modulus of Elasticity & Deflection

 $E_c$  for deflection calculations can be used with the transformed section modulus in the elastic range. After that, the cracked section modulus is calculated and  $E_c$  is adjusted.

Code values:

 $E_c = 57,000\sqrt{f_c'}$  (normal weight)  $E_c = w_c^{1.5} 33\sqrt{f_c'}$ ,  $w_c = 90 \ lb/ft^3 - 160 \ lb/ft^3$ 

Deflections of beams and one-way slabs need not be computed if the overall member thickness meets the minimum specified by the code, and are shown in Table 9.5(a) (see *Slabs*).

# Criteria for Flat Slab & Plate System Design

Systems with slabs and supporting beams, joists or columns typically have multiple bays. The horizontal elements can act as one-way or two-way systems. Most often the flexure resisting elements are continuous, having positive and negative bending moments. These moment and shear values can be found using beam tables, or from code specified approximate design factors. Flat slab two-way systems have drop panels (for shear), while flat plates do not.

# Criteria for Column Design

(American Concrete Institute) ACI 318-02 Code and Commentary:

$P_u \leq \phi_c P_n$ where	$P_{u}$ is a factored load
	$\phi$ is a <u>resistance factor</u> P <sub>n</sub> is the <u>nominal load capacity (strength)</u>
Load combinations, ex:	1.4D (D is dead load) 1.2D + 1.6L (L is live load)


For compression,  $\phi_c = 0.75$  and  $P_n = 0.85P_o$  for spirally reinforced,  $\phi_c = 0.65$  and  $P_n = 0.8P_o$  for tied columns where  $P_o = 0.85f'_c(A_g - A_{st}) + f_yA_{st}$  and  $P_o$  is the name of the maximum axial force with no concurrent bending moment.

Columns which have reinforcement ratios,  $\rho_g = \frac{A_{st}}{A_g}$ , in the

range of 1% to 2% will usually be the most economical, with 1% as a minimum and 8% as a maximum by code.

Bars are symmetrically placed, typically.

Spiral ties are harder to construct.




# Columns with Bending (Beam-Columns)

Concrete columns rarely see only axial force and must be designed for the combined effects of axial load and bending moment. The **interaction** diagram shows the reduction in axial load a column can carry with a bending moment.

Design aids commonly present the interaction diagrams in the form of load vs. equivalent eccentricity for standard column sizes and bars used.

# **Rigid Frames**

Monolithically cast frames with beams and column elements will have members with shear, bending and axial loads. Because the joints can rotate, the effective length must be determined from methods like that presented in the handout on Rigid Frames. The charts for evaluating k for non-sway and sway frames can be found in the ACI code.

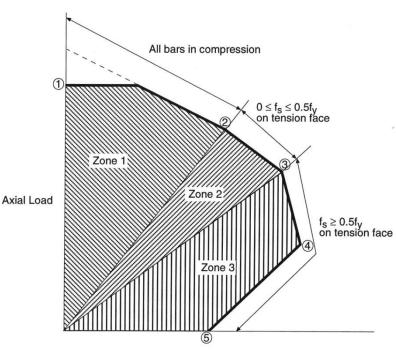

Bending Moment Figure 5-3 Transition Stages on Interaction Diagram

# Frame Columns

Because joints can rotate in frames, the effective length of the column in a frame is harder to determine. The stiffness (EI/L) of each member in a joint determines how rigid or flexible it is. To find k, the relative stiffness, G or  $\Psi$ , must be found for both ends, plotted on the alignment charts, and connected by a line for braced and unbraced fames.

$$G = \Psi = \frac{\Sigma \frac{EI}{l_c}}{\Sigma \frac{EI}{l_h}}$$


where


E = modulus of elasticity for a member

I = moment of inertia of for a member

 $l_{\rm c}$  = length of the column from center to center


- $l_{\rm b}$  = length of the beam from center to center
- For pinned connections we typically use a value of 10 for  $\Psi$ .
- For fixed connections we typically use a value of 1 for  $\Psi$ .



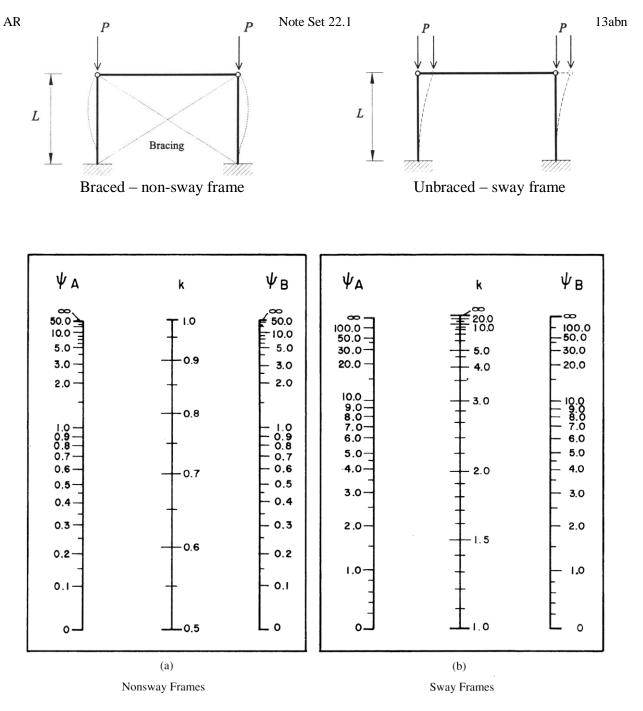



Determine the design moment capacity for the reinforced concrete cross section shown Assume  $f_c^{\prime} = 3000$  psi and Grade 60 reinforcing steel.



**Example 2** (a) Determine the ultimate moment capacity of a beam with dimensions b = 10 in. and  $d_{\text{effective}} = 15$  in. and that has three No. 9 bars  $(3.0 \text{ in.}^2)$  of tension-reinforcing steel. Assume that h = 18 in.,  $F_y = 40$  ksi, and  $f'_c = 5$  ksi. (b) Assume also that the section is used as a cantilever beam 10 ft long, where the service loads are dead load = 400 lb/ft and live load = 300 lb/ft. Is the beam adequate in bending? Calculate the ultimate moment capacity of the beam first.

#### Solution:

(a)  $a = A_s F_y / 0.85 f'_c b = (3)(40,000) / (0.85)(5000)(10) = 2.82$  in.  $\phi M_n = \phi A_s F_y [d - a/2] = 0.9(3)(40,000)[15 - (2.82)/(2)] = 1,466,640$  in.-lb

Check for overreinforcement,  $c = 0.375 \cdot 15 = 5.625$ . Depth of stress block  $a = 0.80 \cdot 5.625$  in. = 4.5 in.  $A_{s,max} = (0.85)(5\text{ksi})(4.5\text{in.})(10\text{in.})/(40\text{ksi}) = 4.78 \text{ in.}^2$  The beam is not over reinforced Check for minimum steel:  $A_{s,min} = \frac{3\sqrt{f'_c}}{F_y}bd = 0.80 \text{ in}^2$ , so beam is sufficiently reinforced.

(b)	U = 1.2D + 1.6L = 1.2(400) + 1.6(300) = 960  lb/ft
	$M_u = w_u L^2/2 = (960)(10^2)/2 = 48,000 \text{ ft-lb} = 576,000 \text{ inlb}$
Since	$M_{\mu} = 576,000 < \phi M_{\mu} = 1,466,640$ , the beam is adequate in bending.

#### EXAMPLE


Determine the ultimate moment capacity of a beam of dimensions b = 250 mm and d = 350 mm and that has 300 mm<sup>2</sup> of reinforcing steel. Assume that  $F_y = 400$  MPa and  $f'_c = 25$  MPa.

#### Solution:


$$a = \frac{A_s F_y}{0.85 f'_c b} = \frac{(300)(400)}{(0.85)(25)(250)} = 22.6 \text{ mm}$$
  
$$\phi M_n = \phi A_s F_y \left( d - \frac{a}{2} \right) = 0.9(300)(400) \left( 350 - \frac{22.6}{2} \right) = 36.5 \text{ kN} \cdot \text{m}$$

#### Example 3

**Example 1.** The service load bending moments on a beam are 58 kipft [78.6 kN-m] for dead load and 38 kip-ft [51.5 kN-m] for live load. The beam is 10 in. [254 mm] wide,  $f'_c$  is 3000 psi [27.6 MPa], and  $f_y$  is 60 ksi [414 MPa]. Determine the depth of the beam and the tensile reinforcing required.



Example 3 (continued)



A simply supported beam 20 ft long carries a service dead load of 300 lb/ft and a live load of 500 lb/ft. Design an appropriate beam (for flexure only). Use grade 40 steel and concrete strength of 5000 psi.

#### SOLUTION:

Find the design moment,  $M_u$ , from the factored load combination of 1.2D + 1.6L. It is good practice to guess a beam size to include self weight in the dead load, because "service" means dead load of everything except the beam itself.

Guess a size of 10 in x 12 in. Self weight for normal weight concrete is the density of 150 lb/ft<sup>3</sup> multiplied by the cross section area: self weight =  $150 \frac{1}{f_{13}} (10in)(12in) \cdot (\frac{1ft}{12in})^2 = 125 \text{ lb/ft}$ 

w<sub>u</sub> = 1.2(300 lb/ft + 125 lb/ft) + 1.6(500 lb/ft) = 1310 lb/ft

The maximum moment for a simply supported beam is  $\frac{wl^2}{8}$ :  $M_u = \frac{w_u l^2}{8} = \frac{1310^{1b}/_{ft} (20ft)^2}{8}$  65,500 lb-ft

 $M_n$  required =  $M_u/\phi = \frac{65,500^{lb-ft}}{0.9}$  = 72,778 lb-ft

To use the design chart aid, find  $R_n = \frac{M_n}{bd^2}$ , estimating that d is about 1.75 inches less than h:

d = 12in - 1.75 in - (0.375) = 10.25 in (NOTE: If there are stirrups, you must also subtract the diameter of the stirrup bar.)

$$R_{n} = \frac{72,778^{lb-ft}}{(10in)(10.25in)^{2}} \cdot (12^{in}/_{ft}) = 831 \text{ psi}$$

 $\rho$  corresponds to approximately 0.023 (which is less than that for 0.005 strain of 0.0319), so the estimated area required, A<sub>s</sub>, can be found:

 $A_s = \rho bd = (0.023)(10in)(10.25in) = 2.36 in^2$ 

The number of bars for this area can be found from handy charts.

(Whether the number of bars actually fit for the width with cover and space between bars <u>must also be considered</u>. If you are at  $\rho_{max} \underline{do not}$  choose an area bigger than the maximum!)

Try  $A_s = 2.37$  in<sup>2</sup> from 3#8 bars

d = 12 in -1.5 in (cover)  $-\frac{1}{2}$  (8/8in diameter bar) = 10 in

Check  $\rho = 2.37$  in<sup>2</sup>/(10 in)(10 in) = 0.0237 which is less than  $\rho_{max-0.005} = 0.0319$  OK (We cannot have an over reinforced beam!!)

Find the moment capacity of the beam as designed,  $\varphi M_n$ 

$$\begin{aligned} &\mathsf{a} = \mathsf{A}_{s} \mathsf{f}_{y} / 0.85 \mathsf{f}_{c} \mathsf{b} = 2.37 \text{ in}^{2} (40 \text{ ksi}) / [0.85(5 \text{ ksi})10 \text{ in}] = 2.23 \text{ in} \\ &\phi \mathsf{M}_{n} = \phi \mathsf{A}_{s} \mathsf{f}_{y} (\mathsf{d} \text{-a}/2) = 0.9 (2.37 \text{ in}^{2}) (40 \text{ ksi}) (10 \text{ in} - \frac{2.23 \text{ in}}{2}) \cdot (\frac{1}{12^{\text{in}} \gamma_{\text{fr}}}) = 63.2 \text{ k-ft} \neq 65.5 \text{ k-ft needed} \text{ (not OK)} \end{aligned}$$

So, we can increase d to 13 in, and  $\phi M_n = 70.3$  k-ft (OK). Or increase A<sub>s</sub> to 2 # 10's (2.54 in<sup>2</sup>), for a = 2.39 in and  $\phi M_n$  of 67.1 k-ft (OK). <u>Don't exceed  $\rho_{max}$  or  $\rho_{max-0.005}$  if you want to use  $\phi=0.9$ </u>

A simply supported beam 20 ft long carries a service dead load of 425 lb/ft (including self weight) and a live load of 500 lb/ft. Design an appropriate beam (for flexure only). Use grade 40 steel and concrete strength of 5000 psi.

#### SOLUTION:

Find the design moment,  $M_u$ , from the factored load combination of 1.2D + 1.6L. If self weight is not included in the service loads, you need to guess a beam size to include self weight in the dead load, because "service" means dead load of everything except the beam itself.

w<sub>u</sub> = 1.2(425 lb/ft) + 1.6(500 lb/ft) = 1310 lb/ft

The maximum moment for a simply supported beam is  $\frac{wl^2}{8}$ :  $M_u = \frac{w_u l^2}{8} = \frac{1310^{lb}/f_{fl}(20ft)^2}{8}$  65,500 lb-ft

 $M_n$  required =  $M_u/\phi = \frac{65,500^{lb-ft}}{0.9} = 72,778$  lb-ft

To use the design chart aid, we can find  $R_n = \frac{M_n}{bd^2}$ , and estimate that h is roughly 1.5-2 times the size of b, and h = 1.1d (rule of thumb): d = h/1.1 = (2b)/1.1, so  $d \approx 1.8b$  or  $b \approx 0.55d$ .

We can find  $R_n$  at the maximum reinforcement ratio for our materials, keeping in mind  $\rho_{max}$  at a strain = 0.005 is 0.0319 off of the chart at about 1070 psi, with  $\rho_{max}$  = 0.037. Let's substitute b for a function of d:

$$R_n = 1070 \text{ psi} = \frac{72,778^{lb-ft}}{(0.55d)(d)^2} \cdot (12^{in/ft})$$
 Rearranging and solving for d = 11.4 inches

That would make b a little over 6 inches, which is impractical. 10 in is commonly the smallest width.

So if h is commonly 1.5 to 2 times the width, b, h ranges from 14 to 20 inches. (10x1.5=15 and 10x2=20)

Choosing a depth of 14 inches, d  $\cong$  14 - 1.5 (clear cover) -  $\frac{1}{2}(1)^{2}$  diameter bar guess) -3/8 in (stirrup diameter) = 11.625 in.

Now calculating an updated R<sub>n</sub> =  $\frac{72,778^{b-ft}}{(10in)(11625in)^2} \cdot (12in/ft) = 646.2psi$ 

 $\rho$  now is 0.020 (under the limit at 0.005 strain of 0.0319), so the estimated area required, A<sub>s</sub>, can be found:

 $A_s = \rho bd = (0.020)(10in)(11.625in) = 1.98 in^2$ 

The number of bars for this area can be found from handy charts. (Whether the number of bars actually fit for the width with cover and space between bars <u>must also be considered</u>. If you are at  $\rho_{max-0.005}$  <u>do not</u> choose an area bigger than the maximum!)

Try  $A_s = 2.37 \text{ in}^2$  from 3#8 bars. (or 2.0 in<sup>2</sup> from 2 #9 bars. 4#7 bars don't fit...)

d(actually) = 14 in. - 1.5 in (cover) - 1/2 (8/8 in bar diameter) - 3/8 in. (stirrup diameter) = 11.625 in.

Check  $\rho$  = 2.37 in<sup>2</sup>/(10 in)(11.625 in) = 0.0203 which is less than  $\rho_{max-0.005}$  = 0.0319 OK (We cannot have an over reinforced beam!!)

Find the moment capacity of the beam as designed,  $\phi M_n$ 

a = A<sub>s</sub>f<sub>y</sub>/0.85f'<sub>c</sub>b = 2.37 in<sup>2</sup> (40 ksi)/[0.85(5 ksi)10 in] = 2.23 in  

$$\phi$$
M<sub>n</sub> =  $\phi$ A<sub>s</sub>f<sub>y</sub>(d-a/2) = 0.9(2.37in<sup>2</sup>)(40ksi)(11.625in -  $\frac{2.23in}{2}$ )  $\cdot (\frac{1}{12^{in_{4}'}}) = 74.7$  k-ft > 65.5 k-ft needed

**OK!** <u>Note</u>: If the section doesn't work, you need to increase d or  $A_s$  as long as you don't exceed  $\rho_{max-0.005}$ 

A simply supported beam 25 ft long carries a service dead load of 2 k/ft, an estimated self weight of 500 lb/ft and a live load of 3 k/ft. Design an appropriate beam (for flexure only). Use grade 60 steel and concrete strength of 3000 psi.

#### SOLUTION:

Find the design moment,  $M_u$ , from the factored load combination of 1.2D + 1.6L. If self weight is estimated, and the selected size has a larger self weight, the design moment must be adjusted for the extra load.

 $w_{u} = 1.2(2 \text{ k/ft} + 0.5 \text{ k/ft}) + 1.6(3 \text{ k/ft}) = 7.8 \text{ k/ft} \qquad \text{So, } M_{u} = \frac{w_{u}l^{2}}{8} = \frac{7.8 \frac{k}{ft}(25 ft)^{2}}{8} 609.4 \text{ k-ft}$  $M_{n} \text{ required} = M_{u}/\phi = \frac{609.4^{k-ft}}{0.8} = 677.1 \text{ k-ft}$ 

To use the design chart aid, we can find  $R_n = \frac{M_n}{bd^2}$ , and estimate that h is roughly 1.5-2 times the size of b, and h = 1.1d (rule of thumb): d = h/1.1 = (2b)/1.1, so  $d \approx 1.8b$  or  $b \approx 0.55d$ .

We can find  $R_n$  at the maximum reinforcement ratio for our materials off of the chart at about 700 psi with  $\rho_{max-0.005}$  = 0.0135. Let's substitute b for a function of d:

 $R_{n} = 700 \text{ psi} = \frac{677.1^{k-ft} (1000^{lb/k})}{(0.55d)(d)^{2}} \cdot (12^{in/ft})$ 

Rearranging and solving for d = 27.6 inches

That would make b 15.2 in. (from 0.55d). Let's try 15. So,

 $h \simeq d + 1.5$  (clear cover) +1/2(1" diameter bar guess) +3/8 in (stirrup diameter) = 27.6 +2.375 = 29.975 in.

Choosing a depth of 30 inches,  $d \cong 30 - 1.5$  (clear cover) -  $\frac{1}{2}(1^{\circ})$  diameter bar guess) -3/8 in (stirrup diameter) = 27.625 in.

Now calculating an updated  $R_n = \frac{677,10d^{b-ft}}{(15in)(27625in)^2} \cdot (12in_{ft}) = 710psi$  This is larger than  $R_n$  for the 0.005 strain limit!

We can't just use  $\rho_{max-.005}$ . The way to reduce  $R_n$  is to increase b or d or both. Let's try increasing h to 31 in., then  $R_n = 661$  psi with d = 28.625 in. That puts us under  $\rho_{max-0.005}$ . We'd have to remember to keep UNDER the area of steel calculated, which is hard to do.

From the chart,  $\rho \approx 0.013$ , less than the  $\rho_{max\cdot0.005}$  of 0.0135, so the estimated area required, A<sub>s</sub>, can be found: A<sub>s</sub> =  $\rho$ bd = (0.013)(15in)(29.625in) = 5.8 in<sup>2</sup>

The number of bars for this area can be found from handy charts. Our charts say there can be 3 - 6 bars that fit when  $\frac{3}{4}$ " aggregate is used. We'll assume 1 inch spacing between bars. The actual limit is the maximum of 1 in, the bar diameter or 1.33 times the maximum aggregate size.


Try  $A_s = 6.0$  in<sup>2</sup> from 6#9 bars. Check the width: 15 - 3 (1.5 in cover each side) - 0.75 (two #3 stirrup legs) - 6\*1.128 - 5\*1.128 in. = -1.16 in NOT OK. Try  $A_s = 5.08$  in<sup>2</sup> from 4#10 bars. Check the width: 15 - 3 (1.5 in cover each side) - 0.75 (two #3 stirrup legs) - 4\*1.27 - 3\*1.27 in. = 2.36 OK. d(actually) = 31 in. - 1.5 in (cover)  $- \frac{1}{2}$  (1.27 in bar diameter) - 3/8 in. (stirrup diameter) = 28.49 in.

Find the moment capacity of the beam as designed,  $\varphi M_n$ 

a = 
$$A_{sfy}/0.85f'_{cb}$$
 = 5.08 in<sup>2</sup> (60 ksi)/[0.85(3 ksi)15 in] = 8.0 in  
 $\phi M_n = \phi A_{sfy}(d-a/2) = 0.9(5.08ir^2)(60ksi)(28.49in - \frac{8.0in}{2}) \cdot (\frac{1}{12i'_{tt}}) = 559.8 \text{ k-ft} < 609 \text{ k-ft} needed!! (NO GOOD)$ 

More steel isn't likely to increase the capacity much unless we are close. It looks like we need more steel **and** lever arm. Try h = 32 in. AND b = 16 in., then  $M_u^*$  (with the added self weight of 33.3 lb/ft) = 680.2 k-ft,  $\rho \approx 0.012$ , As = 0.012(16in)(29.42in)=5.66 in<sup>2</sup>. 6#9's won't fit, but 4#11's will:  $\rho = 0.0132 \checkmark$ , a = 9.18 in, and  $\phi M_n = 697.2$  k-ft which is finally larger than 680.2 k-ft **OK** 

**Example 3.** A T-section is to be used for a beam to resist positive moment. The following data are given: beam span is 18 ft [5.49 m], beams are 9 ft [2.74 m] center to center, slab thickness is 4 in. [0.102 m], beam stem dimensions are  $b_w = 15$  in. [0.381 m] and d = 22 in. [0.559 m],  $f'_c = 4$  ksi [27.6 MPa],  $f_v = 60$  ksi [414 MPa]. Find the required area of steel and select the reinforcing bars for a dead load moment of 125 kip-ft [170 kN-m] plus a live load moment of 100 kip-ft [136 kN-m].



(O.K.)

(O.K.)

#### Example 8

Design a T-beam for a floor with a 4 in slab supported by 22-ft-span-length beams cast monolithically with the slab. The beams are 8 ft on center and have a web width of 12 in. and a total depth of 22 in.;  $f'_c = 3000$  psi and  $f_y = 60$  ksi. Service loads are 125 psf and 200 psf dead load which does not include the weight of the floor system.

#### SOLUTION:

1. Establish the design moment:

slab weight = 
$$\frac{96(4)}{144}(0.150) = 0.400 \text{ kip/ft}$$

stem weight = 
$$\frac{12(18)}{144}(0.150) = 0.225$$

total = 0.625 kip/ft

service DL = 8(0.200) = 1.60 kips/ft

service 
$$LL = 8(0.125) = 1.00 \text{ kip/ft}$$

Calculate the factored load and moment:

$$w_u = 1.2(0.625 + 1.60) + 1.6(1.00) = 4.27 \text{ kip/fm}$$

$$M_u = \frac{w_u \ell^2}{8} = \frac{4.27(22)^2}{8} = 258 \text{ ft-kips}$$

2. Assume an effective depth d = h - 3 in.:

$$d = 22 - 3 = 19$$
 in.

3. Determine the effective flange width:

 $\frac{1}{4}$  span length = 0.25(22)(12) = 66 in.  $b_w + 16h_f = 12 + 16(4) = 76$  in. beam spacing = 96 in.

Use an effective flange width b = 66 in.

4. Determine whether the beam behaves as a true T-beam or as a rectangular beam by computing the practical moment strength  $\phi M_{nf}$  with the full effective flange assumed to be in compression. This assumes that the bottom of the compressive stress block coincides with the bottom of the flange, as shown in Figure 3-10. Thus

$$\phi M_{nf} = \phi(0.85f_c')bh_f\left(d - \frac{h_f}{2}\right)$$
$$= 0.9(0.85)(3)(66)\frac{4(19 - 4/2)}{12} = 858 \text{ ft-kips}$$

- 5. Since 858 ft-kips >258 ft-kips, the total effective flange need not be completely utilized in compression (i.e.,  $a < h_f$ ), and the T-beam behaves as a wide rectangular beam with a width b of 66 in.
- 6. Design as a rectangular beam with *b* and *d* as known values (see Section 2-15):

required 
$$R_n = \frac{M_u}{\phi b d^2} = \frac{258(12)}{0.9(66)(19)^2} = 0.1444$$
 ksi

7. From Table A-8, select the required steel ratio to provide a  $R_n$  of 0.1444 ksi

required  $\rho = 0.0024$ 

8. Calculate the required steel area:  
required 
$$A_s = \rho bd$$
  
= 0.0024(66)(19) = 3.01 in.<sup>2</sup>

9. Select the steel bars. Use  $3#9 (A_s = 3.00 \text{ in.}^2)$ 

minimum 
$$b_w = 7.125$$
 in

Check the effective depth *d*:

$$d = 22 - 1.5 - 0.38 - \frac{1.125}{2} = 19.56$$
 in.

19.49 in. > 19 in.

10. Check 
$$A_{s,\min}$$
. From Table A-5:

$$A_{s,\min} = 0.0033 b_w d$$
  
= 0.0033(12)(19) = 0.75 in.<sup>2</sup>

$$0.75 \text{ in.}^2 < 3.00 \text{ in}^2$$

11. Check 
$$A_{s,max}$$
:

$$A_{s,\max} = 0.0135(66)(19)$$
  
= 16.93 in.<sup>2</sup> > 3.00 in.<sup>2</sup> (O.K)

12. Verify the moment capacity:  
(Is 
$$M_u \le \phi M_n$$
)

$$a = (3.00)(60)/[0.85(3)(66)] = 1.07 \text{ m.}$$
  

$$\phi M_n = 0.9(3.00)(-60)(19.56 - \frac{1.07}{2}) \frac{1}{12}$$
  

$$= 256.9.1 \text{ ft-kips} \qquad (Not O.K)$$

Choose more steel,  $A_s = 3.16 \text{ in}^2 \text{ from } 4\text{-}\#8\text{'s}$ 

d = 19.62 in, a = 1.13 in

$$\phi M_n = 271.0$$
 ft-kips, which is OK

#### 13. Sketch the design

Design a T-beam for the floor system shown for which  $b_w$  and d are given.  $M_D = 200$  ft-k,  $M_L = 425$  ft-k,  $f'_c = 3000$  psi and  $f_v = 60$  ksi, and simple span = 18 ft.

#### **SOLUTION**

#### Effective Flange Width

(a)  $\frac{1}{4} \times 18' = 4'6'' = 54''$ (b) 15'' + (2)(8)(3) = 63''(c) 6'0'' = 72''

Moments Assuming  $\phi = 0.90$ 

$$M_u = (1.2)(200) + (1.6)(425) = 920$$
 ft-k  
 $M_n = \frac{M_u}{0.90} = \frac{920}{0.90} = 1022$  ft-k

First assume  $a \le h_f$  (which is very often the case). Then the design would proceed like that of a rectangular beam with a width equal to the effective width of the T beam flange.

$$\frac{M_u}{\phi b d^2} = \frac{920(12,000)}{(0.9)(54)(24)^2} = 394.4 \text{ psi}$$
  
from Table A.12,  $\rho = 0.0072$   
$$a = \frac{\rho f_y d}{0.85 f_c} = \frac{0.0072(60)(24)}{(0.85)(3)} = 4.06 \text{ in.} > h_f = 3 \text{ in}$$

The beams acts like a T beam, not a rectangular beam, and the values for  $\rho$  and a above are not correct. If the value of a had been  $\leq h_f$ , the value of  $A_s$  would have been simply  $\rho bd = 0.0072(54)(24) = 9.33 \text{ in}^2$ . Now break the beam up into two parts (Figure 5.7) and design it as a T beam.

Assuming  $\phi = 0.90$ 

$$A_{sf} = \frac{(0.85)(3)(54 - 15)(3)}{60} = 4.97 \text{ in.}^2$$
$$M_{uf} = (0.9)(4.97)(60)(24 - \frac{3}{2}) = 6039 \text{ in.-k} = 503 \text{ ft-k}$$
$$M_{uv} = 920 - 503 = 417 \text{ ft-k}$$

Designing a rectangular beam with  $b_w = 15$  in. and d = 24 in. to resist 417 ft-k

$$\frac{M_{uw}}{\phi b_w d^2} = \frac{(12)(417)(1000)}{(0.9)(15)(24)^2} = 643.5$$

$$\rho_w = 0.0126 \text{ from Appendix Table A.12}$$

$$A_{sw} = (0.0126)(15)(24) = 4.54 \text{ in.}^2$$

$$A_{s} = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = \text{effective width}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.97 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.95 + 4.54 = 9.51 \text{ in.}^{2}$$

$$\downarrow = 4.54 + 4.54 = 9.54 \text{ in.}^{2}$$


$$\downarrow = 4.54 + 4.54 = 9.54 \text{ in.}^{2}$$

$$\downarrow = 4.54 + 4.54 = 9.54 \text{ in.}^{2}$$

$$\downarrow = 4.54 + 4.54 = 9.54 \text{ in.}^{2}$$

$$\downarrow = 4.54 + 4.54 = 9.54 \text{ in.}^{2}$$

Figure 5.7 Separation of T beam into rectangular parts.

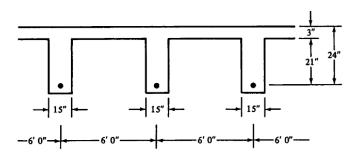

**Example 6.** A one-way solid concrete slab is to be used for a simple span of 14 ft [4.27 m]. In addition to its own weight, the slab carries a super-imposed dead load of 30 psf [1.44 kPa] plus a live load of 100 psf [4.79 kPa]. Using  $f'_c = 3$  ksi [20.7 MPa] and  $f_y = 40$  ksi [276 MPa], design the slab for minimum overall thickness.




TABLE 13.6 Areas Provided By Spaced Reinforcement

Bar Spacing	Area Provided (in. <sup>2</sup> /ft width)									
(in.)	No. 3	No. 4	No. 5	No. 6	No. 7	No. 8	No. 9	No. 10	No. 11	
3	0.44	0.80	1.24	1.76	2.40	3.16	4.00			
3.5	0.38	0.69	1.06	1.51	2.06	2.71	3.43	4.35		
4	0.33	0.60	0.93	1.32	1.80	2.37	3.00	3.81	4.68	
4.5	0.29	0.53	0.83	1.17	1.60	2.11	2.67	3.39	4.16	
5	0.26	0.48	0.74	1.06	1.44	1.89	2.40	3.05	3.74	
5.5	0.24	0.44	0.68	0.96	1.31	1.72	2.18	2.77	3.40	
6	0.22	0.40	0.62	0.88	1.20	1.58	2.00	2.54	3.12	
7	0.19	0.34	0.53	0.75	1.03	1.35	1.71	2.18	2.67	
8	0.16	0.30	0.46	0.66	0.90	1.18	1.50	1.90	2.34	
9	0.15	0.27	0.41	0.59	0.80	1.05	1.33	1.69	2.08	
10	0.13	0.24	0.37	0.53	0.72	0.95	1.20	1.52	1.87	
11	0.12	0.22	0.34	0.48	0.65	0.86	1.09	1.38	1.70	
12	0.11	0.20	0.31	0.44	0.60	0.79	1.00	1.27	1.56	
13	0.10	0.18	0.29	0.40	0.55	0.73	0.92	1.17	1.44	
14	0.09	0.17	0.27	0.38	0.51	0.68	0.86	1.09	1.34	
15	0.09	0.16	0.25	0.35	0.48	0.63	0.80	1.01	1.25	
16	0.08	0.15	0.23	0.33	0.45	0.59	0.75	0.95	1.17	
18	0.07	0.13	0.21	0.29	0.40	0.53	0.67	0.85	1.04	
24	0.05	0.10	0.15	0.22	0.30	0.39	0.50	0.63	0.78	

#### nple 2-9

Design a simple-span one-way slab to carry a uniformly distributed live load of 400 psf. The span is 10 ft (center to center of supports). Use  $f'_c = 4000$  psi and  $f_y = 60,000$  psi. Select the thickness to be not less than the ACI minimum thickness requirement.

#### Solution:

2.

Determine the required minimum h and use this to estimate the slab dead weight.

1. From ACI Table 9.5(a), for a simply supported, solid, one-way slab,

minimum 
$$h = \frac{\ell}{20} = \frac{10(12)}{20} = 6.0$$
 in.

Try h = 6 in. and design a 12-in.-wide segment. Determine the slab weight dead load:

$$\frac{6(12)}{144}(0.150) = 0.075 \text{ kip/ft}$$

The total design load is

$$u = 1.2w_{DL} + 1.6w_{LL}L$$
  
= 1.2(0.075) + 1.6(0.400)  
= 0.730 kip/ft

3. Determine the design moment:

w

$$M_u = \frac{w_u \ell^2}{8} = \frac{0.73(10)^2}{8} = 9.125 \text{ ft-kips}$$

4. Establish the approximate *d*. Assuming No. 6 bars and minimum concrete cover on the bars of ¼ in.,

assumed 
$$d = 6.0 - 0.75 - 0.375 = 4.88$$
 in

5. Determine the required  $R_n$ :

required 
$$R_n = \frac{M_u}{\phi b d^2}$$
  
=  $\frac{9.125(12)}{0.9(12)(4.88)^2} = 0.4257$  ksi

6. From Table A-10, for a required  $R_n = 0.4257$ , the required  $\rho = 0.0077$ . (Note that the required  $\rho$  selected is the next *higher* value from Table A-10.) Thus

$$\rho_{\rm max} = 0.0181 > 0.0077 \tag{O.K.}$$

Use  $\rho = 0.0077$ .

7. required 
$$A_s = \rho b d = 0.0077(12)(4.88) = 0.45 \text{ in.}^2/\text{fm}$$

8. Select the main steel (from Table A-4). Select No. 5 bars at 7½ in. o.c.  $(A_s = 0.50 \text{ in.}^2)$ . The assumption on bar size was satisfactory. The code requirements for maximum spacing have been discussed in Section 2-13. Minimum spacing of bars in slabs, practically, should not be less than 4 in.. although the ACI Code allows bars to be placed closer together, as discussed in Example 2-7. Check the maximum spacing (ACI Code, Section 7.6.5):

maximum spacing = 3h or 18 in.

$$3h = 3(6) = 18$$
 in

$$7\%$$
 in. < 18 in. (O.K.)

Therefore use No. 5 bars at 7½ in. o.c.

9. Select shrinkage and temperature reinforcement (ACI Code, Section 7.12):

required 
$$A_s = 0.0018bh$$

$$= 0.0018(12)(6) = 0.13 \text{ in.}^2/\text{ft}$$

Select No. 3 bars at 10 in. o.c.  $(A_s = 0.13 \text{ in.}^2)$  or No. 4 bars at 18 in. o.c.  $(A_s = 0.13 \text{ in.}^2)$ :

maximum spacing = 5h or 18 in.

Use No. 3 bars at 10 in. o.c.

10.

Note Set 22.1


The main steel area must exceed the area required for shrinkage and temperature steel (ACI Code, Section 10.5.4):

$$0.50 \text{ in.}^2 > 0.13 \text{ in.}^2$$
 (O.K.)


11. Verify the moment capacity:  
(Is 
$$M_u \le \phi M_n$$
)


$$a = \frac{(0.50)(60)}{0.85(4)(12)} = 0.74in$$
  
$$\phi M_n = 0.9(0.50)(60)(5.0625 - \frac{0.74}{2})\frac{1}{12}$$

12. A design sketch is drawn:

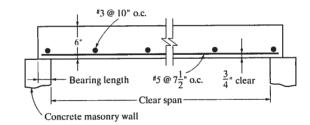

**Example 7.** Design the required shear reinforcement for the simple beam shown in Figure 13.18. Use  $f'_c = 3$  ksi [20.7 MPa] and  $f_y = 40$  ksi [276 MPa] and single U-shaped stirrups.

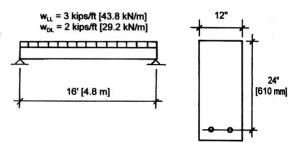

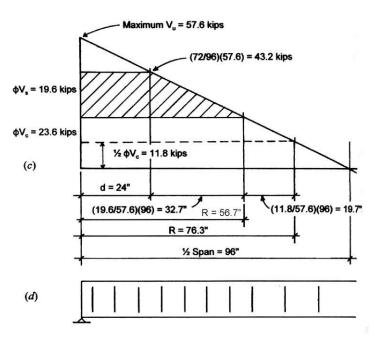

For the simply supported concrete beam shown in Figure 5-61, determine the stirrup spacing (if required) using No. 3 U stirrups of Grade 60 ( $f_y = 60$  ksi). Assume  $f'_c = 3000$  psi.

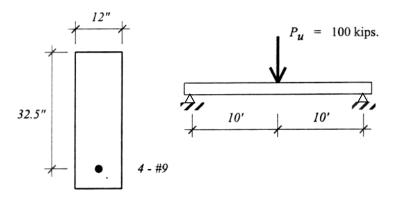


Figure 5-61: Simply supported concrete beam for Example 5-15.


$f_c^{\prime} = 3000 \text{ psi.}$	For #3 bars,	$A_s = 0.11 \text{ in.}^2$ ,
$F_{y} = 60  \text{ksi.}$	with 2 legs, then	$A_{\rm v} = 0.22 \text{ in.}^2$

Solution:


 $V_{\mu}$  = 50 kips (neglecting weight of the beam)


: <u>Use #3 U @ 16</u>" max spacing

Design the shear reinforcement for the simply supported reinforced concrete beam shown with a dead load of 1.5 k/ft and a live load of 2.0 k/ft. Use 5000 psi concrete and Grade 60 steel. Assume that the point of reaction is at the end of the beam.



#### SOLUTION:

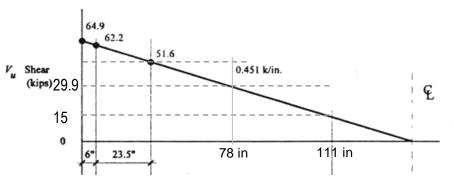



#### Shear diagram:

Find self weight = 1 ft x (27/12 ft) x 150 lb/ft<sup>3</sup> = 338 lb/ft = 0.338 k/ft  $w_u = 1.2 (1.5 k/ft + 0.338 k/ft) + 1.6 (2 k/ft) = 5.41 k/ft (= 0.451 k/in)$   $V_{u (max)}$  is at the ends =  $w_uL/2 = 5.41 k/ft (24 ft)/2 = 64.9 k$  $V_{u (support)} = V_{u (max)} - w_u(distance) = 64.9 k - 5.4 1k/ft (6/12 ft) = 62.2 k$ 

 $V_u$  for design is d away from the support =  $V_u$  (support) -  $w_u$ (d) = 62.2 k - 5.41 k/ft (23.5/12 ft) = 51.6 k

#### Concrete capacity:

We need to see if the concrete needs stirrups for strength or by requirement because  $V_u \le \phi V_c + \phi V_s$  (design requirement)  $\phi V_c = \phi 2 \sqrt{f'_c} b_w d = 0.75$  (2)  $\sqrt{5000}$  psi (12 in) (23.5 in) = 299106 lb = 29.9 kips (< 51.6 k!)

#### Stirrup design and spacing

We need stirrups:  $A_v = V_s s/f_y d$ 

 $\phi V_s \ge V_u - \phi V_c = 51.6 \text{ k} - 29.9 \text{ k} = 21.7 \text{ k}$ 

Spacing requirements are in Table 3-8 and depend on  $\partial V_c/2 = 15.0$  k and  $2\partial V_c = 59.8$  k

2 legs for a #3 is 0.22 in<sup>2</sup>, so  $s_{req'd} \le \phi A_v f_y d/\phi V_s = 0.75(0.22 in^2)(60 ksi)(23.5 in)/21.7 k = 10.72 in Use s = 10"$ 

our maximum falls into the d/2 or 24", so d/2 governs with 11.75 in Our 10" is ok.

This spacing is valid until  $V_u = \phi V_c$  and that happens at (64.9 k – 29.9 k)/0.451 k/in = 78 in

We can put the first stirrup at a minimum of 2 in fr support face, so we need 10" spaces for (78 - 2 - 7 even (8 stirrups altogether ending at 78 in)

After 78" we can change the spacing to the requirement more than the maximum of d/2 = 11.75 in  $\leq 24$ in);

 $s = A_v f_y / 50 b_w = 0.22 in^2 (60,000 psi)/50 (1)$ 


We need to continue to 111 in, so (111 - 78 in)/7 even


 $V_u$  Shear (kips) 0  $6^*$  23.5" 8 - #3 U stirrups at 10 in 3 - #3 U stirrups at 11 in


29

<u>Locating end points:</u> 29.9 k = 64.9 k - 0.451 k/in x (a) a = 78 in 15 k = 64.9 k - 0.451 k/in x (b)b = 111 in.

**Example 1.** A solid one-way slab is to be used for a framing system similar to that shown in Figure 14.1. Column spacing is 30 ft. with evenly spaced beams occurring at 10 ft. center to center. Superimposed loads on the structure (floor live load plus other construction dead load) are a dead load of 38 psf [1.82 kPa] and a live load of 100 psf [4.79 kPa]. Use  $f'_c = 3$  ksi [20.7 MPa] and  $f_y = 40$  ksi [275 MPa]. Determine the thickness for the slab and select its reinforcement.





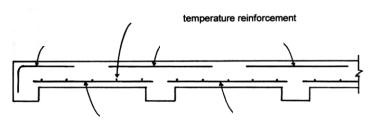

24'-0" C to C columns

в

12'-0"

12'-0'

12'-0" C to C


beams

<u>-</u>

Α

Partial Plan

#### Example 15 (continued)

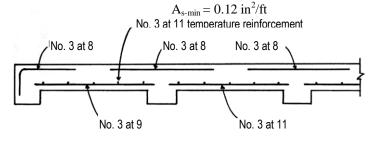

24'-0

#### Example 16

#### Example 6-1

The floor system shown in Figure 6-4 consists of a continuous one-way slab supported by continuous beams. The service loads on the floor are 25 psf dead load (does not include weight of slab) and 250 psf live load. Use  $f'_c = 3000$  psi (normal-weight concrete) and  $f_y = 60,000$  psi. The bars are uncoated.

Design the continuous one-way floor slab.

#### Solution:

The primary difference in this design from previous flexural designs is that, because of continuity, the ACI coefficients and equations will be used to determine design shears and moments.

A. Continuous one-way floor slab

1. Determine the slab thickness. The slab will be designed to satisfy the ACI minimum thickness requirements from Table 9.5(a) of the code and this thickness will be used to estimate slab weight.

With both ends continuous,

minimum 
$$h = \frac{1}{28} \ell_n = \frac{1}{28} (11)(12) = 4.71$$
 in

With one end continuous,

minimum 
$$h = \frac{1}{24} \ell_n = \frac{1}{24} (11)(12) = 5.5$$
 in.

Try a  $5\frac{1}{2}$ -in.-thick slab. Design a 12-in.-wide segment (b = 12 in.).

2. Determine the load:

slab dead load  $=\frac{5.5}{12}(150) = 68.8 \text{ psf}$ 

total dead load = 25.0 + 68.8 = 93.8 psf

$$w_u = 1.2 w_{DL} + 1.6 w_{LL} = 1.2(93.8) + 1.6(250) = 112.6 + 400.0 = 516.2 \text{ psf}$$
 (design load)

В

Because we are designing a slab segment that is 12 in. wide, the foregoing loading is the same as 512.6 lb/ft or 0.513 kip/ft.

#### Example 16 (continued)

3. Determine the moments and shears. Moments are determined using the ACI moment equations. Refer to Figures 6-1 and 6-4. Thus

$$+M_{u} = \frac{1}{14} w_{u} \ell_{n}^{2} = \frac{1}{14} (0.513)(11)^{2} = 4.43 \text{ ft-kips} \qquad (end span)$$

$$+M_{u} = \frac{1}{16} w_{u} \ell_{n}^{2} = \frac{1}{16} (0.513)(11)^{2} = 3.88 \text{ ft-kips} \qquad (interior span)$$

$$-M_{u} = \frac{1}{10} w_{u} \ell_{n}^{2} = \frac{1}{10} (0.513)(11)^{2} = 6.20 \text{ ft-kips} \qquad (end span - first interior support)$$

$$-M_{u} = \frac{1}{11} w_{u} \ell_{n}^{2} = \frac{1}{11} (0.513)(11)^{2} = 5.64 \text{ ft-kips} \qquad (interior span - both supports)$$

$$-M_{u} = \frac{1}{24} w_{u} \ell_{n}^{2} = \frac{1}{24} (0.513)(11)^{2} = 2.58 \text{ ft-kips} \qquad (end span - exterior support)$$

Similarly, the shears are determined using the ACI shear equations. In the end span at the face of the first interior support,

$$V_u = 1.15 \frac{w_u \ell_n}{2} = 1.15(0.513) \left(\frac{11}{2}\right) = 3.24 \text{ kips}$$

(end span – first interior support)

whereas at all other supports,

$$V_u = \frac{w_u \ell_n}{2} = (0.513) \left(\frac{11}{2}\right) = 2.82$$
 kips

4. Design the slab. Assume #4 bars for main steel with  $\frac{3}{4}$  in. cover:  $d = 5.5 - 0.75 - \frac{1}{2}(0.5) = 4.5$  in.

5. Design the steel. (All moments must be considered.) For example, the negative moment in the end span at the first interior support:

$$R_n = \frac{M_u}{\phi b d^2} = \frac{6.20(12)(1000)}{0.9(12)(4.5)^2} = 340^{ft-kips} \quad \text{so } \rho \cong 0.006$$

 $A_s = \rho bd = 0.006(12)(4.5) = 0.325 \text{ in}^2 \text{ per ft. width of slab}$   $\therefore$  Use #4 at 7 in. (16.5 in. max. spacing)

The minimum reinforcement required for flexure is the same as the shrinkage and temperature steel.

(Verify the moment capacity is achieved:  $a \ 0.67$  in. and  $\phi M_n = 6.38$  ft-kips > 6.20 ft-kips)


For grade 60 the minimum for shrinkage and temperature steel is:

 $A_{s-min} = 0.0018bt = 0.0018 (12)(5.5) = 0.12 \text{ in}^2 \text{ per ft. width of slab}$   $\therefore$  Use #3 at 11 in. (18 in. max spacing)

6. Check the shear strength.

 $\phi V_c = \phi 2 \sqrt{f'_c b d} = 0.75(2) \sqrt{3000}(12)(4.5) = 4436.6lb = 4.44$  kips  $V_u \le \phi V_c$  Therefore the thickness is O.K.

7. Development length for the flexure reinforcement is required. (Hooks are required at the spandrel beam.) For example, #6 bars:

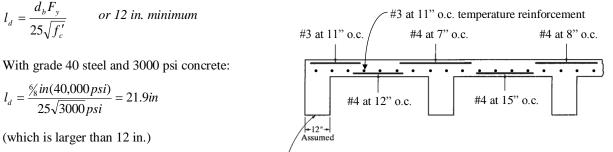

8. Sketch:

A building is supported on a grid of columns that is spaced at 30 ft on center in both the north-south and east-west directions. Hollow core planks with a 2 in. topping span 30 ft in the east-west direction and are supported on precast L and inverted T beams. Size the hollow core planks assuming a live load of 100 lb/ft<sup>2</sup>. Choose the shallowest plank with the least reinforcement that will span the 30 ft while supporting the live load.

#### SOLUTION:

The shallowest that works is an 8 in. deep hollow core plank.

The one with the least reinforcing has a strand pattern of 68-S, which contains 6 strands of diameter 8/16 in. =  $\frac{1}{2}$  in. The S indicates that the strands are straight. The plank supports a superimposed service load of 124 lb/ft<sup>2</sup> at a span of 30 ft with an estimated camber at erection of 0.8 in. and an estimated long-time camber of 0.2 in.

The weight of the plank is 81 lb/ft<sup>2</sup>.


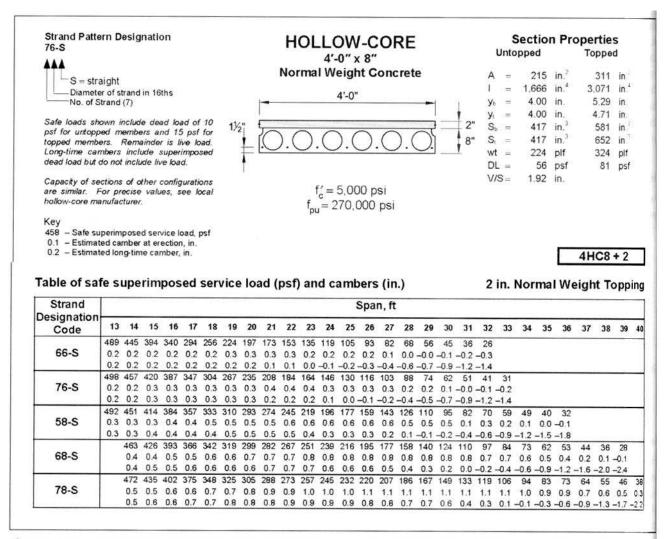


Figure 6.88 Allowed load on 4 ft-wide, 8 in.-deep hollow-core planks (HCPs). (Copyright Prestressed/Precast Concrete Institute (PCI). Reprinted with permission. All rights reserved.)

**Example 1.** A square tied column with  $f'_c = 5$  ksi and steel with  $f_y = 60$  ksi sustains an axial compression load of 150 kips dead load and 250 kips live load with no computed bending moment. Find the minimum practical column size if reinforcing is a maximum of 4% and the maximum size if reinforcing is a minimum of 1%. Also, design for e = 6 in.

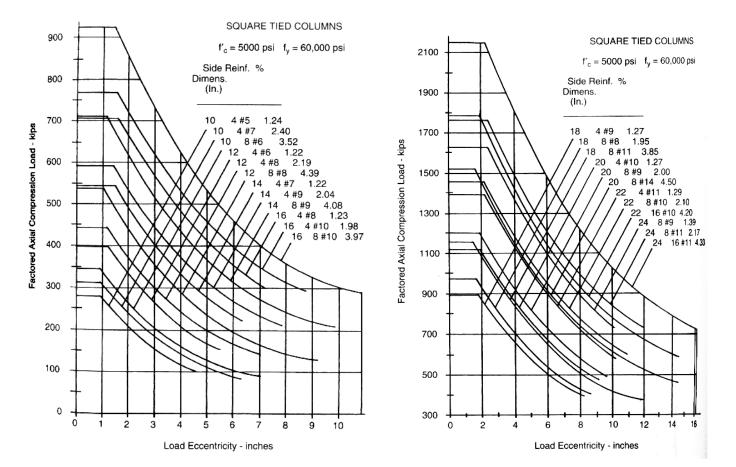

34

Determine the capacity of a 16" x 16" column with 8- #10 bars, tied. Grade 40 steel and 4000 psi concrete.

#### SOLUTION:

Find  $\phi P_n$ , with  $\phi$ =0.65 and  $P_n$  = 0.80P<sub>o</sub> for tied columns and

$$P_o = 0.85 f_c' (A_g - A_{st}) + f_y A_s$$

Steel area (found from reinforcing bar table for the bar size):

 $A_{st}$  = 8 bars × (1.27 in<sup>2</sup>) = 10.16 in<sup>2</sup>

Concrete area (gross):


 $A_g$  = 16 in × 16 in = 256 in<sup>2</sup>

Grade 40 reinforcement has  $f_y = 40,000$  psi and  $f'_c = 4000$  psi

 $\phi P_n = (0.65)(0.80)[0.85(4000 \text{ psi})(256 \text{ in}^2 - 10.16 \text{ in}^2) + (40,000 \text{ psi})(10.16 \text{ in}^2)] = 646,026 \text{ lb} = 646 \text{ kips}$ 

#### Example 20

16" x 16" precast reinforced columns support inverted T girders on corbels as shown. The unfactored loads on the corbel are 81 k dead, and 72 k live. The unfactored loads on the column are 170 k dead and 150 k live. Determine the reinforcement required using the interaction diagram provided. Assume that half the moment is resisted by the column above the corbel and the other half is resisted by the column below. Use grade 50 steel and 5000 psi concrete.

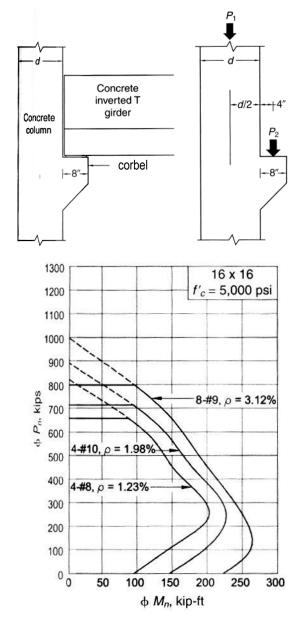



#### **EXAMPLE 5-4**

Design a short square tied column to carry an axial dead load of 300 kip and a live load of 200 kip. Assume that the applied moments on the column are negligible. Use  $f'_c = 4,000$  psi and  $f_y = 60,000$  psi.

#### Solution

Step 1 The factored load,  $P_u$ , is:

$$P_u = 1.2P_D + 1.6P_L$$
  
 $P_u = 1.2(300) + 1.6(200)$   
 $P_u = 680 \text{ kip}$ 

Assume  $\rho_g = 0.03$ .

Step 2 The required area of the column,  $A_g$ , is:

$$A_g = \frac{P_u}{0.8\phi[0.85f'_c(1-\rho_g)+f_y\rho_g]}$$
$$A_g = \frac{680}{0.80(0.65)[0.85(4)(1-0.03)+60(0.03)]}$$
$$A_g = 257 \text{ in}^2$$

Step 3 For a square column, the size, *h*, is:

$$h = \sqrt{A_g} = \sqrt{257}$$
  
$$\therefore h = 16.0 \text{ in.}$$

Try a 16 in.  $\times$  16 in. column:

$$A_g = (16)(16) = 256 \text{ in}^2$$


Step 4 The required amount of steel, A<sub>st</sub>, is:

$$A_{st} = \frac{P_u - 0.8\phi(0.85f'_c A_g)}{0.8\phi(f_y - 0.85f'_c)}$$
$$A_{st} = \frac{680 - 0.8 \times 0.65(0.85 \times 4 \times 256)}{0.8 \times 0.65(60 - 0.85 \times 4)} = 7.73 \text{ in}^2$$


Step 5 Select the size and number of bars. For a square column with bars uniformly distributed along the edges, we keep the number of bars as multiples of four. Using Table A2–9, 8 #9 bars ( $A_s = 8 \text{ in}^2$ ) are selected.

From Table A5–1  $\longrightarrow$  Maximum of 12 #9 bars  $\therefore$  ok

Step 6 Because the longitudinal bars are #9, select #3 bars for the ties. The maximum spacing of the ties  $(s_{max})$  is:



The selected ties are #3 @ 16 in.



Design a 10 ft long circular spiral column for a braced system to support the service dead and live loads of 300 k and 460 k, respectively, and the service dead and live moments of 100 ft-k each. The moment at one end is zero. Use  $f'_c = 4,000$  psi and  $f_y = 60,000$  psi.

#### Solution

- 1.  $P_u = 1.2(300) + 1.6(460) = 1096 \text{ k}$  $M_u = 1.2(100) + 1.6(100) = 280 \text{ ft-k}$
- 2. Assume  $\rho_g = 0.01$ , from Equation 16.10:

$$A_g = \frac{P_u}{0.60[0.85f_c'(1-\rho_g) + f_y\rho_g]}$$
$$= \frac{1096}{0.60[0.85(4)(1-0.01) + 60(0.01)]}$$
$$= 460.58 \text{ in.}^2$$

$$\frac{\pi h^2}{4} = 460.58$$

or h = 24.22 in.

- Use h = 24 in.,  $A_g = 452$  in.<sup>2</sup> 3. Assume #9 size of bar and 3/8 in. spiral center-to-center distance = 24 - 2(cover) - 2(spiral diameter) - 1 (bar diameter) = 24 - 2(1.5) - 2(3/8) - 1.128 = 19.12 in.
- ACI 7.7: Concrete exposed to earth or weather: No. 6 through No. 18 bars...... 2 in. minimum

$$\gamma=\frac{19.12}{24}=0.8$$

Use the interaction diagram Appendix D.21

4. 
$$K_n = \frac{P_u}{\phi f_c' A_g} = \frac{1096}{(0.75)(4)(452)} = 0.808$$
  
 $R_n = \frac{M_u}{\phi f_c' A_g h} = \frac{3360}{(0.75)(4)(452)(24)} = 0.103$ 

- 5. At the intersection point of  $K_n$  and  $R_n$ ,  $\rho_g = 0.02$
- 6. The point is above the strain line = 1, hence  $\phi$  = 0.75 OK
- 7.  $A_{st} = (0.02)(452) = 9.04$  in.<sup>2</sup> From Appendix D.2, select 12 bars of #8,  $A_{st} = 9.48$  in.<sup>2</sup> From Appendix D.14 for a core diameter of 24 - 3 = 21 in. 17 bars of #8 can be arranged in a row
- 8. Selection of spirals From Appendix D.13, size = 3/8 in. pitch = 2¼ in. Clear distance = 2.25 - 3/8 = 1.875 > 1 in. OK
  9. K=1, l=10 × 12 = 120 in., r=0.25(24) = 6 in.

$$\frac{Kl}{r} = \frac{1(120)}{6} = 20$$
$$\left(\frac{M_1}{M_2}\right) = 0$$
$$34 - 12\left(\frac{M_1}{M_2}\right) = 34$$


ACI 10.12: In nonsway frames it shall be permitted to ignore slenderness effects for compression members that satisfy:  $\frac{kl_u}{r} \le 34 - 12 \binom{M_1}{M_2}$ 

since (*Kl/r*) < 34, short column.

	App	roximate Values fo	r a/d
	0.1	0.2	0.3
	Арг	proximate Values for	or $\rho$
b x d (in)	0.0057	0.01133	0.017
10 x 14	2 #6	2 #8	3 #8
	53	90	127
10 x 18	3 #5	2 #9	3 #9
	72	146	207
10 x 22	2 #7	3 #8	(3 #10)
	113	211	321
12 x 16	2 #7	3 #8	4 #8
	82	154	193
12 x 20	2 #8	3 #9	4 #9
	135	243	306
12 x 24	2 #8	3 #9	(4 #10)
	162	292	466
15 x 20	3 #7	4 #8	5 #9
	154	256	383
15 x 25	3 #8	4 #9	4 #11
	253	405	597
15 x 30	3 #8	5 #9	(5 #11)
	304	608	895
18 x 24	3 #8	5 #9	6 #10
	243	486	700
18 x 30	3 #9	6 #9	(6 #11)
	385	729	1074
18 x 36	3 #10	6 #10	(7 #11)
	586	1111	1504
20 x 30	3 # 10	7 # 9	6 # 11
	489	851	1074
20 x 35	4 #9	5 #11	(7 #11)
	599	1106	1462
20 x 40	6 #8	6 #11	(9 #11)
	811	1516	2148
24 x 32	6 #8	7 #10	(8 #11)
	648	1152	1528
24 x 40	6 #9	7 #11	(10 #11)
	1026	1769	2387
24 x 48	5 #10	(8 #11)	(13 #11)
	1303	2426	3723

# Factored Moment Resistance of Concrete Beams, $\phi M_n$ (k-ft) with $f'_c = 4$ ksi, $f_y = 60$ ksi<sup>a</sup>


<sup>a</sup>Table yields values of factored moment resistance in kip-ft with reinforcement indicated. Reinforcement choices shown in parentheses require greater width of beam or use of two stack layers of bars. (*Adapted and corrected from Simplified Engineering for Architects and Builders, 11<sup>th</sup> ed, Ambrose and Tripeny, 2010.* 

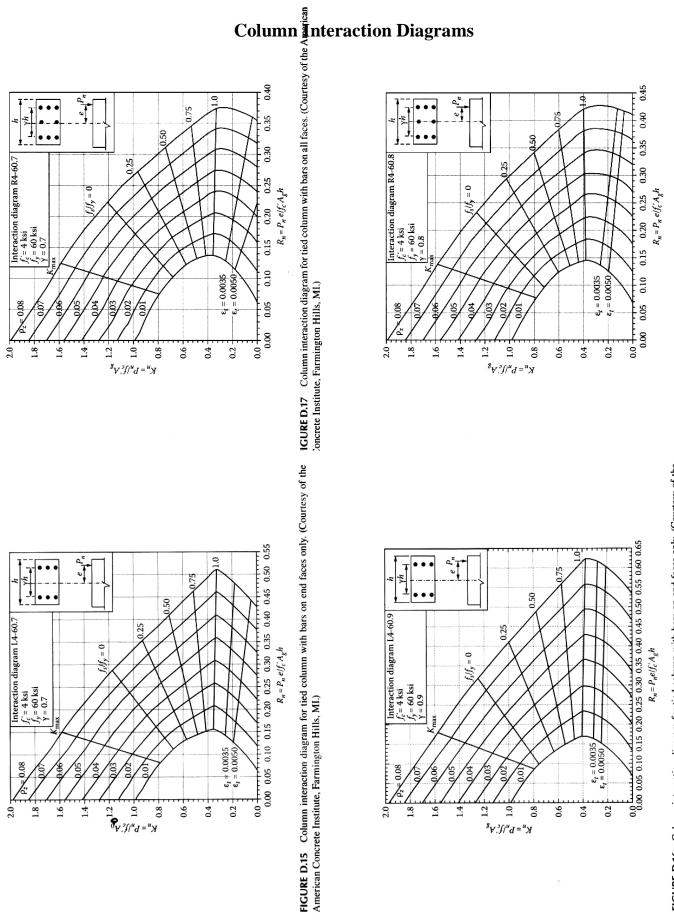


**ICURE D.18** Column interaction diagram for tied column with bars on all faces. (Courtesy of the American Soncrete Institute, Farmington Hills, MI.)


FIGURE D.16 Column interaction diagram for tied column with bars on end faces only. (Courtesy of the American Concrete Institute, Farmington Hills, MI.)

39

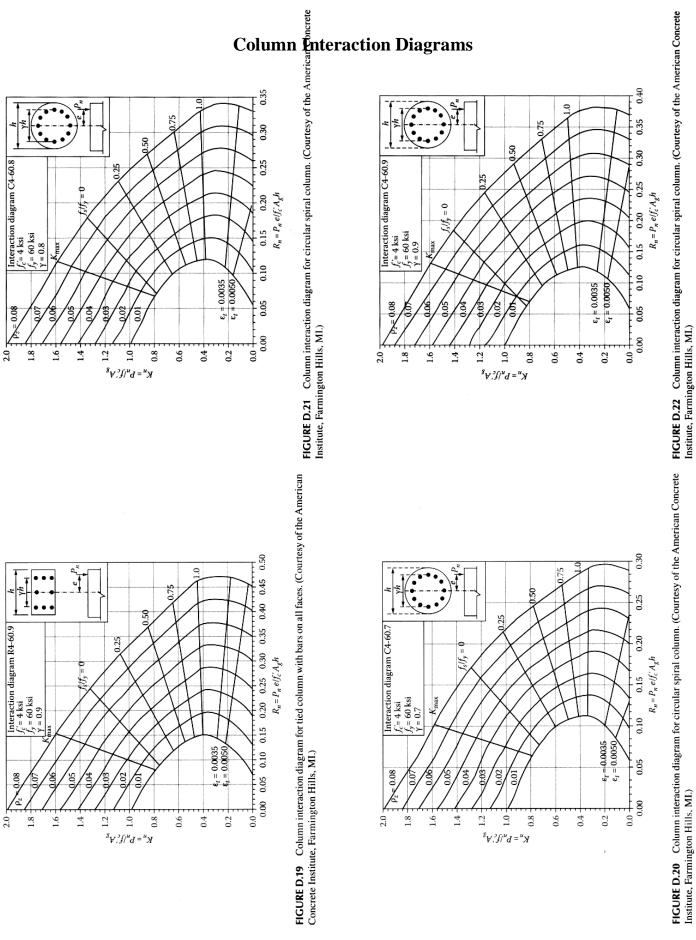

# Beam / One-Way Slab Design Flow Chart

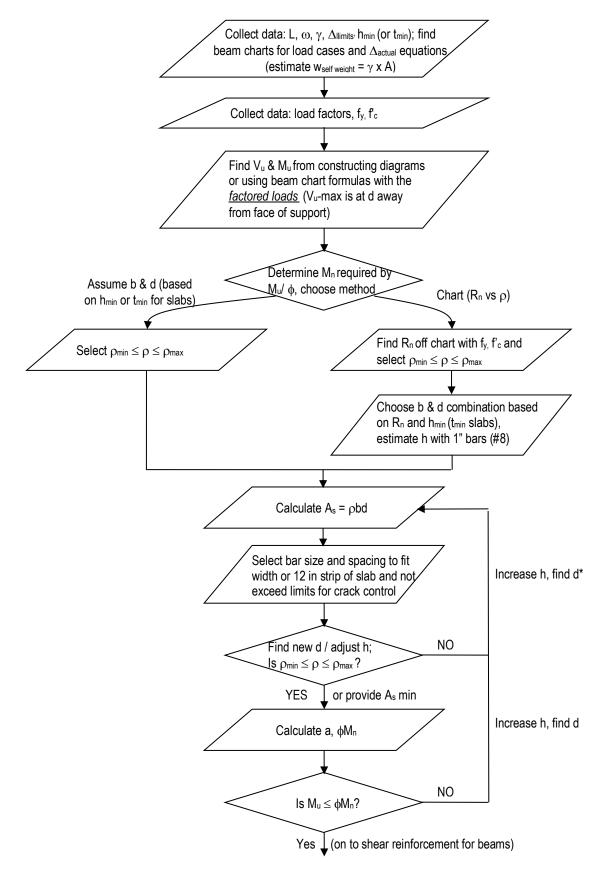

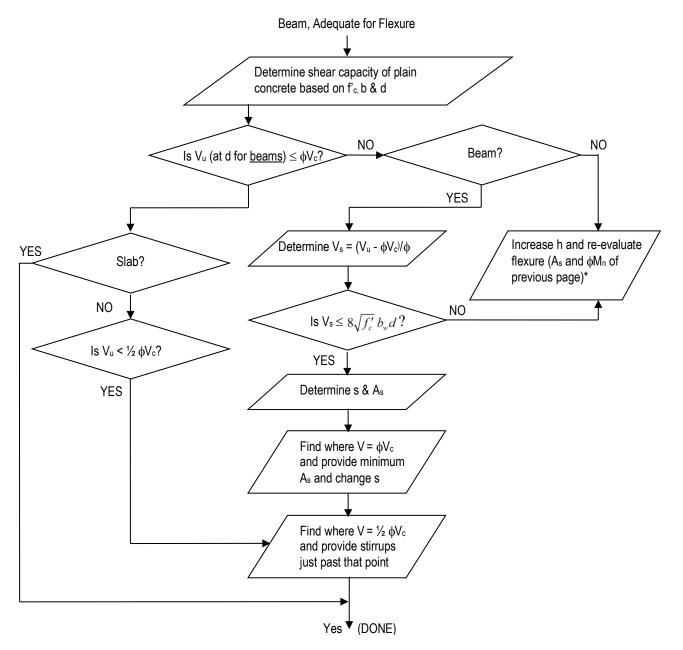

# Beam / One-Way Slab Design Flow Chart - continued

APPENDIX E

# **APPENDIX E — STEEL REINFORCEMENT INFORMATION**

As an aid to users of the ACI Building Code, information on sizes, areas, and weights of various steel reinforcement is presented.

Bar size, no.	Nominal diameter, in.	Nominal area, in. <sup>2</sup>	Nominal weight lb/ft		
3	0.375	. 0.11	0.376		
4	0.500	0.20	0.668		
5	0.625	0.31	1.043		
6	0.750	0.44	1.502		
7	0.875	0.60	2.044		
8	1.000	0.79	2.670		
9	1.128	1.00	3.400		
10	1.270	1.27	4.303		
11	1.410	1.56	5.313		
14	1.693	2.25	7.650		
18	2.257	4.00	13.600		

#### ASTM STANDARD REINFORCING BARS

# 1 .. . .

ASTM STANDARD PRESTRESSING TENDONS

Туре*	vpe <sup>*</sup> Nominal diameter, in.		Nominal weight lb/ft	
	1/4 (0.250)	0.036	0.122	
	5/16 (0.313)	0.058	0.197	
Seven-wire strand	3/8 (0.375)	0.080	0.272	
(Grade 250)	7/16 (0.438)	0.108	0.367	
	1/2 (0.500)	0.144	0.490	
	(0.600)	0.216	0.737	
	3/8 (0.375)	0.085	0.290	
Seven-wire strand	7/16 (0.438)	0.115	0.390	
(Grade 270)	1/2 (0.500)	0.153	0.520	
	(0.600)	0.217	0.740	
	0.192	0.029	0.098	
	0.196	0.030	0.100	
Prestressing wire	0.250	0.049	0.170	
	0.276	0.060	0.200	
	3/4	0.44	1.50	
	7/8	0.60	2.04	
Prestressing bars	1	0.78	2.67	
(plain)	1-1/8	0.99	3.38	
	1-1/4	1.23	4.17	
	1-3/8	1.48	5.05	
	5/8	0.28	0.98	
	3/4	0.42	1.49	
Prestressing bars (deformed)	1	0.85	3.01	
(ucroffied)	1-1/4	1.25	4.39	
	1-3/8	1.58	5.56	

\* Availability of some tendon sizes should be investigated in advance.

ACI 318 Building Code and Commentary

#### 318/318R-386

APPENDIX E

					Area, in. <sup>2</sup> /ft of width for various spacings								
W & D size		Nominal	Nominal	Nominal	Center-to-center spacing, in.								
Plain	Deformed	diameter, in.	area, in. <sup>2</sup>	weight, lb/ft	2	3	4	6	8	10	12		
W31	D31	0.628	0.310	1.054	1.86	1.24	0.93	0.62	0.465	0.372	0.31		
W30	D30	0.618	0.300	1.020	1.80	1.20	0.90	0.60	0.45	0.366	0.30		
W28	D28	0.597	0.280	0.952	1.68	1.12	0.84	0.56	0.42	0.336	0.28		
W26	D26	0.575	0.260	0.934	1.56	1.04	0.78	0.52	0.39	0.312	0.26		
W24	D24	0.553	0.240	0.816	1.44	0.96	0.72	0.48	0.36	0.288	0.24		
W22	D22	0.529	0.220	0.748	1.32	0.88	0.66	0.44	0.33	0.264	0.22		
W20	D20	0.504	0.200	0.680	1.20	0.80	0.60	0.40	0.30	0.24	0.20		
W18	D18	0.478	0.180	0.612	1.08	0.72	0.54	0.36	0.27	0.216	0.18		
W16	D16	0.451	0.160	0.544	0.96	0.64	0.48	0.32	0.24	0.192	0.16		
W14	D14	0.422	0.140	0.476	0.84	0.56	0.42	0.28	0.21	0.168	0.14		
W12	D12	0.390	0.120	0.408	0.72	0.48	0.36	0.24	0.18	0.144	0.12		
W11	D11	0.374	0.110	0.374	0.66	0.44	0.33	0.22	0.165	0.132	0.1		
W10.5		0.366	0.105	0.357	0.63	0.42	0.315	0.21	0.157	0.126	0.10		
W10	D10	0.356	0.100	0.340	0.60	0.40	0.30	0.20	0.15	0.12	0.10		
W9.5		0.348	0.095	0.323	0.57	0.38	0.285	0.19	0.142	0.114	0.09		
W9	D9	0.338	0.090	0.306	0.54	0.36	0.27	0.18	0.135	0.108	0.0		
W8.5		0.329	0.085	0.289	0.51	0.34	0.255	0.17	0.127	0.102	0.08		
W8	D8	0.319	0.080	0.272	0.48	0.32	0.24	0.16	0.12	0.096	0.08		
W7.5.		0.309	0.075	0.255	0.45	0.30	0.225	0.15	0.112	0.09	0.07		
W7	D7	0.298	0.070	0.238	0.42	0.28	0.21	0.14	0.105	0.084	0.0		
W6.5		0.288	0.065	0.221	0.39	0.26	0.195	0.13	0.097	0.078	0.06		
W6	D6	0.276	0.060	0.204	0.36	0.24	0.18	0.12	0.09	0.072	0.00		
W5.5		0.264	0.055	0.187	0.33	0.22	0.165	0.11	0.082	0.066	0.05		
W5	D5	0.252	0.050	0.170	0.30	0.20	0.15	0.10	0.075	0.06	0.05		
W4.5		0.240	0.045	0.153	0.27	0.18	0.135	0.09	0.067	0.054	0.04		
W4	D4	0.225	0.040	0.136	0.24	0.16	0.12	0.08	0.06	0.048	0.04		
W3.5		0.211	0.035	0.119	0.21	0.14	0.105	0.07	0.052	0.042	0.03		
W3		0.195	0.030	0.102	0.18	0.12	0.09	0.06	0.045	0.036	0.03		
W2.9		0.192	0.029	0.098	0.174	0.116	0.087	0.058	0.043	0.035	0.02		
W2.5		0.178	0.025	0.085	0.15	0.10	0.075	0.05	0.037	0.03	0.02		
W2		0.159	0.020	0.068	0.12	0.08	0.06	0.04	0.03	0.024	0.02		
W1.4		0.135	0.014	0.049	0.084	0.056	0.042	0.028	0.021	0.017	0.01		

#### ASTM STANDARD WIRE REINFORCEMENT

ACI 318 Building Code and Commentary

# STEEL REINFORCEMENT INFORMATION

Nominal			Number of Bars									
Bar Size	Diameter (in.)	Weight (lb/ft)	1	2	3	4	5	6	7	8	9	10
#3	0.375	0.376	0.11	0.22	0.33	0.44	0.55	0.66	0.77	0.88	0.99	1.10
#4	0.500	0.668	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60	1.80	2.00
#5	0.625	1.043	0.31	0.62	0.93	1.24	1.55	1.86	2.17	2.48	2.79	3.10
#6	0.750	1.502	0.44	0.88	1.32	1.76	2.20	2.64	3.08	3.52	3.96	4.40
<b>#</b> 7	0.875	2.044	0.60	1.20	1.80	2.40	3.00	3.60	4.20	4.80	5.40	6.00
#8	1.000	2.670	0.79	1.58	2.37	3.16	3.95	4.74	5.53	6.32	7.11	7.90
#9	1.128	3.400	1.00	2.00	3.00	4.00	5.00	6.00	7.00	8.00	9.00	10.00
#10	1.270	4.303	1.27	2.54	3.81	5.08	6.35	7.62	8.89	10.16	11.43	12.70
#11	1.410	5.313	1.56	3.12	4.68	6.24	7.80	9.36	10.92	12.48	14.04	15.60
#14ª	1.693	7.65	2.25	4.50	6.75	9.00	11.25	13.50	15.75	18.00	20.25	22.50
#18ª	2.257	13.60	4.00	8.00	12.00	16.00	20.00	24.00	28.00	32.00	36.00	40.00

Table 3.7.1	
Total Areas for Various	Numbers of Reinforcing Bars

\* #14 and #18 bars are used primarily as column reinforcement and are rarely used in beams.

Table 3-7	Areas of Bars	per Foot Width of	Slab—A <sub>s</sub> (in. <sup>2</sup> /ft)

Bar	Bar spacing (in.)												
size	6	7	8	9	10	11	12	13	14	15	16	17	18
#3	0.22	0.19	0.17	0.15	0.13	0.12	0.11	0.10	0.09	0.09	0.08	0.08	0.07
#4	0.40	0.34	0.30	0.27	0.24	0.22	0.20	0.18	0.17	0.16	0.15	0.14	0.13
#5	0.62	0.53	0.46	0.41	0.37	0.34	0.31	0.29	0.27	0.25	0.23	0.22	0.21
#6	0.88	0.75	0.66	0.59	0.53	0.48	0.44	0.41	0.38	0.35	0.33	0.31	0.29
#7	1.20	1.03	0.90	0.80	0.72	0.65	0.60	0.55	0.51	0.48	0.45	0.42	0.40
#8	1.58	1.35	1.18	1.05	0.95	0.86	0.79	0.73	0.68	0.63	0.59	0.56	0.53
#9	2.00	1.71	1.50	1.33	1.20	1.09	1.00	0.92	0.86	0.80	0.75	0.71	0.67
#10	2.54	2.18	1.91	1.69	1.52	1.39	1.27	1.17	1.09	1.02	0.95	0.90	0.85
#11	3.12	2.67	2.34	2.08	1.87	1.70	1.56	1.44	1.34	1.25	1.17	1.10	1.04

Table 3-4 Maximum Bar Spacing in One-Way Slabs for Crack Control (in.)\*


	Exterior Exposure (z = 129 kips/in.)				Interior Exposure (z = 156 kips/in.)				
Bar Size	Cover (in.)				Cover (in.)				
	3 <sub>/4</sub>	1	1- <sup>1</sup> /2	2	3 <sub>/4</sub>	1	1- <sup>1</sup> /2	2	
#4		14.7	7.5	4.5			13.3	8.0	
#5		13.4	7.0	4.3			12.4	7.6	
#6		12.2	6.5	4.1			11.6	7.2	
#7	16.3	11.1	6.1	3.9			10.8	6.8	
#8	14.7	10.2	5.8	3.7			10.2	6.5	
#9	13.3	9.4	5.4	3.5		16.6	9.6	6.2	
#10	12.0	8.6	5.0	3.3		15.2	8.9	5.9	
#11	10.9	7.9	4.7	3.1		14.0	8.4	5.6	

\*Valid for  $f_s = 0.6f_y = 36$  ksi, and single layer of reinforcement. Spacing should not exceed 3 times slab thickness nor 18 in. (ACI 7.6.5). No value indicates spacing greater than 18 in.

	Maximum size coarse aggregate—3/4 in.												
Bar Size		Beam width, b <sub>w</sub> (in.)											
	10												
#5	3	5	6	7	8	10	11	12	13	15	16		
#6	3	4	6	7	8	9	10	11	12	14	15		
#7	3	4	5	6	7	8	9	10	11	12	13		
#8	3	4	5	6	7	8	9	10	11	12	13		
#9	2	3	4	5	6	7	8	8	9	10	11		
#10	2	3	4	4	5	6	7	8	8	9	10		
#11	2	3	3	4	5	5	6	7	8	8	9		

# Table 3-3 Maximum Number of Bars in a Single Layer

		Maximum size coarse aggregate—1 in.												
Bar Size		Beam width, b <sub>w</sub> (in.)												
	10	12	14	16	18	20	22	24	26	28	30			
#5	3	4	5	6	7	8	9	10	11	12	13			
#6	3	4	5	6	7	8	9	10	10	11	12			
#7	2	3	4	5	6	7	8	9	10	10	11			
#8	2	3	4	5	6	7	7	8	9	10	11			
#9	2	3	4	5	5	6	7	8	9	9	10			
#10	2	3	4	4	5	6	7	7	8	9	10			
#11	2	3	3	4	5	5	6	7	8	8	9			

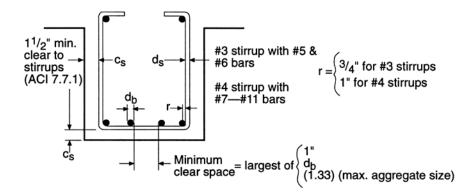



	INTERIOR EXPOSURE (z = 175 kips/in.)												
Bar Size		Beam width, b <sub>w</sub> (in.)											
	10	12	14	16	18	20	22	24	26	28	30		
#5	1	2	2	2	2	2	3	3	3	3	3		
#6	1	2	2	2	2	2	3	3	3	3	3		
#7	2	2	2	2	2	3	3	3	3	3	4		
#8	2	2	2	2	2	3	3	3	3	4	4		
<b>#9</b>	2	2	2	2	3	3	3	3	3	4	4		
#10	2	2	2	2	3	3	3	3	4	4	4		
#11	2	2	2	3	3	3	3	4	4	4	4		

Table 3-2 Minimum Number of Bars in a Single Layer (ACI 10.6)*	Table 3-2	Minimum	Number	of	Bars	in a	Single	Layer	(ACI	10.6)	)*
--	-----------	---------	--------	----	------	------	--------	-------	------	-------	----

# Torsion

#### Notation:


а	= name for width dimension
а	= area bounded by the centerline of a
	thin walled section subjected to
	torsion
b	= name for height dimension
С	= radial distance to shear stress
	location
$C_i$	= inner radial distance to shear stress
	location
$C_o$	= outer radial distance to shear stress
	location
$c_1$	= coefficient for shear stress for a
	rectangular bar in torsion
$c_2$	= coefficient for shear twist for a
	rectangular bar in torsion


- G = shear modulus
- J =polar moment of inertia
- L = length
- s = length of a segment of a thin walled section
- t = name for thickness
- T = torque (axial moment)
- $\phi$  = angle of twist
- $\pi$  = pi (3.1415 radians or 180°)
- $\rho$  = radial distance
- $\tau$  = engineering symbol for shearing stress
- $\Sigma$  = summation symbol

# **Deformation in Torsionally Loaded Members**

Axi-symmetric cross sections subjected to axial moment or **torque** will remain plane and undistorted.

At a section, internal torque (resisiting applied torque) is made up of shear forces parallel to the area and in the direction of the torque. The distribution of the shearing stresses depends on the angle of twist,  $\phi$ . The cross section remains plane and undistored.





# **Shearing Strain**

Shearing strain is the angle change of a straight line segment along the axis.

 $\gamma = \frac{\rho \phi}{L}$ 

where

 $\rho$  is the radial distance from the centroid to the point under strain.

The maximum strain is at the surface, a distance c from the centroid:  $\gamma_{max} = \frac{c\phi}{L}$ 

G is the <u>Shear Modulus</u> or <u>Modulus of Rigidity</u>:  $\tau = G \cdot \gamma$ 

#### **Shearing Strain and Stress**

In the linear elastic range: the torque is the summation of torsion stresses over the area:

$$T = \frac{\tau J}{\rho}$$
 gives:  $\tau = \frac{T\rho}{J}$ 

Maximum torsional stress,  $\tau_{max}$ , occurs at the **outer diameter** (or **perimeter**).

#### **Polar Moment of Inertia**

For axi-symmetric shapes, there is only one value for polar moment of inertia, J, determined by the radius, c:

solid section:  $J = \frac{\pi c^4}{2}$  hollow section:  $J = \frac{\pi (c_o^4 - c_i^4)}{2}$ 

# **Combined Torsion and Axial Loading**

Just as with combined axial load and shear, combined torsion and axial loading result in maximum shear stress at a 45° oblique "plane" of twist.



# **Shearing Strain**

In the linear elastic range:

$$\phi = \frac{TL}{IG}$$

$$\phi = \sum_{i} \frac{T_i L_i}{J_i G_i}$$

#### **Torsion in Noncircular Shapes**

J is no longer the same along the lateral axes. Plane sections do not remain plane, but distort.  $\tau_{max}$  is still at the furthest distance away from the centroid. For rectangular shapes:

$$\tau_{\max} = \frac{T}{c_1 a b^2} \qquad \phi = \frac{T L}{c_2 a b^3 G}$$

For a/b > 5:

$$c_1 = c_2 = \frac{1}{3} \left( 1 - 0.630 \frac{b}{a} \right)$$


	3.1. Coefi Jular Bars	ficients for in Torsion
a/b	<i>c</i> <sub>1</sub>	C2
1.0	* 0.208	0.1406
1.2	0.219	0.1661
1.5	0.231	0.1958
2.0	0.246	0.229
2.5	0.258	0.249
3.0	0.267	0.263
4.0	0.282	0.281
5.0	0.291	0.291

0.312


0.333

0.312

0.333





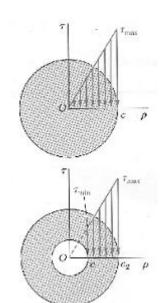

10.0


 $\infty$ 

Note Set 24

# **Open Sections**

For long narrow shapes where a/b is very large  $(a/b \rightarrow \infty) c_1 = c_2 = 1/3$  and:

$$\tau_{\max} = \frac{T}{\frac{\gamma_3 ab^2}{\gamma_3 ab^2}} \qquad \phi = \frac{TL}{\frac{\gamma_3 ab^3 G}{\gamma_3 ab^3 G}}$$

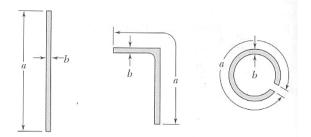

#### Shear Flow of Closed Thin Walled Sections


q is the internal shearing force per unit length, and is constant on a cross section even though the thickness of the wall may very.  $\mathcal{A}$  is the area bounded by the centerline of the wall section;  $s_i$ , is a length segment of the wall and  $t_i$  is the corresponding thickness of the length segment.


 $\tau = \frac{T}{2t\mathcal{A}} \qquad \phi = \frac{TL}{4t\mathcal{A}^2} \sum_i \frac{s_i}{t_i}$ 

# $\tau = \frac{T}{2t\mathcal{A}}$ Shear Flow in Open Sections

The shear flow must wrap around at all edges, and the total torque is distributed among the areas making up the cross section in proportion to the torsional rigidity of each rectangle ( $ab^2/3$ ). The total angle of twist is the sum of the  $\phi$  values from each rectangle. t<sub>i</sub> is the thickness of each rectangle and b<sub>i</sub> is the length of each rectangle.

$$\tau_{\max} = \frac{Tt_{\max}}{\frac{1}{3}\Sigma b_i t_i^3} \qquad \phi = \frac{TL}{\frac{1}{3}G\Sigma b_i t_i^3}$$







#### Example 1

#### Example 8.9.1

Compare the torsional resisting moment T and the torsional constant J for the sections of Fig. 8.9.4 all having about the same cross-sectional area. The maximum shear stress  $\tau$  is 14 ksi.





SOLUTION

(a) Circular thin-wall section.

$$T = \frac{\tau J}{\rho} = \frac{(14ksi)(3937in^4)}{5.25in} \cdot \frac{1ft}{12in} = 87.5k - ft$$
$$J = \frac{\pi (c_o^4 - c_i^4)}{2} = \frac{\pi ((5.25in)^4 - (4.75in)^4)}{2} = 3937in^4$$

(b) Rectangular box section.  $\tau = \frac{T}{2t\mathcal{A}}$ 

$$T = \tau 2t \mathcal{A} = (14ksi) 2(0.5in)(72in^2) \cdot \frac{1ft}{12in} = 84k - ft$$
$$\mathcal{A} \approx (12in)(6in) = 72in^2$$

(c) Channel section. Since for this open section,

$$\tau_{max} = \frac{Tt_{max}}{\frac{1}{3}\sum b_i t_i^3} = \frac{Tt}{J} \qquad T = \frac{\tau J}{t_{max}} \frac{(14ksi)(4.08in^4)}{1in} \cdot \frac{1ft}{12in} = 4.8k - ft$$

the maximum shear stress will be in the flange. Also,

$$J = \sum \frac{bt^3}{3} \qquad J = \frac{1}{3} \left[ 10in(0.5in)^3 + (5.5in)(1in)^3 + (5.5in)(1in)^3 \right] = 4.08in^4$$

#### One-Way Frame Analysis Simplified Design, 3<sup>rd</sup> ed., PCA 2004

#### Notation:

D	= shorthand for dead load	W <sub>d</sub>	= load per unit length on a beam from
$l_n$	= clear span from face of support to		dead load
	face of support in concrete design	W <sub>e</sub>	= load per unit length on a beam from
L	= shorthand for live load		live load
		Wu	= load per unit length on a beam from
_			load factors

#### 2.3 FRAME ANALYSIS BY COEFFICIENTS

The ACI Code provides a simplified method of analysis for both one-way construction (ACI 8.3.3) and twoway construction (ACI 13.6). Both simplified methods yield moments and shears based on coefficients. Each method will give satisfactory results within the span and loading limitations stated in Chapter 1. The direct design method for two-way slabs is discussed in Chapter 4.

#### 2.3.1 Continuous Beams and One-Way Slabs

When beams and one-way slabs are part of a frame or continuous construction, ACI 8.3.3 provides approximate moment and shear coefficients for gravity load analysis. The approximate coefficients may be used as long as all of the conditions illustrated in Fig. 2-2 are satisfied: (1) There must be two or more spans, approximately equal in length, with the longer of two adjacent spans not exceeding the shorter by more than 20 percent; (2) loads must be uniformly distributed, with the service live load not more than 3 times the dead load (L/D  $\leq$  3); and (3) members must have uniform cross section throughout the span. Also, no redistribution of moments is permitted (ACI 8.4). The moment coefficients defined in ACI 8.3.3 are shown in Figs. 2-3 through 2-6. In all cases, the shear in end span members at the interior support is taken equal to  $1.15w_u \ell_n / 2$ . The shear at all other supports is  $w_u / 2$  (see Fig. 2-7).  $w_u \ell_n$  is the combined factored load for dead and live loads,  $w_u = 1.2w_d + 1.6 w_\ell$ . For beams,  $w_u$  is the uniformly distributed load per unit length of beam (plf), and the coefficients yield total moments and shears on the beam. For one-way slabs,  $w_u$  is the uniformly distributed load per unit area of slab (psf), and the moments and shears are for slab strips one foot in width. The span length  $\ell_n$  is defined as the clear span of the beam or slab. For negative moment at a support with unequal adjacent spans,  $\ell_n$  is the average of the adjacent clear spans. Support moments and shears are at the faces of supports.

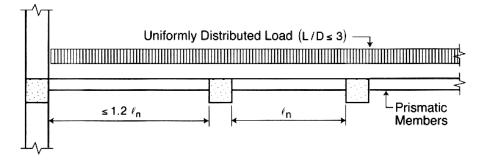


Figure 2-2 Conditions for Analysis by Coefficients (ACI 8.3.3)

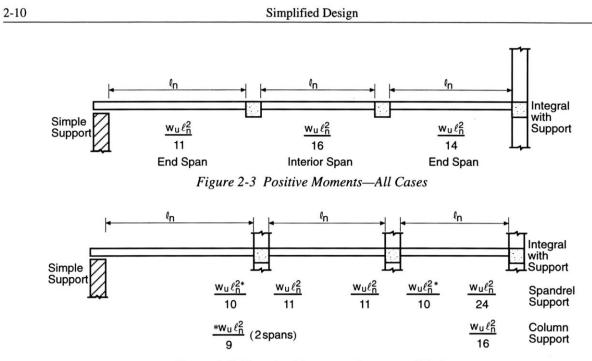


Figure 2-4 Negative Moments-Beams and Slabs

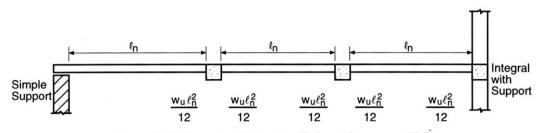


Figure 2-5 Negative Moments—Slabs with spans  $\leq 10 \text{ ft}$ 




Figure 2-6 Negative Moments—Beams with Stiff Columns ( $\Sigma K_c/\Sigma K_b > 8$ )

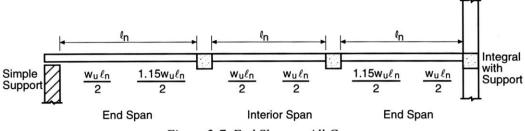


Figure 2-7 End Shears—All Cases

#### Thickness and Cover Requirements for Fire Protection Simplified Design, PCA 1993

Table 10-1 Minimum Thickness for Floor and Roof Slabs and Cast-In-Place Walls, in. (Load Bearing and Nonload-Bearing)

		Fire resistance rating								
Concrete type	1 hr.	1 <sup>1</sup> / <sub>2</sub> hr.	2 hr.	3 hr.	4 hr.					
Siliceous aggregate	3.5	4.3	5.0	6.2	7.0					
Carbonate aggregate	3.2	4.0	4.6	5.7	6.6					
Sand-lightweight	2.7	3.3	3.8	4.6	5.4					
Lightweight	2.5	3.1	3.6	4.4	5.1					

Table	10-2	Minimum	Concrete	Column	Dimensions,	in.
i abic	10 2	TVIII III III III III	001101010	Column	Difficitorio,	

	Fire resistance rating								
Concrete type	1 hr.	$1^{1}/_{2}$ hr.	2 hr.	3 hr.	4 hr.				
Siliceous aggregate	8	8	10	12	14				
Carbonate aggregate	8	8	10	12	12				
Sand-lightweight	8	8	9	10.5	12				

Table 10-3 Minimum Cover for Reinforced Concrete Floor or Roof Slabs, in.

		Restraine	ed Slabs*		Unrestrained Slabs*				
		Fire resista	ance rating		Fire resistance rating				
Concrete type	1 hr.	1 <sup>1</sup> / <sub>2</sub> hr.	2 hr.	3 hr.	1 hr.	1 <sup>1</sup> / <sub>2</sub> hr.	2 hr.	3 hr.	
Siliceous aggregate Carbonate aggregate	3/4 3/4	3/4 3/4	<sup>3</sup> / <sub>4</sub> <sup>3</sup> / <sub>4</sub>	<sup>3</sup> / <sub>4</sub> 3/ <sub>4</sub>	<sup>3</sup> /4 3/4	<sup>3</sup> / <sub>4</sub> <sup>3</sup> / <sub>4</sub>	1 3 <sub>/4</sub>	1 <sup>1</sup> /4 1 <sup>1</sup> /4	
Sand-lightweight or lightweight	3/4	3 <sub>/4</sub>	3/4	3/4	3/4	3/ <sub>4</sub>	3/4	1 <sup>1</sup> /4	

\*See Table 10-5

# Table 10-4Minimum Cover to Main Reinforcing Bars in Reinforced Concrete Beams, in.(Applicable to All Types of Structural Concrete)

		Fire resistance rating						
Restrained or unrestrained*	Beam width, in.**	1 hr.	1 <sup>1</sup> / <sub>2</sub> hr.	2 hr.	3 hr.	4 hr.		
Restrained	5	3/4	3/4	3/4	1	1 <sup>1</sup> /4		
Restrained	7	3/4	3 <sub>/4</sub>	3/ <sub>4</sub>	3 <sub>/4</sub>	3/4		
Restrained	≥ 10	3/4	3/4	3 <sub>/4</sub>	3 <sub>/4</sub>	<sup>3</sup> /4		
Unrestrained	5	3/4	1	1 <sup>1</sup> /4	_	-		
Unrestrained	7	3 <sub>/4</sub>	<sup>3</sup> / <sub>4</sub>	3 <sub>/4</sub>	1 <sup>3/</sup> 4	3		
Unrestrained	≥ 10	<sup>3</sup> /4	<sup>3</sup> /4	3/ <sub>4</sub>	1	1 <sup>3/</sup> 4		

\*See Table 10-5

\*\*For beam widths between the tabulated values, the minimum cover can be determined by interpolation.

Table 10-6 Minimum Cover for Reinforced Concrete Columns, in.

	Fire resistance rating				
Concrete type	1 hr.	1 <sup>1</sup> / <sub>2</sub> hr.	2 hr.	3 hr.	4 hr.
Siliceous aggregate	1 <sup>1</sup> /2	1 <sup>1</sup> /2	1 <sup>1</sup> /2	1 <sup>1</sup> /2	2
Carbonate aggregate	$1^{1}/_{2}$	1 <sup>1</sup> /2	$1^{1/2}$	$1^{1}/_{2}$	1 <sup>1</sup> /2
Sand-lightweight	1 <sup>1</sup> /2	1 <sup>1</sup> /2	$1^{1}/_{2}$	$1^{1}/_{2}$	1 <sup>1</sup> /2

**Openings in Concrete Slab Systems** from <u>Notes on ACI 318-99</u>, Portland Cement Association, 1999

# 11.12.5 Openings in Slabs

The effect of openings (vertical holes through slabs) on the shear strength of slabs must be investigated when the openings are within the column strip areas of slabs or within middle strip areas when the openings are closer than 10 times the slab thickness (10h) from a column. A reduction in shear strength is made by considering as ineffective that portion of the critical section  $b_0$  which is enclosed by straight lines projecting from the column centroid to the edges of the opening. Ineffective portions of critical sections  $b_0$  are illustrated in Fig. 18-10. For slabs with shear reinforcement, the ineffective portion of the perimeter  $b_0$  is one-half of that without shear reinforcement. The one-half factor is interpreted to apply equally to shearhead reinforcement and bar or wire reinforcement.

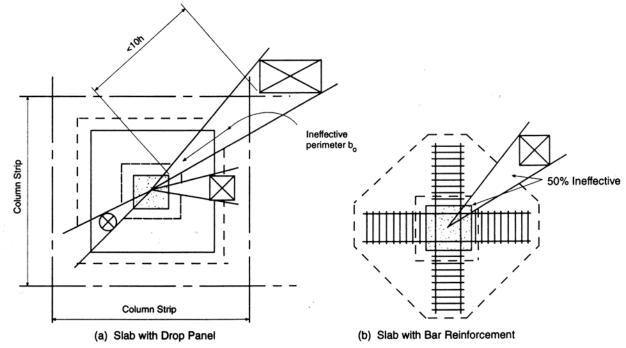


Figure 18-10 Effect of Slab Openings on Shear Strength

# 13.4 OPENINGS IN SLAB SYSTEMS

Openings of any size are permitted in slab systems without beams if special analysis indicates that both strength and serviceability of the slab system, considering the effects of the opening, are satisfied. Without special analysis, openings up to a certain size are permitted as illustrated in Fig. 18-11. The size of openings located within intersecting middle strip areas is unlimited. Within the area of the slab common to intersecting column strips, size of openings is the most restrictive, due to their effect on slab shear strength or load transfer near slabcolumn connections. See discussion on effect of slab openings on shear strength (11.12.5) and Fig. 18-10. Without special analysis, size of openings within intersecting column strips is limited to one-sixteenth of the slab span length in either direction (1/8 ( $\ell/2$ ) =  $\ell/16$ ). Within the slab area common to one column and one middle strip, opening size is limited to one-eighth the span length in either direction (1/4 ( $\ell/2$ ) =  $\ell/8$ ).

The total amount of reinforcement required for the panel without openings, in both directions, must be maintained; reinforcement interrupted by any opening must be replaced, one-half on each side of the opening.

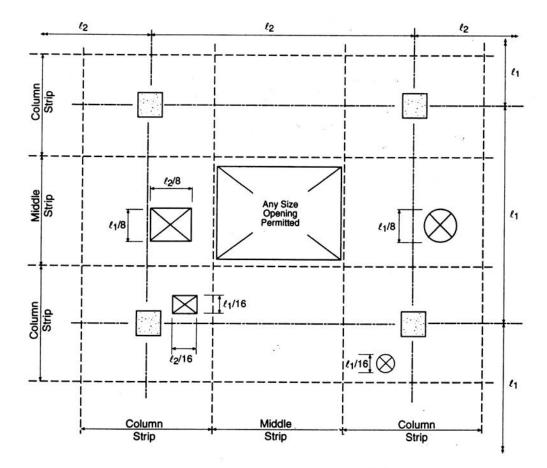


Figure 18-11 Openings in Slab Systems without Beams

# **Foundation Design**

# Notation:

Nota	tion:
а	= name for width dimension
A	= name for area
b	= width of retaining wall stem at base
	= width resisting shear stress
$b_o$	= perimeter length for two-way shear
00	in concrete footing design
В	= spread footing or retaining wall base
D	dimension in concrete design
сс	= shorthand for clear cover
d	= effective depth from the top of a
	reinforced concrete member to the
	centroid of the tensile steel
	= name for diameter
е	= eccentric distance of application of a
	force (P) from the centroid of a
	cross section
f	= symbol for stress
f'c	= concrete design compressive stress
	ontal-resisting = total force resisting
110112	horizontal sliding
$F_{slidin}$	$_{g}$ = total sliding force
$F_x$	= force in the x direction
<i>F.S.</i>	= shorthand for factor of safety
$h_{f}$	= height of a concrete spread footing
Ĥ	= height of retaining wall
$H_A$	= horizontal force due to active soil
	pressure
$l_d$	= development length for reinforcing
	steel
L	
М	= moment due to a force
$M_n$	= nominal flexure strength with the
	steel reinforcement at the yield
	stress and concrete at the concrete
	design strength for reinforced
	concrete beam design
	<sub>turning</sub> = total overturning moment
M <sub>resis</sub>	ting = total moment resisting overturning
	about a point
$M_u$	= maximum moment from factored
	loads for LRFD beam design
n	= name for number
Ν	= name for normal force to a surface
0	= point of overturning of a retaining

wall, commonly at the "toe"

- p = pressure
- $p_A$  = active soil pressure P = name for axial force vector
  - = force due to a pressure
- $P_D$  = dead load axial force
- $P_L$  = live load axial force
- $P_u$  = factored axial force
- q = soil bearing pressure
- $q_a$  = allowable soil bearing stress in allowable stress design, as is  $q_{allowable}$
- $q_g$  = gross soil bearing pressure
- $q_{net}$  = net allowed soil bearing pressure, as is  $q_n$
- $q_u$  = ultimate soil bearing strength in allowable stress design
  - = factored soil bearing capacity in concrete footing design from load factors, as is  $q_{nu}$
- R = name for reaction force vector
- SF = shorthand for factor of safety
- *t* = thickness of retaining wall stem at top
- T = name of a tension force
- V = name for volume
- $V_c$  = shear force capacity in concrete
- $V_u$  = factored shear for reinforced concrete design
- w = name for width
- $w_u$  = load per unit length on a beam from load factors
- W = name for force due to weight
- x = horizontal distance
- $\overline{y}$  = the distance in the y direction from a reference axis to the centroid of a shape
- $\phi$  = resistance factor
- $\gamma_c$  = density or unit weight of concrete
- $\gamma_s$  = density or unit weight of soil
- $\pi$  = pi (3.1415 radians or 180°)
- $\rho$  = reinforcement ratio in concrete beam design = A<sub>s</sub>/bd
- $\mu$  = coefficient of static friction
- 1

# Foundations

A foundation is defined as the engineered interface between the earth and the structure it supports that transmits the loads to the soil or rock. The design differs from structural design in that the choices in material and framing system are not available, and quality of materials cannot be assured. Foundation design is dependent on geology and climate of the site.


#### Soil Mechanics

Soil is another building material and the properties, just like the ones necessary for steel and concrete and wood, must be known before designing. In addition, soil has other properties due to massing of the material, how soil particles pack or slide against each other, and how water affects the behavior. The important properties are

- specific weight (density)
- allowable soil pressure
- factored net soil pressure allowable soil pressure less surcharge with a factor of safety
- shear resistance
- backfill pressure
- cohesion & friction of soil
- effect of water
- settlement
- rock fracture behavior

# Structural Strength and Serviceability

There are significant serviceability considerations with soil. Soils can settle considerably under foundation loads, which can lead to redistribution of moments in continuous slabs or beams, increases in stresses and cracking. Excessive loads can

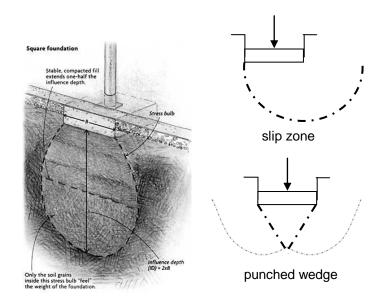

cause the soil to fail in bearing and in shear. The presence of water can cause soils to swell or shrink and freeze and thaw, which causes heaving. Fissures or fault lines can cause seismic instabilities.

A geotechnical engineer or engineering service can use tests on soil bearings from the site to determine the ultimate bearing capacity,  $q_u$ . Allowable stress design is utilized for soils because of the variability do determine the allowable bearing capacity,  $q_a = q_u/(\text{safety factor})$ .

Values of  $q_a$  range from 3000 - 4000 psi for most soils, while clay type soils have lower capacities and sandy soils to rock have much higher capacities.

Soil acts somewhat like water, in that it exerts a lateral pressure because of the weight of the material above it, but the relationship is not linear. Soil can have an <u>active</u> pressure from soil behind a retaining wall and a <u>passive</u> pressure from soil in front of the footing. Active pressure is typically greater than passive pressure.

#### Foundation Materials

Typical foundation materials include:

- plain concrete
- reinforced concrete
- steel
- wood
- composites, ie. steel tubing filled with concrete

ssure because s not linear. g wall and a ressure is	K	active (trying to move wall)
passive (resists movement)		9

Table 7-1 Average Bearing Capacities of Various Foundation Beds

Soil	Bearing Capacity, q <sub>a</sub> (ksf)		
Alluvial soil	≤ 1		
Soft clay	2		
Firm clay	4		
Wet sand	4		
Sand and clay mixed	4		
Fine dry sand (compact)	6		
Hard clay	8		
Coarse dry sand (compact)	8		
Sand and gravel mixed (compact)	10		
Gravel (compact)	12		
Soft rock	16		
Hard pan or hard shale	20		
Medium rock	30		
Hard rock	80		

# **Foundation Design**

#### Generalized Design Steps

Design of foundations with variable conditions and variable types of foundation structures will be different, but there are steps that are typical to every design, including:

- 1. Calculate loads from structure, surcharge, active & passive pressures, etc.
- 2. Characterize soil hire a firm to conduct soil tests and produce a report that includes soil material properties
- 3. Determine footing location and depth shallow footings are less expensive, but the variability of the soil from the geotechnical report will drive choices
- 4. Evaluate soil bearing capacity the factor of safety is considered here
- 5. Determine footing size these calculations are based on working loads and the allowable soil pressure
- 6. Calculate contact pressure and check stability
- 7. Estimate settlements
- 8. Design the footing structure design for the material based on applicable structural design codes which may use allowable stress design, LRFD or limit state design (concrete).

# Shallow Foundation Types

Considered simple and cost effective because little soil is removed or disturbed.

- *Spread footing* A single column bears on a square or rectangular pad to distribute the load over a bigger area.
- *Wall footing* A continuous wall bears on a wide pad to distribute the load.
- *Eccentric footing* A spread or wall footing that also must resist a moment in addition to the axial column load.
- *Combined footing* Multiple columns (typically two) bear on a rectangular or trapezoidal shaped footing.

<image>

- *Unsymmetrical footing* A footing with a shape that does not Figure 5.1 Spread footing shapes and dimensional distribute bearing pressure from column loads and moments. It typically involves a hole or a non-rectangular shape influenced by a boundary or property line.
- *Strap footing* A combined footing consisting of two spread footings with a beam or strap connecting the slabs. The purpose of this is to limit differential settlements.
- *Mat foundation* A slab that supports multiple columns. The mat can be stiffened with a grid or grade beams. It is typically used when the soil capacity is very low.


# **Deep Foundation Types**

Considerable material and excavation is required, increasing cost and effort.

- *Retaining Walls* A wall that retains soil or other materials, and must resist sliding and overturning. Can have counterforts, buttresses or keys.
- *Basement Walls* A wall that encloses a basement space, typically next to a floor slab, and that may be restrained at the top by a floor slab.
- *Piles* Next choice when spread footings or mats won't work, piles are used to distribute loads by end bearing to strong soil or friction to low strength soils. Can be used to resist uplift, a moment causing overturning, or to compact soils. Also useful when used in combination to control settlements of mats or slabs.  $P_a = A_a \cdot f_a$

Drilled Piers – Soil is removed to the shape of the pier and concrete is added.

*Caissons* –Water and possibly wet soil is held back or excavated while the footing is constructed or dropped into place.

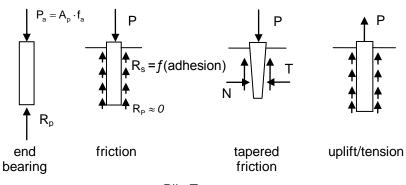

Pile Types

#### Note Set 27.1

# Loads and Stresses

Bearing loads must be distributed to the soil materials, but because of their variability and the stiffness of the footing pad, the resulting stress, or soil pressure, is not necessarily uniform. But we assume it is for design because dealing with the complexity isn't worth the time or effort.

The increase in weight when replacing soil with concrete is called the <u>overburden</u>. Overburden may also be the result of adding additional soil to the top of the excavation for a retaining wall. It is extra *uniformly distributed load* that is considered by reducing the allowable soil pressure (instead of increasing the loads), resulting in a net allowable soil pressure,  $q_{\text{net}}$ :

$$q_{net} = q_{allowable} - h_f(\gamma_c - \gamma_s)$$

In order to design the footing size, the actual stress P/A must be less than or equal to the allowable pressure: P

$$\frac{P}{A} \le q_{net}$$

# Design Stresses


The result of a uniform pressure on the underside of a footing is identical to a distributed load on a slab over a column when looked at *upside down*. The footing slab must resist bending, one-way shear and two-way shear (punching).




Combined axial and bending stresses increase the pressure on one edge or corner of a footing. We assume again a linear distribution based on a constant relationship to settling. If the pressure combination is in tension, this effectively means the contact is gone between soil and footing and the pressure is really zero. To avoid zero pressure, the eccentricity must stay within the <u>kern</u>. The maximum pressure must not exceed the net allowable soil pressure.

If the contact is gone, the maximum pressure can be determined knowing that the volume of the *pressure wedge* has to equal the column load, and the centroid of the *pressure wedge* coincides with the effective eccentricity.


Wedge volume is  $V = \frac{wpx}{2}$  where *w* is the width, *p* is the soil pressure, and *x* is the wedge length (3*a*), so  $p = \frac{2P}{wx} or \frac{2N}{wx}$  (and  $e = \frac{M}{P} or \frac{M}{N}$  and  $a = \frac{1}{2} width - e$ )




RIGID footing on sand




RIGID footing on clay







one-way shear

two-way shear





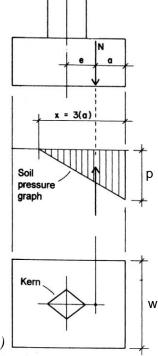

Overturning is considered in design such that the resisting moment from the soil pressure (equivalent force at load centroid) is greater than the overturning moment, M, by a factor of safety of at least 1.5

$$SF = \frac{M_{resist}}{M_{overturning}} \ge 1.5$$

where

 $M_{resist}$  = average resultant soil pressure x width x location of load centroid with respect to column centroid

 $M_{overturning} = P \times e$ 

#### **Combined Footings**

The design of combined footing requires that the centroid of the area be as close as possible to the resultant of the two column loads for uniform pressure and settling.

#### Retaining Walls

The design of retaining walls must consider overturning, settlement, sliding and bearing pressure. The water in the retained soil can significantly affect the loading and the active pressure of the soil. The lateral force acting at a height of H/3 is determined from the active pressure,  $p_A$ , (in force/cubic area) as:

 $H_A = \frac{p_A H^2}{2}$ 

Overturning is considered the same as for eccentric footings:

$$SF = \frac{M_{resist}}{M_{overturning}} \ge 1.5 - 2$$

where

 $M_{resist}$  = summation of moments about "o" to resist rotation, typically including the moment due to the weight of the stem and base and the moment due to the passive pressure.


M<sub>overturning</sub> = moment due to the active pressure about "o".


Sliding must also be avoided:


$$SF = rac{F_{horizontat-resist}}{F_{sliding}} \ge 1.25 - 2$$

where:

 $F_{horizontal-resist}$  = summation of forces to resist sliding, typically including the force from the passive pressure and friction (F= $\mu$ ·N where  $\mu$  is a constant for the materials in contact and N is the normal force to the ground acting down and shown as R). F<sub>sliding</sub> = sliding force as a result of active pressure.







For sizing, some rules of thumbs are:

- footing size, B
- reinforced concrete,  $B \approx 2/5 2/3$  wall height (H)
- footing thickness,  $h_f \approx 1/12 1/8$  footing size (B)
- base of stem,  $b \approx 1/10 1/12$  wall height (H+h<sub>f</sub>)
- top of stem,  $t \ge 12$  inches

#### Example 1


- *Example 2.* Design a square column footing for the following data: Soil density =  $100 \text{ lb/ft}^3$ , Concrete density =  $150 \text{ lb/ft}^3$ 
  - Column load = 200 kips [890 kN] dead load and 300 kips [1334 kN] live load


Column size = 15 in. [380 mm] square


Maximum allowable soil pressure = 4000 psf [200 kPa]

Concrete design strength = 3000 psi [21 MPa]


Yield stress of steel reinforcement = 40 ksi [280 MPa]








(b) For punching shear





#### Example 2


For the 16 in. thick 8.5 ft. square reinforced concrete footing carrying 150 kips dead load and 100 kips live load on a 24 in. square column, determine if the footing thickness is adequate for 4000 psi . A 3 in. cover is required with concrete in contact with soil.

Also determine the moment for reinforced concrete design.

#### SOLUTION:

1. Find design soil pressure:  $q_u = \frac{P_u}{A}$ 

 $P_{u} = 1.2D + 1.6L = 1.2 (150 \text{ k}) + 1.6 (100 \text{ k}) = 340 \text{ k}$  $q_{u} = \frac{340k}{(8.5 \text{ ft})^{2}} = 4.71 \text{ k/ft}^{2}$ 

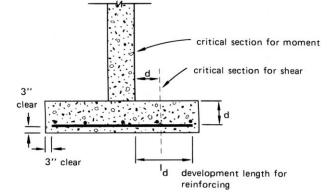

2. Evaluate one-way shear at d away from column face (Is  $V_u < \phi V_c$ ?)

 $d = h_f - c.c. - distance$  to bar intersection

presuming #8 bars:

d = 16 in. - 3 in. (soil exposure) - 1 in. x (1 layer of #8's) = 12 in.

 $V_u$  = total shear =  $q_u$  (edge area)

 $V_u$  on a 1 ft strip =  $q_u$  (edge distance) (1 ft)

 $V_u = 4.71 \text{ k/ft}^2 [(8.5 \text{ ft} - 2 \text{ ft})/2 - (12 \text{ in.})(1 \text{ ft}/12 \text{ in.})] (1 \text{ ft}) = 10.6 \text{ k}$ 


 $\phi V_n$  = one-way shear resistance =  $\phi 2 \sqrt{f'_c}$  bd

for a one foot strip, b = 12 in.

$$\phi V_c = 0.75(2\sqrt{4000} \text{ psi})(12 \text{ in.})(12 \text{ in.}) = 13.7 \text{ k} > 10.6 \text{ k OK}$$

3. Evaluate two-way shear at d/2 away from column face (Is  $V_u < \phi V_c$ ?)

 $b_o$  = perimeter = 4 (24 in. + 12 in.) = 4 (36 in.) = 144 in  $V_u$  = total shear on area outside perimeter =  $P_u - q_u$  (punch area)  $V_u$  = 340 k - (4.71 k/ft<sup>2</sup>)(36 in.)<sup>2</sup>(1 ft/12 in.)<sup>2</sup> = 297.6 kips

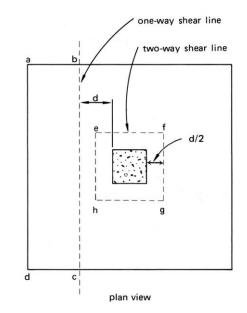

 $\partial V_n$  = two-way shear resistance =  $\partial 4 \sqrt{f'_c} b_0 d = 0.75(4 \sqrt{4000} \text{ psi})(144 \text{ in.})(12 \text{ in.}) = 327.9 \text{ k} > 297.6 \text{ k OK}$ 

#### 4. Design for bending at column face

 $M_u = w_u L^2/2$  for a cantilever. L = (8.5 ft - 2 ft)/2 = 3.25 ft, and  $w_u$  for a 1 ft strip =  $q_u$  (1 ft)

 $M_u = 4.71 \text{ k/ft}^2(1 \text{ ft})(3.25 \text{ ft})^2/2 = 24.9 \text{ k-ft}$  (per ft of width)

To complete the reinforcement design, use b =12 in. and trial d = 12 in., choose  $\rho$ , determine A<sub>s</sub>, find if  $\beta M_n > M_{u...}$ 

5. Check transfer of load from column to footing:

$$\phi P_n = \phi 0.85 f'_c? A_1 \sqrt{\frac{A_2}{A_1}} \le \phi 0.85 f_c 2A_1 = 0.65(0.85)(4000 \text{ psi})(2)(12 \text{ in.})(12 \text{ in.}) = 636.5 \text{ k} > 340 \text{ k OK}$$

#### Example 3

- Example 8-1: Evaluate the suitability of a 4-ft square footing supporting a 1-ft square column ( $P_D = 75$  kips and  $P_L = 25$  kips) for an allowable soil pressure of 7 k/ft<sup>2</sup> using a) gross soil pressure, b) net soil pressure. The bottom of the one-foot thick footing is set at 5 ft below grade. The unit weight of soil is given as 125 pcf.
  - a) gross soil pressure,  $q_g$ :

		-	foo	ting wei	ght:	(4)(4)(1)(0.150)	=	2.4
				-	-	: (1)(1)(4)(0.150)	=	0.6
			soi	l weight:	(	(4)(16-1)(0.125)	$c_{i}=c_{i}$	7.5
	- service loads: 75 + 25			=	100.0			
						Total		110.5 kips
$q_{g}$	=	$\frac{P}{A}$	=	110.5	=	$6.9 \text{ kips/ft}^2 < 7 \text{ kips/ft}^2$	<u>O.K.</u>	

b) net soil pressure,  $q_n$ :

 $q_n$ 

$$= \frac{100}{16} = 6.25 \text{ kips/ft}^2 < q_n = 7 - 1(0.150 - 0.125) = 6.975 \text{ kips/ft}^2 \text{ O.K.}$$

c) 
$$q_{nu} = \frac{1.2(75) + 1.6(25)}{16} = 8.13 \text{ kips/ft}^2$$

#### Example 4

Determine the depth required for the group of 4 friction piles having 12 in. diameters if the column load is 100 kips and the frictional resistance is  $400 \text{ lbs/ft}^2$ .

#### SOLUTION:

The downward load is resisted by a friction force. Friction is determined by multiplying the friction resistance (a stress) by the area:  $F = fA_{SKIN}$ 

The area of n cylinders is:  $A_{SKIN} = n(2\pi \frac{d}{2}L)$ 

Our solution is to set  $P \le F$  and solve for length:

$$100k \le 400 \frac{lb}{ft^2} (4^{piles}) (2\pi) (\frac{12in}{2}) L \cdot (\frac{1ft}{12in}) \cdot (\frac{1k}{1000lb}) L \ge 19.9 \frac{ft}{pile}$$

#### Example 5

Determine the depth required for the friction and bearing pile having a 36 in. diameter if the column load is 300 kips, the frictional resistance is  $600 \text{ lbs/ft}^2$  and the end bearing pressure allowed is 8000 psf.


#### SOLUTION:

The downward load is resisted by a friction force and a bearing force, which can be determined from multiplying the bearing pressure by the area in contact:  $F = fA_{SKIN} + qA_{TIP}$ 

The area of a circle is:  $A_{TIP} = \pi \frac{d^2}{4}$ 

Our solution is to set  $P \le F$  and solve for length:

$$300k \le 600 \frac{b}{ft^2} 2\pi (\frac{36in}{2})L \cdot (\frac{1ft}{12in}) \cdot (\frac{1k}{1000lb}) + 8000 \frac{b}{ft^2} \pi \frac{(36in)^2}{4} \cdot (\frac{1ft}{12in})^2 \cdot (\frac{1k}{1000lb}) L \ge 43.1 ft$$



P = 300 kips

# Design of Isolated Square and Rectangular Footings (ACI 318-02)

# Notation:

a	= equivalent square column size in
	spread footing design

- = depth of the effective compression block in a concrete beam
- $A_g$  = gross area, equal to the total area ignoring any reinforcement
- $A_{req}$  = area required to satisfy allowable stress
- $A_s$  = area of steel reinforcement in concrete design
- $A_1$  = area of column in spread footing design
- $A_2$  = projected bearing area of column load in spread footing design
- *b* = rectangular column dimension in concrete footing design
  - = width, often cross-sectional

 $b_f$  = width of the flange of a steel or cross section

- $b_o$  = perimeter length for two-way shear in concrete footing design
- *B* = spread footing dimension in concrete design
  - = dimension of a steel base plate for concrete footing design
- $B_s$  = width within the longer dimension of a rectangular spread footing that reinforcement must be concentrated within for concrete design
- c = rectangular column dimension in concrete footing design
- C = dimension of a steel base plate for concrete footing design
- d = effective depth from the top of a reinforced concrete member to the centroid of the tensile steel
- $d_b$  = bar diameter of a reinforcing bar
- $d_f$  = depth of a steel column flange (wide flange section)
- $f'_{c}$  = concrete design compressive stress
- $f_y$  = yield stress or strength
- $h_f$  = height of a concrete spread footing
- $l_d$  = development length for reinforcing steel
- $l_{dc}$  = development length for column

- $l_s$  = lap splice length in concrete design
- L = name for length or span length
- $L_m$  = projected length for bending in concrete footing design
- L' = length of the one-way shear area in concrete footing design
- $M_n$  = nominal flexure strength with the steel reinforcement at the yield stress and concrete at the concrete design strength for reinforced concrete flexure design
- $M_u$  = maximum moment from factored loads for LRFD beam design
- P = name for axial force vector
- $P_{dowels}$  = nominal capacity of dowels from concrete column to footing in concrete design
- $P_D$  = dead load axial force
- $P_L$  = live load axial force
- $P_n$  = nominal column or bearing load capacity in concrete design
- $P_u$  = factored axial force
- $q_{allowable}$  = allowable soil bearing stress in allowable stress design
- $q_{net}$  = net allowed soil bearing pressure
- $q_u$  = factored soil bearing capacity in concrete footing design from load factors
- $V_c$  = shear force capacity in concrete
- $V_n$  = nominal shear force capacity
- $V_{u1}$  = maximum one-way shear from factored loads for LRFD beam design
- $V_{u2}$  = maximum two-way shear from factored loads for LRFD beam design
- $\beta_c$  = ratio of long side to short side of the column in concrete footing design
- $\phi$  = resistance factor
- $\gamma_c$  = density or unit weight of concrete
- $\gamma_s$  = density or unit weight of soil
- $\rho$  = reinforcement ratio in concrete beam design = A<sub>s</sub>/bd
- $v_c$  = shear strength in concrete design

- NOTE: This procedure assumes that the footing is concentrically loaded and carries no moment so that the soil pressure may be assumed to be uniformly distributed on the base.
- 1) Find service dead and live column loads:

 $P_D$  = Service dead load from column

 $P_L$  = Service live load from column

 $P = P_D + P_L$  (typically – see **ACI 9.2**)

2) Find design (factored) column load, Pu:

 $P_{\rm U} = 1.2P_{\rm D} + 1.6P_{\rm L}$ 

3) Find an approximate footing depth, h<sub>f</sub>

 $h_f = d + 4$ " and is usually in multiples of 2, 4 or 6 inches.

a) For rectangular columns

$$4d^2 + 2(b+c)d = \frac{P_u}{\phi v_c}$$

**b**) For round columns

$$d^2 + ad = \frac{P_u}{\phi v_c} \qquad a = \sqrt{\frac{\pi d^2}{4}}$$

where: *a* is the equivalent square column size

$$v_c = 4\sqrt{f'_c}$$
 for two-way shear  $\phi = 0.75$  for shear

4) Find net allowable soil pressure, q<sub>net</sub>:

By neglecting the weight of any additional top soil added, the net allowable soil pressure takes into account the change in weight when soil is removed and replaced by concrete:

$$q_{net} = q_{allowable} - h_f (\gamma_c - \gamma_s)$$


where  $\gamma_c$  is the unit weight of concrete (typically 150 lb/ft<sup>3</sup>) and  $\gamma_s$  is the unit weight of the displaced soil


5) Find required area of footing base and establish length and width:


$$A_{req} \geq \frac{P}{q_{net}}$$


For square footings choose  $B \ge \sqrt{A_{req}}$ 

For rectangular footings choose  $B \times L \ge A_{reg}$ 



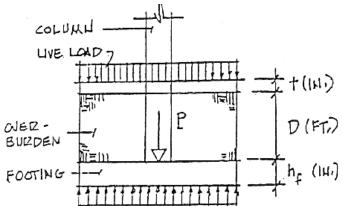





- 6) <u>Check transfer of load from column to footing</u>: ACI 15.8
  - a) Find load transferred by bearing on concrete in column: ACI 10.17 basic:  $\phi P_n = \phi 0.85 f'_c A_1$  where  $\phi = 0.65$  and  $A_1$  is the area of the column

with confinement: 
$$\phi P_n = \phi 0.85 f_c' A_1 \sqrt{\frac{A_2}{A_1}}$$
 where  $\sqrt{\frac{A_2}{A_1}}$  cannot exceed 2.

IF the column concrete strength is lower than the footing, calculate  $\phi P_n$  for the column too.

**b**) Find load to be transferred by dowels:

$$\phi P_{dowels} = P_u - \phi P_n$$

IF  $\phi P_n \ge P_u$  only nominal dowels are required.

c) Find required area of dowels and choose bars


Req. dowel 
$$A_s = \frac{\phi P_{dowels}}{\phi f_y}$$
 where  $\phi = 0.65$  and  $f_y$  is the reinforcement grade

Choose dowels to satisfy the required area and nominal requirements:

- i) Minimum of 4 bars
- ii) Minimum  $A_s = 0.005 A_g$  ACI 15.8.2.1

where  $A_g$  is the gross column area

**iii**) 4 - #5 bars



$$l_{dc} = \frac{0.02 f_y d_b}{\sqrt{f'_c}}$$
 but not less than  $0.0003 f_y d_b$  or 8" where  $d_b$  is the bar diameter

NOTE: The footing must be deep enough to accept  $l_{dc}$ . Hooks are not considered effective in compression and are only used to support dowels during construction.

h :


e) Find length of lapped splices of dowels with column bars: ACI 12.16


i) larger of  $l_{dc}$  or  $0.0005 f_y d_b (f_y \text{ of grade 60 or less})$ 

of smaller bar  $(0.0009 f_y - 24)d_b$  (f<sub>y</sub> over grade 60)

- ii)  $l_{dc}$  of larger bar
- iii) not less than 12"

See ACI 12.17.2 for possible reduction in  $l_s$ 






de MIH

 $l_s$  is the largest of:

#### 7) <u>Check two-way (slab) shear:</u>

- a) Find dimensions of loaded area:
  - i) For concrete columns, the area coincides with the column area, if rectangular, or equivalent square area if circular (see 3)b))
  - ii) For steel columns an equivalent loaded area whose boundaries are halfway between the faces of the steel column and the edges of the steel base plate is used: ACI 15.4.2c.

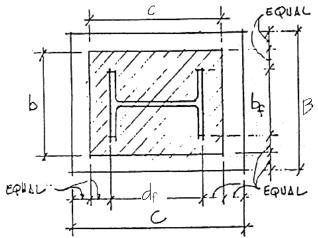

$$b = b_f + \frac{(B - b_f)}{2}$$
 where  $b_f$  is the width of column flange and B is base plate side

 $c = d_f + \frac{(C - d_f)}{2}$  where  $d_f$  is the depth of column flange and C is base plate side

b) Find shear perimeter: ACI 11.12.1.2

Shear perimeter is located at a distance of  $\frac{d}{2}$  outside boundaries of loaded area and

length is  $b_o = 2(c+d) + 2(b+d)$ 

(average  $d = h_f - 3$  in. cover - 1 assumed bar diameter)

c) Find <u>factored</u> net soil pressure,  $q_u$ :

$$q_u = \frac{P_u}{B^2} \text{ or } \frac{P_u}{B \times L}$$

**d**) Find total shear force for two-way shear,  $V_{u2}$ :

$$V_{u2} = P_u - q_u (c+d)(b+d)$$


e) Compare  $V_{u2}$  to two-way capacity,  $\phi V_n$ :


$$V_{u2} \le \phi \left(2 + \frac{4}{\beta_c}\right) \sqrt{f_c'} b_o d \le \phi 4 \sqrt{f_c'} b_o d \quad \text{ACI 11.12.2.1}$$

where  $\phi = 0.75$  and  $\beta_c$  is the ratio of long side to short

#### side of the column

NOTE: This should be acceptable because the initial footing size was chosen on the basis of two-way shear limiting. If it is not acceptable, increase  $h_f$  and repeat steps starting at b).

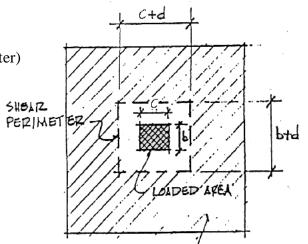

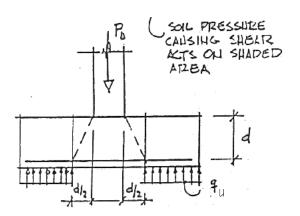

8) <u>Check one-way (beam) shear:</u>

The critical section for one-way shear extends across the width of the footing at a distance d from the face of the loaded area (see 7)a) for loaded area). The footing is treated as a cantilevered beam. ACI 11.12.1.1

- **a)** Find projection, *L*':
  - i) For square footing:

$$L' = \frac{B}{2} - (d + \frac{b}{2})$$
 where b is the smaller dim. of

the loaded area

ii) For rectangular footings:

$$L' = \frac{L}{2} - (d + \frac{\bullet}{2})$$
 where • is the dim. parallel to

the long side of the footing

**b**) Find total shear force on critical section,  $V_{ul}$ :

$$V_{u1} = BL'q_u$$

c) Compare  $V_{u1}$  to one-way capacity,  $\phi V_n$ :

$$V_{u1} \le \phi 2 \sqrt{f_c' B d}$$
 ACI 11.12.3.1 where  $\phi = 0.75$ 

NOTE: If it is not acceptable, increase  $h_{\rm f}$  .

#### 9) Check for bending stress and design reinforcement:

Square footings may be designed for moment in one direction and the same reinforcing used in the other direction. For rectangular footings the moment and reinforcing must be calculated separately in each direction. The critical section for moment extends across the width of the footing at the face of the loaded area. ACI 15.4.1, 15.4.2.


**a**) Find projection,  $L_m$ :


$$L_m = \frac{B}{2} - \frac{\bullet}{2}$$
 where • is the smaller dim. of column for a square


footing. For a rectangular footing, use the value perpendicular to the critical section.

**b**) Find total moment, M<sub>u</sub>, on critical section:

$$M_u = q_u \frac{BL_m^2}{2}$$
 (find both ways for a rectangular footing)







c) Find required  $A_s$ :

$$R_n = \frac{M_n}{bd^2} = \frac{M_u}{\phi bd^2}$$
, where  $\phi = 0.9$ , and  $\rho$  can be found

from Figure 3.8.1 of Wang & Salmon.

or:

i) guess *a* 

$$\mathbf{ii}) \qquad A_s = \frac{0.85 f_c' ba}{f_v}$$

**iii)** solve for 
$$a = 2\left(d - \frac{M_u}{\phi A_s f_y}\right)$$

iv) repeat from ii) until a converges, solve for  $A_s$ 

Minimum  $A_s$ 


= 0.0018bhGrade 60 for temperature and shrinkage control= 0.002bhGrade 40 or 50

ACI 10.5.4 specifies the requirements of 7.12 must be met, and max. spacing of 18"

d) Choose bars:


For square footings use the same size and number of bars uniformly spaced in each direction (ACI 15.4.3). Note that required  $A_s$  must be furnished in each direction.

For rectangular footings bars in long direction should be uniformly spaced. In the short direction bars should be distributed as follows (ACI 15.4.4):




# bars = 
$$\frac{2}{L_B'+1} \cdot (\#bars in B)$$
 (integer)

ii) Remaining bars in short direction should be uniformly spaced in outer portions of footing.



e) Check development length:

Find required development length,  $l_d$ , in tension from handout or from equations in **ACI 12.2**.  $l_d$  must be less than  $(L_m - 2^n)$  (end cover). If not possible, use more bars of smaller diameter.



# **Masonry Design**

#### Notation:

11000		
Α	=	name for area
$A_n$	=	net area, equal to the gross area
		subtracting any reinforcement
$A_{nv}$	=	net shear area of masonry
$A_s$		area of steel reinforcement in
		masonry design
$A_{st}$	=	area of steel reinforcement in
		masonry column design
ACI	=	American Concrete Institute
ASCE	]=	American Society of Civil Engineers
b		width, often cross-sectional
С	=	name for a compression force
		compression force in the masonry
		for masonry design
CMU	=	shorthand for concrete masonry unit
d		effective depth from the top of a
		reinforced masonry beam to the
		centroid of the tensile steel
e	=	eccentric distance of application of a
		force ( <i>P</i> ) from the centroid of a cross
		section
$f_a$	=	axial stress
$f_b$	=	bending stress
$f_m$		calculated compressive stress in
e m		masonry
$f'_m$	=	masonry design compressive stress
$f_s$	=	stress in the steel reinforcement for
C		masonry design
$f_{v}$		shear stress
$F_a$		allowable axial stress
$F_b$		allowable bending stress
$F_s$	=	allowable tensile stress in
-		reinforcement for masonry design
$F_t$		allowable tensile stress
		allowable shear stress
$F_{vm}$	=	allowable shear stress of the
-		masonry
$F_{vs}$	=	allowable shear stress of the shear
1		reinforcement
h		name for height
-		effective height of a wall or column
$I_x$	=	moment of inertia with respect to an
		x-axis

j	= multiplier by effective depth of
	masonry section for moment arm, jd
k	= multiplier by effective depth of

- masonry section for neutral axis, kd
- L = name for length or span length
- *M* = internal bending moment = type of masonry mortar
- $M_m$  = moment capacity of a reinforced masonry beam governed by steel stress
- *M<sub>s</sub>* = moment capacity of a reinforced masonry beam governed by masonry stress
- *MSJC*= Masonry Structural Joint Council
- *n* = modulus of elasticity transformation coefficient for steel to masonry
- n.a. = shorthand for neutral axis (N.A.)
- N = type of masonry mortar
- NCMA = National Concrete Masonry Association
- *O* = type of masonry mortar
- P = name for axial force vector
- $P_a$  = allowable axial load in columns
- r = radius of gyration
- S =section modulus
  - = type of masonry mortar
- $S_x$  = section modulus with respect to an x-axis
- t = name for thickness
- T = name for a tension force
- $T_s$  = tension force in the steel
  - reinforcement for masonry design
- TMS = The Masonry Society

$$w$$
 = name for distributed load

- $\beta_1$  = coefficient for determining stress block height, *c*, in masonry LRFD design
- $\varepsilon_m$  = strain in the masonry
- $\varepsilon_s$  = strain in the steel
- $\rho$  = reinforcement ratio in masonry design

#### **Reinforced Masonry Design**

Structural design standards for reinforced masonry are established by the *Masonry Standards Joint Committee* consisting of ACI, ASCE and The Masonry Society (TMS), and presents allowable stress design as well as limit state (strength) design.

#### Materials

 $f_{\rm m}$  = masonry prism compressive strength from testing

Reinforcing steel grades are the same as those used for reinforced concrete beams.

Units can be brick, concrete or stone.

Mortar consists of masonry cement, lime, sand, and water. Grades are named from the word <u>MASONWORK</u>, with average strengths of 2500psi, 1800 psi, 750 psi, 350 psi, and 75 psi, respectively.

Grout is a flowable mortar, usually with a high amount of water to cement material. It is used to fill voids and bond reinforcement.

#### Allowable Stress Design

For unreinforced masonry, like masonry walls, tension stresses are allowed in flexure. Masonry walls typically see compression stresses too.

For reinforced masonry, the steel is presumed to resist *all* tensile stresses and the tension in the masonry is ignored.

Factors of Safety are applied to the limit stresses for allowable stress values:

bending (unreinforced)	$F_{\rm b} = 1/3 f'_m$
bending (reinforced)	$F_{\rm b} = 0.45 f'_m$
bending (tension/unreinforced)	table 2.2.3.2
beam shear (unreinforced for flexure)	$F_v = 1.5 \sqrt{f'_m} \le 120 \text{ psi}$
beam shear (reinforced) – $M/(Vd) \le 0.25$	$F_{\rm v}=3.0\sqrt{f_m'}$
beam shear (reinforced) – $M/(Vd) \ge 1.0$	$F_{\rm v}=2.0\sqrt{f_m'}$
Grades 40 or 50 reinforcement	$F_s = 20 \text{ ksi}$
Grades 60 reinforcement	$F_s = 32 \text{ ksi}$
Wire joint reinforcement	$F_s = 30 \text{ ksi}$

where  $f'_{m}$  = specified compressive strength of masonry

#### Internal Equilibrium for Bending

$$C_m = \text{compression in masonry} = \text{stress x area} = f_m \frac{b(kd)}{2}$$

 $T_s$  = tension in steel = stress x area =  $A_s f_s$ 

$$C_{m} = T_{s} \text{ and } \bullet$$

$$M_{m} = T_{s}(d - kd/3) = T_{s}(jd)$$

$$M_{s} = C_{m}(jd)$$

where

 $f_m$  = compressive stress in the masonry from flexure

 $f_s$  = tensile stress in the steel reinforcement

kd = the height to the neutral axis

b = width of stress area

d = effective depth of section = depth to n.a. of reinforcement

jd = moment arm from tension force to compression force

 $A_s$  = area of steel

 $n = E_s/E_m$  used to transform steel to equivalent area of masonry for elastic stresses

 $\rho$  = reinforcement ratio

#### Criteria for Beam Design

For flexure design:

$$M_m = f_m b \frac{kd}{2} jd = 0.5 f_m b d^2 jk$$
 or  $M_s = A_s f_s jd = \rho b d^2 jf_s$ 

The design is adequate when  $f_b \leq F_b$  in the masonry and  $f_s \leq F_s$  in the steel.

Shear stress is determined by  $f_v = V/A_{nv}$  where  $A_{nv}$  is net shear area. Shear strength is determined from the shear capacity of the masonry and the stirrups:  $F_v = F_{vm} + F_{vs}$ . Stirrup spacings are limited to d/2 but not to exceed 48 in.

where:

$$F_{vm} = \frac{1}{2} \left[ \left( 4.0 - 1.75 \left( \frac{M}{Vd} \right) \right) \sqrt{f'_m} \right] + 0.25 \frac{P}{A_n} \quad \text{where M/(Vd) is positive and cannot exceed 1.0}$$
  

$$F_{vs} = 0.5 \left( \frac{A_v F_s d}{A_{nv} s} \right) \qquad (F_v = 3.0 \sqrt{f'_m} \quad \text{when M/(Vd)} \ge 0.25 )$$
  

$$(F_v = 2.0 \sqrt{f'_m} \quad \text{when M(Vd)} \ge 1.0.) \quad \text{Values can be linearly interpolated.}$$

#### Load and Resistance Factor Design

The design methodology is similar to reinforced concrete ultimate strength design. It is useful with high shear values and for seismic design. The limiting masonry strength is  $0.80f'_{m}$ .

# **Criteria for Column Design**

(Masonry Joint Code Committee) Building Code Requirements and Commentary for Masonry Structures define a column as having b/t < 3 and h/t > 4.

where

b = width of the "wall" t = thickness of the "wall" h = height of the "wall"

A slender column has a minimum dimension of 8" on one side and  $h/t \le 25$ .

Columns must be reinforced, and have ties. A minimum eccentricity (causing bending) of 0.1 times the side dimension is required.

Allowable Axial Load for Reinforced Masonry

$$P_{a} = \left[0.25 f'_{m} A_{n} + 0.65 A_{st} F_{s} \right] \left[1 - \left(\frac{h}{140r}\right)^{2}\right] \quad \text{for h/t} \le 99$$
$$P_{a} = \left[0.25 f'_{m} A_{n} + 0.65 A_{st} F_{s} \right] \left(\frac{70r}{h}\right)^{2} \qquad \text{for h/t} > 99$$



Allowable Axial Stresses for Unreinforced Masonry


$$F_{a} = 0.25 f'_{m} \left[ 1 - \left(\frac{h}{140r}\right)^{2} \right] \qquad \text{for } h/t \le 99$$
$$F_{a} = 0.25 f'_{m} \left(\frac{70r}{h}\right)^{2} \qquad \text{for } h/t > 99$$

where

 $h = effective length \\ r = radius of gyration \\ A_n = effective (or net) area of masonry \\ A_{st} = area of steel reinforcement \\ f'_m = specified masonry compressive strength \\ F_s = allowable compressive stress in column reinforcement with lateral confinement.$ 

# Combined Stresses

When maximum moment occurs somewhere other than at the end of the column or wall, a "virtual" eccentricity can be determined from e = M/P.



# Masonry Columns and Walls

Masonry Columns and waits There are no modification factors, but in addition to satisfying  $\frac{f_a}{F_a} + \frac{f_b}{F_b} \le 1.0$ , the tensile stress

cannot exceed the allowable:  $f_b - f_a \leq F_t$  or the compressive stress exceed allowable for reinforced masonry:  $f_a + f_b \leq F_b$  provided  $f_a \leq F_a$ .

8" CMU face shell

assume  $E_m = 1800$  ksi

bedding

#### Example 1

Determine if the unreinforced CMU wall can sustain its loads with the wind. Specify a mortar type and unit strength per MSJC.

$$\frac{f_a}{F_a} + \frac{f_b}{F_b} \le 1.0 \qquad F_b = \frac{1}{3} f'_m \qquad f_b = \frac{M}{S} \qquad f_a = \frac{P}{A}$$

$$F_a = 0.25 f'_m \left[ 1 - \left(\frac{h}{140r}\right)^2 \right] for \frac{h}{r} \le 99$$

$$F_a = 0.25 f'_m \left(\frac{70r}{h}\right)^2 for \frac{h}{r} > 99$$

$$\frac{h}{r} = \frac{12 ft(12in)}{3.21in} = 44.9 \text{ so } F_a = 0.25 f'_m \left[ 1 - \left(\frac{12 \cdot 12in}{140 \cdot 3.21in}\right)^2 \right] = 0.224 f'_m$$

$$\frac{h}{r} = \frac{4k(1000 \text{ W})}{4k(1000 \text{ W})}$$

4 kip/

 $f_a = \frac{4k(1000^{10}/k)}{30in^2} = 133\,psi$ 

Case "A" with wind

at midheight of wall : 
$$(1 \text{ ft} \cdot \text{kips/ft}^2)$$
 (ft) (in/ft)  


$$M = \frac{Pe}{2} + \frac{wh^2}{8} = \frac{4 \text{ kip x } 3''}{2} + \left[\frac{(0.030)(12)^2}{8}\right] x 12 = 12.5 \text{ kip - in.}$$

$$f_b = \frac{12,500 \text{ lb} \cdot \text{in}}{81.0 \text{ in}^3} = 154 \text{ psi} \qquad f_b \le 1/3 f'_m$$
tension criterion :  $f'_m \ge 154/(1/3) = 462 \text{ psi}$   
 $-f_a + f_b = F_t$   
 $-133 \text{ psi} + 154 \text{ psi} = 21 \text{ psi}$   
 $F_{i \text{ reg'd}} = 21 \text{ psi}$   
Moment distribution Moment distribution from

compression criterion :

$$\frac{f_a}{F_a} + \frac{f_b}{F_b} < 1, \qquad \frac{133}{0.174f'_m} + \frac{154}{0.333f'_m} = 1; \qquad f'_m = 1056 \text{ psi}$$

from eccentricity



Case "B" without wind

at top of wall : 
$$M = Pe = 12.0 \text{ kip - in.}$$
  
 $f_b = 12,000 \text{ lb - in/81 in}^3 = 148 \text{ psi}$   
tension criterion :  $-f_a + f_b = F_t$   
 $-133 \text{ psi + 148 psi = 15 psi}$   $F_{t \text{ reg'd}} = 15 \text{ psi}$   
Per MSJC Table 2.2.3.2, use PCL Type N mortar  $F_t = 25 \text{ psi}$   
compression criterion :  $\frac{f_a}{F_a} + \frac{f_b}{F_b} \le 1.0$   
 $\frac{133}{0.224 f'_m} + \frac{148}{0.333 f'_m} = 1.00$   $f'_m = 1038 \text{ psi}$   $f'_m = 1056 \text{ psi (governs)}$ 

Direction of flexural tensile	Mortar types					
stress and masonry type		ment/lime or cement	Masonry cement or air entrained portland cement/lime			
	M or S	N	M or S	N		
Normal to bed joints						
Solid units	53 (366)	40 (276)	32 (221)	20 (138)		
Hollow units <sup>1</sup>						
Ungrouted	33 (228)	25 (172)	20 (138)	12 (83)		
Fully grouted	86 (593)	84 (579)	81 (559)	77 (531)		
Parallel to bed joints in running bond			_			
Solid units	106 (731)	80 (552)	64 (441)	40 (276)		
Hollow units						
Ungrouted and partially grouted	66 (455)	50 (345)	40 (276)	25 (172)		
Fully grouted	106 (731)	80 (552)	64 (441)	40 (276)		
Parallel to bed joints in masonry not laid in running bond						
Continuous grout section parallel to bed joints	133 (917)	133 (917)	133 (917)	133 (917)		
Other	0 (0)	0 (0)	0 (0)	0 (0)		

#### Table 2.2.3.2 — Allowable flexural tensile stresses for clay and concrete masonry, psi (kPa)

For partially grouted masonry, allowable stresses shall be determined on the basis of linear interpolation between fully grouted hollow units and ungrouted hollow units based on amount (percentage) of grouting.

17B REVISED

> March 1999

# Technical Notes on Brick Construction

Brick Industry Association 11490 Commerce Park Drive, Reston, Virginia 20191


#### REINFORCED BRICK MASONRY BEAMS

**Abstract:** Reinforced brick masonry (RBM) beams are an efficient and attractive means of spanning building openings. The addition of steel reinforcement and grout permits brick masonry to span considerable distances while maintaining continuity of the building facade. Attractive brick soffits and elimination of steel support members are two of the advantages of reinforced brick masonry beams. This *Technical Notes* addresses the design of reinforced brick masonry beams. Building code requirements are reviewed and design aids are provided to simplify the design process. Illustrations indicate the proper detailing and typical construction of reinforced brick masonry beams.

Key Words: beam, deflection, girder, lintel, reinforced brick masonry, reinforcement.

#### INTRODUCTION

Reinforced brick masonry (RBM) beams are widely used as flexural members. Common applications of RBM beams include girders supporting floor and roof systems, and arches and lintels spanning openings for windows and doors. Girder is the term applied to a large beam with a long span that usually supports smaller framing members. A lintel is a beam over a wall opening, typically simply supported with no framing members. The main advantage of RBM beams is that the structural element and the architectural finish are one and the same. In some cases, however, they provide economical solutions without considering the savings due to a built-in finish. They are often built as an integral part of a masonry wall as illustrated in Figure 1. RBM beams are designed to carry all superimposed loads, including that portion of the wall weight above

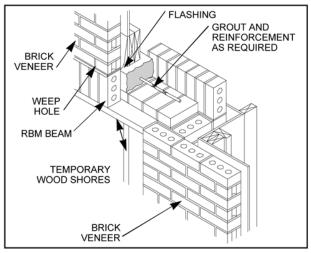

Typical RBM Beam in Brick Veneer Wall FIG. 1

supported by the beam. While steel lintels are more common, RBM beams provide distinct advantages over steel lintels. Among the advantages are:

- 1. More efficient use of materials. The masonry serves as a structural element with a relatively small amount of steel reinforcement added.
- 2. Elimination of differential movement. This movement is often the cause of cracks in masonry.
- 3. Inherent fire resistance.
- 4. Reduced maintenance. Periodic painting of exposed steel is eliminated.
- 5. Lower cost.

This *Technical Notes* provides a review of the design of RBM beams. Factors influencing design and performance are reviewed. Design recommendations and aids are provided and their use illustrated with an example. For additional information about RBM beams and design calculations, refer to the *Masonry Designers' Guide* (MDG) [2]. The MDG also provides an extensive review of the requirements of the *Building Code Requirements for Mason - ry Structures* (ACI 530/ASCE 5/TMS 402-95)[1], hereafter termed the MSJC Code. Other *Technical Notes* in this series provide the history of RBM, material and construction requirements, and design of other RBM elements.

This *Technical Notes* does not address the design of deep beams (wall beams) or bond beams. A deep beam is one with a depth-to-span ratio exceeding 0.8. Assumptions made in this *Technical Notes* regarding the distribution of stress in beams under flexure and the loading conditions do not apply to deep beams. Bond beams are formed by placing horizontal reinforcement in a wall without an opening underneath.

#### NOTATION

Following are notations used in the text, figures, and table in this *Technical Notes*.

- $A_v$  Area of shear reinforcement, in.<sup>2</sup> (mm<sup>2</sup>)
- b Length of bearing plate, ft (m)
- d Effective depth of beam, in. (mm)
- d<sub>b</sub> Nominal diameter of reinforcement, in. (mm)
- F<sub>s</sub> Allowable steel stress, psi (MPa)
- f'<sub>m</sub> Specified compressive strength of masonry, psi (MPa)
- H Height of beam, in. (mm)
- l<sub>d</sub> Embedment length of reinforcement, in. (mm)
- M<sub>G</sub> Design moment due to gravity loads, in.-lb (N-m)
- M<sub>s</sub> Design moment due to in-plane shear, in.-lb (N-m)
- M<sub>w</sub> Design moment due to out-of-plane wind or seismic load, in.-lb (N-m)
- P Design concentrated load, lb (kg)
- s Spacing of shear reinforcement, in. (mm)
- V Design shear force, lb (kg)
- W Width of beam, in. (mm)
- w<sub>p</sub> Design uniform distributed load, lb/ft (kg/m)
- y Distance from top of beam to bearing plate, ft (m)


### DETERMINATION OF LOADING

The basic concept of a beam is as a pure flexural member. A flexural member spans an opening and transfers vertical gravity loads to its supports, as illustrated in Fig. 2(a). RBM beams act in this manner to support their own weight and other applied gravity loads. However, it is also common for RBM beams to be part of a masonry wall. As such, RBM beams are often subjected to out-of-plane wind and seismic forces, as depicted in Fig. 2(b). This causes bending of the RBM beam in the out-of-plane direction, which is often about the weak axis of the beam. In addition, reinforced masonry walls may be shear-resisting members, or "shear walls", which are part of the lateral load-resisting system of a building. In such a structural system, RBM beams may be used as connections between shear walls or piers, as illustrated in Fig. 2(c). Such beams are called coupling beams because they "couple" the shear walls or piers. If the relative sizes of the two piers being coupled are similar, the RBM beam is subject to considerable load when an in-plane shear force is applied to the wall. This is why damage to masonry shear walls is often concentrated at coupling beams following an earthquake or high-wind event.

The designer should consider all aspects of loading for an RBM beam. It is difficult to predict the loading condition that will produce the critical design condition. For example, a RBM beam that is part of a wall will be subject to a combination of gravity loads and out-ofplane wind or seismic loads. Many factors influence the loading conditions for RBM beams.

### **Arching Action**

Arching action is a property of all masonry walls which are laid in an overlapping bond pattern. Brick masonry will span, in a step-like manner similar to a corbel, over a wall opening when laid in running bond pattern. Vertical gravity loads above the openings are

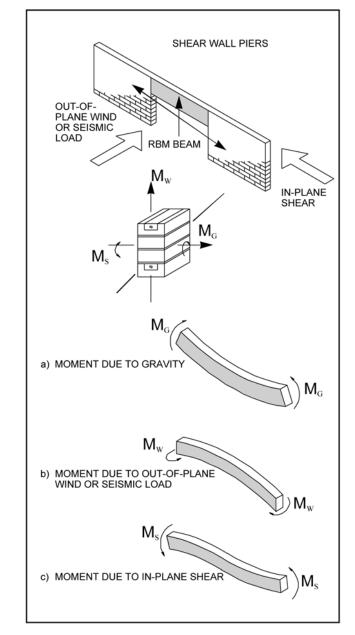


Moments on RBM Beam FIG. 2

transferred to the wall elements on each side. This is the reason why sizable holes can be created in masonry walls without causing collapse. Arching action will occur provided that the following conditions are met:

- 1. An overlapping bond pattern is used in the masonry surrounding the opening.
- 2. The masonry above the apex of a 45 degree isosceles triangle above the beam exceeds 12 in. (300 mm).
- There are no movement joints or adjacent wall openings that hinder the load path of arching action.
- The abutments are sufficiently strong and rigid to resist the horizontal thrust due to arching action. These concepts are illustrated in Fig. 3.

Provided arching action occurs, the self weight of masonry wall carried by the beam may be safely as-

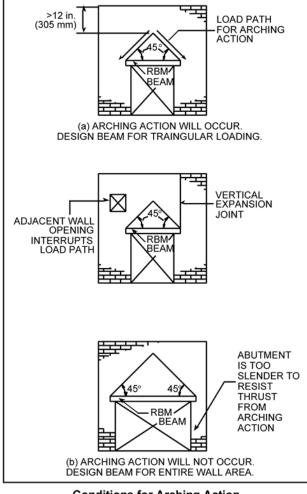

Conditions for Arching Action FIG. 3

sumed as the weight within a triangular area above the beam formed by 45 degree angles, as shown in Fig. 3. The self weight of the wall must be added to the live and dead loads of floors and roofs which bear on the wall above the opening. If a stack bond pattern is used, the full area of brick masonry above the wall opening should be considered in the RBM beam design with no assumption of arching action.

#### **Concentrated Loads**

Loads from beams, girders, trusses and other concentrated loads that frame into the wall must be applied to the RBM beam in the appropriate manner. Concentrated loads may be assumed to be distributed over a wall length equal to the base of a trapezoid whose top is at the point of load application and whose sides make an angle of 60 degrees with the horizontal. In Fig. 4, the portion of the concentrated load carried by the beam is distributed over the length indicated as a uniform load. The distributed load, w<sub>p</sub>, on the RBM beam is computed by the following equation:

where:

$$w_p = P/(b + 2ytan 30)$$
 Eq. 1

 $w_p$ = design uniform distributed load, 1b/ft (kg/m)

P = design concentrated load, 1b (kg)

- b =length of bearing plate, ft (m)
- y = distance from top of beam to bearing plate, ft (m)

This is approximately 0.866 times P divided by y. Because the apex of the 45 degree triangle is above the top of the wall in this example, the RBM beam should be designed assuming no arching action occurs.


The designer should check the stress condition at bearing points for RBM beams. This applies to loads on the beam and to the beam's reaction on the wall. The MSJC Code limits the bearing stress to 0.25  $f'_m$ , where  $f'_m$  is the specified compressive strength of masonry. A rule-of-thumb recommended for many years is to provide a minimum of 4 in. (100 mm) of bearing length for masonry beams. The masonry directly beneath a bearing point should be constructed with solid brick or with solidly grouted hollow brick. Concentrated loads should not bear directly on ungrouted hollow brick masonry because of the potential for localized cracking or crushing of the face shells.

### **Construction Loads**

When designing a RBM beam that is prefabricated or built on the ground and lifted into place, it is important to consider the loads during transport and handling. To address these loads, the beam may require reinforcement at both the top and bottom of the beam. Beams built in place are constructed on shores. These must be designed for the dead weight of the beam plus any superimposed load prior to adequate curing of the reinforced brickwork.

### **Movement Joints**

Movement joints are a necessity in masonry walls to accommodate differential movement and avoid cracking. It is common to place vertical expansion joints at or near the jamb of wall openings. In RBM buildings there is a reduced need for expansion joints and such joints may be spaced farther apart. Refer to *Technical Notes* 18 Series for a discussion of the placement of movement joints. The presence of a movement joint

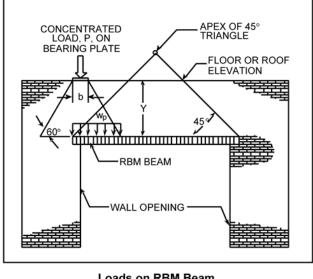

Loads on RBM Beam FIG. 4

near a RBM beam will influence the loads and support conditions for the beam. For example, a simple support condition should be assumed since arching action will not occur if a movement joint is at or near the jamb of the opening. Furthermore, the beam will not act as a coupling beam between shear walls. This is, in fact, one means of simplifying the design and function of a RBM beam by eliminating loads due to in-plane shear.

## DESIGN OF RBM BEAMS

RBM beam design should not be relegated to "ruleof-thumb" methods or arbitrary selection of beam configuration and steel reinforcement. In any beam design, a careful analysis of the loads to be carried and a calculation of the resultant stresses should be incorporated to provide adequate strength and to prevent excessive cracking and deflection.

In addition to adequate strength, it is preferred that beams exhibit ductile behavior when overloaded. If the beam is overloaded, it should deform (deflect) a considerable amount prior to collapse. Deformation allows redistribution of loads to other members and provides visual indication that the beam is overloaded. Some building codes stipulate a maximum reinforcement ratio for RBM beams for this purpose.

Another aspect is the relation between the RBM beam's strength and its cracking moment. Failure of unreinforced masonry in flexure is brittle, exhibiting sudden cracking and often collapse. Consequently, a reinforced beam should provide a moment strength in excess of its cracking moment. The amount of this overstrength is somewhat arbitrary, but a factor of 1.3 is required by the *Uniform Building Code*[3]. This means that the moment strength of a cracked-section, RBM beam should exceed 1.3 times the cracking moment of the beam. This is not a requirement of the MSJC Code, but is considered good engineering practice.

#### Beam Sizing

In the design of an RBM beam, the required cross-sectional area of masonry is based primarily on the maximum bending moment. However, there are other factors to consider when sizing an RBM beam. For example, it is often desirable to have the width of the RBM beam coincide with the specified wall thickness. RBM beams are sometimes formed with special U-shaped, hollow brick for this reason. These brick may be manufactured specially for this purpose or they may be cut from full-size units at the site. Manufactured special shapes may not be readily available in many localities, so it is best to contact the brick manufacturer as early as possible before proceeding with a design based on their use. The beam's depth will be determined by the appropriate number of courses of masonry units present. The beam's depth should be taken as only those courses of solid brick or that are solidly grouted. The beam's depth may be limited by the height of the wall above an opening. In such cases, compression steel may be necessary when sufficient masonry area is not provided.

#### Lateral Bracing

With short spans and relatively deep beams, there is little likelihood of excessive cracking, deflection or rotation. This may not be the case, however, for beams that are relatively long span, shallow or highly loaded. Such beams may be vulnerable to lateral torsional buckling. The designer should consider the lateral bracing conditions to ensure that the beam is laterally braced. The MSJC Code requires that the compression face of beams be laterally supported at a maximum spacing of 32 times the beam thickness. A brick veneer wall is laterally braced by wall ties to the backup system. A RBM beam that is part of a load-bearing wall system may not be laterally braced along its span length. In addition, movement joints at the jambs of a wall opening may result in a lack of lateral bracing for the beam at its supports. In such cases, attachment of the wall to the floor or roof diaphragm is the common means of providing lateral bracing for the beam.

#### **RBM** Arches

Design of RBM arches should begin with an analysis assuming the arch is unreinforced, in accordance with *Technical Notes* 31A or the ARCH computer program available from the Brick Industry Association. Such an analysis will indicate the locations of highest moment and shear, and the horizontal thrust at the abutments. Should the analysis so indicate, the arch should be designed as a reinforced beam. Further, if the conditions shown in Fig. 3 are not met, or if movement joints are provided at the abutments so that the arch may spread under load, the arch should be designed as if it were a straight, simply supported beam as a conservative measure. Alternately, a finite element analysis of the arch may be conducted to determine design moment, shear, and thrust values.

RBM arches cause both a vertical bearing stress and a horizontal thrust on their abutments. The designer has the option of resisting the horizontal thrust of the arch by the abutments or providing room for movement as the RBM arch deforms under load. Judicious placement of vertical expansion joints and flashing will permit horizontal movement and simplify the arch design. This is recommended for longer span arches because providing adequate thrust resistance is difficult and movement joint spacing is limited. In this case, it is very important to provide adequate bearing at the abutments.

### STEEL REINFORCEMENT AND TIES

The quantity of reinforcement required for an RBM beam is typically determined by the applied loads. However, the applicable building code may prescribe a minimum amount of reinforcement and this may dictate the amount of reinforcement required in a RBM beam. For example, all building codes now stipulate a minimum amount of reinforcement for masonry members in areas prone to earthquakes. Some building codes require that reinforcement in masonry coupling beams be uniformly distributed throughout the beam's height. This may require additional reinforcement and grouting of the masonry above wall openings in RBM beams.

### Bond and Hooks

Typically, reinforcement is inserted in masonry beams to resist tension. The tension must be transferred from the masonry to the reinforcement. This is achieved through adequate bond between the steel reinforcement and the masonry. The bond stress along the length of the reinforcement should not exceed an allowable bond stress of 160 psi (1.1 MPa), according to the MSJC Code Commentary. A minimum embedment length must be provided in order to not exceed this bond stress. Consequently, the MSJC Code stipulates a required bond length for reinforcement in tension, called the minimum embedment length. The minimum embedment length is computed by the following equation:  $l_d = 0.0015d_bF_s$  Eq. 2

where:

 $l_d$  = embedment length of reinforcement, in. (mm)

 $d_{b}$  = nominal diameter of reinforcement, in. (mm)

 $F_s$  = allowable steel stress, psi (MPa)

Table 1 provides the minimum development lengths for various bar and wire sizes, based on Grade 60 ksi (414 MPa) reinforcing bars and 70 ksi (483 MPa) steel wire.

The ends of reinforcing bars and wires may require a standard hook to properly secure the reinforcement and to achieve its strength. In simply-supported beams, the peak moment is often at midspan. For this case, the reinforcement in RBM beams can likely be developed by the bond between the bar or wire and the surrounding masonry with no need for hooks at the ends of the beam. However, a cantilever RBM beam may require a hook at the support end. In addition, shear reinforce-

#### TABLE 1

#### Minimum Development Lengths

	Reinforcement	Minimum Development Length, I <sub>d</sub> in. (mm)	
Туре	No., in. (mm)		
<b>Bars</b> 60 ksi (414 MPa)	3, 0.38 (09.5) 4, 0.50 (12.7) 5, 0.63 (15.9) 6, 0.75 (19.1) 7, 0.88 (22.2) 8, 1.00 (25.4) 9, 1.13 (28.7) 10, 1.27 (32.3) 11, 1.41 (35.8)	13.5 (343) 18.0 (457) 22.5 (572) 27.0 (686) 31.5 (800) 36.0 (914) 40.6 (1030) 45.7 (1160) 50.8 (1290)	
<b>Wires</b> 70 ksi (483 MPa)	W1.1, 11 Gage (3.1) W1.7, 9 Gage (3.8) W2.1, 8 Gage (4.1) W2.8, 0.188 (4.8) W4.9, 0.256 (6.4)	min. 6 (152) governs 6.7 (170) 7.3 (185) 8.3 (214) 11.3 (286)	

Note Set 28.2

ment should always be terminated with a hook. Standard hooks for principal reinforcement may be either a 90 degree or 180 degree turn. Often, the designated space for grout and reinforcement in RBM beams is very small. It can be difficult for a contractor to execute a reinforcement detail properly. Consider that a 180 degree hook doubles the number of bars at a given cross section. The designer should always consider the reinforcement placement, tolerances, and cover restrictions stated in the building codes. *Technical Notes* 17A Revised provides further information on bar sizes, placement requirements and construction tolerances.

#### Shear Reinforcement

Where shear reinforcement is required, it should be spaced so that every potential crack is crossed by shear reinforcement. Shear cracks are assumed to be oriented at a 45 degree angle to the longitudinal axis of the RBM beam. This restricts the spacing of shear reinforcement to onehalf the beam's effective depth, d. The spacing of shear reinforcement may be computed by the following equation:

$$= A_v F_s d/V$$
 Eq. 3

where:

s = spacing of shear reinforcement, in. (mm)

 $A_v =$  area of shear reinforcement, in.<sup>2</sup> (mm<sup>2</sup>)

S

 $F_s$  = allowable stress for shear reinforcement, psi (MPa)

d = effective depth of beam, in. (mm)

V = design shear force, 1b (kg)

When shear reinforcement is required, it should be designed to resist the entire shear force. Shear reinforcement should always be placed parallel to the shear force. For RBM beams the shear reinforcement should be placed vertically. It can be difficult to provide shear reinforcement in RBM beams due to the limited size of grout spaces. This is especially the case with hollow brick units 6 in. (150 mm) or less in thickness and grout spaces between wythes less than approximately 2 in. (50 mm) in width. Consequently, it may be advantageous to increase the beam's depth so that shear reinforcement is not necessary. In fact, this is often the method used by designers to determine the minimum depth of a RBM beam required for a given loading.

## Ties

There are two instances when it may be necessary to include ties in reinforced brick beams. These instances occur only when the beam is formed by grouting between wythes. If the beam has sufficient depth, ties may be required between the wythes. The grout exerts a hydrostatic pressure that must be resisted during construction. The MSJC requires wall ties between wythes as follows:

Wire size W1.7 (3.8 mm), one tie per  $2\frac{2}{3}$  ft<sup>2</sup> (0.25 m<sup>2</sup>) Wire size W2.8 (4.8 mm), one tie per  $4\frac{1}{2}$  ft<sup>2</sup> (0.42 m<sup>2</sup>) Maximum spacing of 36 in. (914 mm) horizontally and 24 in. (610 mm) vertically

Rectangular or Z ties may be used.

In beams that form deep soffits (large beam widths) it may be advisable to tie the soffit brickwork to the grout. Although the grout does bond to the brick, the metal ties should provide additional capacity and safety. Such ties are placed in the mortar joint and extend into the grout.

### DEFLECTION

Deflection of RBM beams is considered a serviceability issue. Excessive deflection might cause damage to interior finishes, functional problems with doors or windows, and cracking of masonry supported by the beam. The MSJC Code requires that the deflection of RBM beams that support unreinforced or empirically-designed masonry should not exceed the lesser of 0.3 in. (7.6 mm) or span length divided by 600. Deflection of RBM beams may be computed based on uncracked or cracked section properties. Use of uncracked sections results in underestimating the deflection. Deflection based on cracked sections only are over-estimated and are more difficult to calculate. Use of uncracked section is recommended.

Creep is a time-dependent property of brick masonry that will cause the deflection of RBM beams to increase over time. An accurate formula for the estimation of long-term deflections of RBM beams due to creep, that is applicable for all cases and easy to use, does not currently exist. A rule-of-thumb is that the long-term deflection of RBM beams due to creep will be approximately 50 percent greater than their instantaneous deflection. This means that a beam that deflects 1.0 in. (25 mm) when it is fully loaded will creep over time such that its final deflection will be approximately 1.5 in. (38 mm).

#### **DESIGN CURVES**

Maximum efficiency and safety dictate the need for a rational design of all RBM beams according to the applicable building code. However, it is often helpful for the designer to have design aids that can be used to quickly develop a preliminary beam design. The design curves in Figs. 5-9 are provided for that purpose. The size and configuration of masonry and quantity of reinforcement can be quickly determined from these curves based on the span of the beam and the uniform gravity load supported by the beam, including the beam's self-weight. The curves are based on the following assumptions:

- Compressive strength of masonry is not less than 2000 psi (14 MPa). For most brick masonry, this value will be exceeded. This value was chosen so that beam capacity was not limited by the masonry's compressive strength.
- 2. Elastic modulus of masonry is not less than 1600 ksi (11030 MPa).
- 3. The beam is simply supported and subject to uniform gravity loads only.
- 4. No compression or shear reinforcement is provided.
- 5. Deflection is calculated on uncracked section properties. The deflection limit of span length divided by 600 does not govern for span lengths less than 14 ft. (4.3 m).

The effective depth, d, reflected in the design curves is based on the beam height, H, minus a value for masonry cover. The cover value is based on a reasonable approximation of brick, mortar and grout cover on the underside of reinforcement for the beams shown. The actual effective depth should always be checked for each particular RBM beam configuration.

### DESIGN EXAMPLE

To illustrate the use of the Design Curves, consider the following example. A RBM beam is to span over a garage door with a clear span of 9 ft (2.7 m). The beam supports its own weight and the weight of the brick masonry wall above the beam, so that the uniform load on the beam is 250 lbs/ft (372 kg/m) of span. The RBM beam and the wall above the beam are nominal 6 in. (150 mm) wide and constructed with hollow brick. Determine the beam depth and reinforcement required for these conditions. From Figs. 5(b) and 5(e), one concludes that a 4 in. (100 mm) or 8 in. (200 mm) high by 6 in. (150 mm) wide RBM beam is not adequate for the given span and loading. Therefore, the applicable Design Curve is Fig. 6(b), which is for a full unit depth, RBM beam. For the given conditions, a minimum depth of 12 in. (300 mm) and one No. 4 bar are required. At this point, any deflection criteria should be considered and may require a greater beam depth.


### SUMMARY

RBM beams are an attractive and efficient means of spanning openings. Attention to detailing of reinforcement and proper design are the key aspects addressed in this *Technical Notes*. The most common RBM beam configurations are shown with consideration of the inter-connection of beam and wall elements. Design curves provided in this *Technical Notes* can be used to develop preliminary beam designs for many different applications and loading conditions.


The information and suggestions contained in this *Technical Notes* are based on the available data and the experience of the engineering staff of the Brick Industry Association. The information contained herein must be used in conjunction with good technical judgment and a basic understanding of the properties of brick masonry. Final decisions on the use of the information contained in this *Technical Notes* are not within the purview of the Brick Industry Association and must rest with the project architect, engineer and owner.

### REFERENCES


- Building Code Requirements for Masonry Structures (ACI 530/ASCE 5/TMS 402-95), American Society of Civil Engineers, Reston, VA, 1996.
- Masonry Designers' Guide, John Matthys, ed., The Masonry Society, Boulder, CO, 1993.
- Uniform Building Code, 1997 Edition, International Conference of Building Officials, Whittier, CA, 1997.

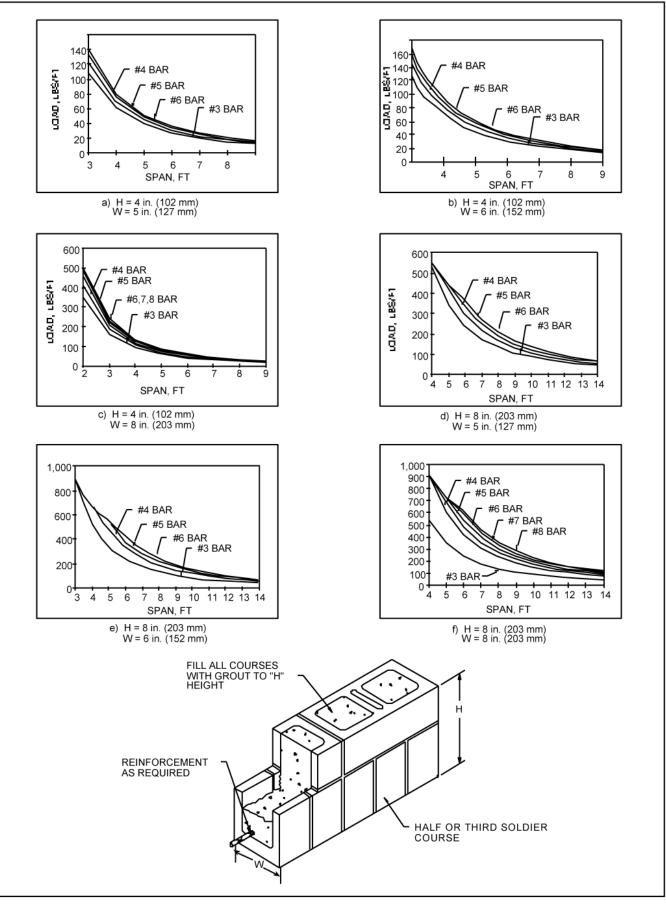


Design Curves for Partial Soldier Course Beams FIG. 5

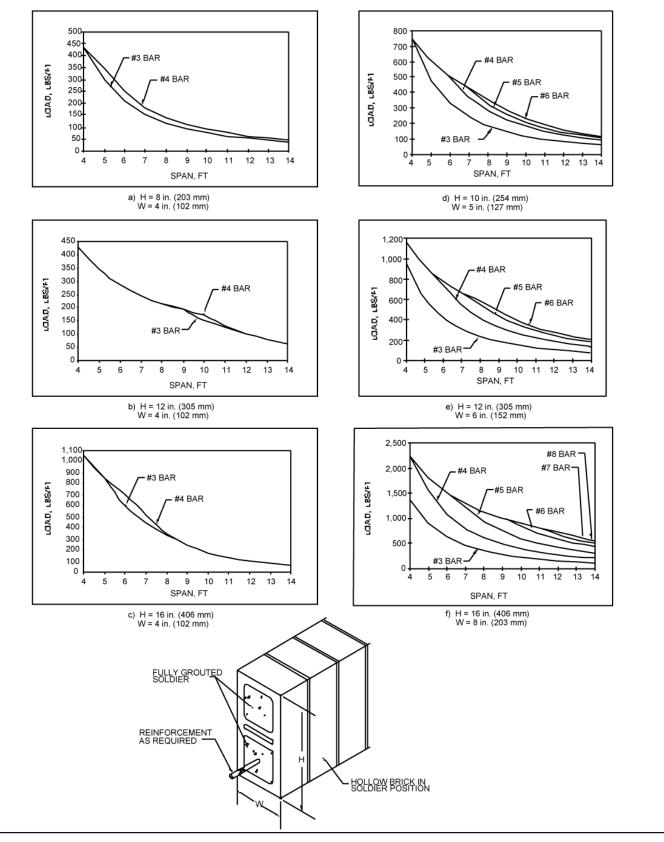


Design Curves for Soldier Course Beams FIG. 6

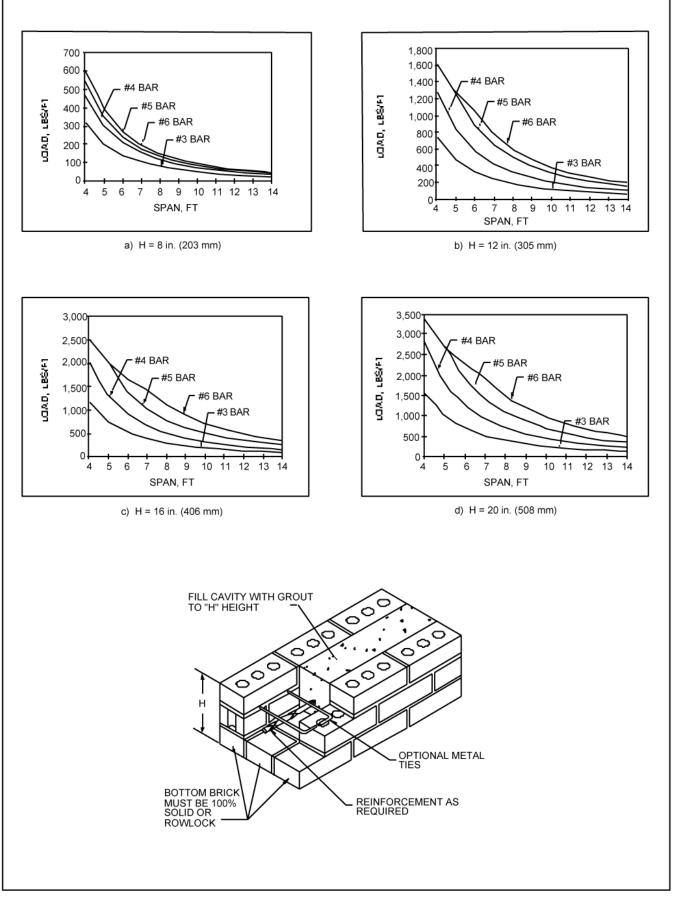

#### Design Curves for 12 in. (305 mm) Wide Beams FIG. 7

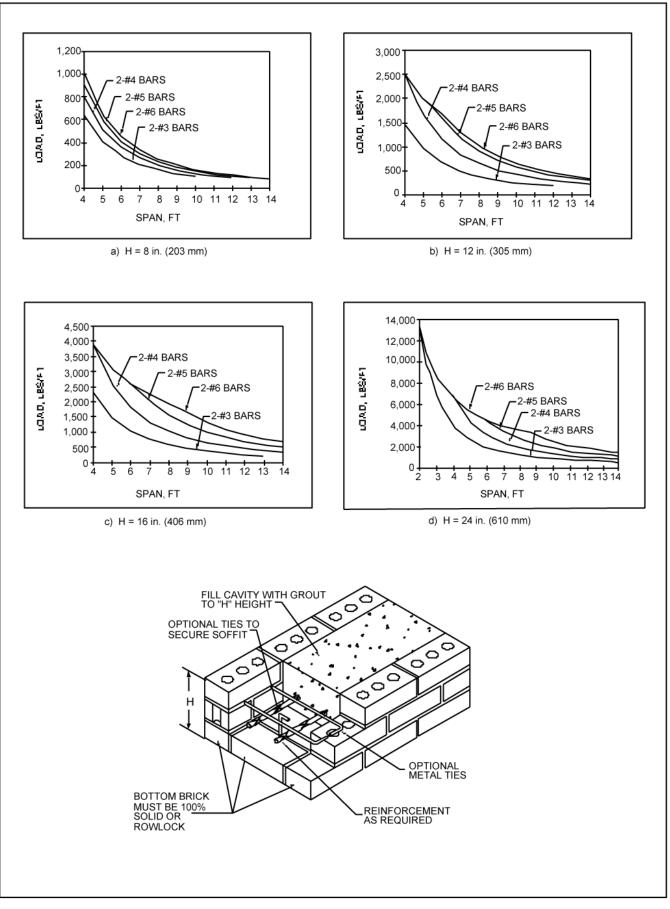


#### Design Curves for 16 in. (406 mm) Wide Beams FIG. 8

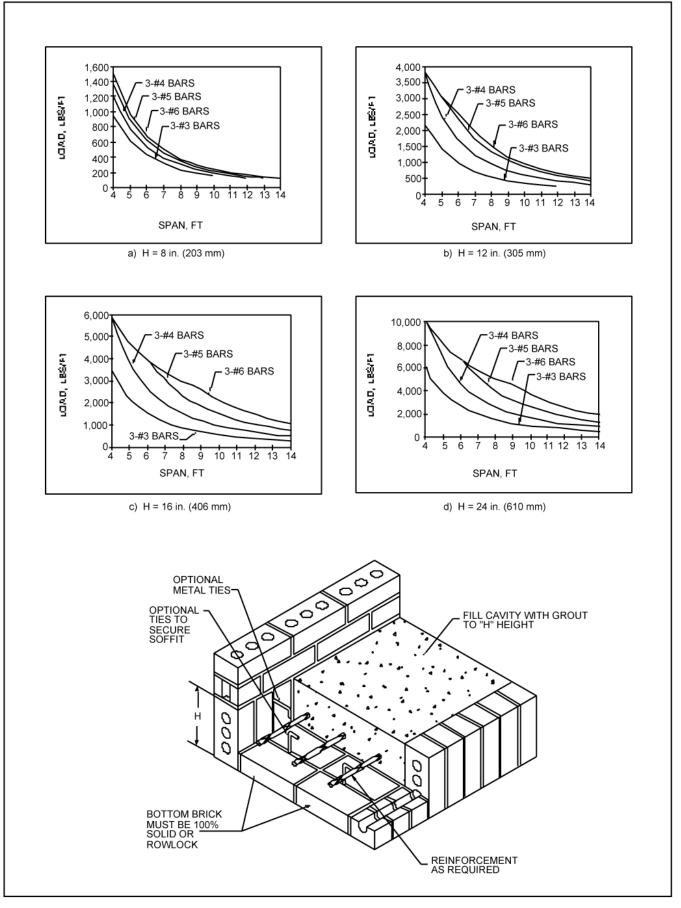

#### Design Curves for 24 in. (610 mm) Wide Beams FIG. 9

# Excerpts from NCMA TEK Manual for Concrete Masonry Design and Construction

# Section Properties (14-1B 2007)

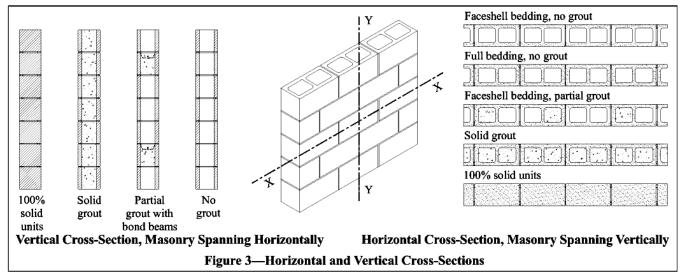

# Table for Horizontal Cross Sections (net)

Units	Grouted	Mortar Bedding	А	Ix	S <sub>x</sub>	r
	Spacing	C	in <sup>2</sup> /ft	in <sup>4</sup> /ft	in <sup>3</sup> /ft	in
	1 0		$(10^3 \text{mm}^2/\text{m})$	$(10^6 \text{ mm}^4/\text{m})$	$(10^6 \text{ mm}^3/\text{m})$	(mm)
4 Inch Si	ingle Wythe Wall	s, ¾ in. Face Shells	s (standard)	, , ,		,
Hollow	No grout	Faceshell	18.0 (38.1)	38.0 (51.9)	21.0 (1.13)	1.45 (36.9)
Hollow	No grout	Full	21.6 (45.7)	39.4 (53.8)	21.7 (1.17)	1.35 (34.3)
100 % so	olid/grouted	Full	43.5 (92.1)	47.4 (64.7)	26.3 (1.41)	1.04 (26.5)
6 Inch Si	ingle Wythe Wall	s, 1 in. Face Shells	(standard)			•
Hollow	No grout	Faceshell	24.0 (50.8)	130.3 (178)	46.3 (2.49)	2.33 (59.2)
Hollow	None	Full	32.2 (68.1)	139.3 (190)	49.5 (2.66)	2.08 (52.9)
100% Sc	olid/grouted	Full	67.5 (143)	176.9 (242)	63.3 (3.40)	1.62 (41.1)
Hollow	16" o. c.	Faceshell	46.6 (98.6)	158.1 (216)	55.1 (2.96)	1.79 (45.5)
Hollow	24" o. c.	Faceshell	39.1 (82.7)	151.8 (207)	52.2 (2.81)	1.87 (47.4)
Hollow	32" o. c.	Faceshell	35.3 (74.7)	148.7 (203)	50.7 (2.73)	1.91 (48.5)
Hollow	40" o. c.	Faceshell	33.0 (69.9)	146.8 (200)	49.9 (2.68)	1.94 (49.3)
Hollow	48" o. c.	Faceshell	31.5 (66.7)	145.5 (199)	49.3 (2.65)	1.96 (49.8)
Hollow	72" o. c.	Faceshell	29.0 (61.45)	143.5 (196)	51.0 (2.74)	2.00 (50.8)
Hollow	96" o. c.	Faceshell	27.8 (58.8)	142.4 (194)	50.6 (2.72)	2.02 (51.3)
Hollow	122" o. c.	Faceshell	27.0 (57.1)	141.8 (194)	50.4 (2.71)	2.03 (51.5)
8 Inch Single Wythe Walls, 1 <sup>1</sup> / <sub>4</sub> in. Face Shells (standard)						
Hollow	No grout	Faceshell	30.0 (63.5)	308.7 (422)	81.0 (4.35)	3.21 (81.5)
Hollow	No grout	Full	41.5 (87.9)	334.0 (456)	87.6 (4.71)	2.84 (72.0)
100% solid/grouted		Full	91.5 (194)	440.2 (601)	116.3 (6.25)	2.19 (55.7)
Hollow	16" o. c.	Faceshell	62.0 (131)	387.1 (529)	99.3 (5.34)	2.43 (61.6)
Hollow	24" o. c.	Faceshell	51.3 (109)	369.4 (504)	93.2 (5.01)	2.53 (64.3)
Hollow	32" o. c.	Faceshell	46.0 (97.3)	360.5 (492)	90.1 (4.85)	2.59 (65.8)
Hollow	40" o. c.	Faceshell	42.8 (90.6)	355.2 (485)	88.3 (4.75)	2.63 (66.9)
Hollow	48" o. c.	Faceshell	40.7 (86.0)	351.7 (480)	87.1 (4.68)	2.66 (67.6)
Hollow	72" o. c.	Faceshell	37.1 (78.5)	345.8 (472)	85.0 (4.57)	2.71 (69.0)
Hollow	92" o. c.	Faceshell	35.3 (74.7)	342.8 (468)	89.9 (4.83)	2.74 (69.6)
Hollow	120" o. c.	Faceshell	34.3 (72.6)	341.0 (466)	89.5 (4.81)	2.76 (70.1)

	Units	Grouted Cores	Mortar Bedding	А	Ix	S <sub>x</sub>	r
$\begin{tabular}{ c c c c c c c c c c c c c c c c c c c$	Onito	Grouted Cores	Mortar Deading		$in^4/ft$	$in^{3}/ft$	
10         Inch Single Wythe Walls, 1 ¼ in. Face Shells (standard)           Hollow         No grout         Faceshell         30.0 (63.5)         530.0 (724)         110.1 (5.92)         4.20 (107)           Hollow         No grout         Faceshell         30.0 (63.5)         530.0 (724)         110.1 (5.92)         4.20 (107)           Hollow         16" o. c.         Faceshell         74.8 (158)         744.7 (1017)         154.7 (8.32)         30.4 (77.2)           Hollow         24" o. c.         Faceshell         52.4 (111)         675.5 (023)         140.4 (7.55)         3.29 (83.6)           Hollow         48" o. c.         Faceshell         44.9 (95.0)         652.4 (891)         135.6 (7.29)         3.33 (84.6)           Hollow         48" o. c.         Faceshell         39.9 (84.5)         637.0 (870)         132.4 (7.12)         3.9 (85.1)           Hollow         90 or o. c.         Faceshell         30.0 (63.5)         811.2 (1108)         139.6 (7.50)         5.20 (132)           Hollow         No grout         Full         53.1 (112)         971.5 (1327)         167.1 (8.98)         4.28 (109)           100/m solid/grouted         Full         13.0 (12)         971.5 (1327)         167.1 (8.98)         4.28 (109)           100/m solid/grout							
	10 Inch S	Single Wythe Wa	lls, 1 ¼ in. Face Sh	, ,	()	(10	()
		0 1		,	530.0 (724)	110.1 (5.92)	4.20 (107)
$\begin{array}{ c c c c c c c c c c c c c c c c c c c$	Hollow	0		· ,			( )
Hollow 16" o. c. Faceshell 74.8 (158) 744.7 (1017) 154.7 (8.32) 3.04 (77.2)       Hollow 24" o. c. Faceshell 59.8 (127) 698.6 (954) 145.2 (7.81) 3.16 (80.3)       Hollow 40" o. c. Faceshell 52.4 (111) 675.5 (723) 140.4 (7.55) 3.24 (82.3)       Hollow 40" o. c. Faceshell 44.9 (95.0) 652.4 (891) 135.6 (7.29) 3.33 (84.0)       Hollow 40" o. c. Faceshell 39.9 (84.5) 637.0 (870) 132.4 (7.12) 3.39 (86.1)       Hollow 96" o. c. Faceshell 39.9 (84.5) 637.0 (870) 132.4 (7.12) 3.39 (86.1)       Hollow 120" o. c. Faceshell 36.0 (76.2) 624.7 (853) 129.8 (6.98) 3.45 (87.6)       Hollow 120" o. c. Faceshell 30.0 (63.5) 811.2 (1108) 139.6 (7.50) 5.20 (132)       Hollow No grout Fault 51.1 (112) 971.5 (1327) 167.1 (8.98) 4.28 (108)       Hollow No grout Full 53.1 (112) 971.5 (1327) 167.1 (8.98) 4.28 (108)       Hollow 16" o. c. Faceshell 87.3 (185) 1262.3 (1724) 217.2 (11.7) 3.64 (92.5)       Hollow 16" o. c. Faceshell 68.7 (144) 1165.4 (1591) 200.5 (10.7) 3.79 (96.8)       Hollow 24" o. c. Faceshell 58.7 (124) 1116.9 (1252) 129.2 (10.3) 3.88 (88.6)       Hollow 40" o. c. Faceshell 58.7 (124) 1116.9 (1252) 129.2 (10.3) 3.88 (88.6)       Hollow 40" o. c. Faceshell 58.7 (124) 1116.9 (1252) 129.2 (10.3) 3.88 (88.6)       Hollow 44" o. c. Faceshell 52.9 (112) 1087.8 (1486) 187.2 (10.1) 3.95 (100)       Hollow 48" o. c. Faceshell 49.1 (104) 1068.4 (1459) 183.8 (88.8) 3.99 (101)       Hollow 48" o. c. Faceshell 49.1 (104) 1064.8 (1459) 183.8 (88.8) 3.99 (101)       Hollow 48" o. c. Faceshell 39.6 (83.8) 1020.0 (1393) 175.5 (9.44) 4.12 (105)       Hollow 120" o. c. Faceshell 39.6 (83.8) 1020.0 (1393) 175.5 (9.44) 4.12 (105)       Hollow 120" o. c. Faceshell 39.6 (83.8) 1020.0 (1393) 175.5 (9.44) 4.12 (105)       Hollow 120" o. c. Faceshell 39.6 (83.8) 1020.0 (1393) 175.5 (9.44) 4.12 (105)       Hollow 10" o. c. Faceshell 39.0 (63.5) 1152.5 (1574) 169.2 (9.09) 6.20 (157)       Hollow 10" o. c. Faceshell 43.7 (70.6) 1145.1 (13.8) (486) (23.7) (33.9 (78.8) (9.8)       Hollow 10" o. c. Faceshell 39.0 (63.5		Ŭ		. ,			
$ \begin{array}{ c c c c c c c c c c c c c c c c c c c$	-			. ,	. ,	· · · · ·	
$\begin{array}{c c c c c c c c c c c c c c c c c c c $				· · · ·			
$      Hollow 40^\circ o. c. Faceshell 47.9 (101) 661.6 (904) 137.5 (7.39) 3.29 (83.6)       Hollow 72^\circ o. c. Faceshell 34.9 (95.0) 652.4 (891) 135.6 (7.29) 3.33 (84.6)       Hollow 72^\circ o. c. Faceshell 37.5 (79.4) 629.3 (859) 130.8 (7.03) 3.43 (87.1)       Hollow 96^\circ o. c. Faceshell 37.5 (79.4) 629.3 (859) 130.8 (7.03) 3.43 (87.1)       Hollow No grout Faceshell 36.0 (76.2) 624.7 (853) 129.8 (6.98) 3.45 (87.6)       12 Inch Single Wythe Walls. 1/4 in. Face Shells (standard)       Hollow No grout Faceshell 30.0 (63.5) 811.2 (1108) 139.6 (7.50) 5.20 (132)       Hollow No grout Faceshell 87.3 (112) 971.5 (1327) 167.1 (898) 4.28 (109)       100% solid/grouted Full 139.5 (295) 1571.0 (2145) 270.3 (14.5) 3.36 (85.3)       Hollow 16^\circ o. c. Faceshell 87.3 (185) 1262.3 (1724) 217.2 (11.7) 3.64 (92.5)       Hollow 32^\circ o. c. Faceshell 88.7 (124) 1116.9 (1525) 192.2 (10.3) 3.88 (88.6)       Hollow 40^\circ o. e. Faceshell 52.9 (112) 1087.8 (1486) 187.2 (10.1) 3.95 (100)       Hollow 47^\circ o. c. Faceshell 42.7 (90.4) 1036.1 (1415) 178.3 (9.59) 4.07 (103)       Hollow 48^\circ o. c. Faceshell 39.6 (83.8) 1020.0 (1393) 175.5 (9.44) 4.12 (105)       Hollow 96^\circ o. c. Faceshell 39.0 (63.5) 1152.5 (1574) 169.2 (9.09) 6.20 (157)       Hollow 96^\circ o. c. Faceshell 39.0 (63.5) 1152.5 (1574) 169.2 (9.09) 6.20 (157)       Hollow 96^\circ o. c. Faceshell 39.0 (63.5) 1152.5 (1574) 169.2 (9.09) 6.20 (157)       Hollow No grout Faceshell 30.0 (63.5) 1152.5 (1574) 169.2 (9.09) 6.20 (157)       Hollow No grout Faceshell 30.0 (63.5) 1152.5 (1574) 169.2 (9.09) 6.20 (157)       Hollow 10^\circ o. c. Faceshell 30.0 (63.5) 1152.7 (1574) 169.2 (9.09) 6.20 (157)       Hollow 10^\circ o. c. Faceshell 30.0 (63.5) 1152.7 (1574) 169.2 (9.09) 6.20 (157)       Hollow 10^\circ o. c. Faceshell 30.0 (63.5) 1152.7 (1574) 169.2 (9.09) 6.20 (157)       Hollow 10^\circ o. c. Faceshell 30.0 (63.5) 1152.7 (1574) 169.2 (9.09) 6.20 (157)       Hollow 10^\circ o. c. Faceshell 30.0 (63.5) 1153.7 (2000) 224.7 (12.1) 4.98 (126)       1009 8001/grouted Full 163.2 (136) 2529.4$						· · · · ·	
$\begin{array}{c c c c c c c c c c c c c c c c c c c $				. ,	· · · · ·	. ,	
$\begin{array}{ c c c c c c c c c c c c c c c c c c c$							
$\begin{array}{c c c c c c c c c c c c c c c c c c c $				. ,		· · · ·	
$\begin{array}{ c c c c c c c c c c c c c c c c c c c$							
$\begin{array}{ c c c c c c c c c c c c c c c c c c c$							
$\begin{array}{ c c c c c c c c c c c c c c c c c c c$							
$ \begin{array}{ c c c c c c c c c c c c c c c c c c c$					811.2 (1108)	139.6 (7.50)	5.20 (132)
$\begin{array}{ c c c c c c c c c c c c c c c c c c c$		U U					
$\begin{array}{ c c c c c c c c c c c c c c c c c c c$		<u> </u>		. ,	. ,	· /	
$\begin{array}{ c c c c c c c c c c c c c c c c c c c$	-			. ,	· · · ·	· · · · ·	
$\begin{array}{c c c c c c c c c c c c c c c c c c c $							
$\begin{array}{ c c c c c c c c c c c c c c c c c c c$				. ,	· · · · ·		
$\begin{array}{ c c c c c c c c c c c c c c c c c c c$				. ,	· · ·		
$\begin{array}{c c c c c c c c c c c c c c c c c c c $				. ,	· · · · ·	· · · · ·	
$\begin{array}{c c c c c c c c c c c c c c c c c c c $				. ,	· · · · ·		
$\begin{array}{ c c c c c c c c c c c c c c c c c c c$				. ,	· · ·		
14 Inch Single Wythe Walls. 1 ¼ in. Face Shells (standard)HollowNo groutFaceshell $30.0 (63.5)$ $1152.5 (1574)$ $169.2 (9.09)$ $6.20 (157)$ HollowNo groutFull $58.2 (123)$ $1442.9 (1970)$ $211.8 (11.4)$ $4.98 (126)$ $100\%$ solid/groutedFull $163.5 (346)$ $2529.4 (3454)$ $371.3 (20.0)$ $3.93 (99.8)$ Hollow16" o. c.Faceshell $99.9 (211)$ $1970.0 (2690)$ $289.2 (15.5)$ $4.25 (108)$ Hollow24" o. c.Faceshell $76.6 (162)$ $1794.3 (2450)$ $263.4 (14.2)$ $4.41 (112)$ Hollow32" o. c.Faceshell $64.9 (137)$ $1706.4 (2330)$ $250.5 (13.5)$ $4.51 (115)$ Hollow40" o. c.Faceshell $53.3 (113)$ $1618.6 (2210)$ $237.6 (12.8)$ $4.64 (118)$ Hollow40" o. c.Faceshell $53.3 (113)$ $1618.6 (2210)$ $237.6 (12.8)$ $4.64 (118)$ Hollow96" o. c.Faceshell $41.6 (88.1)$ $1530.7 (2090)$ $224.7 (12.1)$ $4.79 (122)$ Hollow96" o. c.Faceshell $39.3 (83.2)$ $1513.2 (2067)$ $221.1 (11.9)$ $4.83 (123)$ 16Inch Single Wythe Walls. $1.4'$ in. Face Shells (standard)HollowNo groutFaceshell $30.0 (63.5)$ $1553.7 (2122)$ $198.9 (10.2)$ $7.20 (183)$ HollowNo groutFaceshell $30.0 (63.5)$ $1553.7 (2122)$ $198.9 (10.2)$ $7.20 (183)$ HollowNo groutFaceshell $30.0 (63.5)$ $1553.7 ($							
$\begin{array}{ c c c c c c c c c c c c c c c c c c c$							
$\begin{array}{ c c c c c c c c c c c c c c c c c c c$					1152.5 (1574)	169.2 (9.09)	6.20 (157)
$\begin{array}{c ccccccccccccccccccccccccccccccccccc$		0			· · · · · ·		
Hollow16" o. c.Faceshell99.9 (211)1970.0 (2690)289.2(15.5)4.25 (108)Hollow24" o. c.Faceshell76.6 (162)1794.3 (2450)263.4 (14.2)4.41 (112)Hollow32" o. c.Faceshell64.9 (137)1706.4 (2330)250.5 (13.5)4.51 (115)Hollow40" o. c.Faceshell58.0 (123)1653.7 (2258)242.8 (13.0)4.59 (117)Hollow48" o. c.Faceshell53.3 (113)1618.6 (2210)237.6 (12.8)4.64 (118)Hollow72" o. c.Faceshell45.5 (96.3)1560.0 (2130)229.0 (12.3)4.74 (120)Hollow96" o. c.Faceshell41.6 (88.1)1530.7 (2090)224.7 (12.1)4.79 (122)Hollow120" o. c.Faceshell39.3 (83.2)1513.2 (2067)221.1 (11.9)4.83 (123)16Inch Single Wythe Walls.1 ¼ in. Face Shells (standard)HollowNo groutFaceshell30.0 (63.5)1553.7 (2122)198.9 (10.2)7.20 (183)HollowNo groutFaceshell30.0 (63.5)1553.7 (2122)198.9 (10.2)7.20 (183)HollowNo groutFull187.5 (397)3814.7 (5209)488.3 (26.3)4.51 (115)Hollow16" o. c.Faceshell112.4 (238)2896.2 (3955)370.7 (19.9)4.84 (123)Hollow24" o. c.Faceshell71.2 (151)2463.4 (3364)315.3 (17.0)5.14 (131)Hollow32" o. c.Faceshell77.5 (122)2319.1 (3167)296.9 (16.0)<		0		. ,	· · · · ·		
$\begin{array}{c c c c c c c c c c c c c c c c c c c $	-		Faceshell	. ,			
$\begin{array}{c ccccccccccccccccccccccccccccccccccc$					· · ·		
$\begin{array}{c c c c c c c c c c c c c c c c c c c $					1706.4 (2330)		. ,
Hollow48" o. c.Faceshell53.3 (113)1618.6 (2210)237.6 (12.8)4.64 (118)Hollow72" o. c.Faceshell45.5 (96.3)1560.0 (2130)229.0 (12.3)4.74 (120)Hollow96" o. c.Faceshell41.6 (88.1)1530.7 (2090)224.7 (12.1)4.79 (122)Hollow120" o. c.Faceshell39.3 (83.2)1513.2 (2067)221.1 (11.9)4.83 (123)16 Inch Single Wythe Walls.1 ¼ in. Face Shells (standard)HollowNo groutFaceshell30.0 (63.5)1553.7 (2122)198.9 (10.2)7.20 (183)HollowNo groutFaceshell30.0 (63.5)1553.7 (2122)198.9 (10.2)7.20 (183)HollowNo groutFull63.2 (134)2030.6 (2773)259.9 (13.9)5.67 (144)100% solid/groutedFull187.5 (397)3814.7 (5209)488.3 (26.3)4.51 (115)Hollow16" o. c.Faceshell112.4 (238)2896.2 (3955)370.7(19.9)4.84 (123)Hollow24" o. c.Faceshell85.0 (180)2607.7 (3561)333.8 (17.9)5.02 (127)Hollow32" o. c.Faceshell63.0 (133)2376.9 (3246)304.2 (16.4)5.22 (133)Hollow40" o. c.Faceshell57.5 (122)2319.1 (3167)296.9 (16.0)5.28 (134)Hollow48" o. c.Faceshell57.5 (122)2319.1 (3167)296.9 (16.0)5.28 (134)Hollow72" o. c.Faceshell43.7 (92.5)2174.9 (3970)278.4 (15.0)5.45 (138)<	-			· · · ·			
$\begin{array}{c c c c c c c c c c c c c c c c c c c $				. ,			
Hollow96" o. c.Faceshell41.6 (88.1)1530.7 (2090)224.7 (12.1)4.79 (122)Hollow120" o. c.Faceshell39.3 (83.2)1513.2 (2067)221.1 (11.9)4.83 (123)16 Inch Single Wythe Walls. 1 ¼ in. Face Shells (standard)HollowNo groutFaceshell30.0 (63.5)1553.7 (2122)198.9 (10.2)7.20 (183)HollowNo groutFaceshell30.0 (63.5)1553.7 (2122)198.9 (10.2)7.20 (183)HollowNo groutFull63.2 (134)2030.6 (2773)259.9 (13.9)5.67 (144)100% solid/groutedFull187.5 (397)3814.7 (5209)488.3 (26.3)4.51 (115)Hollow16" o. c.Faceshell112.4 (238)2896.2 (3955)370.7(19.9)4.84 (123)Hollow24" o. c.Faceshell85.0 (180)2607.7 (3561)333.8 (17.9)5.02 (127)Hollow32" o. c.Faceshell71.2 (151)2463.4 (3364)315.3 (17.0)5.14 (131)Hollow40" o. c.Faceshell63.0 (133)2376.9 (3246)304.2 (16.4)5.22 (133)Hollow48" o. c.Faceshell57.5 (122)2319.1 (3167)296.9 (16.0)5.28 (134)Hollow72" o. c.Faceshell48.3 (102)2223.0 (3036)284.5 (15.3)5.39 (137)Hollow96" o. c.Faceshell43.7 (92.5)2174.9 (3970)278.4 (15.0)5.45 (138)							
$\begin{array}{c c c c c c c c c c c c c c c c c c c $					. ,	. ,	. ,
16 Inch Single Wythe Walls. 1 ¼ in. Face Shells (standard)HollowNo groutFaceshell30.0 (63.5)1553.7 (2122)198.9 (10.2)7.20 (183)HollowNo groutFull63.2 (134)2030.6 (2773)259.9 (13.9)5.67 (144)100% solid/groutedFull187.5 (397)3814.7 (5209)488.3 (26.3)4.51 (115)Hollow16" o. c.Faceshell112.4 (238)2896.2 (3955)370.7(19.9)4.84 (123)Hollow24" o. c.Faceshell85.0 (180)2607.7 (3561)333.8 (17.9)5.02 (127)Hollow32" o. c.Faceshell71.2 (151)2463.4 (3364)315.3 (17.0)5.14 (131)Hollow40" o. c.Faceshell57.5 (122)2319.1 (3167)296.9 (16.0)5.28 (134)Hollow48" o. c.Faceshell48.3 (102)2223.0 (3036)284.5 (15.3)5.39 (137)Hollow96" o. c.Faceshell43.7 (92.5)2174.9 (3970)278.4 (15.0)5.45 (138)							
HollowNo groutFaceshell30.0 (63.5)1553.7 (2122)198.9 (10.2)7.20 (183)HollowNo groutFull63.2 (134)2030.6 (2773)259.9 (13.9)5.67 (144)100% solid/groutedFull187.5 (397)3814.7 (5209)488.3 (26.3)4.51 (115)Hollow16" o. c.Faceshell112.4 (238)2896.2 (3955)370.7(19.9)4.84 (123)Hollow24" o. c.Faceshell85.0 (180)2607.7 (3561)333.8 (17.9)5.02 (127)Hollow32" o. c.Faceshell71.2 (151)2463.4 (3364)315.3 (17.0)5.14 (131)Hollow40" o. c.Faceshell63.0 (133)2376.9 (3246)304.2 (16.4)5.22 (133)Hollow48" o. c.Faceshell57.5 (122)2319.1 (3167)296.9 (16.0)5.28 (134)Hollow72" o. c.Faceshell48.3 (102)2223.0 (3036)284.5 (15.3)5.39 (137)Hollow96" o. c.Faceshell43.7 (92.5)2174.9 (3970)278.4 (15.0)5.45 (138)						× /	. ,
HollowNo groutFull63.2 (134)2030.6 (2773)259.9 (13.9)5.67 (144)100% solid/groutedFull187.5 (397)3814.7 (5209)488.3 (26.3)4.51 (115)Hollow16" o. c.Faceshell112.4 (238)2896.2 (3955)370.7 (19.9)4.84 (123)Hollow24" o. c.Faceshell85.0 (180)2607.7 (3561)333.8 (17.9)5.02 (127)Hollow32" o. c.Faceshell71.2 (151)2463.4 (3364)315.3 (17.0)5.14 (131)Hollow40" o. c.Faceshell63.0 (133)2376.9 (3246)304.2 (16.4)5.22 (133)Hollow48" o. c.Faceshell57.5 (122)2319.1 (3167)296.9 (16.0)5.28 (134)Hollow72" o. c.Faceshell48.3 (102)2223.0 (3036)284.5 (15.3)5.39 (137)Hollow96" o. c.Faceshell43.7 (92.5)2174.9 (3970)278.4 (15.0)5.45 (138)		<u> </u>			1553.7 (2122)	198.9 (10.2)	7.20 (183)
100% solid/groutedFull187.5 (397)3814.7 (5209)488.3 (26.3)4.51 (115)Hollow16" o. c.Faceshell112.4 (238)2896.2 (3955)370.7(19.9)4.84 (123)Hollow24" o. c.Faceshell85.0 (180)2607.7 (3561)333.8 (17.9)5.02 (127)Hollow32" o. c.Faceshell71.2 (151)2463.4 (3364)315.3 (17.0)5.14 (131)Hollow40" o. c.Faceshell63.0 (133)2376.9 (3246)304.2 (16.4)5.22 (133)Hollow48" o. c.Faceshell57.5 (122)2319.1 (3167)296.9 (16.0)5.28 (134)Hollow72" o. c.Faceshell48.3 (102)2223.0 (3036)284.5 (15.3)5.39 (137)Hollow96" o. c.Faceshell43.7 (92.5)2174.9 (3970)278.4 (15.0)5.45 (138)		0					
Hollow16" o. c.Faceshell112.4 (238)2896.2 (3955)370.7(19.9)4.84 (123)Hollow24" o. c.Faceshell85.0 (180)2607.7 (3561)333.8 (17.9)5.02 (127)Hollow32" o. c.Faceshell71.2 (151)2463.4 (3364)315.3 (17.0)5.14 (131)Hollow40" o. c.Faceshell63.0 (133)2376.9 (3246)304.2 (16.4)5.22 (133)Hollow48" o. c.Faceshell57.5 (122)2319.1 (3167)296.9 (16.0)5.28 (134)Hollow72" o. c.Faceshell48.3 (102)2223.0 (3036)284.5 (15.3)5.39 (137)Hollow96" o. c.Faceshell43.7 (92.5)2174.9 (3970)278.4 (15.0)5.45 (138)						( )	
Hollow24" o. c.Faceshell85.0 (180)2607.7 (3561)333.8 (17.9)5.02 (127)Hollow32" o. c.Faceshell71.2 (151)2463.4 (3364)315.3 (17.0)5.14 (131)Hollow40" o. c.Faceshell63.0 (133)2376.9 (3246)304.2 (16.4)5.22 (133)Hollow48" o. c.Faceshell57.5 (122)2319.1 (3167)296.9 (16.0)5.28 (134)Hollow72" o. c.Faceshell48.3 (102)2223.0 (3036)284.5 (15.3)5.39 (137)Hollow96" o. c.Faceshell43.7 (92.5)2174.9 (3970)278.4 (15.0)5.45 (138)		0	Faceshell				
Hollow32" o. c.Faceshell71.2 (151)2463.4 (3364)315.3 (17.0)5.14 (131)Hollow40" o. c.Faceshell63.0 (133)2376.9 (3246)304.2 (16.4)5.22 (133)Hollow48" o. c.Faceshell57.5 (122)2319.1 (3167)296.9 (16.0)5.28 (134)Hollow72" o. c.Faceshell48.3 (102)2223.0 (3036)284.5 (15.3)5.39 (137)Hollow96" o. c.Faceshell43.7 (92.5)2174.9 (3970)278.4 (15.0)5.45 (138)				. ,			
Hollow40" o. c.Faceshell63.0 (133)2376.9 (3246)304.2 (16.4)5.22 (133)Hollow48" o. c.Faceshell57.5 (122)2319.1 (3167)296.9 (16.0)5.28 (134)Hollow72" o. c.Faceshell48.3 (102)2223.0 (3036)284.5 (15.3)5.39 (137)Hollow96" o. c.Faceshell43.7 (92.5)2174.9 (3970)278.4 (15.0)5.45 (138)							
Hollow48" o. c.Faceshell57.5 (122)2319.1 (3167)296.9 (16.0)5.28 (134)Hollow72" o. c.Faceshell48.3 (102)2223.0 (3036)284.5 (15.3)5.39 (137)Hollow96" o. c.Faceshell43.7 (92.5)2174.9 (3970)278.4 (15.0)5.45 (138)				. ,			
Hollow72" o. c.Faceshell48.3 (102)2223.0 (3036)284.5 (15.3)5.39 (137)Hollow96" o. c.Faceshell43.7 (92.5)2174.9 (3970)278.4 (15.0)5.45 (138)							
Hollow         96" o. c.         Faceshell         43.7 (92.5)         2174.9 (3970)         278.4 (15.0)         5.45 (138)							

Note Set 28.3

# Allowable Stresses for Unreinforced Concrete Masonry (14-7C 2012)

## Compression

Axial ...... $F_a = 1/4 \text{ f'}_m [1-(h/140r)^2]$ , where h/r ≥99 ..... $F_a = 1/4 \text{ f'}_m (70r/h)^2$ , where h/r > 99 Flexural ..... $F_b = 1/3 \text{ f'}_m$ 

## Shear

where 
$$f_v = \frac{VQ}{I_n b}$$
  
1.5  $\sqrt{f'_m} \le 120 \text{ psi}$ 

### Table 1—Allowable Flexural Tensile Stresses, psi (kPa) (ref. 1a)

Direction of flexural	Mortar types				
tensile stress and masonry type		ment/ lime or • cement	Masonry cement or air-entrained portland cement/lime		
	M or S	N	M or S	N	
Normal to bed joints:					
Solid units Hollow units <sup>A</sup>	53 (366)	40 (276)	32 (221)	20 (138)	
Ungrouted Fully grouted	33 (228) 86 (593)	25 (172) 84 (579)	20 (138) 81 (559)	12 (83) 77 (531)	
Parallel to bed joints in running bond: Solid units	106 (731)	80 (552)	64 (441)	40 (276)	
Hollow units Ungrouted & partially grouted	66 (455)	50 (345)	40 (276)	25 (172)	
Fully grouted	106 (731)	80 (552)	64 (441)	40 (276)	
Parallel to bed joints in masonry not laid in running bond: Continuous grout section parallel to bed joints	133 (917)	133 (917)	133 (917)	133 (917)	
Other	0 (0)	0 (0)	0 (0)	0 (0)	

<sup>A</sup> For partially grouted masonry, allowable stresses are determined on the basis of linear interpolation between fully grouted hollow units and ungrouted hollow units based on amount (percentage) of grouting.

## Allowable Stresses for Reinforced Concrete Masonry (14-7C 2012)

## Compression

Axial ...... 
$$P_a = \left[0.25 f'_m A_n + 0.65 A_{st} F_s \left[1 - \left(\frac{h}{140r}\right)^2\right], \text{ where h/r} \ge 99$$
  
.....  $P_a = \left[0.25 f'_m A_n + 0.65 A_{st} F_s \left(\frac{70r}{h}\right)^2, \text{ where h/r} > 99$   
Flexural ......  $F_b = 0.45 \text{ f'm}$ 

## Shear

where 
$$f_v = \frac{V}{A_{nv}}$$
 and  $F_v = F_{vm} + F_{vs}$   
 $M/Vd \le 0.25....F_v = 3\sqrt{f'_m}$   
 $M/Vd \ge 1.0...F_v = 2\sqrt{f'_m}$ 

M/Vd falls between.....may be linearly interpolated

and

$$F_{vm} = \frac{1}{2} \left[ \left( 4.0 - 1.75 \left( \frac{M}{Vd} \right) \right) \sqrt{f'_m} \right] + 0.25 \frac{P}{A_n}$$
$$F_{vs} = 0.5 \left( \frac{A_v F_s d}{A_n s} \right)$$

# **Steel Reinforcement**

Tension

Grade 40	$F_s = 20,000 \text{ psi} (137.9 \text{ MPa})$
Grade 60	$F_s = 32,000 \text{ psi} (220.7 \text{ MPa})$
Joint reinforcement	$F_s = 30,000 \text{ psi} (206.9 \text{ MPa})$

# NOTATIONS

- $A_{\rm n}$  net cross-sectional area of masonry, in.<sup>2</sup> (mm<sup>2</sup>)
- $A_{\rm nv}$  net shear area, in.<sup>2</sup> (mm<sup>2</sup>)
- $A_v$  cross-sectional area of shear reinforcement, in.<sup>2</sup> (mm<sup>2</sup>)
- *b* width of section, in. (mm)
- d distance from extreme compression fiber to centroid of tension reinforcement, in. (mm)
- $F_{\rm a}$  allowable compressive stress due to axial load only, psi (MPa)
- $F_{\rm b}$  allowable compressive stress due to flexure only, psi (MPa)
- $F_{\rm s}$  allowable tensile or compressive stress in reinforcement, psi (MPa)
- $F_v$  allowable shear stress in masonry, psi (MPa)
- $F_{\rm vm}$  allowable shear resisted by the masonry, psi (MPa)
- $F_{vx}$  allowable shear resisted by the shear reinforcement, psi (MPa)
- $f'_m$  specified compressive strength of masonry, psi (MPa)
- $f_{\rm s}$  calculated shear stress in the masonry, psi (MPa)
- *h* effective height of column, wall, or pilaster, in. (mm)
- $I_n$  moment of inertia of net cross-sectional area of a member, in.<sup>4</sup> (mm<sup>4</sup>)
- M maximum moment occurring simultaneously with design shear force, V, at section under consideration, in.-lb (N.m)
- *P* axial compression load, lb (N)
- $P_{\rm a}$  allowable axial compressive force in a reinforced member, lb (N)
- Q first moment of inertia about the neutral axis of an area between the extreme fiber and the plane at which the shear stress is being calculated, in.<sup>3</sup>(mm<sup>3</sup>)
- *r* radius of gyration, in. (mm)
- *s* spacing of shear reinforcement, in. (mm)
- V design shear force, lb (N)