Masonry Design

Notation:

 \boldsymbol{A} = name for area j = multiplier by effective depth of = net area, equal to the gross area masonry section for moment arm, id A_n subtracting any reinforcement k = multiplier by effective depth of = net shear area of masonry masonry section for neutral axis, kd A_{nv} = area of steel reinforcement in = name for length or span length \boldsymbol{L} A_s masonry design = internal bending moment M = type of masonry mortar = area of steel reinforcement in A_{st} = moment capacity of a reinforced masonry column design M_m ACI = American Concrete Institute masonry beam governed by steel ASCE = American Society of Civil Engineers stress = width, often cross-sectional = moment capacity of a reinforced $M_{\rm s}$ masonry beam governed by masonry = name for a compression force C C_m = compression force in the masonry stress MSJC= Masonry Structural Joint Council for masonry design CMU = shorthand for concrete masonry unit = modulus of elasticity transformation = effective depth from the top of a coefficient for steel to masonry reinforced masonry beam to the = shorthand for neutral axis (N.A.) n.a. centroid of the tensile steel N = type of masonry mortar = eccentric distance of application of a *NCMA* = National Concrete Masonry eforce (P) from the centroid of a cross Association section 0 = type of masonry mortar = axial stress P = name for axial force vector f_a P_a = allowable axial load in columns f_b = bending stress = radius of gyration = calculated compressive stress in f_m S = section modulus masonry = type of masonry mortar = masonry design compressive stress = section modulus with respect to an S_x f_{s} = stress in the steel reinforcement for x-axis masonry design = name for thickness = shear stress f_{v} T= name for a tension force F_a = allowable axial stress T_{s} = tension force in the steel F_h = allowable bending stress reinforcement for masonry design F_{s} = allowable tensile stress in TMS =The Masonry Society reinforcement for masonry design = name for distributed load F_t = allowable tensile stress = coefficient for determining stress $\beta_{\scriptscriptstyle 1}$ F_{v} = allowable shear stress block height, c, in masonry LRFD F_{vm} = allowable shear stress of the design masonry = strain in the masonry \mathcal{E}_m = allowable shear stress of the shear F_{vs} $\boldsymbol{\mathcal{E}}_{s}$ = strain in the steel reinforcement = name for height = reinforcement ratio in masonry h ρ = effective height of a wall or column design = moment of inertia with respect to an I_{x} x-axis

Reinforced Masonry Design

Structural design standards for reinforced masonry are established by the *Masonry Standards Joint Committee* consisting of ACI, ASCE and The Masonry Society (TMS), and presents allowable stress design as well as limit state (strength) design.

Materials

 $f'_{\rm m}$ = masonry prism compressive strength from testing

Reinforcing steel grades are the same as those used for reinforced concrete beams.

Units can be brick, concrete or stone.

Mortar consists of masonry cement, lime, sand, and water. Grades are named from the word <u>MASONWORK</u>, with average strengths of 2500psi, 1800 psi, 750 psi, 350 psi, and 75 psi, respectively.

Grout is a flowable mortar, usually with a high amount of water to cement material. It is used to fill voids and bond reinforcement.

Allowable Stress Design

For unreinforced masonry, like masonry walls, tension stresses are allowed in flexure. Masonry walls typically see compression stresses too.

For reinforced masonry, the steel is presumed to resist *all* tensile stresses and the tension in the masonry is ignored.

Factors of Safety are applied to the limit stresses for allowable stress values:


bending (unreinforced)	$F_b = 1/3 f'_m$
bending (reinforced)	$F_b = 0.45 f'_m$
bending (tension/unreinforced)	table 2.2.3.2
beam shear (unreinforced for flexure)	$F_{\rm v} = 1.5 \sqrt{f'_{\it m}} \le 120 \; {\rm psi}$
beam shear (reinforced) – $M/(Vd) \le 0.25$	$F_{\rm v} = 3.0 \sqrt{f_m'}$
beam shear (reinforced) $-M/(Vd) \ge 1.0$	$F_{\rm v}=2.0\sqrt{f_{\it m}^{\prime}}$
Grades 40 or 50 reinforcement	$F_s = 20 \text{ ksi}$
Grades 60 reinforcement	$F_s = 32 \text{ ksi}$
Wire joint reinforcement	$F_s = 30 \text{ ksi}$

where f''_{m} = specified compressive strength of masonry

Internal Equilibrium for Bending

 $C_m = \text{compression in the masonry} = \text{stress x area} = f_m \frac{b(kd)}{2}$

 T_s = tension in steel = stress x area = $A_s f_s$

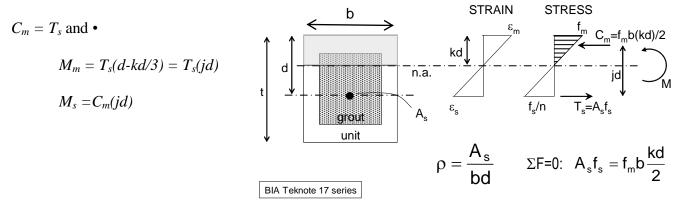

where

 f_m = compressive stress in the masonry from flexure

 f_s = tensile stress in the steel reinforcement

kd = the height to the neutral axis

b = width of stress area

d = effective depth of section = depth to n.a. of reinforcement

jd = moment arm from tension force to compression force

 A_s = area of steel

 $n = E_s/E_m$ used to transform steel to equivalent area of masonry for elastic stresses

 ρ = reinforcement ratio

Criteria for Beam Design

For flexure design:

$$M_m = f_m b \frac{kd}{2} jd = 0.5 f_m b d^2 jk$$
 or $M_s = A_s f_s jd = \rho b d^2 jf_s$

The design is adequate when $f_b \leq F_b$ in the masonry and $f_s \leq F_s$ in the steel.

Shear stress is determined by $f_v = V/A_{nv}$ where A_{nv} is net shear area. Shear strength is determined from the shear capacity of the masonry and the stirrups: $F_v = F_{vm} + F_{vs}$. Stirrup spacings are limited to d/2 but not to exceed 48 in.

where:


$$F_{vm} = \frac{1}{2} \left[\left(4.0 - 1.75 \left(\frac{M}{Vd} \right) \right) \sqrt{f'_m} \right] + 0.25 \frac{P}{A_n} \quad \text{where M/(Vd) is positive and cannot exceed 1.0}$$

$$F_{vs} = 0.5 \left(\frac{A_v F_s d}{A_{nv} s} \right) \qquad (F_v = 3.0 \sqrt{f'_m} \quad \text{when M/(Vd)} \ge 0.25)$$

$$(F_v = 2.0 \sqrt{f'_m} \quad \text{when M(Vd)} \ge 1.0.) \quad \text{Values can be linearly interpolated.}$$

Load and Resistance Factor Design

The design methodology is similar to reinforced concrete ultimate strength design. It is useful with high shear values and for seismic design. The limiting masonry strength is $0.80f'_{\rm m}$.



Criteria for Column Design

(Masonry Joint Code Committee) Building Code Requirements and Commentary for Masonry Structures define a column as having b/t < 3 and h/t > 4.

where

b = width of the "wall"

t = thickness of the "wall"

h = height of the "wall"

A slender column has a minimum dimension of 8" on one side and $h/t \le 25$.

Columns must be reinforced, and have ties. A minimum eccentricity (causing bending) of 0.1 times the side dimension is required.

Allowable Axial Load for Reinforced Masonry

$$P_a = \left[0.25 f_m' A_n + 0.65 A_{st} F_s\right] 1 - \left(\frac{h}{140r}\right)^2 \quad \text{for h/t} \le 99$$

$$P_a = \left[0.25 f'_m A_n + 0.65 A_{st} F_s \left(\frac{70r}{h}\right)^2\right]$$
 for h/t > 99



Allowable Axial Stresses for Unreinforced Masonry

$$F_a = 0.25 f'_m \left| 1 - \left(\frac{h}{140r} \right)^2 \right|$$
 for h/t \le 99

$$F_a = 0.25 f'_m \left(\frac{70r}{h}\right)^2$$
 for h/t > 99

where

h = effective length

r = radius of gyration

 A_n = effective (or net) area of masonry

 A_{st} = area of steel reinforcement

 f'_m = specified masonry compressive strength

 F_s = allowable compressive stress in column reinforcement with lateral confinement.

Combined Stresses

When maximum moment occurs somewhere other than at the end of the column or wall, a "virtual" eccentricity can be determined from e = M/P.

Masonry Columns and Walls

There are no modification factors, but in addition to satisfying $\frac{f_a}{F_a} + \frac{f_b}{F_b} \le 1.0$, the tensile stress cannot exceed the allowable: $f_b - f_a \le F_t$ or the compressive stress exceed allowable for reinforced masonry: $f_a + f_b \le F_b$ provided $f_a \le F_a$.


Example 1

Determine if the unreinforced CMU wall can sustain its loads with the wind. Specify a mortar type and unit strength per MSJC.

$$\frac{f_a}{F_a} + \frac{f_b}{F_b} \le 1.0 \qquad F_b = \frac{1}{3} f'_m \qquad f_b = \frac{M}{S} \qquad f_a = \frac{P}{A}$$

$$F_a = 0.25 f'_m \left[1 - \left(\frac{h}{140r} \right)^2 \right] for \frac{h}{r} \le 99$$

$$F_a = 0.25 f'_m \left(\frac{70r}{h} \right)^2 for \frac{h}{r} > 99$$

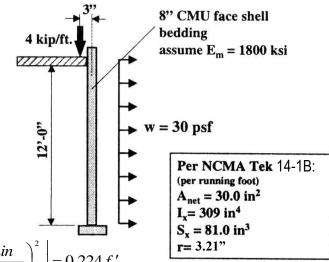

$$\frac{h}{r} = \frac{12 ft(12in)}{3.21in} = 44.9 \text{ so } F_a = 0.25 f'_m \left[1 - \left(\frac{12 \cdot 12in}{140 \cdot 3.21in} \right)^2 \right] = 0.224 f'_m$$

$$f_a = \frac{4k(1000 \frac{10}{k})}{30in^2} = 133psi$$

Case "A" with wind

at midheight of wall: (1 ft-kips/ft^2) (ft) (in/ft) $M = \frac{Pe}{2} + \frac{wh^2}{8} = \frac{4 \text{ kip } x 3''}{2} + \left[\frac{(0.030)(12)^2}{8}\right] x 12 = 12.5 \text{ kip - in.}$ $f_b = \frac{12,500 \text{ lb - in}}{81.0 \text{ in}^3} = 154 \text{ psi} \qquad f_b \le 1/3f_m$

tension criterion: $-f_a + f_b = F_t$

-133 psi + 154 psi = 21 psi

 $F_{t req'd} = 21 psi$

compression criterion :

$$\frac{f_a}{F_a} + \frac{f_b}{F_b} < 1.$$
 $\frac{133}{0.174f'_m} + \frac{154}{0.333f'_m} = 1;$ $f'_m = 1056 \ psi$

 $f_{b} \leq \frac{1}{3}f_{m}$ $f'_{m} \geq \frac{154}{(1/3)} = 462 \text{ psi}$ $f_{b} \leq \frac{1}{3}f'_{m}$ $f'_{m} \geq \frac{154}{(1/3)} = 462 \text{ psi}$ $M_{max} = Pe$ M = Pe/2

Moment distribution from eccentricity

Moment distribution from distributed wind load

Case "B" without wind

at top of wall: M = Pe = 12.0 kip - in.

 $f_b = 12,000 \, lb - in/81 \, in^3 = 148 \, psi$

tension criterion: $-f_a + f_b = F_t$

-133 psi + 148 psi = 15 psi $F_{t \text{ req'd}} = 15 \text{ psi}$

Per MSJC Table 2.2.3.2, use PCL Type N mortar $F_t = 25$ psi

compression criterion: $\frac{f_a}{F_a} + \frac{f_b}{F_b} \le 1.0$

$$\frac{133}{0.224 f_m'} + \frac{148}{0.333 f_m'} = 1.00 \qquad f_m' = 1038 \text{ psi} \qquad \boxed{f_m' = 1056 \text{ psi (governs)}}$$

Table 2.2.3.2 — Allowable flexural tensile stresses for clay and concrete masonry, psi (kPa)

Direction of flexural tensile stress and masonry type	Mortar types			
	Portland cement/lime or mortar cement		Masonry cement or air entrained portland cement/lime	
	M or S	N	M or S	N
Normal to bed joints				
Solid units	53 (366)	40 (276)	32 (221)	20 (138)
Hollow units ¹				
Ungrouted	33 (228)	25 (172)	20 (138)	12 (83)
Fully grouted	86 (593)	84 (579)	81 (559)	77 (531)
Parallel to bed joints in running bond				
Solid units	106 (731)	80 (552)	64 (441)	40 (276)
Hollow units				
Ungrouted and partially grouted	66 (455)	50 (345)	40 (276)	25 (172)
Fully grouted	106 (731)	80 (552)	64 (441)	40 (276)
Parallel to bed joints in masonry not laid in running bond	-			
Continuous grout section parallel to bed joints	133 (917)	133 (917)	133 (917)	133 (917)
Other	0 (0)	0 (0)	0 (0)	0 (0)

For partially grouted masonry, allowable stresses shall be determined on the basis of linear interpolation between fully grouted hollow units and ungrouted hollow units based on amount (percentage) of grouting.